

SOUNDPROOFING SOLUTIONS

TECHNICAL MANUAL

- XYLOFON
- PIANO
- ALADIN
- SILENT FLOOR PUR
- SILENT FLOOR PE
- SILENT WALL BYTUM
- SILENT WALL BYTUM SA



Solutions for Building Technology

CONTENTS

XYLOFON	3
PIANO	99
ALADIN.....	141
SILENT FLOOR PUR.....	169
SILENT FLOOR PE.....	203
SILENT WALL BYTUM	215
SILENT WALL BYTUM SA.....	230

IXYLOFON

TECHNICAL MANUAL



 **rothoblaas**

Solutions for Building Technology

CONTENTS

PRODUCT CHOICE AND DETERMINATION OF K_{ij}	10
EUROPEAN TECHNICAL ASSESSMENT (ETA)	12
XYLOFON 20	15
XYLOFON 35	16
XYLOFON 50	24
XYLOFON 70	32
XYLOFON 80	38
XYLOFON 90	42
SUSTAINABILITY	14
THE CEN MODEL (EN ISO 12354)	46
DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES	47
THE SIMPLIFIED METHOD	48
FLANKSOUND PROJECT	50
MEASUREMENT CONFIGURATION	51
SOUND REDUCTION INDEX AND IMPACT SOUND LEVEL	62
ON SITE MEASUREMENTS	73
ACOUSTIC AND MECHANICAL INTERACTION	88
SHEAR AND TENSILE STRENGTH OF NINO AND TITAN SILENT CERTIFIED IN ETA	90
MECHANICAL INTERACTION AND FRICTION	92
INFLUENCE OF MECHANICAL FASTENING USING STAPLES	93
FIRE SAFETY IN MULTI-STORY BUILDINGS	94
XYLOFON AND FIRE	97


XYLOFON

HIGH PERFORMANCE RESILIENT
SOUNDPROOFING PROFILE



LCA
FLANKSOUND
EN ISO 10848

CE
ETA-23/0061

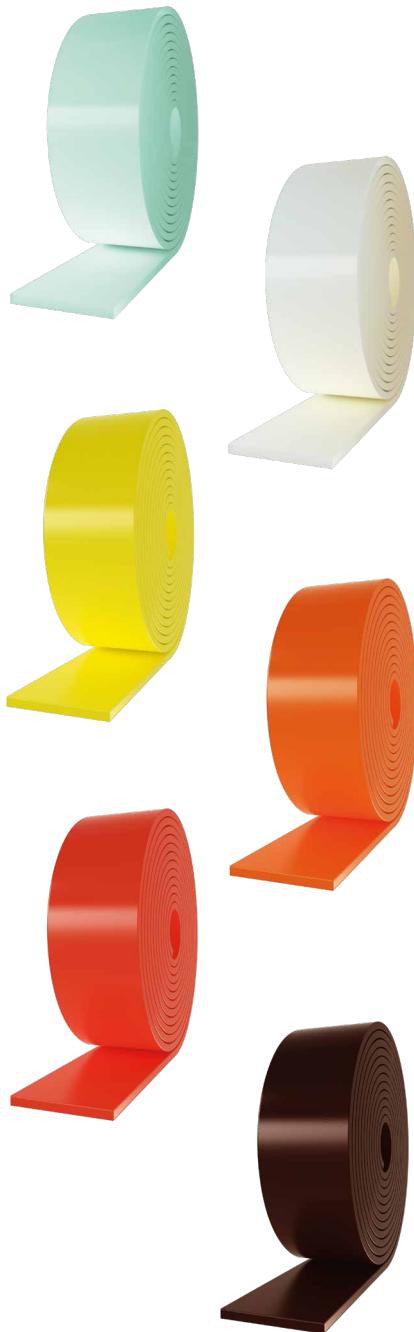

CODES AND DIMENSIONS

CODE	Shore	B [mm]	L [m]	s [mm]	B [in]	L [ft]	s [in]	pcs
XYL20050	20	50	3,66	6,0	2	12	1/4	1
XYL20080		80	3,66	6,0	3 1/8	12	1/4	1
XYL20090		90	3,66	6,0	3 1/2	12	1/4	1
XYL20100		100	3,66	6,0	4	12	1/4	1
XYL20120		120	3,66	6,0	4 3/4	12	1/4	1
XYL20140		140	3,66	6,0	5 1/2	12	1/4	1
XYL20160		160	3,66	6,0	6 1/4	12	1/4	1
XYL35080	35	80	3,66	6,0	3 1/8	12	1/4	1
XYL35090		90	3,66	6,0	3 1/2	12	1/4	1
XYL35100		100	3,66	6,0	4	12	1/4	1
XYL35120		120	3,66	6,0	4 3/4	12	1/4	1
XYL35140		140	3,66	6,0	5 1/2	12	1/4	1
XYL35160		160	3,66	6,0	6 1/4	12	1/4	1
XYL50080	50	80	3,66	6,0	3 1/8	12	1/4	1
XYL50090		90	3,66	6,0	3 1/2	12	1/4	1
XYL50100		100	3,66	6,0	4	12	1/4	1
XYL50120		120	3,66	6,0	4 3/4	12	1/4	1
XYL50140		140	3,66	6,0	5 1/2	12	1/4	1
XYL50160		160	3,66	6,0	6 1/4	12	1/4	1
XYL70080	70	80	3,66	6,0	3 1/8	12	1/4	1
XYL70090		90	3,66	6,0	3 1/2	12	1/4	1
XYL70100		100	3,66	6,0	4	12	1/4	1
XYL70120		120	3,66	6,0	4 3/4	12	1/4	1
XYL70140		140	3,66	6,0	5 1/2	12	1/4	1
XYL70160		160	3,66	6,0	6 1/4	12	1/4	1
XYL80080	80	80	3,66	6,0	3 1/8	12	1/4	1
XYL80090		90	3,66	6,0	3 1/2	12	1/4	1
XYL80100		100	3,66	6,0	4	12	1/4	1
XYL80120		120	3,66	6,0	4 3/4	12	1/4	1
XYL80140		140	3,66	6,0	5 1/2	12	1/4	1
XYL80160		160	3,66	6,0	6 1/4	12	1/4	1
XYL90080	90	80	3,66	6,0	3 1/8	12	1/4	1
XYL90090		90	3,66	6,0	3 1/2	12	1/4	1
XYL90100		100	3,66	6,0	4	12	1/4	1
XYL90120		120	3,66	6,0	4 3/4	12	1/4	1
XYL90140		140	3,66	6,0	5 1/2	12	1/4	1
XYL90160		160	3,66	6,0	6 1/4	12	1/4	1

SEPARATING PROFILE FOR TITAN AND NINO

CODE		pcs
XYL3570200		TTF200 10
XYL35120240		TTN240 - TTS240 10
XYL35100200		TCF200 - TCN200 10
XYL3580105		NINO100100 10
XYL3555150		NINO15080 10
XYL35120105		NINO100200 10



SEPARATING PROFILE FOR WHT AND SCREWS

CODE		pcs
XYLW806060		WHT340 WHT440 WHT540 10
XYLW808080		- 10
XYLW8080140		- 1
XYLW803811		- 50





K_{ij} values entered in ETA

K_{ij} tested for all hardness values and with appropriate fastening system

from page 8

ΔL_{ij} > 7 dB



Mechanical performance and elastic behaviour **tested** according to ETA

- elastic response of the profile applied in buildings
- elastic response of the profile as vibration damping

page 10



Sustainability

possibility of knowing the impact of the product thanks to **EPDs** evaluated from **LCA**s

page 12



Sound reduction measurements

measured effectiveness in reducing flanking sound transmission through soundproofing power measures

page 44

ΔR_{Df+Ff,situ} = 10 dB



FLANKSOUND PROJECT

K_{ij} for 15 different types of joint

page 48



Impact noise level measurements

measured effectiveness in reducing flanking sound transmission through impact sound measures

page 61

ΔL_{n,Df+Ff,situ} = 8 dB



On site measurements

effectiveness verified through the measurement of passive acoustic requirements in constructed buildings

page 71



Static to acoustic interaction

experimental investigations and tests on different configurations up to 34,6 kN shear strength with **NINO** with **XYLOFON PLATE**

page 86



Influence of friction

experimental investigations for timber-to-timber shear connections

page 90




Fire safety in buildings

Study of compartmentalisation of timber buildings temperatures below 300°C after 4 hours and without secondary flashover after 3 hours

page 92

XYLOFON + FIRE SEALING



Fire resistance

experimental test **EI 60**

page 95

PRODUCT COMPARISON

products	thickness	acoustic improvement $\Delta_{i,ij}^{(1)}$	elastic modulus in compression E_c
XYLOFON 20	6 mm 1/4 in	> 7 dB	1,45 N/mm ² 210 psi
XYLOFON 35	6 mm 1/4 in	7,4 dB	3,22 N/mm ² 467 psi
XYLOFON 50	6 mm 1/4 in	10,6 dB	7,11 N/mm ² 1031 psi
XYLOFON 70	6 mm 1/4 in	7,8 dB	14,18 N/mm ² 2057 psi
XYLOFON 80	6 mm 1/4 in	> 7 dB	25,39 N/mm ² 3683 psi
XYLOFON 90	6 mm 1/4 in	> 7 dB	36,56 N/mm ² 5303 psi

LEGEND:

-  load for acoustic optimisation
-  compression at 3 mm deformation (ultimate limit state)

dynamic elastic modulus $E'_{5Hz} - E'_{50Hz}$	damping factor $\tan\delta_{5Hz} - \tan\delta_{50Hz}$	acoustic load / maximum applied load
-	-	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>0,016 0,14</p> <p>0,016 1,25</p>
3,10 N/mm² - 3,60 N/mm² <i>450 psi - 522 psi</i>	0,321 - 0,382	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>0,038 0,32</p> <p>0,038 3,61</p>
3,93 N/mm² - 4,36 N/mm² <i>570 psi - 632 psi</i>	0,173 - 0,225	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>0,22 0,68</p> <p>0,22 8,59</p>
6,44 N/mm² - 7,87 N/mm² <i>934 psi - 1141 psi</i>	0,118 - 0,282	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>0,49 1,5</p> <p>0,49 11,1</p>
16,90 N/mm² - 21,81 N/mm² <i>2451 psi - 3163 psi</i>	0,150 - 0,185	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>1,3 2,4</p> <p>1,3 19,51</p>
39,89 N/mm² - 65,72 N/mm² <i>5786 psi - 9532 psi</i>	0,307 - 0,453	<p>acoustic load [N/mm²] maximum applied load [N/mm²]</p> <p>2,2 4,5</p> <p>2,2 28,97</p>

(1) $\Delta_{ij,ij} = K_{ij,with} - K_{ij,without}$

PRODUCT CHOICE AND DETERMINATION OF K_{ij}

DESIGNING THE CORRECT PROFILE ACCORDING TO THE LOAD

Resilient profiles must be correctly loaded in order to isolate the low to medium frequencies of structurally transmitted vibrations: guidance on how to proceed with the evaluation of the product are given below.

It is advisable to add the permanent load value at 50% of the characteristic value of the accidental load.

$$Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$$

$$Q_{\text{linear}} = DL + 0,5 LL$$

It is necessary to focus on the operating conditions and not the ultimate limit state conditions. This is because the goal is to insulate the building from noise during normal operating conditions and not during design limit states.

PRODUCT SELECTION

The product can also be selected using the application tables (see for example the following table for XYLOFON 35).



TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lb/ft]		compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [in]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]
	min	max	min	max	min	max	
XYL35080	3,04	2242	25,6	18882			
XYL35090	3,42	2522	28,8	21242			
XYL35100	3,8	2803	32	23602	0,038	0,32	0,05
XYL35120	4,56	3363	38,4	28322	5,5	46,4	2
XYL35140	5,32	3924	44,8	33043			20
XYL35160	6,08	4484	51,2	37765			3,61 524



To properly evaluate the product using MyProject, simply follow the step-by-step instructions provided by the software.




Note: The static behaviour of the material in compression is evaluated, considering that the deformations due to the loads are static. This is because a building is not affected by significant movement phenomena, nor dynamic deformation.

Rothoblaas has chosen to define a load range that allows good acoustic performance and avoids excessive deformation and differential movements in the materials, including the building's final architectural finishes. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

DETERMINATION OF PERFORMANCE

Once the loads have been identified, it is necessary to determine the design frequency - that is the stimulating frequency for the element from which the structure needs to be isolated. Below is an example, to make the explanation easier and simple to understand.

Suppose there is a load of 0.3 N/mm^2 acting on the profile. In this case, we used the XYLOFON 35 product, because the load is not particularly high. Reading the graph, it can be seen that the profile has a resonance frequency of around 22 Hz.

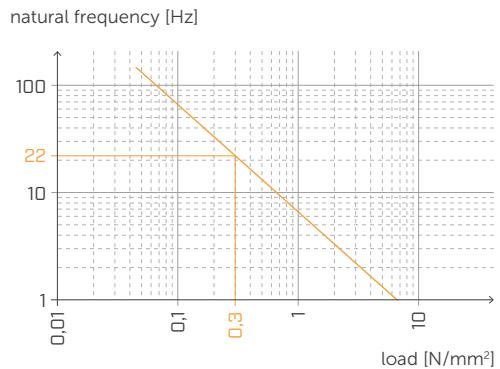


At this point, the degree of transmission for the product under these load conditions can be calculated, referring to the design frequency of 100 Hz.

$$\text{transmission} = f/f_0 = 4.55$$

Then the transmission graph is used, placing the value 4.55 obtained on the x-axis and intersecting the degree of the transmission curve. It follows that the transmission of the material is negative i.e. that the material is able to insulate around -11 dB.


TRANSMISSION IS POSITIVE WHEN THE MATERIAL TRANSMITS AND IS NEGATIVE WHEN THE PROFILE BEGINS TO INSULATE. This means this figure shows that the product, loaded in this way, insulates 11 dB at a reference frequency of 100 Hz.

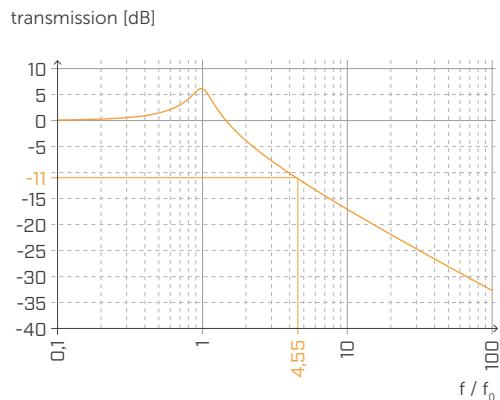

The same thing can be done using the attenuation graph. The percentage of vibration attenuated at the initial design frequency is obtained. The attenuation is also calculated with the load conditions referring to the design frequency of 100 Hz.

$$\text{attenuation} = f/f_0 = 4.55$$

The graph is used by placing the calculated value of 4.55 on the x-axis and intersecting the attenuation curve. It follows that the material's attenuation is optimal, i.e., the material can isolate more than 92 % of the transmission.

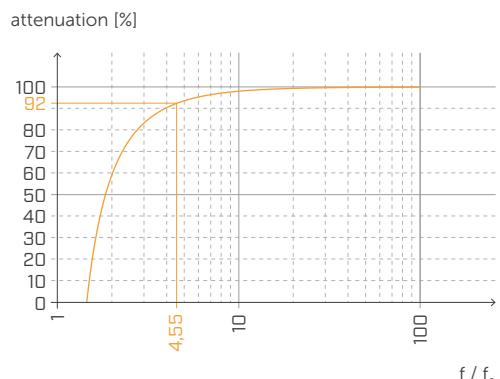

Essentially, the same result is obtained with two different inputs, but when deformation is set, the starting point is the mechanical performance, not the acoustic one. In the light of this fact, Rothoblaas always recommends starting with the design frequency and the loads to optimise the material based on the real conditions.

■ EUROPEAN TECHNICAL ASSESSMENT (ETA)

The European Technical Assessment (ETA) provides an **independent procedure at European level** for assessing the essential performance characteristics of non-standard construction products.



OBJECTIVITY AND INDEPENDENCE

Only independent Technical Assessment Bodies (TAB) can issue ETAs. Third-party evaluation enhances the credibility of product performance information, improves **market transparency**, and ensures that the stated values are tested to **precise standards** appropriate for the intended use of the product.



TRANSPARENCY

ETAs provide **reliable product performance information** that can be compared across Europe on the basis of harmonised technical specifications, the European Assessment Documents (EADs). ETAs have made construction products **comparable throughout the European Economic Area** through the provision of detailed product performance information.

■ PARAMETERS TESTED ACCORDING TO ETA


STATIC AND DYNAMIC MODULUS OF ELASTICITY

Many products on the market have been tested to determine the dynamic elastic modulus and damping factor in order to provide transmissibility graphs according to the natural frequency of the resilient profile.


Since there is no common standard, each manufacturer follows a different procedure, and often the standard used and the test setup are not stated.




Considering the intended use of **XYLOFON**, the dynamic elastic modulus and damping factor must be determined in compression (there would be no point in defining them according to other deformation methods). Dynamic elastic modulus and damping factor are measured under dynamic conditions and are relevant for vibration reduction in service equipment or other vibration sources.

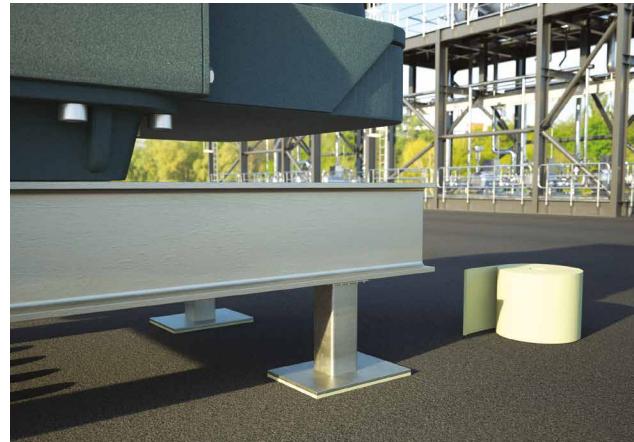

In buildings, **XYLOFON** is subject to static and quasi-static loading, so the dynamic elastic modulus is not as representative of the product's actual behaviour.




Tests show that profile friction could affect the elastic modulus value, and that is why it is necessary to always perform measurements with and without a lubricant to have a value that is independent of boundary conditions (without friction) and a value that is representative of the in situ operating conditions (with friction).

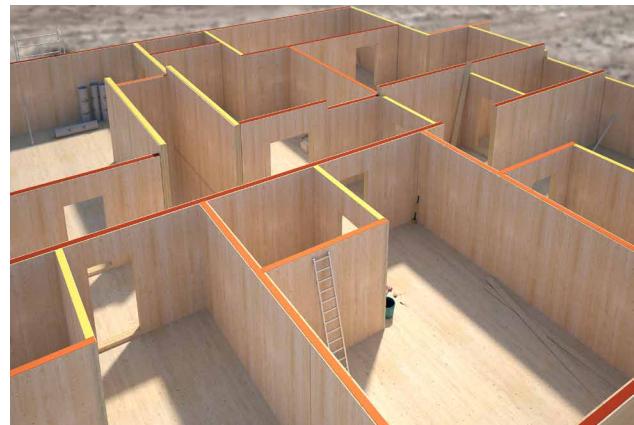

VIBRATION REDUCTION INDEX - K_{ij}

Due to the lack of a common standard, each manufacturer provides K_{ij} values tested in a different configuration (type of joint, number of fastening systems, etc.). Clarifying the test setup and boundary conditions being used is important because the result is strongly influenced by the many variables that define the joint.

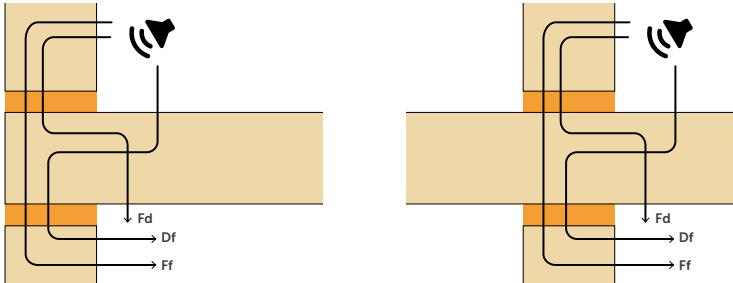

In the European Technical Assessment, the results are expressed clearly to avoid ambiguity in the configuration.




STRESS AND DEFORMATION IN COMPRESSION

XYLOFON has been tested under significant compressive stresses, demonstrating linear behaviour even under high loads.

From a static point of view, it is important to provide the **compressive stress according to the deformation** (e.g., 1 mm, 2 mm and 3 mm compression) so as to limit the maximum deformation and possible structural failure.

Resilient profiles are subjected to constant loading during their working life, so it is important to estimate the **long-term behaviour** for both static reasons (to avoid differential failure in the structure) and acoustic reasons (a flattened resilient strip does not have the same elastic response and consequently the acoustic performance declines).

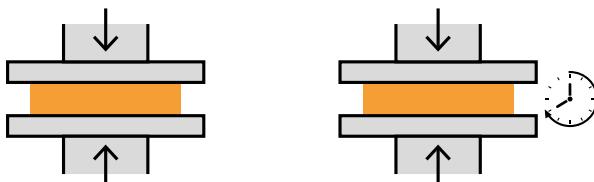

For the same reason, it is important to assess the **final thickness of the product** after compression for a given time and after a recovery period.



Rothoblaas has invested in the development of solutions that follow a multidisciplinary approach and take into account the real conditions of the construction site. Laboratory measurements, static tests, durability tests, moisture control and fire performance studies allow the designer to benefit from real performance data and not just theoretical values that have limited practical applications.



SUSTAINABILITY



Environmental sustainability is an increasingly central issue in the construction sector and it has been taken into account in our company for a long time.

Although timber construction is in many respects more sustainable than other building systems, an assessment of the impacts linked to the entire life cycle of the products is still necessary in order to make an objective comparison between different building systems.

A suitable tool for this is the **EPD (Environmental Product Declaration)**. This is a type III environmental declaration in accordance with EN ISO 14025 which, based on specific parameters, makes it possible to produce a technical document to use in order to make an objective comparison of the environmental impact of various products.

The EPD is a declaration based on **LCA (Life Cycle Assessment)** for which the study of all aspects related to the production, use and disposal of the product is required.



This is a voluntary initiative, not obligatory by law, which we have decided to implement to know the environmental impact of our products, and to allow the designer to have an accurate idea of the ecological footprint of the building he or she is designing.

CO₂

We strongly believe in
a future with less CO₂

XYLOFON 20

CODES AND DIMENSIONS

CODE	Shore	B [mm]	L [m]	s [mm]	B [in]	L [ft]	s [in]	pcs
XYL20050	20	50	3,66	6,0	2	12	1/4	1
XYL20080		80	3,66	6,0	3 1/8	12	1/4	1
XYL20090		90	3,66	6,0	3 1/2	12	1/4	1
XYL20100		100	3,66	6,0	4	12	1/4	1
XYL20120		120	3,66	6,0	4 3/4	12	1/4	1
XYL20140		140	3,66	6,0	5 1/2	12	1/4	1
XYL20160		160	3,66	6,0	6 1/4	12	1/4	1

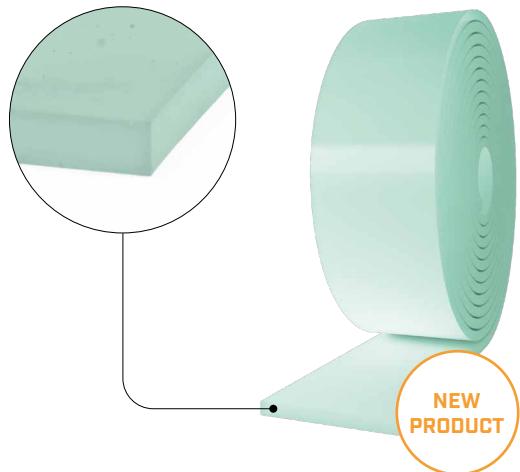


TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]				compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]				reduction [mm] [mil]	compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]
	min	max	min	max	min	max	min	max		
XYL20050	0,7	590	8	5163						
XYL20080	1,12	944	12,8	8261						
XYL20090	1,26	1062	14,4	9293						
XYL20100	1,4	1180	16	10326						
XYL20120	1,68	1416	19,2	12391						
XYL20140	1,96	1652	22,4	14456						
XYL20160	2,24	1888	25,6	16521						

(1) The load ranges reported are optimised with respect to the static behaviour of the material assessed under compression, considering the effect of friction and the system resonance frequency, which falls between 20 and 30 Hz, with a maximum deformation of 12%. See the manual or use MyProject to view transmissibility and attenuation graphs.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

LIGHTNESS AND HEIGHT

XYLOFON 20 is the range innovation for light structures and low loads. The acoustic insulation performance is the same as for Mass Timber products, but the 20 shore polyurethane compound allows for use on frame structures, roofs and floors with small dimensions.

In the construction of multi-storey buildings, the use of XYLOFON 20 ensures soundproofing of the highest floors.



PERFORMANCE

Acoustic improvement tested:

$$\Delta_{l,ij}^{(3)} : > 7 \text{ dB}$$

Maximum applied load (3 mm deformation):

$$1,25 \text{ N/mm}^2$$

Acoustic service load:

$$\text{from } 0,014 \text{ to } 0,16 \text{ N/mm}^2$$

XYLOFON 35

TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]				compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]				reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]	
	min		max		min		max		min	max	3,61	524
XYL35080	3,04	2242	25,6	18882								
XYL35090	3,42	2522	28,8	21242								
XYL35100	3,8	2803	32	23602	0,038		0,32		0,05	0,5		
XYL35120	4,56	3363	38,4	28322	5,5		46,4		2	20		
XYL35140	5,32	3924	44,8	33043								
XYL35160	6,08	4484	51,2	37763								

(1) The load ranges reported here are optimised with respect to the acoustic and static behaviour of the material in compression. However, it is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed. See the manual for transmissibility and attenuation graphs.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value	USC conversion
Acoustic improvement $\Delta_{ij}^{(3)}$	ISO 10848	7,4 dB	-
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	3,22 MPa (1,74 MPa)	467 psi (252 psi)
Dynamic elastic modulus evaluated at 1 Hz $E'_{1Hz} - E''_{1Hz}$	ISO 4664-1	2,79 - 0,77 MPa	405 - 112 psi
Dynamic elastic modulus evaluated at 5 Hz $E'_{5Hz} - E''_{5Hz}$	ISO 4664-1	3,10 - 1,00 MPa	450 psi - 145 psi
Dynamic elastic modulus evaluated at 10 Hz $E'_{10Hz} - E''_{10Hz}$	ISO 4664-1	3,28 - 1,09 MPa	476 - 158 psi
Dynamic elastic modulus evaluated at 50 Hz $E'_{50Hz} - E''_{50Hz}$	ISO 4664-1	3,60 - 1,38 MPa	522 - 200 psi
Damping factor evaluated at 1 Hz $\tan\delta_{1Hz}$	ISO 4664-1	0,276	-
Damping factor evaluated at 5 Hz $\tan\delta_{5Hz}$	ISO 4664-1	0,321	-
Damping factor evaluated at 10 Hz $\tan\delta_{10Hz}$	ISO 4664-1	0,332	-
Damping factor evaluated at 50 Hz $\tan\delta_{50Hz}$	ISO 4664-1	0,382	-
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	0,54	-
Compression set c.s.	ISO 1856	0,72%	-
Compression at 1 mm deformation σ_{1mm}	ISO 844	0,5 N/mm ²	73 psi
Compressive stress at 2 mm strain σ_{2mm}	ISO 844	1,54 N/mm ²	223 psi
Compressive stress at 3 mm strain σ_{3mm}	ISO 844	3,61 N/mm ²	524 psi
Dynamic stiffness $s^{(4)}$	ISO 9052	1262 MN/m ³	
Max processing temperature (TGA)	-	200 °C	392 °F
Reaction to fire	EN 13501-1	class E	-
Water absorption after 48h	ISO 62	< 1 %	-

(3) $\Delta_{ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$.

(4) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load.



PERFORMANCE

Acoustic improvement tested:

$\Delta_{ij}^{(3)} : 7,4 \text{ dB}$


Maximum applied load
(3 mm deformation):

3,61 N/mm²


Acoustic service load:

from 0,038 to 0,32 N/mm²


STRESS | DEFORMATION COMPRESSION

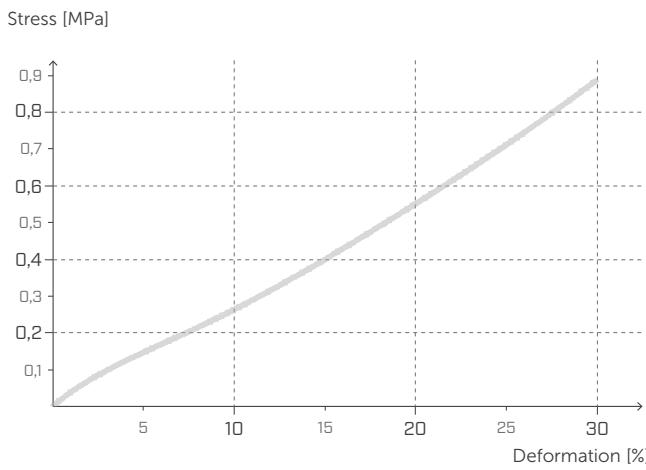


CREEP COMPRESSION

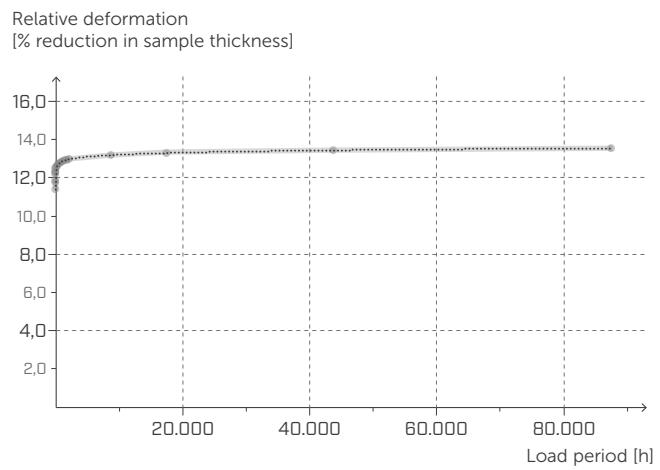


DYNAMIC ELASTIC MODULUS E' DMTA

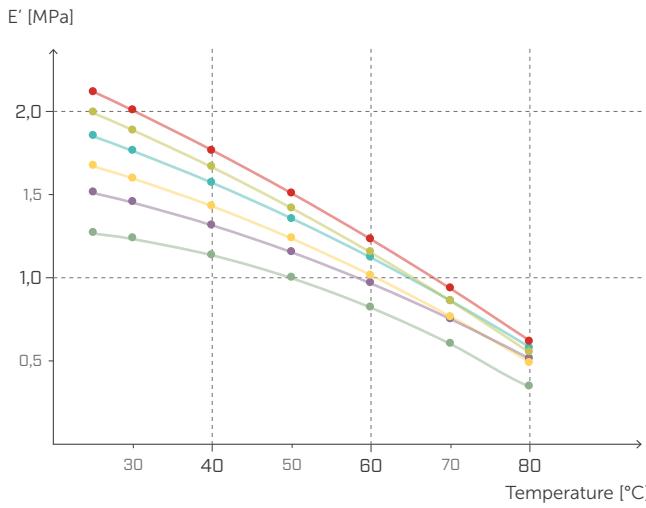


TAN δ UNDER STRESS DMTA

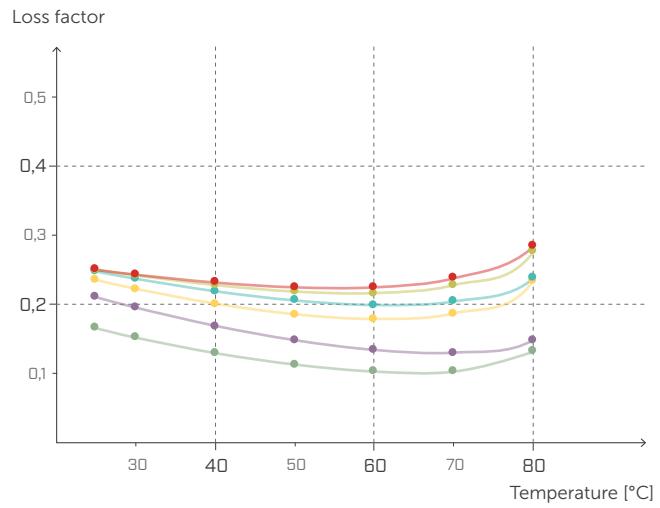

DYNAMIC ELASTIC MODULUS G' DMTA

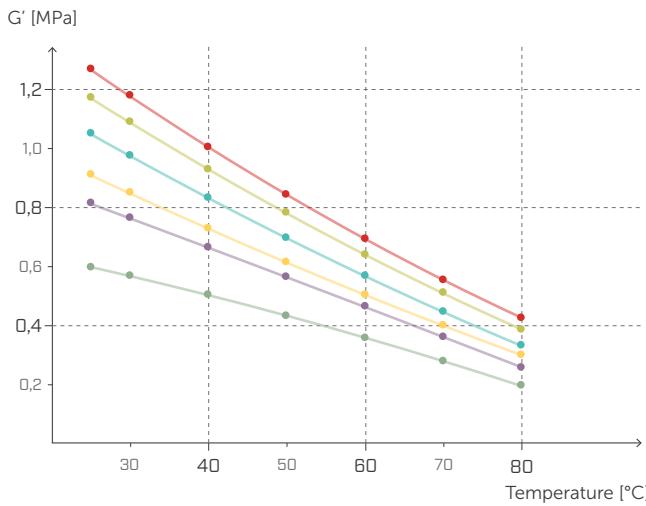

TAN δ SHEAR DMTA

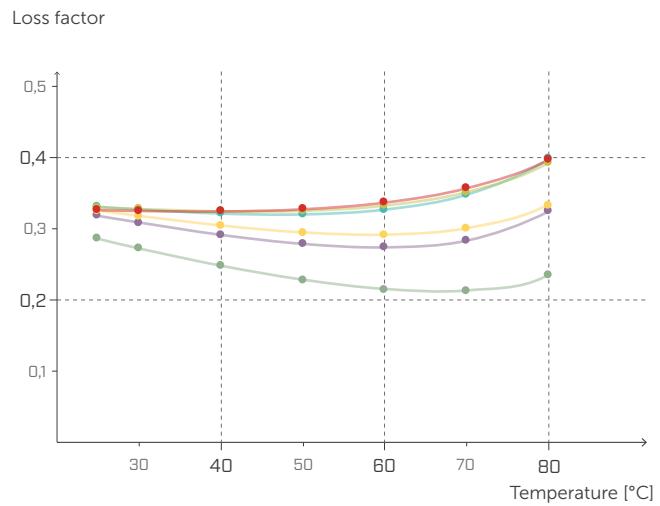

—●— 1,0 Hz/MPa

—●— 5,0 Hz/MPa

—●— 10,0 Hz/MPa

—●— 20,0 Hz/MPa

—●— 33,3 Hz/MPa

—●— 50,0 Hz/MPa

■ STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

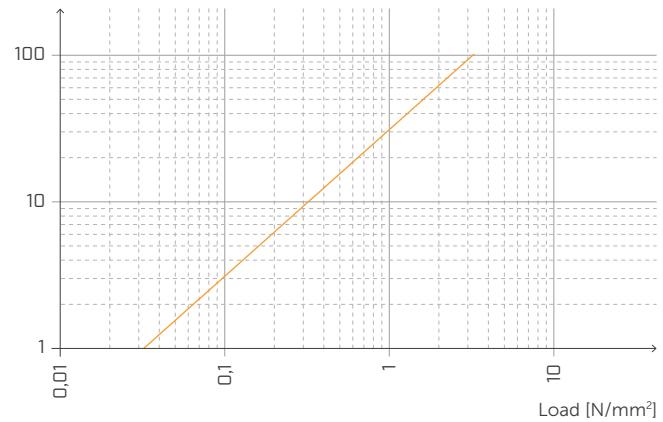


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

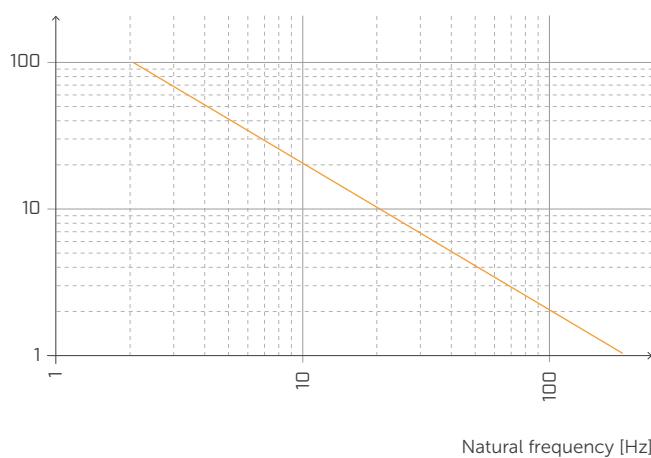


TRANSMISSIBILITY

Transmission [dB]

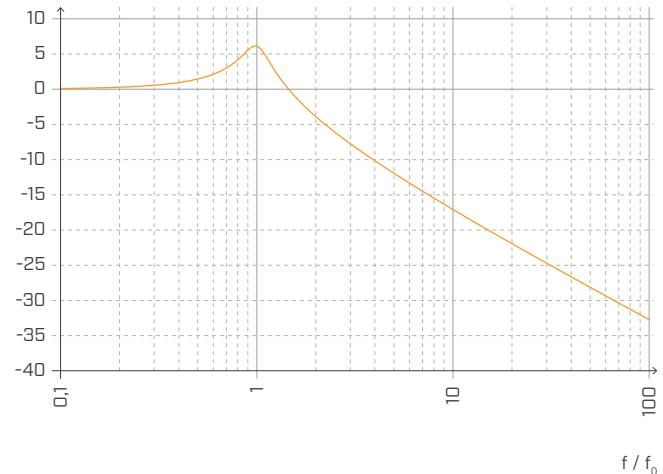

ATTENUATION


Attenuation [%]

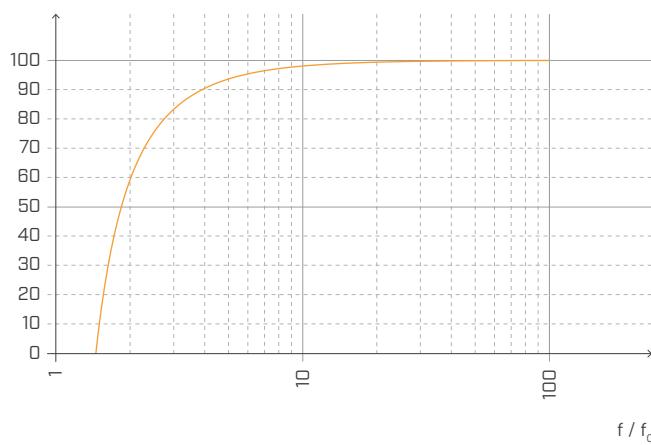

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

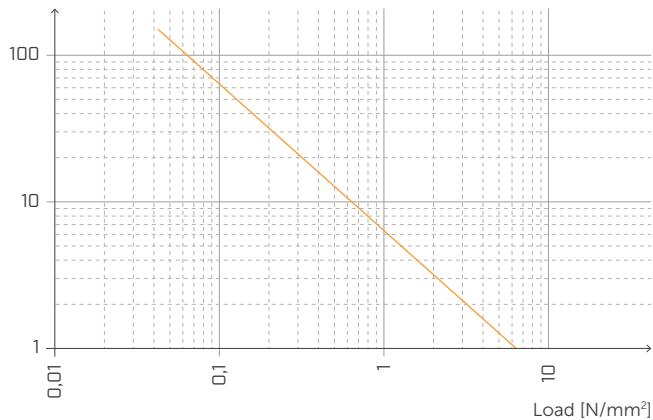


DEFORMATION AND LOAD

Deformation [%]

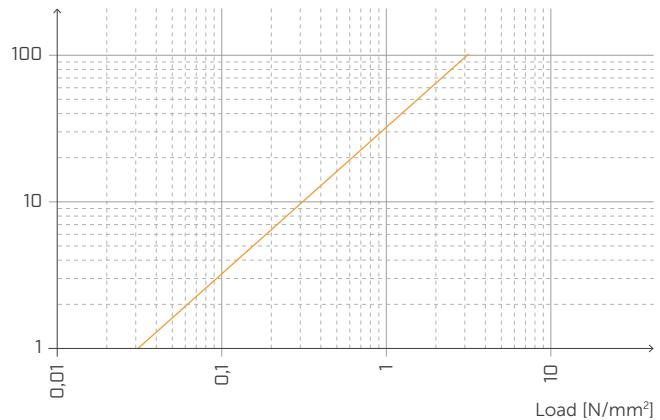


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

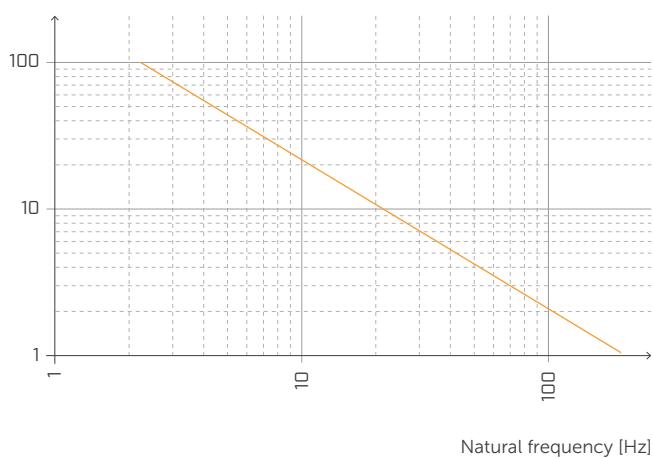


TRANSMISSIBILITY

Transmission [dB]

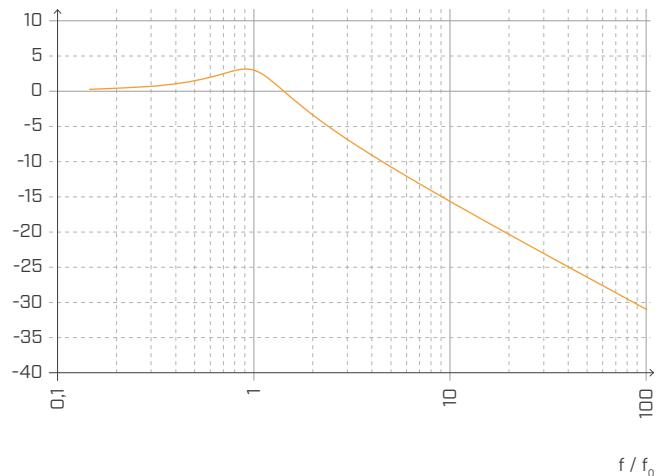

ATTENUATION

Attenuation [%]

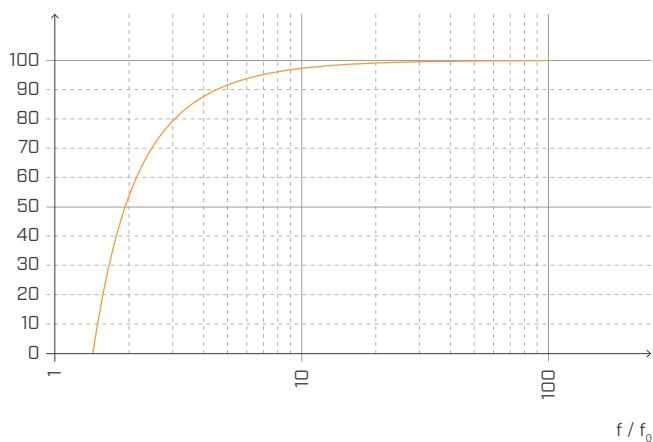


Normalised with respect to the resonance frequency with $f = 5 \text{ Hz}$.

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

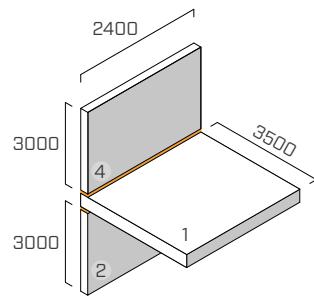

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

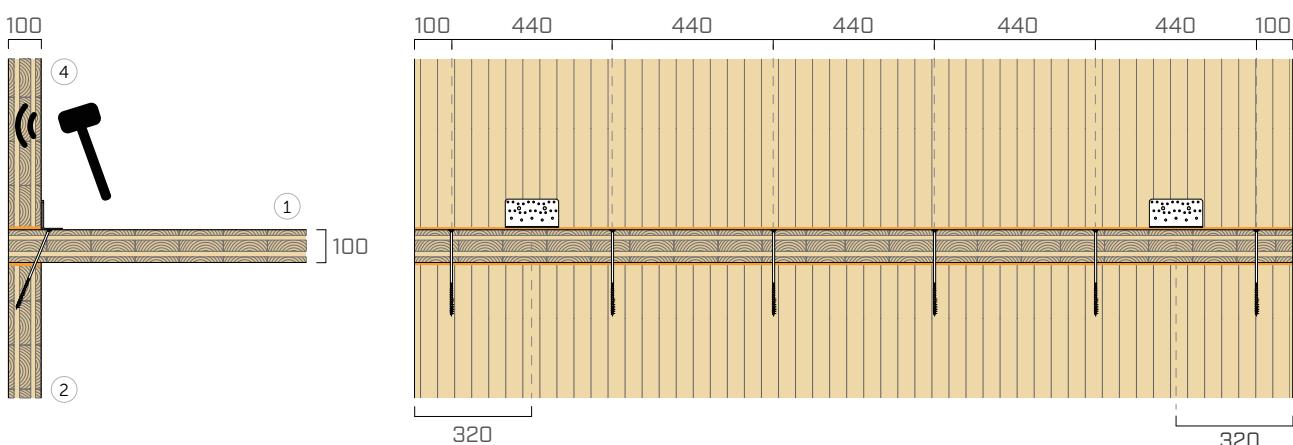

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	12,5	19,6	10,5	13,7	14,8	16,7	19,0	17,6	16,7	18,5	21,3	22,8	23,2	18,8	19,8	20,5

$$\overline{K_{14}} = \mathbf{17,9 \text{ dB}} \quad \overline{K_{14,0}} = \mathbf{14,4 \text{ dB}} \quad \Delta_{l,14} = \mathbf{3,5 \text{ dB}}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	18,2	21,3	12,3	15,3	17,3	17,6	20,7	20,1	23,6	22,3	23,2	24,0	24,3	22,0	24,1	20,3

$$\overline{K_{12}} = \mathbf{20,3 \text{ dB}} \quad \overline{K_{12,0}} = \mathbf{14,6 \text{ dB}} \quad \Delta_{l,12} = \mathbf{5,7 \text{ dB}}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	11,8	25,9	16,1	23,5	21,1	25,4	23,9	23,6	26,2	27,5	32,6	34,1	33,2	35,0	34,7	32,0


$$\overline{K_{24}} = \mathbf{26,8 \text{ dB}} \quad \overline{K_{24,0}} = \mathbf{20,4 \text{ dB}} \quad \Delta_{l,24} = \mathbf{6,4 \text{ dB}}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

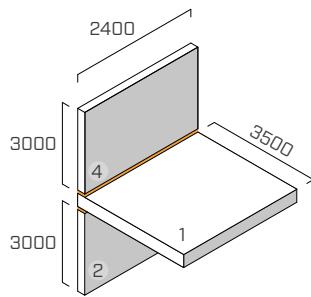

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 210000

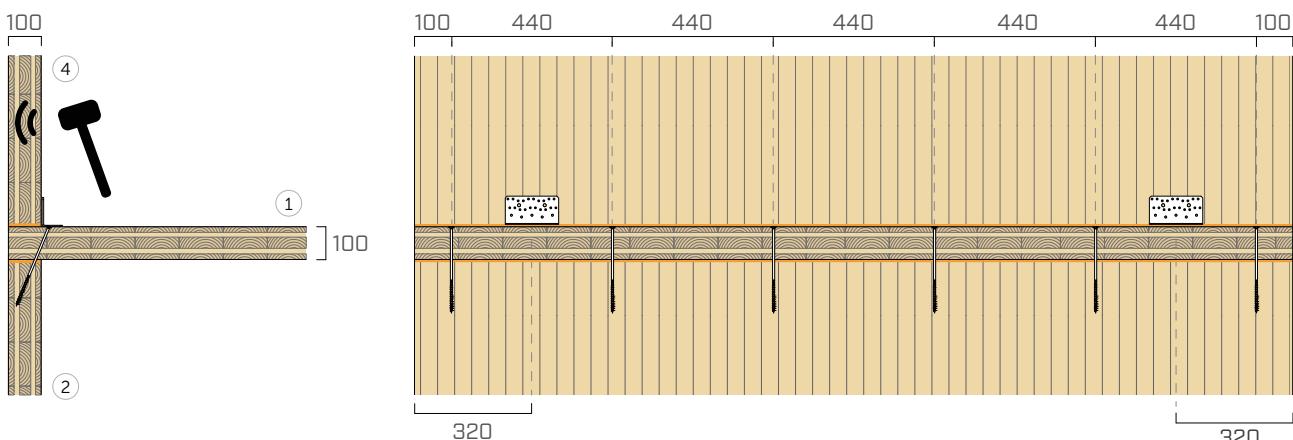

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	21,0	20,1	16,1	19,9	17,5	21,4	24,4	17,7	20,9	17,6	17,9	19,2	20,7	18,2	18,5	21,7

$$\overline{K_{14}} = 19,4 \text{ dB}$$

$$\overline{K_{14,0}} = 13,3 \text{ dB}$$

$$\Delta_{l,14} = 6,1 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	21,7	24,6	17,2	20,0	21,1	20,5	20,0	20,9	21,8	22,6	20,7	22,4	27,0	21,8	22,3	27,4

$$\overline{K_{12}} = 21,6 \text{ dB}$$

$$\overline{K_{12,0}} = 14,5 \text{ dB}$$

$$\Delta_{l,12} = 7,1 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	18,9	29,2	23,3	22,6	24,2	22,5	22,0	20,2	22,6	22,0	24,7	25,8	32,0	29,9	28,5	29,6

$$\overline{K_{24}} = 24,7 \text{ dB}$$

$$\overline{K_{24,0}} = 17,3 \text{ dB}$$


$$\Delta_{l,24} = 7,4 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

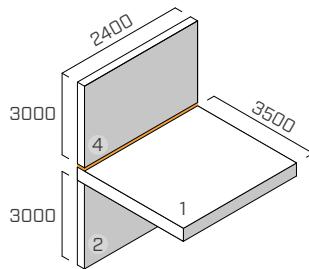

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the upper wall and the floor

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 210000

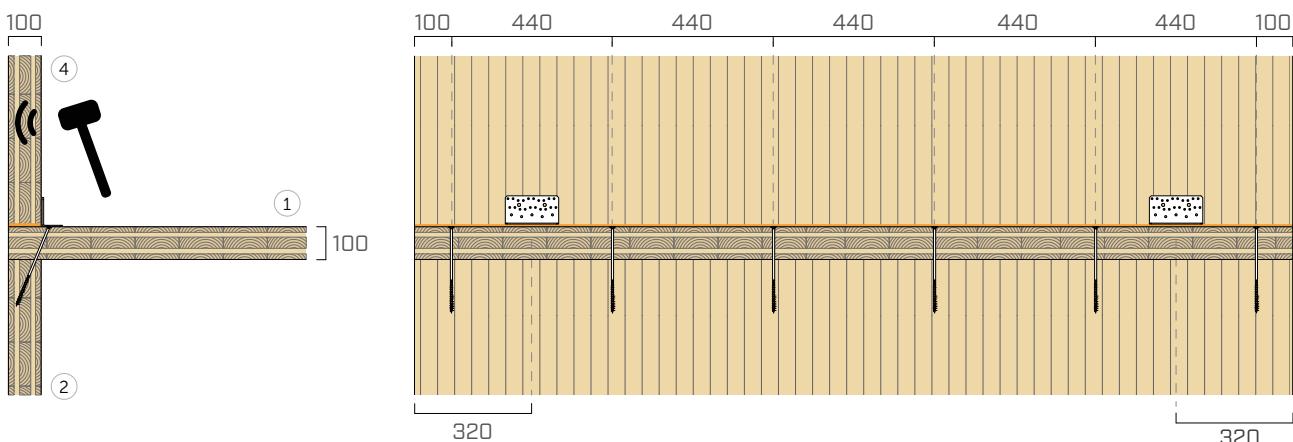

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	20,9	19,3	20,5	20,4	16,4	21,4	26,2	19,1	21,6	17,7	18,9	21,6	20,1	17,7	18,3	20,1

$$\overline{K_{14}} = 20,1 \text{ dB}$$

$$\overline{K_{14,0}} = 13,3 \text{ dB}$$

$$\Delta_{l,14} = 6,8 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	20,1	18,3	12,5	10,2	13,3	10,6	13,9	10,7	14,6	11,1	9,6	13,2	17,3	14,8	17,9	21,1

$$\overline{K_{12}} = 13,1 \text{ dB}$$

$$\overline{K_{12,0}} = 14,5 \text{ dB}$$

$$\Delta_{l,12} = -1,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	20,4	25,7	23,2	20,7	22,1	24,3	24,6	20,5	22,5	20,9	22,2	23,9	27,5	27,8	28,3	28,1

$$\overline{K_{24}} = 23,5 \text{ dB}$$

$$\overline{K_{24,0}} = 17,3 \text{ dB}$$


$$\Delta_{l,24} = 6,2 \text{ dB}$$

X-JOINT | INTERNAL WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 7,1 m - 7.8 ft x 23.3 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

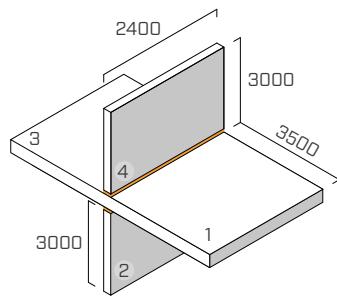

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

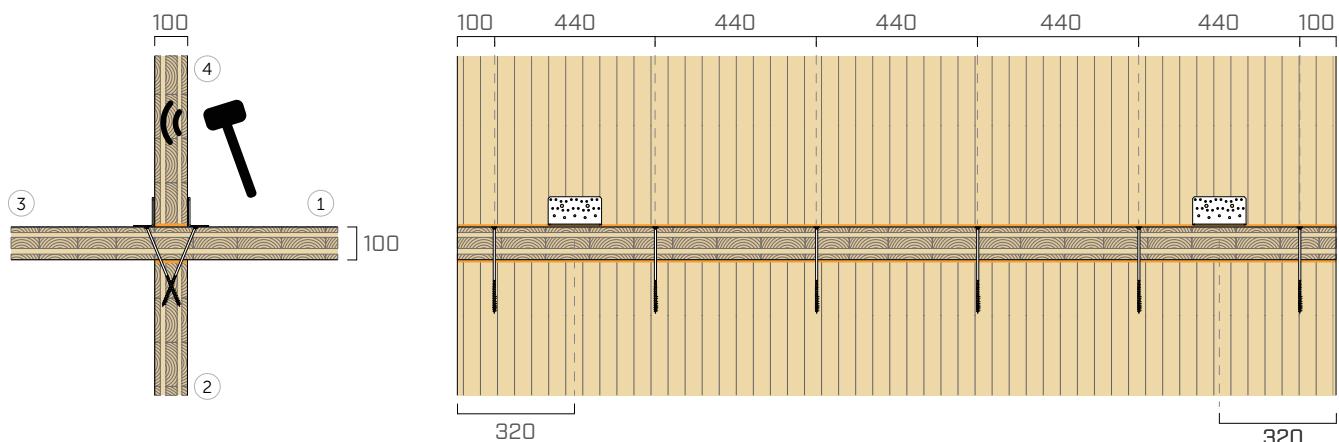

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	19,5	21,5	19,6	17,0	17,5	14,7	19,1	21,0	20,8	19,3	22,2	23,2	22,6	20,4	19,8	19,9

$$\overline{K_{14}} = 19,9 \text{ dB}$$

$$\overline{K_{14,0}} = 17,0 \text{ dB}$$

$$\Delta_{l,14} = 2,9 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	16,7	15,6	12,0	17,4	17,7	16,1	21,0	20,2	23,1	19,1	23,4	22,4	24,2	23,9	24,7	24,0

$$\overline{K_{12}} = 19,7 \text{ dB}$$

$$\overline{K_{12,0}} = 15,9 \text{ dB}$$

$$\Delta_{l,12} = 3,8 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	17,1	26,2	25,2	26,9	23,2	25,9	28,2	24,6	26,6	30,2	32,2	33,5	31,4	37,0	36,3	32,8

$$\overline{K_{24}} = 28,6 \text{ dB}$$

$$\overline{K_{24,0}} = 23,2 \text{ dB}$$

$$\Delta_{l,24} = 5,4 \text{ dB}$$

XYLOFON 50

TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]				compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]
	min	max	min	max	min	max	min	max	
XYL50080	17,6	12981	54,4	40123					
XYL50090	19,8	14604	61,2	45139					
XYL50100	22	16226	68	50154	0,22	0,68	0,07	0,6	8,59
XYL50120	26,4	19472	81,6	60185	31,9	98,6	3	24	1246
XYL50140	30,8	22717	95,2	70216					
XYL50160	35,2	25962	108,8	80247					

(1) The load ranges reported here are optimised with respect to the acoustic and static behaviour of the material in compression. However, it is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed. See the manual for transmissibility and attenuation graphs.


(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value	USC conversion
Acoustic improvement $\Delta_{ij}^{(3)}$	ISO 10848	10,6 dB	-
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	7,11 MPa (2,89 MPa)	1031 psi (419 psi)
Dynamic elastic modulus evaluated at 1 Hz $E'_{1Hz} - E''_{1Hz}$	ISO 4664-1	4,64 - 0,55 MPa	673 - 80 psi
Dynamic elastic modulus evaluated at 5 Hz $E'_{5Hz} - E''_{5Hz}$	ISO 4664-1	3,93 - 0,68 MPa	570 psi - 99 psi
Dynamic elastic modulus evaluated at 10 Hz $E'_{10Hz} - E''_{10Hz}$	ISO 4664-1	4,09 - 0,73 MPa	593 - 106 psi
Dynamic elastic modulus evaluated at 50 Hz $E'_{50Hz} - E''_{50Hz}$	ISO 4664-1	4,36 - 0,98 MPa	632 - 142 psi
Damping factor evaluated at 1 Hz $\tan\delta_{1Hz}$	ISO 4664-1	0,153	-
Damping factor evaluated at 5 Hz $\tan\delta_{5Hz}$	ISO 4664-1	0,173	-
Damping factor evaluated at 10 Hz $\tan\delta_{10Hz}$	ISO 4664-1	0,178	-
Damping factor evaluated at 50 Hz $\tan\delta_{50Hz}$	ISO 4664-1	0,225	-
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	0,53	-
Compression set c.s.	ISO 1856	1,25%	-
Compression at 1 mm deformation σ_{1mm}	ISO 844	1,11 N/mm ²	161 psi
Compression at 2 mm deformation σ_{2mm}	ISO 844	3,50 N/mm ²	508 psi
Compression at 3 mm deformation σ_{3mm}	ISO 844	8,59 N/mm ²	1246 psi
Dynamic stiffness $s^{(4)}$	ISO 9052	1455 MN/m ³	-
Max processing temperature (TGA)	-	200 °C	392 °F
Reaction to fire	EN 13501-1	class E	-
Water absorption after 48h	ISO 62	< 1 %	-

(3) $\Delta_{ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$.

(4) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load.

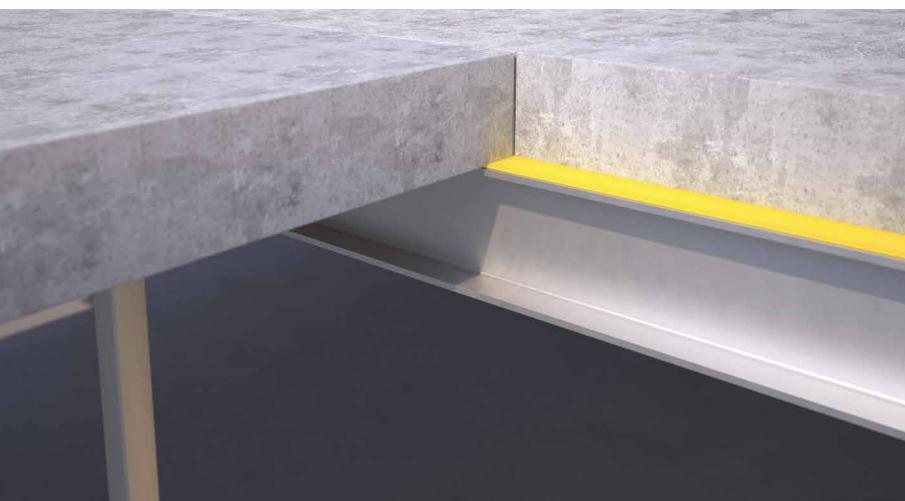

PERFORMANCE

Acoustic improvement tested:

$\Delta_{ij}^{(3)} : 10,6 \text{ dB}$


Maximum applied load
(3 mm deformation):

8,59 N/mm²


Acoustic service load:

from 0,22 to 0,68 N/mm²


STRESS | DEFORMATION COMPRESSION

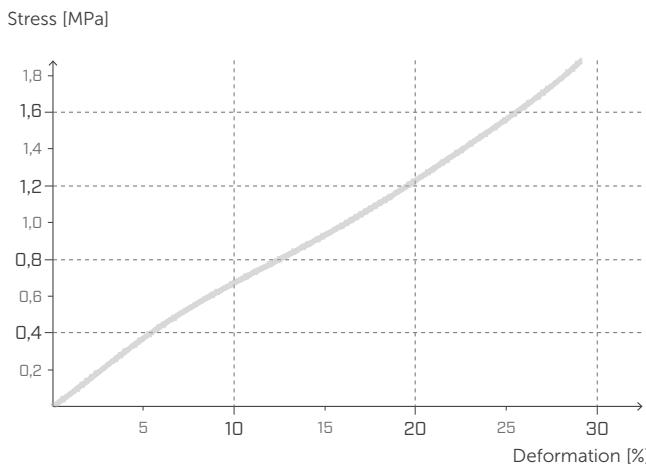


CREEP COMPRESSION

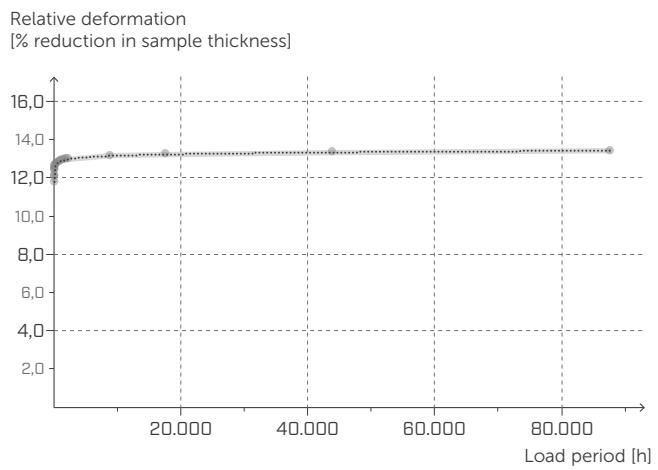


DYNAMIC ELASTIC MODULUS E' DMTA

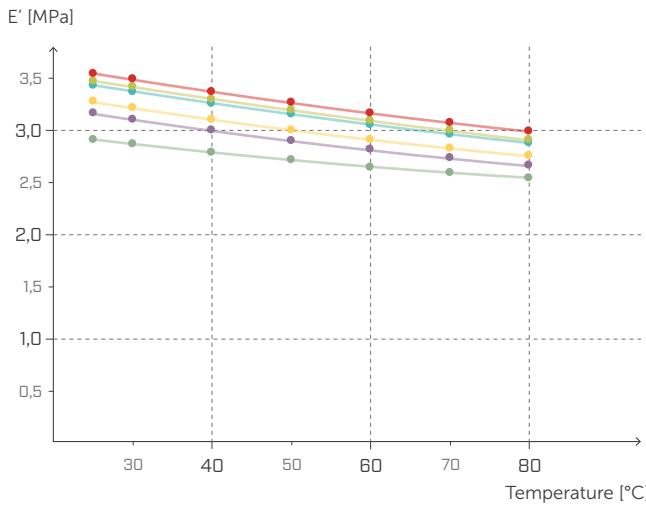


TAN δ UNDER STRESS DMTA

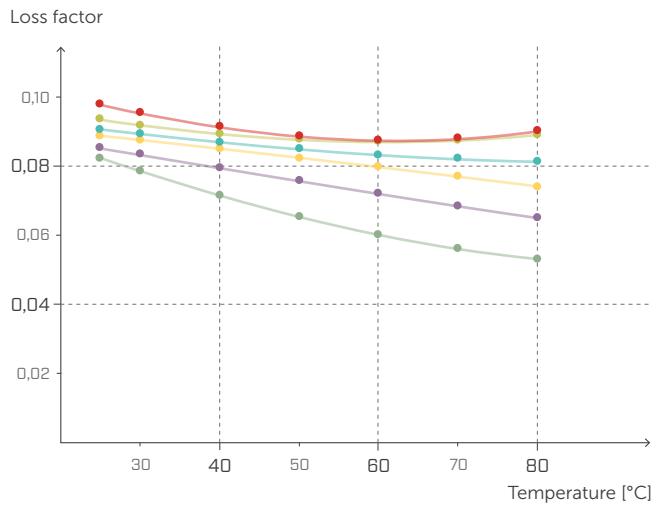

DYNAMIC ELASTIC MODULUS G' DMTA

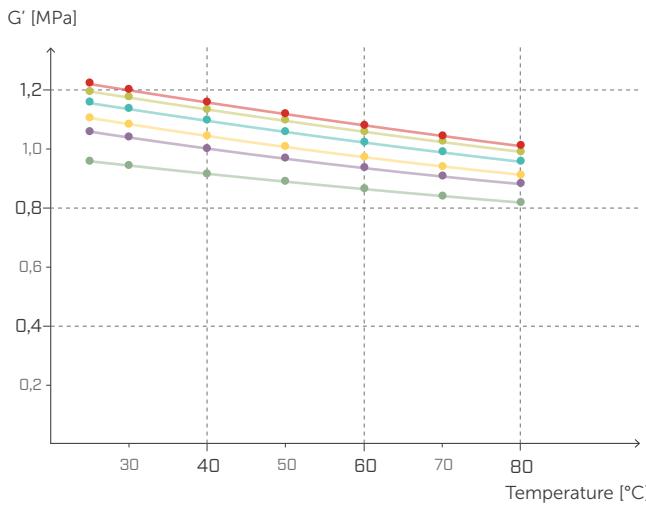

TAN δ SHEAR DMTA

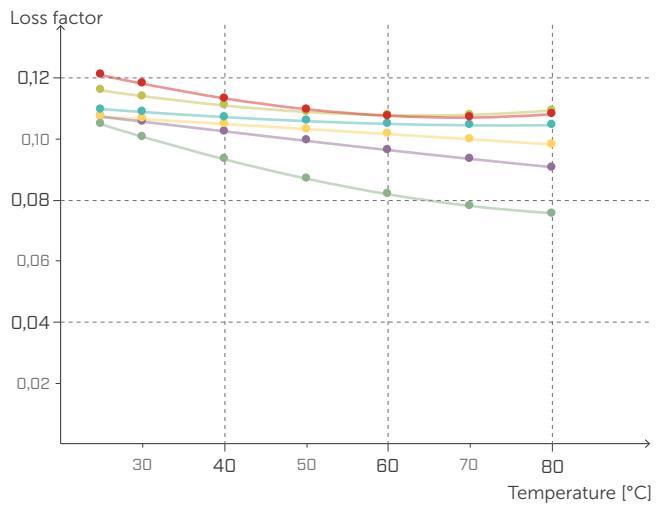

—●— 1,0 Hz/MPa

—●— 5,0 Hz/MPa

—●— 10,0 Hz/MPa

—●— 20,0 Hz/MPa

—●— 33,3 Hz/MPa

—●— 50,0 Hz/MPa


STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

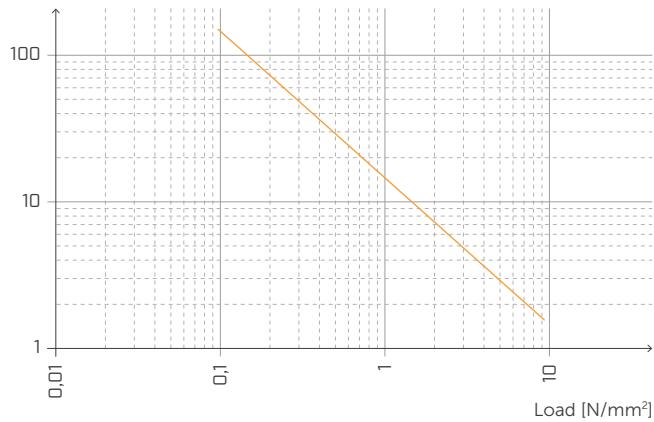


DEFORMATION AND LOAD

Deformation [%]

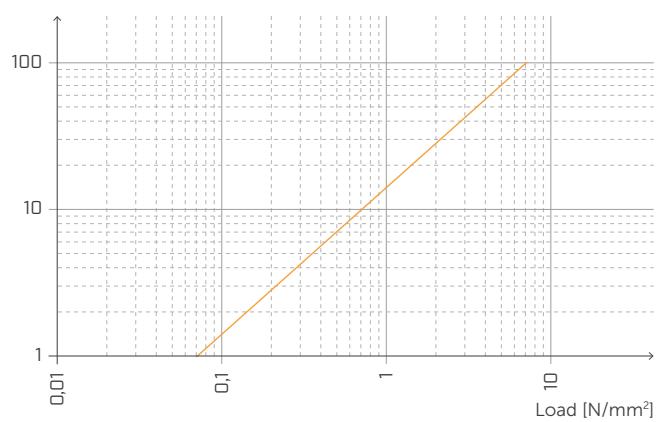


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

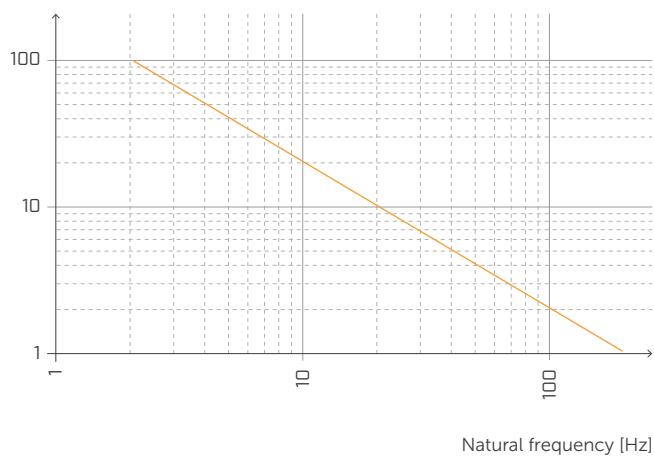


TRANSMISSIBILITY

Transmission [dB]

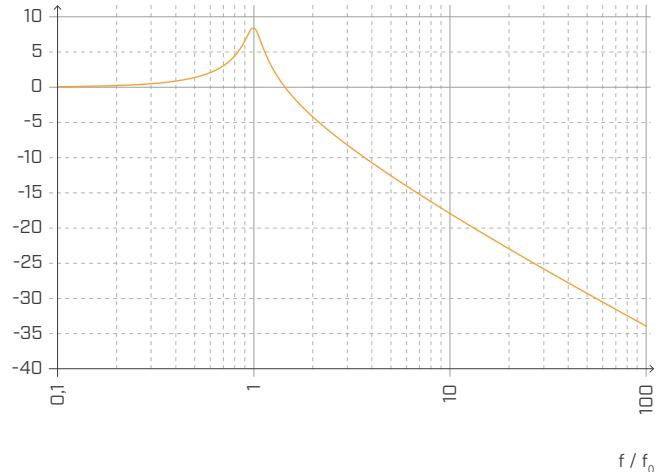

ATTENUATION


Attenuation [%]

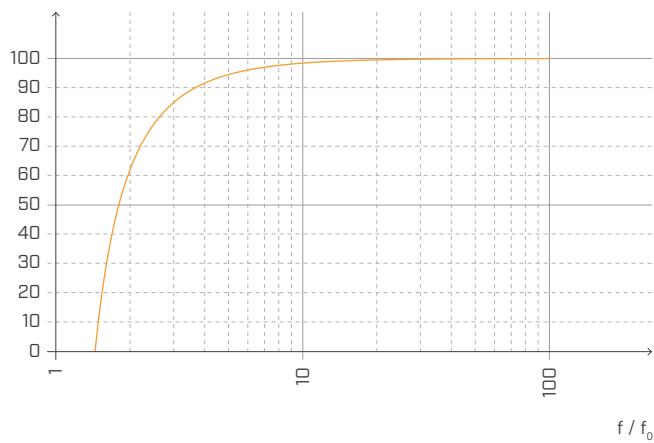

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

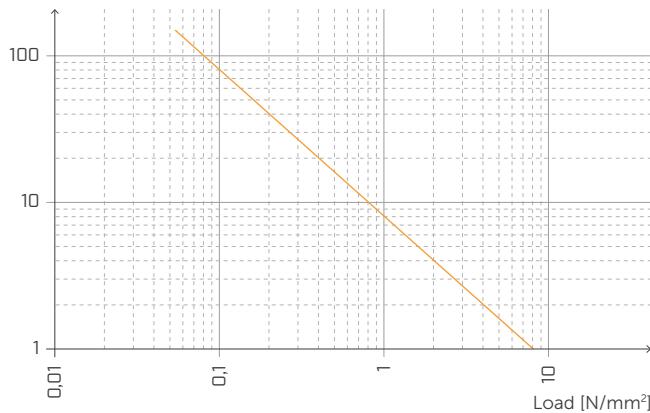


DEFORMATION AND LOAD

Deformation [%]

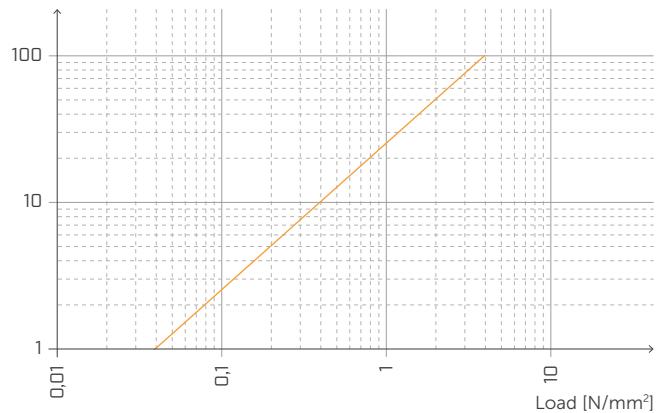


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

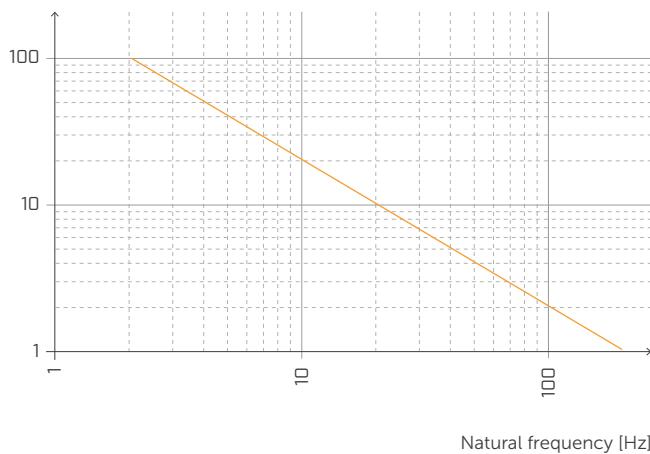


TRANSMISSIBILITY

Transmission [dB]

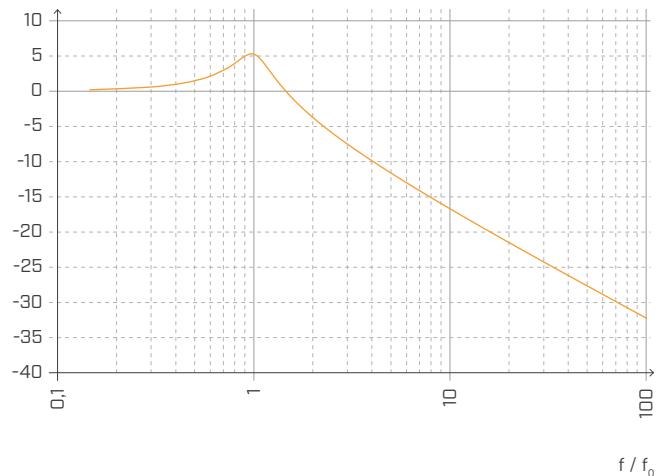

ATTENUATION

Attenuation [%]

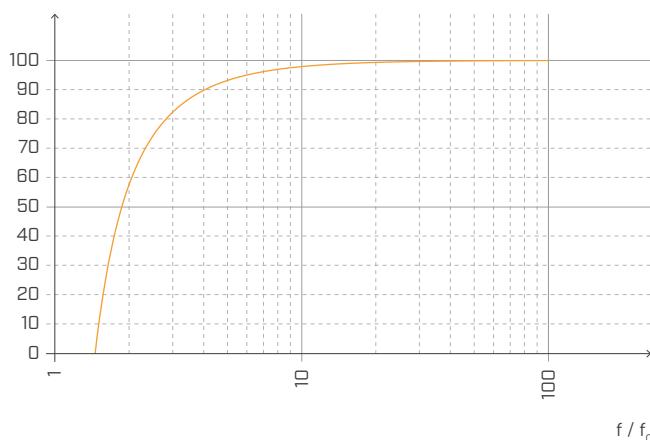


Normalised with respect to the resonance frequency with $f = 5 \text{ Hz}$.

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

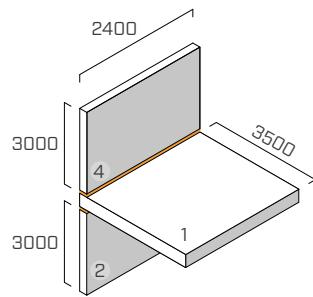

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 50 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 338000

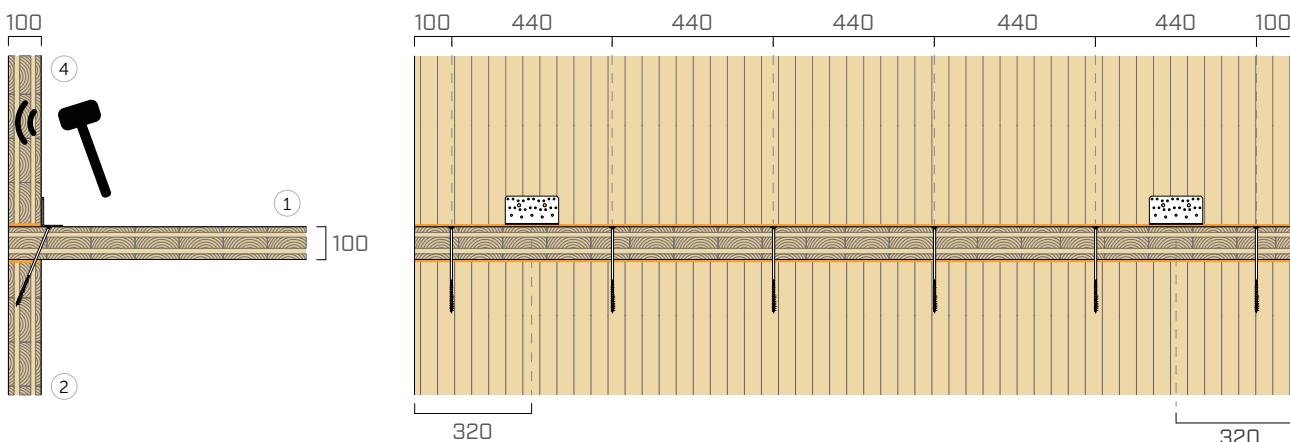

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	17,6	17,7	20,5	21,3	18,4	21,9	24,3	16,9	20,5	21,0	18,6	19,7	21,9	16,1	16,3	20,7

$$\overline{K_{14}} = 19,9 \text{ dB}$$

$$\overline{K_{14,0}} = 13,3 \text{ dB}$$

$$\Delta_{l,14} = 6,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	22,1	19,2	15,9	21,0	20,5	21,5	24,0	21,2	19,8	23,0	23,7	23,6	26,8	23,2	24,3	28,3

$$\overline{K_{12}} = 21,8 \text{ dB}$$

$$\overline{K_{12,0}} = 14,5 \text{ dB}$$

$$\Delta_{l,12} = 7,3 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	18,7	26,7	26,6	31,1	24,4	27,8	26,6	25,3	22,5	27,8	28,6	33,2	28,6	33,3	34,0	31,6

$$\overline{K_{24}} = 27,9 \text{ dB}$$

$$\overline{K_{24,0}} = 17,3 \text{ dB}$$


$$\Delta_{l,24} = 10,6 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

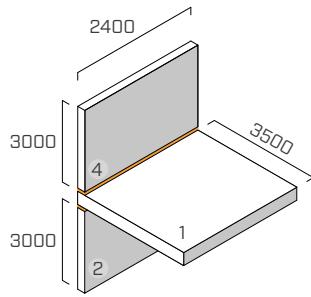

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 50 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

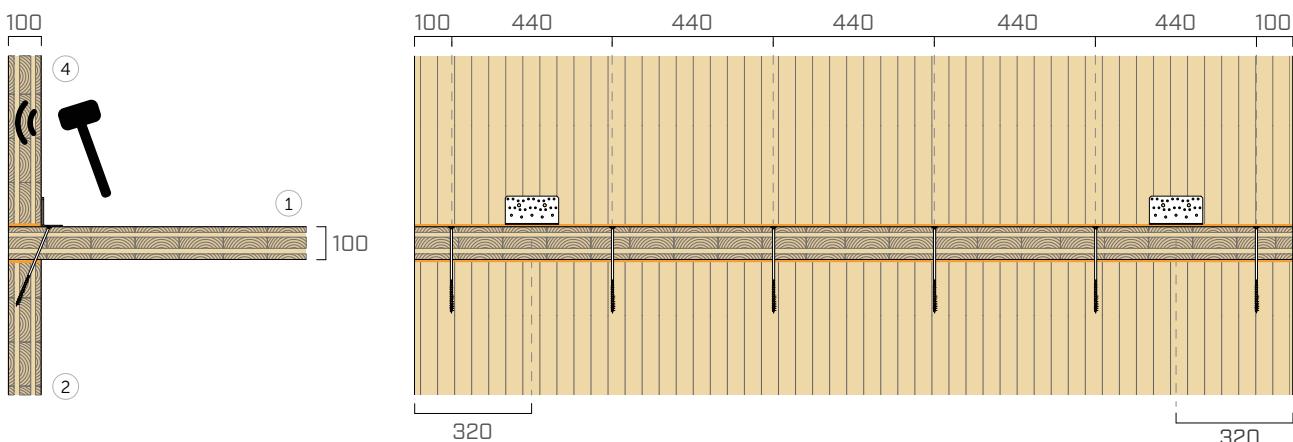

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	12,3	18,4	17,0	19,7	15,3	19,3	23,6	20,5	22,2	19,9	23,6	24,5	24,6	22,4	21,8	20,5

$$\overline{K_{14}} = 20,8 \text{ dB}$$

$$\overline{K_{14,0}} = 14,4 \text{ dB}$$

$$\Delta_{l,14} = 6,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	15,5	19,2	15,8	18,1	19,0	19,4	20,9	18,3	18,8	20,3	20,4	23,7	25,0	24,1	21,3	23,5

$$\overline{K_{12}} = 20,2 \text{ dB}$$

$$\overline{K_{12,0}} = 14,6 \text{ dB}$$

$$\Delta_{l,12} = 5,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	12,3	25,0	20,2	26,9	23,5	27,7	27,0	27,0	28,8	30,5	33,5	36,0	35,9	38,7	36,1	31,6

$$\overline{K_{24}} = 29,3 \text{ dB}$$

$$\overline{K_{24,0}} = 20,4 \text{ dB}$$


$$\Delta_{l,24} = 8,9 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

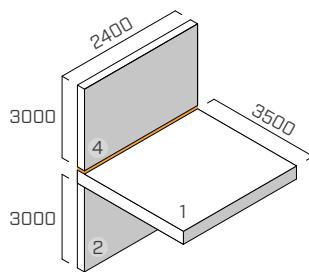

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 50 + XYLOFON PLATE

position: between the upper wall and the floor

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 338000

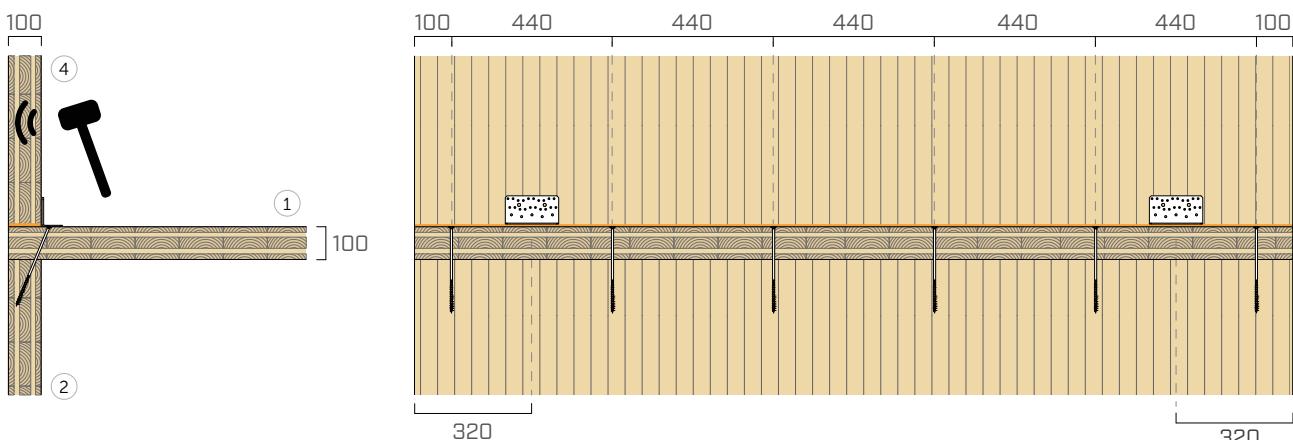

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	19,4	18,3	20,6	27,4	19,4	23,9	25,0	17,1	19,3	20,4	19,6	20,6	22,8	17,3	18,4	21,1

$$\overline{K_{14}} = 20,9 \text{ dB}$$

$$\overline{K_{14,0}} = 13,3 \text{ dB}$$

$$\Delta_{l,14} = 7,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	15,8	13,8	8,9	9,4	13,8	10,5	13,8	10,2	11,7	11,0	10,1	13,0	15,9	14,9	16,8	19,9

$$\overline{K_{12}} = 12,1 \text{ dB}$$

$$\overline{K_{12,0}} = 14,5 \text{ dB}$$

$$\Delta_{l,12} = -2,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	18,2	23,7	23,2	28,0	26,4	24,5	24,4	19,6	20,2	23,0	21,0	25,7	26,4	29,3	30,3	28,2

$$\overline{K_{24}} = 24,3 \text{ dB}$$

$$\overline{K_{24,0}} = 17,3 \text{ dB}$$


$$\Delta_{l,24} = 7 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

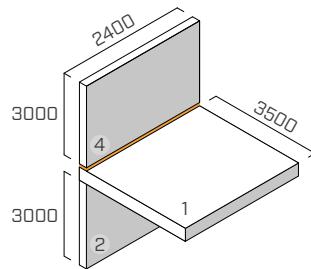

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 50 + XYLOFON PLATE

position: between the upper wall and the floor

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

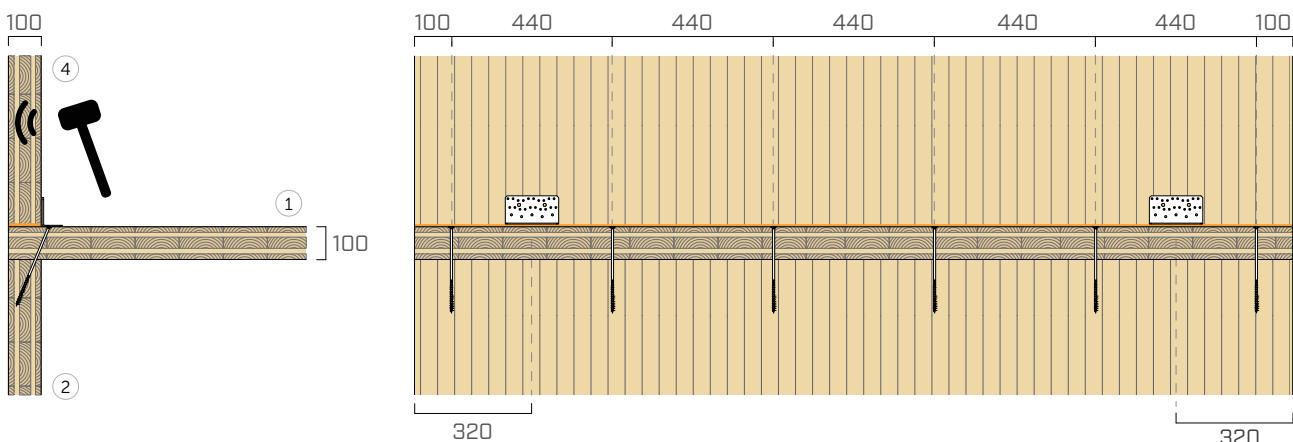

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	11,0	14,4	16,0	17,2	17,3	19,8	23,1	20,1	23,5	21,7	26,9	26,6	24,5	24,6	24,1	22,0

$$\overline{K_{14}} = 21,2 \text{ dB}$$

$$\overline{K_{14,0}} = 14,4 \text{ dB}$$

$$\Delta_{l,14} = 6,8 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	15,8	10,9	9,5	9,2	14,5	10,7	13,2	10,3	14,3	12,1	14,5	14,4	15,7	18,0	19,4	19,7

$$\overline{K_{12}} = 12,9 \text{ dB}$$

$$\overline{K_{12,0}} = 14,6 \text{ dB}$$

$$\Delta_{l,12} = -1,8 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	15,2	24,5	21,3	23,8	19,6	23,0	22,6	21,9	26,7	26,8	31,6	26,3	29,8	34,3	34,9	31,1

$$\overline{K_{24}} = 25,5 \text{ dB}$$

$$\overline{K_{24,0}} = 20,4 \text{ dB}$$

$$\Delta_{l,24} = 5,1 \text{ dB}$$

XYLOFON 70

TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]		compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]	
	min	max	min	max	min	max	11,1	
XYL70080	39,2	28912	120	88507				
XYL70090	44,1	32526	135	99571				
XYL70100	49	36141	150	110634	0,49	1,5	0,2	0,65
XYL70120	58,8	43369	180	132761	71,1	218	8	26
XYL70140	68,6	50597	210	154888				
XYL70160	78,4	57825	240	177015				

(1) The load ranges reported here are optimised with respect to the acoustic and static behaviour of the material in compression. However, it is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed. See the manual for transmissibility and attenuation graphs.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value	USC conversion
Acoustic improvement $\Delta_{ij}^{(3)}$	ISO 10848	7,8 dB	-
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	14,18 MPa (7,26 MPa)	2057 psi (1053 psi)
Dynamic elastic modulus evaluated at 1 Hz $E'_{1Hz} - E''_{1Hz}$	ISO 4664-1	6,00 - 0,47 MPa	870 - 68 psi
Dynamic elastic modulus evaluated at 5 Hz $E'_{5Hz} - E''_{5Hz}$	ISO 4664-1	6,44 - 0,77 MPa	934 psi - 112 psi
Dynamic elastic modulus evaluated at 10 Hz $E'_{10Hz} - E''_{10Hz}$	ISO 4664-1	6,87 - 1,03 MPa	996 - 149 psi
Dynamic elastic modulus evaluated at 50 Hz $E'_{50Hz} - E''_{50Hz}$	ISO 4664-1	7,87 - 2,22 MPa	1141 - 322 psi
Damping factor evaluated at 1 Hz $\tan\delta_{1Hz}$	ISO 4664-1	0,077	-
Damping factor evaluated at 5 Hz $\tan\delta_{5Hz}$	ISO 4664-1	0,118	-
Damping factor evaluated at 10 Hz $\tan\delta_{10Hz}$	ISO 4664-1	0,148	-
Damping factor evaluated at 50 Hz $\tan\delta_{50Hz}$	ISO 4664-1	0,282	-
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	2,9	-
Compression set c.s.	ISO 1856	0,71%	-
Compression at 1 mm deformation σ_{1mm}	ISO 844	2,44 N/mm ²	354 psi
Compression at 2 mm deformation σ_{2mm}	ISO 844	5,43 N/mm ²	788 psi
Compression at 3 mm deformation σ_{3mm}	ISO 844	11,10 N/mm ²	1610 psi
Dynamic stiffness $s^{(4)}$	ISO 9052	1822 MN/m ³	
Max processing temperature (TGA)	-	200 °C	392 °F
Reaction to fire	EN 13501-1	class E	-
Water absorption after 48h	ISO 62	< 1 %	-

(3) $\Delta_{ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$.

(4) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load.



PERFORMANCE

Acoustic improvement tested:

$\Delta_{ij}^{(3)} : 7,8 \text{ dB}$


Maximum applied load
(3 mm deformation):

11,1 N/mm²


Acoustic service load:

from 0,49 to 1,5 N/mm²


STRESS | DEFORMATION COMPRESSION

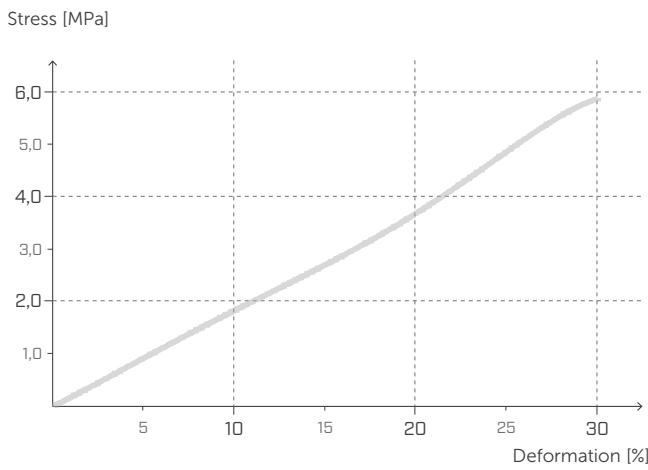


CREEP COMPRESSION

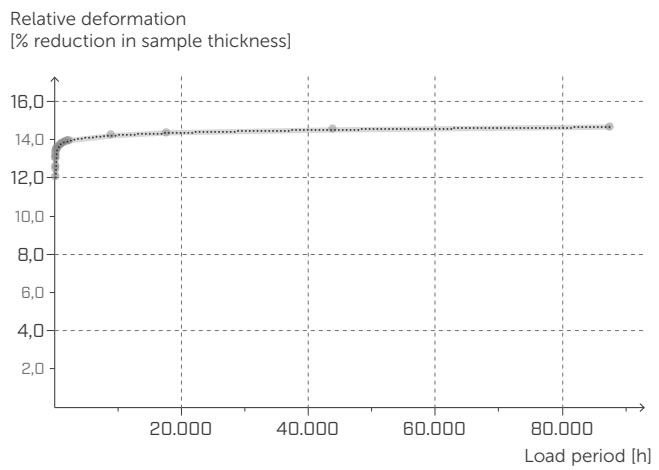


DYNAMIC ELASTIC MODULUS E' DMTA

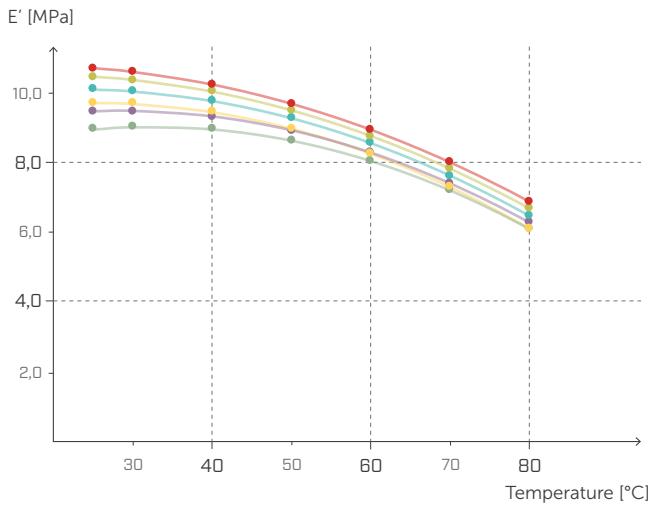


TAN δ UNDER STRESS DMTA

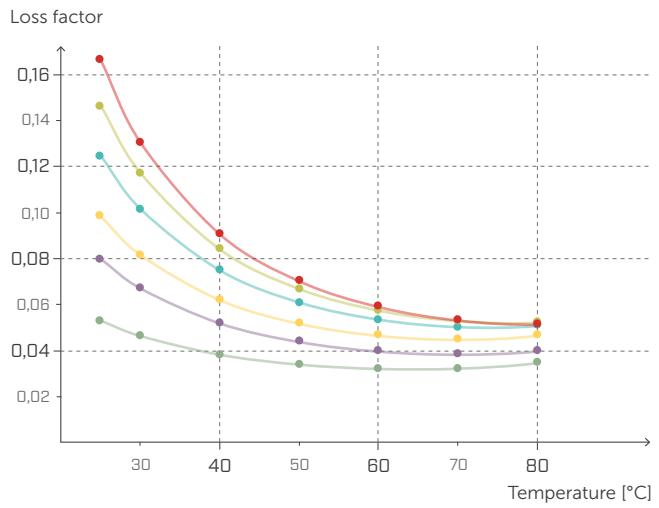

DYNAMIC ELASTIC MODULUS G' DMTA

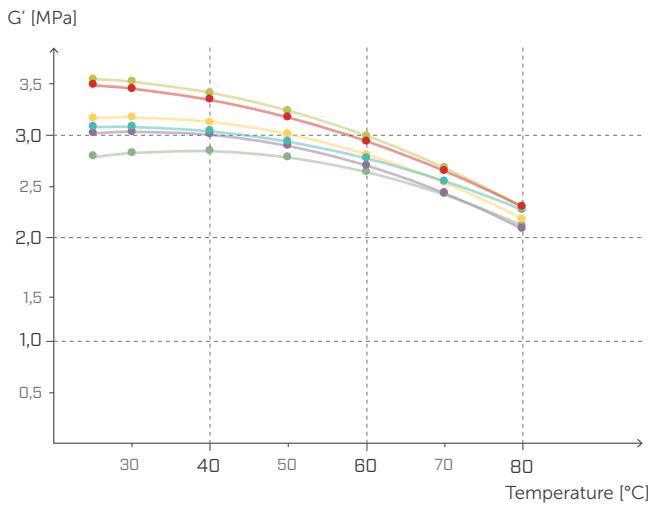

TAN δ SHEAR DMTA

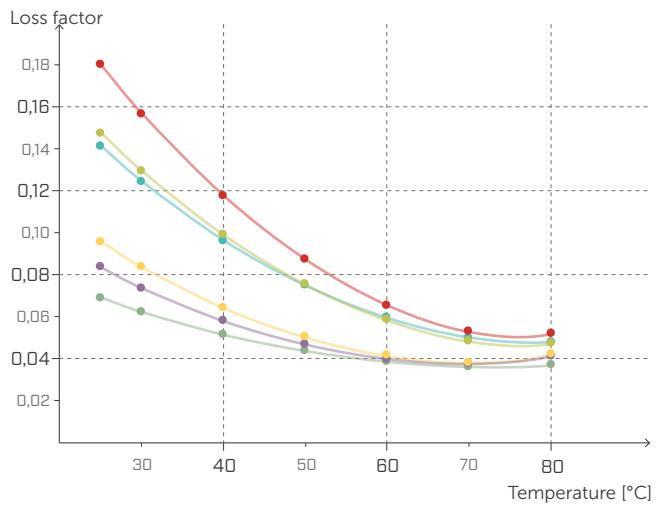

—●— 1,0 Hz/MPa

—●— 5,0 Hz/MPa

—●— 10,0 Hz/MPa

—●— 20,0 Hz/MPa

—●— 33,3 Hz/MPa

—●— 50,0 Hz/MPa

STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

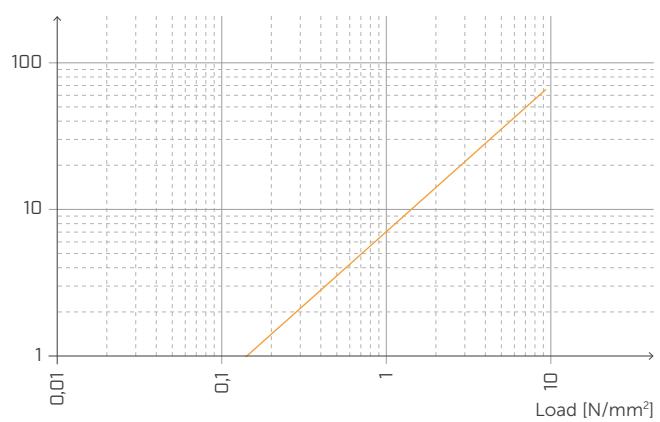


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

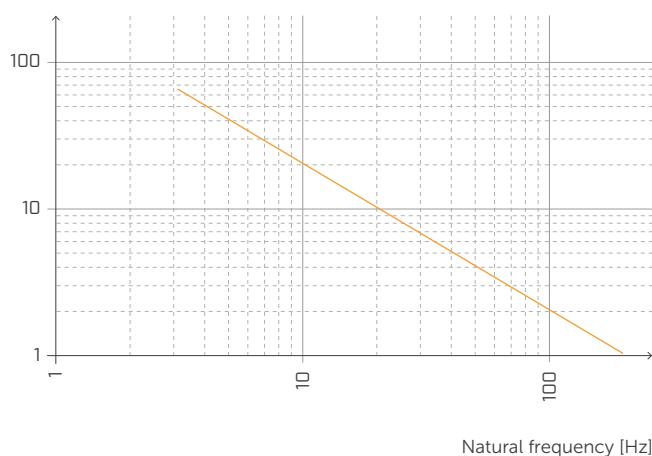


TRANSMISSIBILITY

Transmission [dB]

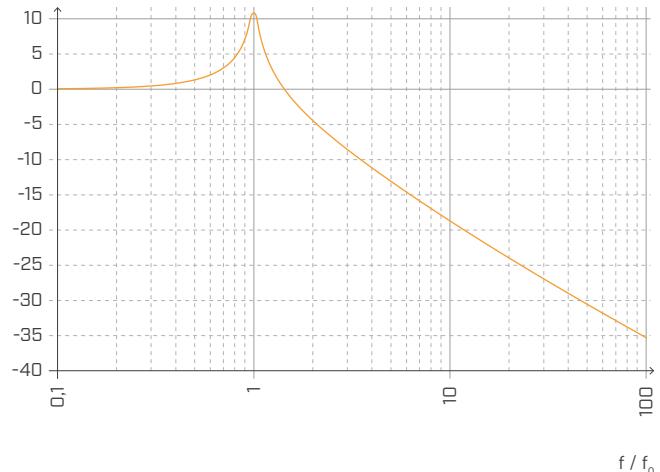

ATTENUATION

Attenuation [%]

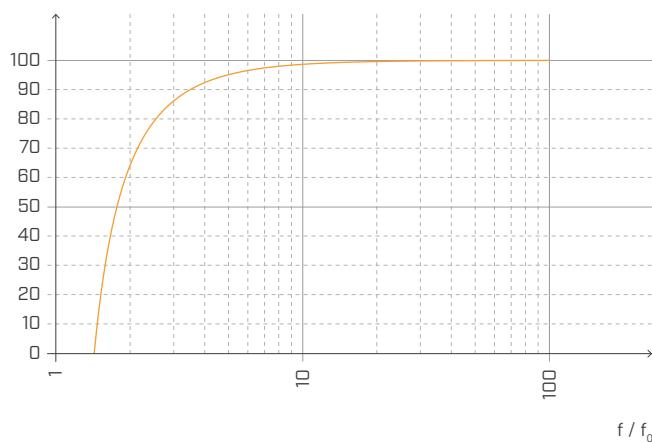

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

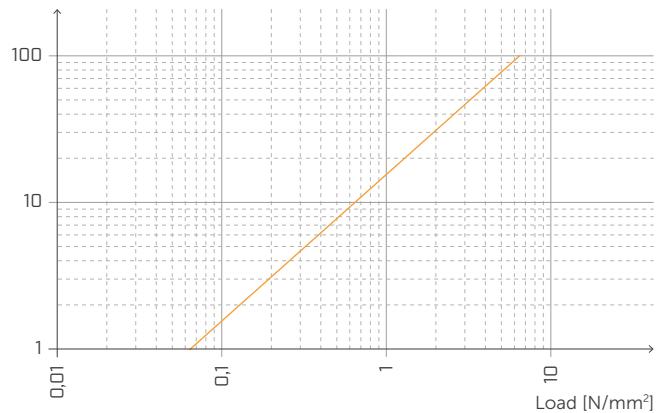


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

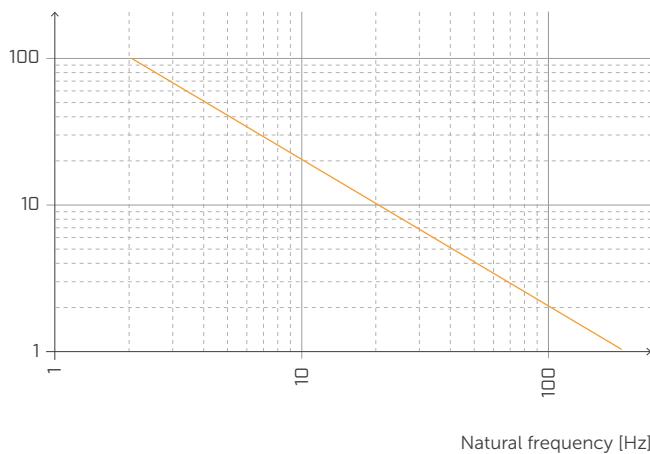


TRANSMISSIBILITY

Transmission [dB]

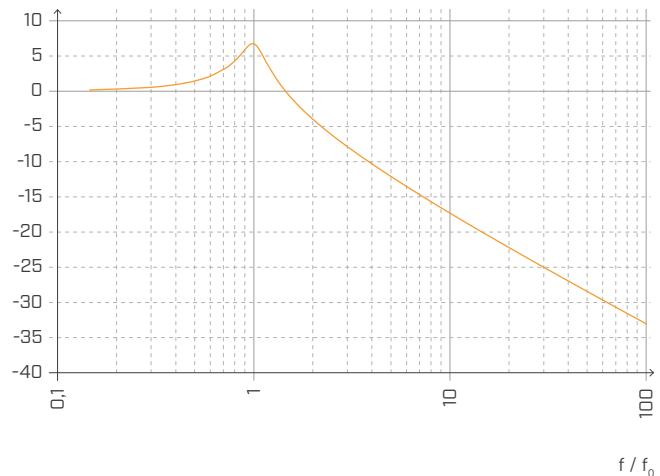

ATTENUATION

Attenuation [%]

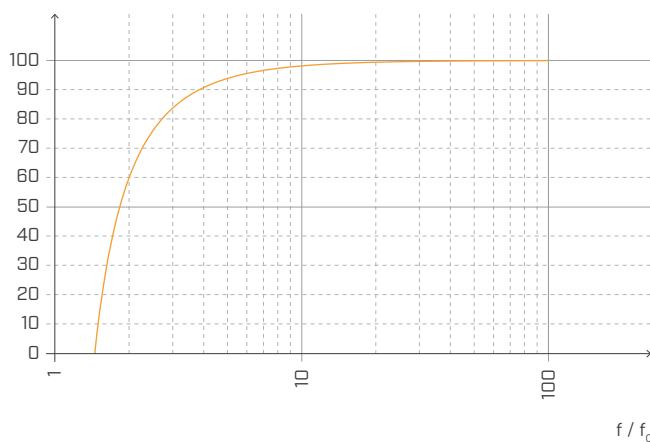


Normalised with respect to the resonance frequency with $f = 5 \text{ Hz}$.

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

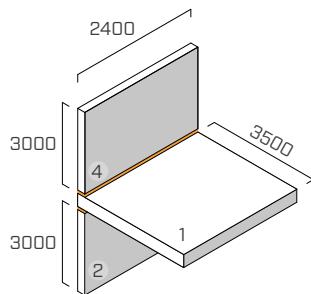

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm (69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 70 + XYLOFON PLATE

position: between the upper wall and the floor + between the floor and the lower wall

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 625000

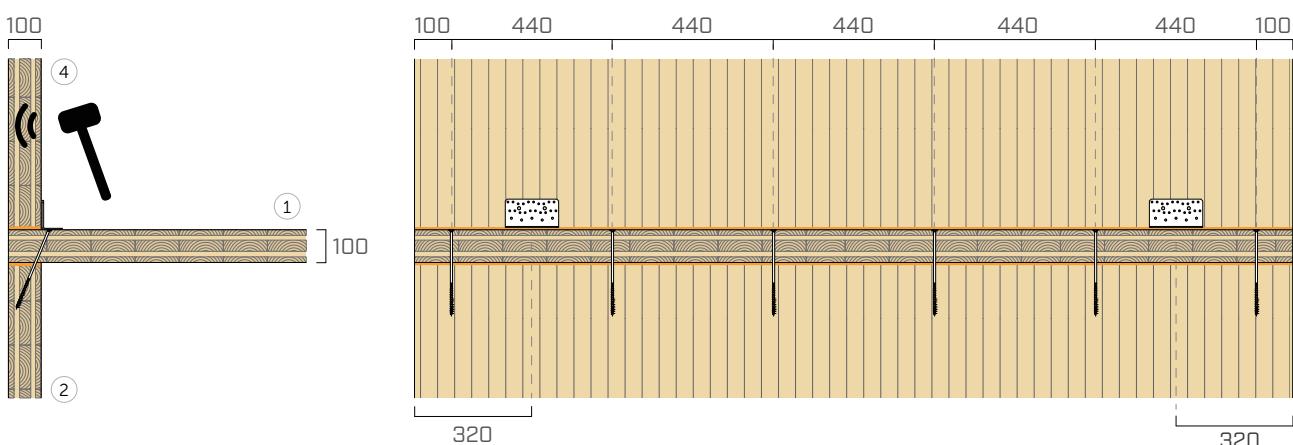

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	15,1	21,7	16,7	14,0	18,0	15,9	19,6	15,5	16,8	16,5	14,7	16,8	18,0	15,6	14,4	17,8

$$\overline{K_{14}} = 16,9 \text{ dB}$$

$$\overline{K_{14,0}} = 13,3 \text{ dB}$$

$$\Delta_{l,14} = 3,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	21,1	23,8	15,4	17,4	16,0	18,2	20,6	18,4	20,4	19,8	18,3	17,8	22,8	18,8	18,4	22,3

$$\overline{K_{12}} = 19,0 \text{ dB}$$

$$\overline{K_{12,0}} = 14,5 \text{ dB}$$

$$\Delta_{l,12} = 4,5 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	16,1	28,4	25,6	24,8	23,3	23,9	22,3	22,5	23,1	23,4	25,2	23,7	29,1	31,5	31,2	31,1

$$\overline{K_{24}} = 25,1 \text{ dB}$$

$$\overline{K_{24,0}} = 17,3 \text{ dB}$$


$$\Delta_{l,24} = 7,8 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)
 floor: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3,5 m - 7.8 ft x 11 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (2,4 m x 3 m - 7.8 ft x 10 ft)

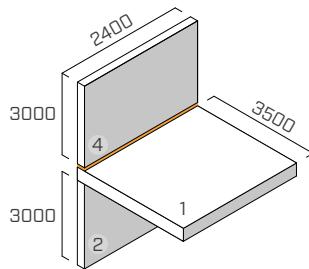

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm (17 1/4 in)

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm 69 5/16 in)

fastening pattern on CLT: 31 screws Ø5 x 50 mm

RESILIENT PROFILE


XYLOFON 70 + XYLOFON PLATE

position: between the upper wall and the floor

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 2,40 m (7.8 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 625000

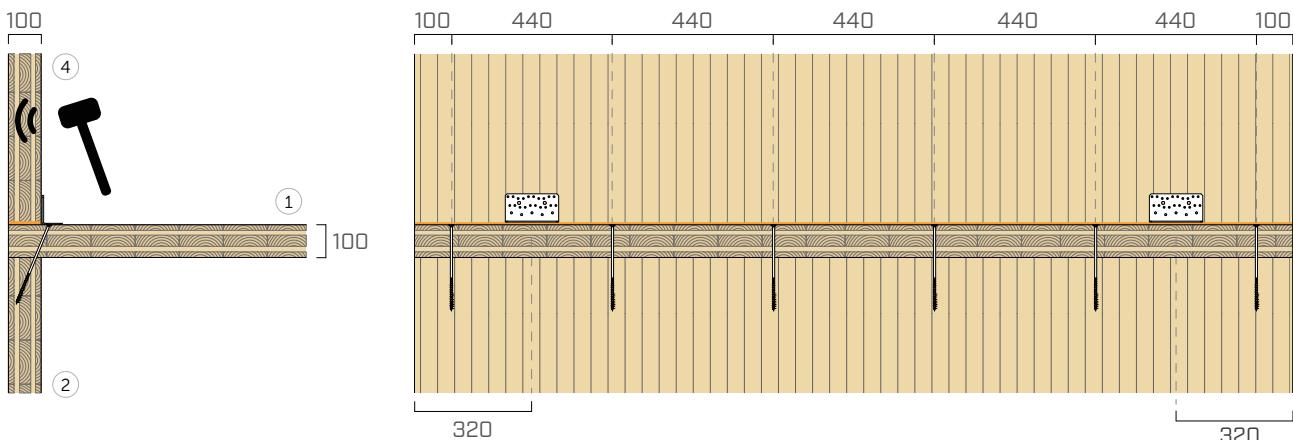

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	18,4	16,2	21,3	21,8	18,9	17,4	20,2	16,7	16,7	17,1	14,7	18,3	18,6	16,3	13,8	19,2

$$\overline{K_{14}} = 18,0 \text{ dB} \quad \overline{K_{14,0}} = 13,7 \text{ dB} \quad \Delta_{l,14} = 4,7 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	18,9	19,1	15,6	10,6	13,1	12,8	14,6	10,5	13,8	12,0	11,0	11,9	17,2	14,3	16,4	21,3

$$\overline{K_{12}} = 16,6 \text{ dB} \quad \overline{K_{12,0}} = 14,5 \text{ dB} \quad \Delta_{l,12} = -0,9 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	15,0	28,7	25,6	22,0	23,5	23,6	22,5	19,3	18,4	21,2	22,2	22,5	24,8	27,4	29,6	29,9

$$\overline{K_{24}} = 23,2 \text{ dB} \quad \overline{K_{24,0}} = 17,3 \text{ dB} \quad \Delta_{l,24} = 5,9 \text{ dB}$$

XYLOFON 80

TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]		compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]	
	min	max	min	max	min	max	19,51	
XYL80080	104	76706	192	141612				
XYL80090	117	86295	216	159313				
XYL80100	130	95883	240	177015	1,3	2,4	0,3	0,57
XYL80120	156	115060	288	212418	189	348	12	22
XYL80140	182	134236	336	247821				
XYL80160	208	153413	384	283224				

(1) The load ranges reported here are optimised with respect to the acoustic and static behaviour of the material in compression. However, it is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed. See the manual for transmissibility and attenuation graphs.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value	USC conversion
Acoustic improvement $\Delta_{ij}^{(3)}$	ISO 10848	> 7 dB	-
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	25,39 MPa (13,18 MPa)	3683 psi (1912psi)
Dynamic elastic modulus evaluated at 1 Hz $E'_{1Hz} - E''_{1Hz}$	ISO 4664-1	15,44 - 1,52 MPa	2239 - 220 psi
Dynamic elastic modulus evaluated at 5 Hz $E'_{5Hz} - E''_{5Hz}$	ISO 4664-1	16,90 - 2,54 MPa	2451 psi - 368 psi
Dynamic elastic modulus evaluated at 10 Hz $E'_{10Hz} - E''_{10Hz}$	ISO 4664-1	18,02 - 3,34 MPa	2614 - 484 psi
Dynamic elastic modulus evaluated at 50 Hz $E'_{50Hz} - E''_{50Hz}$	ISO 4664-1	21,81 - 6,88 MPa	3163 - 998 psi
Damping factor evaluated at 1 Hz $\tan\delta_{1Hz}$	ISO 4664-1	0,099	-
Damping factor evaluated at 5 Hz $\tan\delta_{5Hz}$	ISO 4664-1	0,15	-
Damping factor evaluated at 10 Hz $\tan\delta_{10Hz}$	ISO 4664-1	0,185	-
Damping factor evaluated at 50 Hz $\tan\delta_{50Hz}$	ISO 4664-1	0,315	-
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	10,3	-
Compression set c.s.	ISO 1856	1,31%	-
Compression at 1 mm deformation σ_{1mm}	ISO 844	3,85 N/mm ²	558 psi
Compression at 2 mm deformation σ_{2mm}	ISO 844	9,52 N/mm ²	1381 psi
Compression at 3 mm deformation σ_{3mm}	ISO 844	19,51 N/mm ²	2830 psi
Dynamic stiffness s' ⁽⁴⁾	ISO 9052	2157 MN/m ³	
Max processing temperature (TGA)	-	200 °C	392 °F
Reaction to fire	EN 13501-1	class E	-
Water absorption after 48h	ISO 62	< 1 %	-

(3) $\Delta_{ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$.

(4) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load.



PERFORMANCE

Acoustic improvement tested:

$\Delta_{ij}^{(3)} : > 7 \text{ dB}$


Maximum applicable load (3 mm deformation):

19,51 N/mm²


Acoustic service load:

from 1,3 to 2,4 N/mm²


STRESS | DEFORMATION COMPRESSION

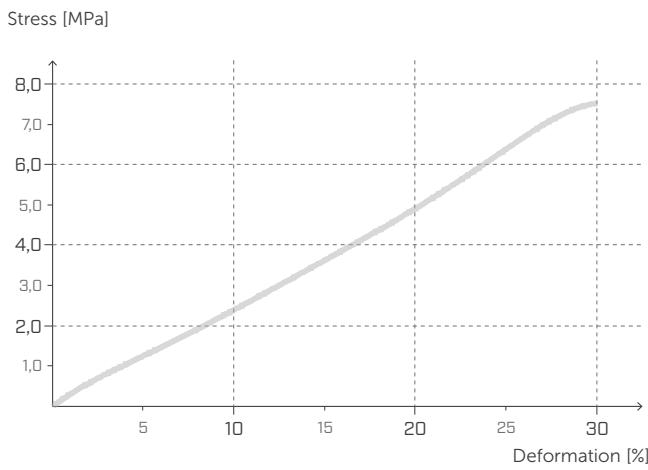


CREEP COMPRESSION

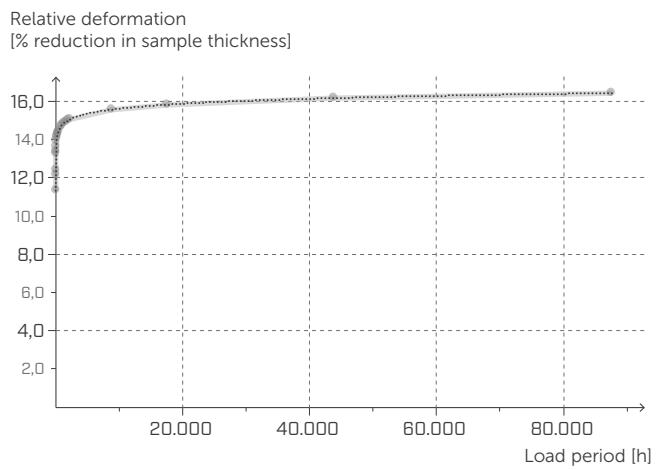


DYNAMIC ELASTIC MODULUS E' DMTA

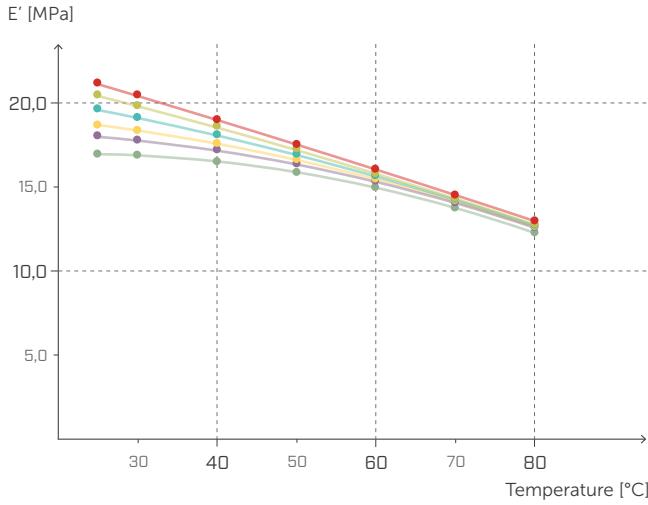


TAN δ UNDER STRESS DMTA

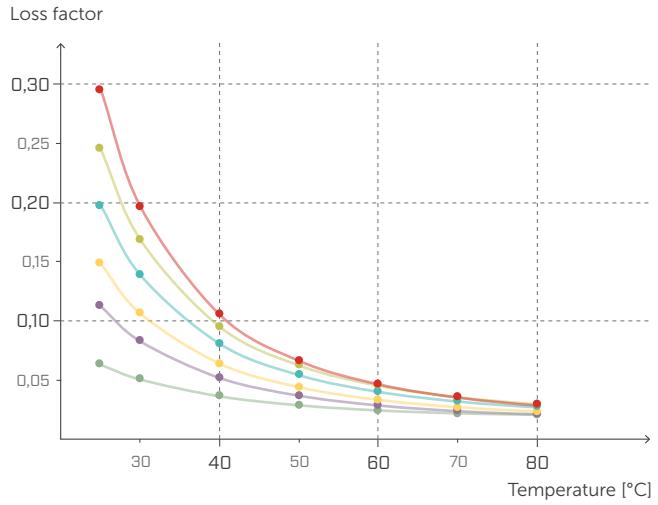

DYNAMIC ELASTIC MODULUS G' DMTA

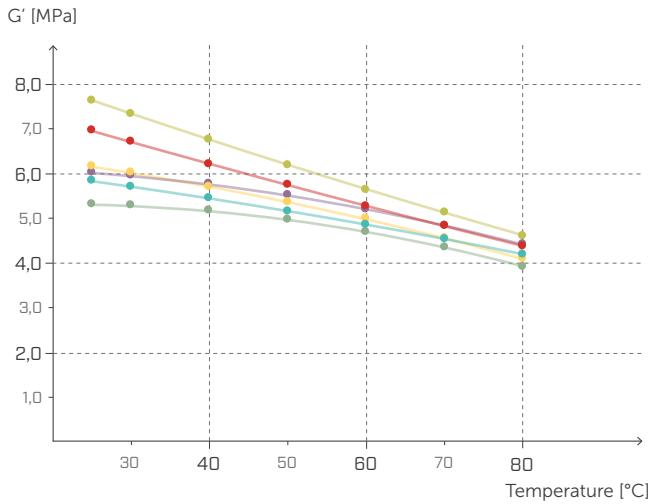

TAN δ SHEAR DMTA

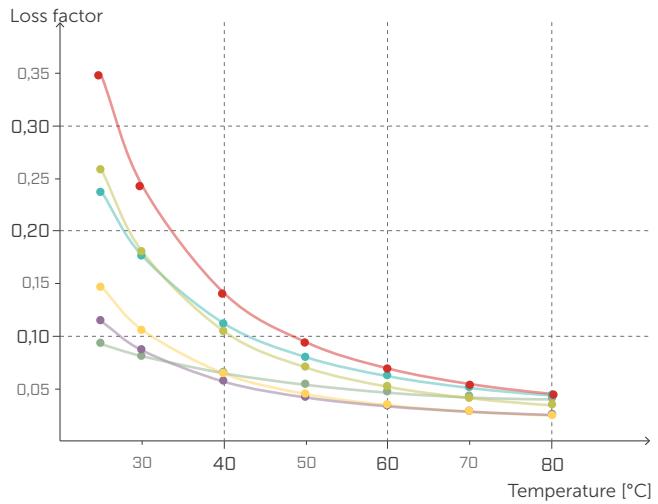

—●— 1,0 Hz/MPa

—●— 5,0 Hz/MPa

—●— 10,0 Hz/MPa

—●— 20,0 Hz/MPa

—●— 33,3 Hz/MPa

—●— 50,0 Hz/MPa

STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

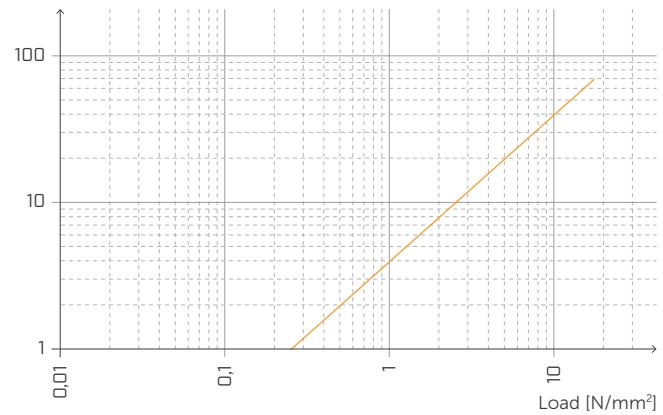


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

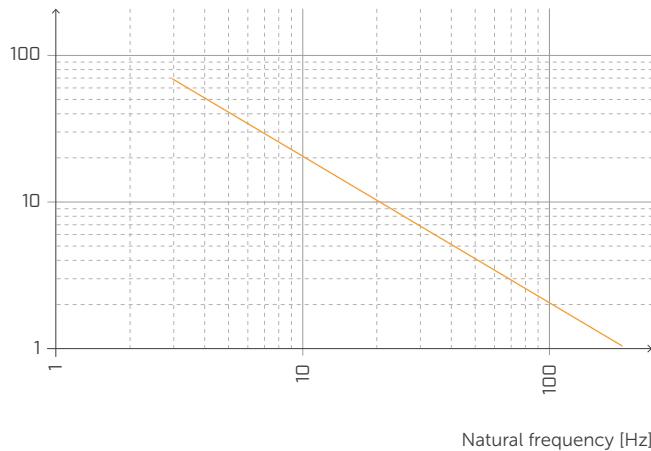


TRANSMISSIBILITY

Transmission [dB]

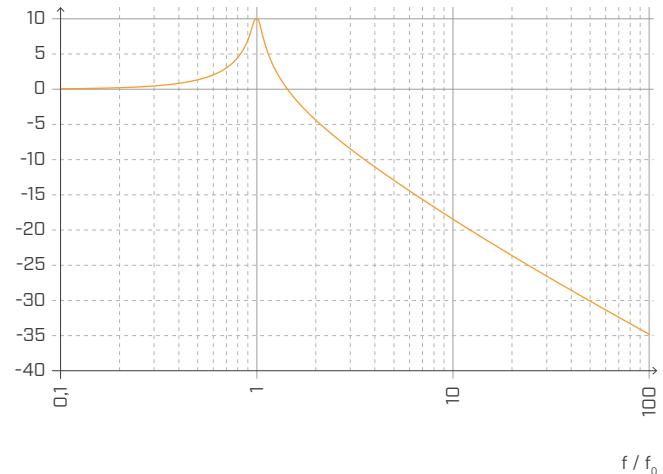

ATTENUATION


Attenuation [%]

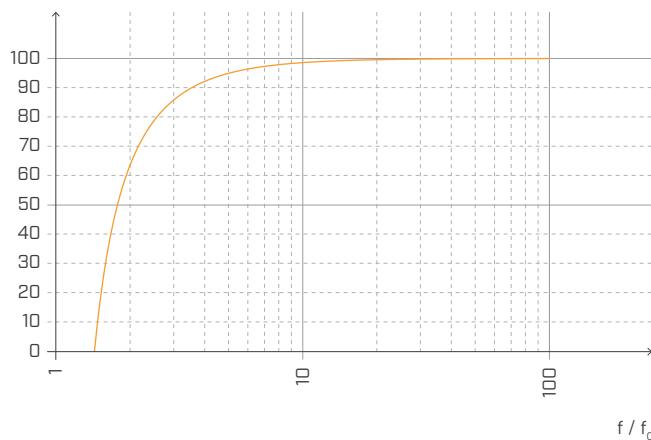

Normalised with respect to the resonance frequency with $f = 20$ Hz.

NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

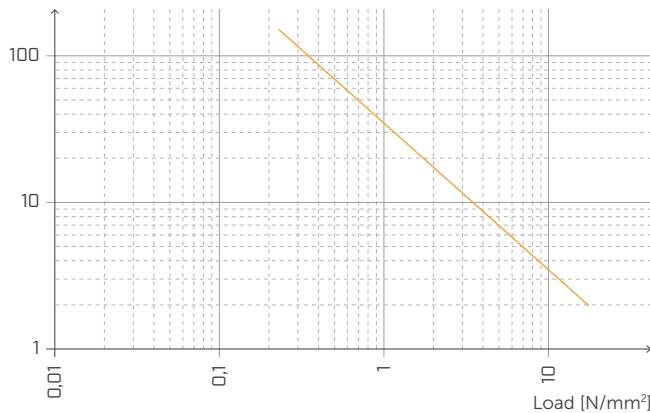


DEFORMATION AND LOAD

Deformation [%]




DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

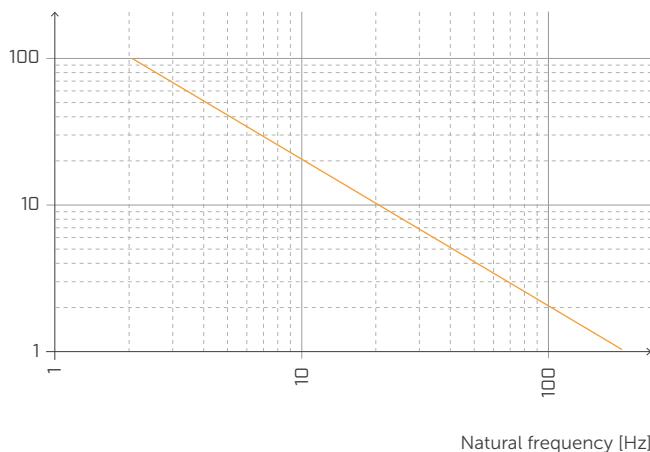


TRANSMISSIBILITY

Transmission [dB]

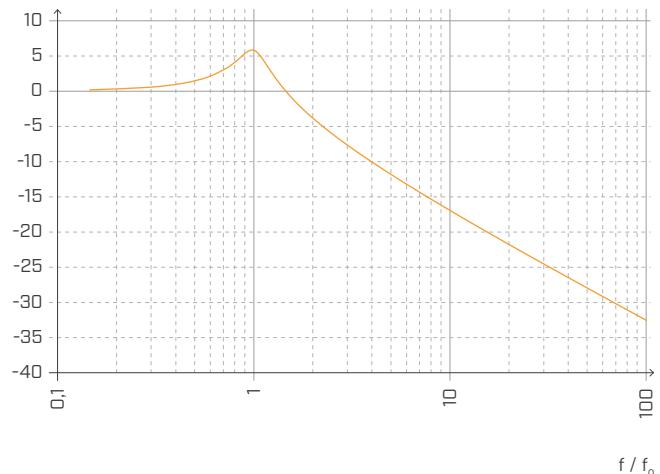

ATTENUATION

Attenuation [%]

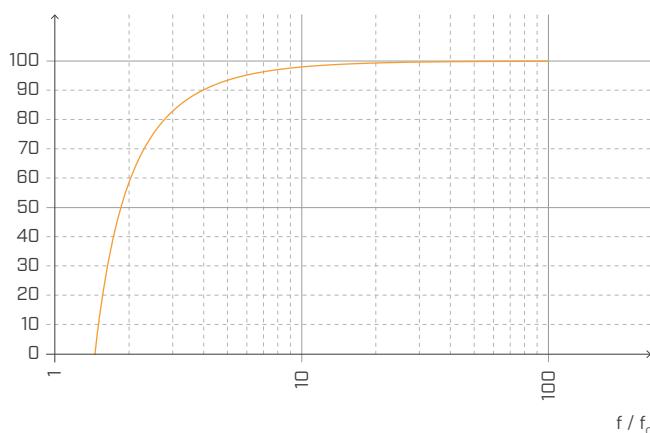

Normalised with respect to the resonance frequency with $f = 5 \text{ Hz}$.

XYLOFON 90

TABLE OF USE⁽¹⁾

CODE	load for acoustic optimisation ⁽²⁾ [kN/m] [lbf/ft]		compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]	
	min	max	min	max	min	max		
XYL90080	176	129811	360	265522				
XYL90090	198	146037	405	298713				
XYL90100	220	162264	450	331903	2,2	4,5	0,3	0,74
XYL90120	264	194716	540	398283	319	653	12	29
XYL90140	308	227169	630	464664				
XYL90160	352	259622	720	531045				

(1) The load ranges reported here are optimised with respect to the acoustic and static behaviour of the material in compression. However, it is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed. See the manual for transmissibility and attenuation graphs.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50% of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value	USC conversion
Acoustic improvement $\Delta_{ij}^{(3)}$	ISO 10848	> 7 dB	-
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	36,56 MPa (21,91 MPa)	5303 psi (3178psi)
Dynamic elastic modulus evaluated at 1 Hz $E'_{1Hz} - E''_{1Hz}$	ISO 4664-1	32,2 - 6,9 MPa	4670 - 1001 psi
Dynamic elastic modulus evaluated at 5 Hz $E'_{5Hz} - E''_{5Hz}$	ISO 4664-1	39,89 - 12,23 MPa	5786 - 1774 psi
Dynamic elastic modulus evaluated at 10 Hz $E'_{10Hz} - E''_{10Hz}$	ISO 4664-1	45,37 - 16,04 MPa	6580 - 2326 psi
Dynamic elastic modulus evaluated at 50 Hz $E'_{50Hz} - E''_{50Hz}$	ISO 4664-1	65,72 - 29,78 MPa	9532 - 4319 psi
Damping factor evaluated at 1 Hz $\tan\delta_{1Hz}$	ISO 4664-1	0,214	-
Damping factor evaluated at 5 Hz $\tan\delta_{5Hz}$	ISO 4664-1	0,307	-
Damping factor evaluated at 10 Hz $\tan\delta_{10Hz}$	ISO 4664-1	0,354	-
Damping factor evaluated at 50 Hz $\tan\delta_{50Hz}$	ISO 4664-1	0,453	-
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	0,28	-
Compression set c.s.	ISO 1856	2,02%	-
Compression at 1 mm deformation σ_{1mm}	ISO 844	5,83 N/mm ²	846 psi
Compression at 2 mm deformation σ_{2mm}	ISO 844	14,41 N/mm ²	2090 psi
Compression at 3 mm deformation σ_{3mm}	ISO 844	28,97 N/mm ²	4202 psi
Dynamic stiffness $s^{(4)}$	ISO 9052	> 2200 MN/m ³	
Max processing temperature (TGA)	-	200 °C	392 °F
Reaction to fire	EN 13501-1	class E	-
Water absorption after 48h	ISO 62	< 1 %	-

(3) $\Delta_{ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$.

(4) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load.



PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 7 \text{ dB}$


Maximum applied load (3 mm deformation):

29,87 N/mm²


Acoustic service load:

from 2,2 to 4,5 N/mm²


STRESS | DEFORMATION COMPRESSION

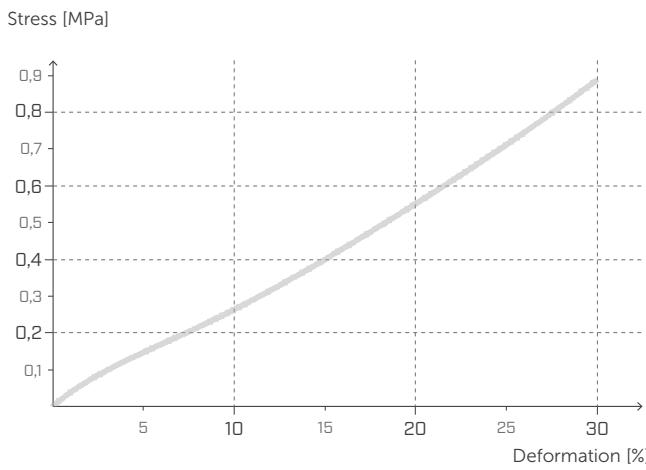


CREEP COMPRESSION

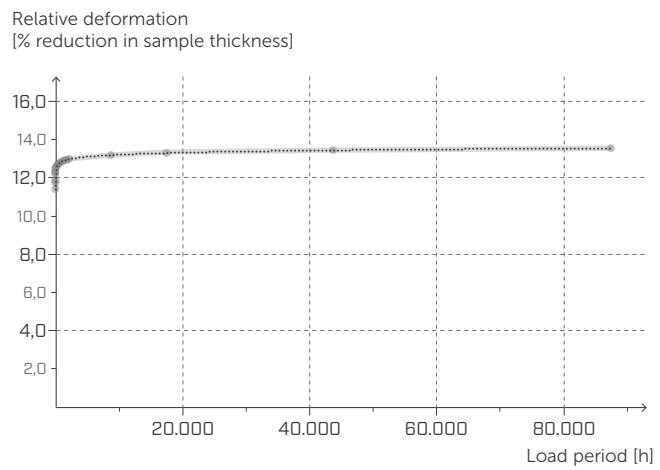


DYNAMIC ELASTIC MODULUS E' DMTA

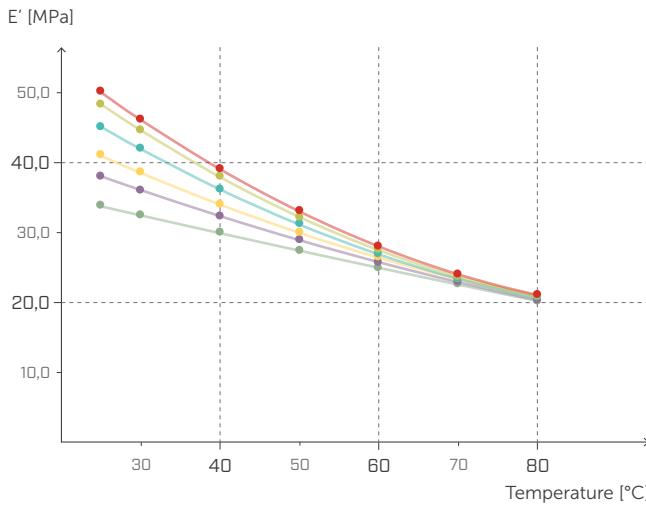


TAN δ UNDER STRESS DMTA

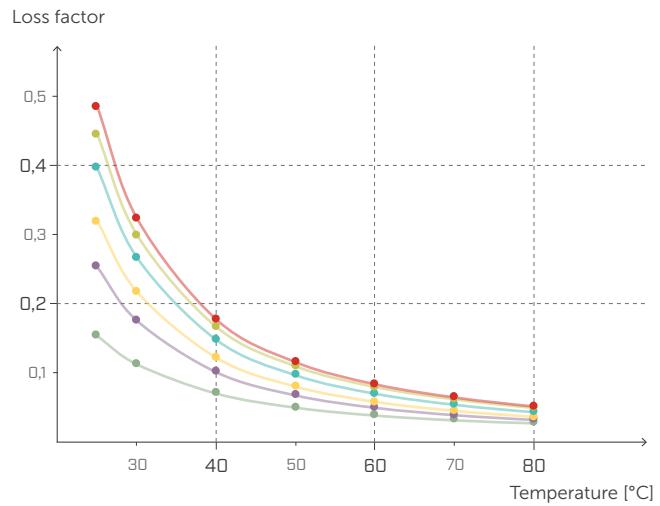

DYNAMIC ELASTIC MODULUS G' DMTA

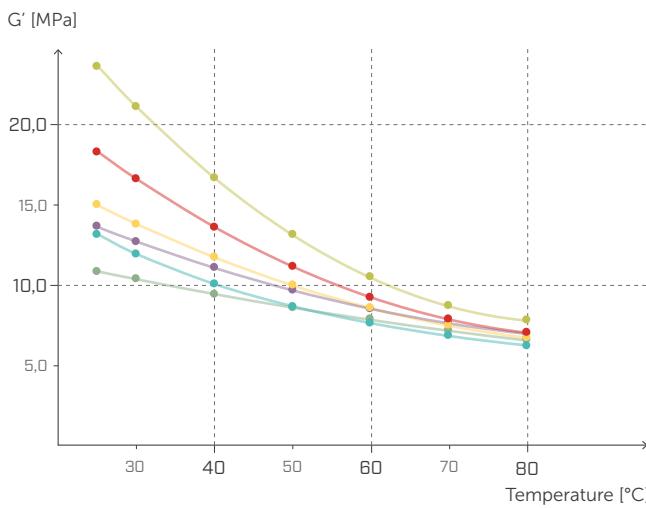

TAN δ SHEAR DMTA

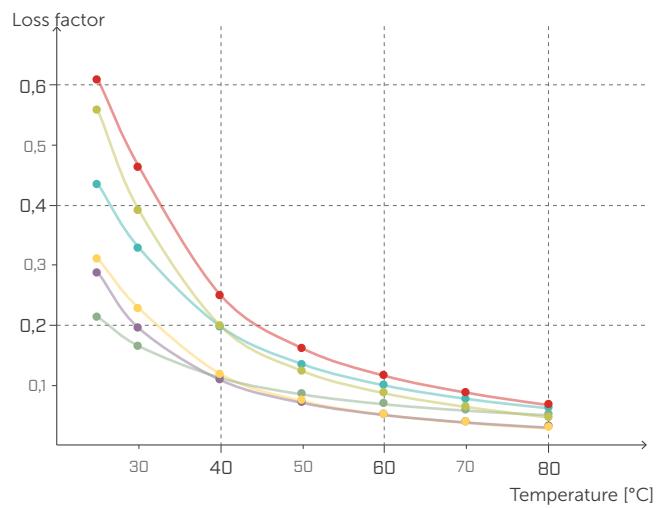

—●— 1,0 Hz/MPa —●— 5,0 Hz/MPa —●— 10,0 Hz/MPa

—●— 20,0 Hz/MPa —●— 33,3 Hz/MPa —●— 50,0 Hz/MPa

STATIC LOAD [buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

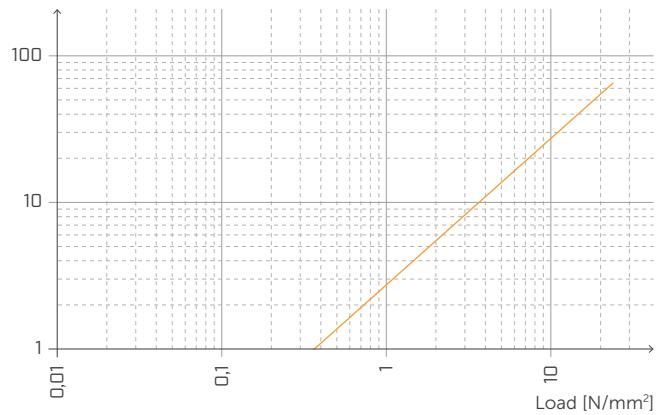


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

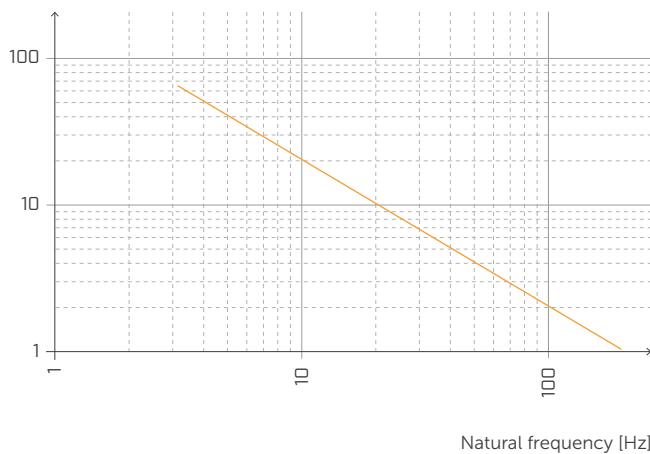


TRANSMISSIBILITY

Transmission [dB]

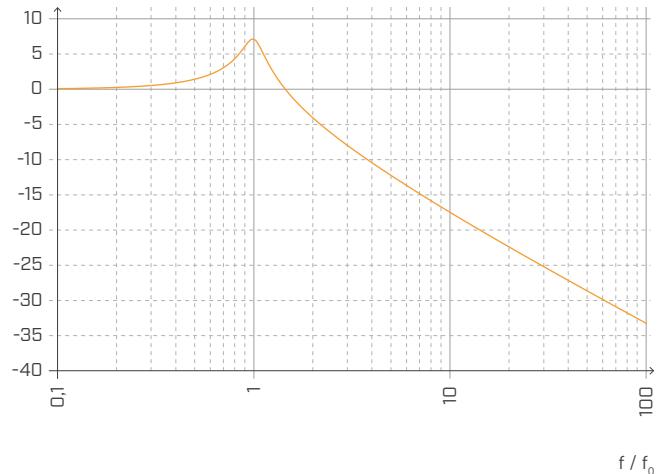

ATTENUATION

Attenuation [%]

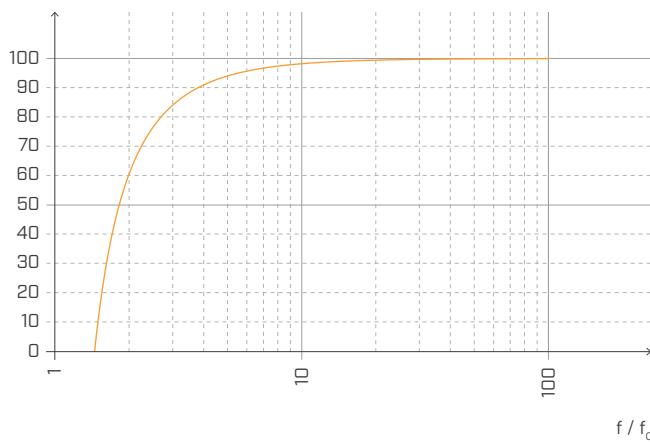

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

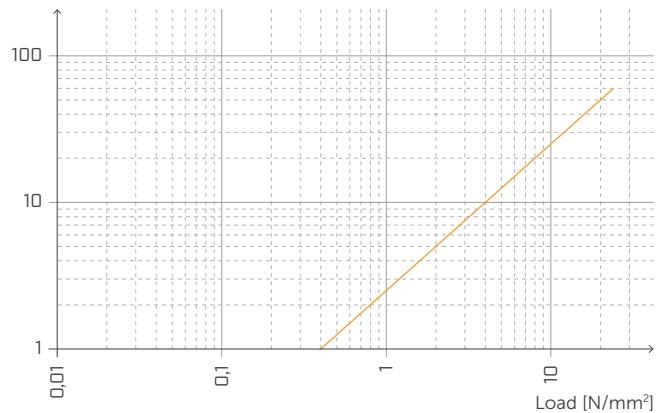


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

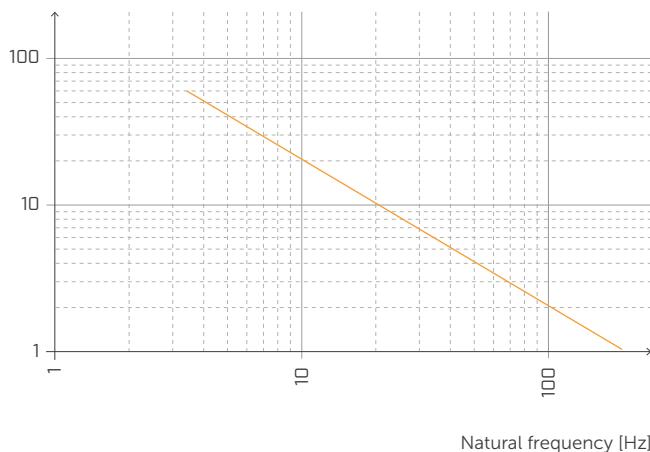


TRANSMISSIBILITY

Transmission [dB]

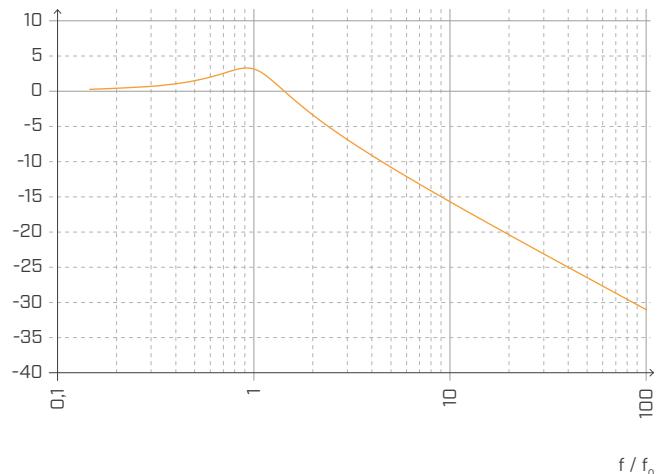

ATTENUATION

Attenuation [%]

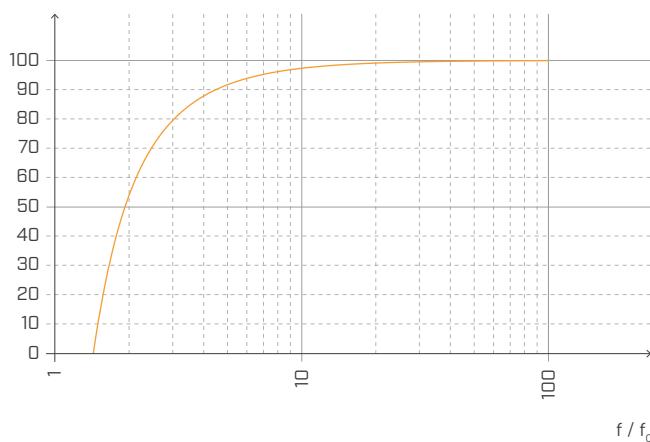

Normalised with respect to the resonance frequency with $f = 5 \text{ Hz}$.

THE CEN MODEL (EN ISO 12354)

The CEN model proposed in the EN ISO 12354 series of standards provides a powerful tool to predict the acoustic performance of a partition from the characteristics of the construction elements. The EN ISO 12354 series has been expanded to provide more specific information regarding timber frame and CLT structures.



EN ISO 12354-1:2017
Airborne sound insulation between rooms.



EN ISO 12354-2:2017
Impact sound soundproofing between rooms.

APPARENT SOUND REDUCTION INDEX

EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method.

When using the simplified calculation model, disregarding the presence of small penetrations and airborne transmission paths $D_{n,j,w}$, the apparent sound reduction index R'_w can be calculated as the logarithmic sum of the direct component $R_{Dd,w}$ and the flanking transmission components $R_{ij,w}$.

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{n,j,w}}{10}} \right] (dB)$$

The sound reduction index for flanking transmission paths $R_{ij,w}$ can be estimated as:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{l_0 l_{ij}} (dB)$$


where:

$R_{i,w}$ e $R_{j,w}$ are sound reduction evaluation indices of flanking elements i and j respectively;

ΔR_i , ΔR_j are sound reduction index increases due to the installation of architectural finishes for element i in the source environment and/or element j in the receiving environment;

K_{ij} vibration reduction index through the joint

S is the area of the separating element and l_{ij} is the length of the joint between the separating wall and the flanking elements i and j, l_0 being a reference length of 1 m.

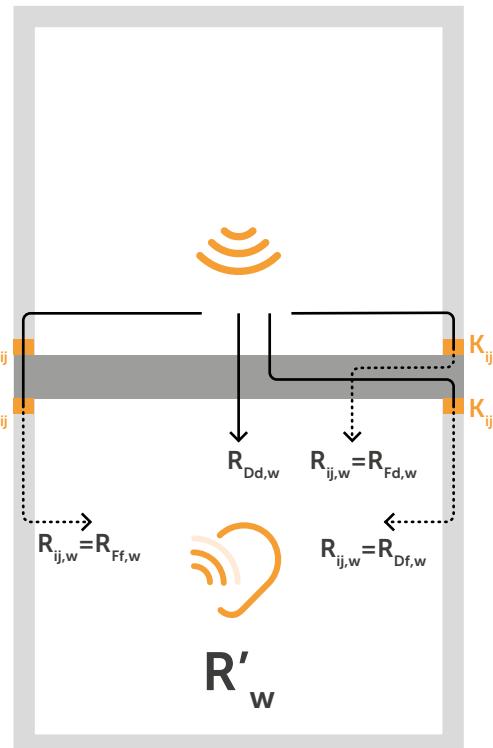

Among the input parameters required by the calculation model, the sound reduction indices can be obtained from accredited laboratory measurements or from the manufacturers of construction elements. Additionally, a number of open-access databases offer data for frequently used construction solutions. The ΔR_w can be estimated by modelling the wall assembly in terms of a mass-spring-mass system (EN ISO 12354 Annex D).

The most critical parameter to estimate is the **VIBRATION REDUCTION INDEX** K_{ij} . This quantity represents the vibration energy dissipating into the junction, and is associated with the structural coupling of the elements. High values of K_{ij} generate the best junction performance. Standard EN ISO 12354 provides some predictive estimates of two standard T and X-shaped joints for CLT structures, which are shown on the right, but the experimental data available is still limited. This is why Rotho-blaas has invested in several measurement campaigns to provide usable data with this calculation model.

The ASTM standards currently do not provide a predictive model for the evaluation of flanking sound transmission, so the ISO 12354 and ISO 10848 standards are used and "translated" into the ASTM metric.

ASTM & K_{ij}

$$STC_{ij} = \frac{STC_i}{2} + \frac{STC_j}{2} + K_{ij} + \max(\Delta STC_i, \Delta STC_j) + \frac{\min(\Delta STC_i, \Delta STC_j)}{2} + 10 \log \frac{S_s}{l_0 l_{ij}}$$

DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES

INCORPORATING OF RESILIENT LAYERS LIKE XYLOFON, PIANO, CORK AND ALADIN STRIPE

The MyProject software can be used during design, or follow one of the methods below, extrapolated from internationally valid standards.

METHOD 1 BASED ON EN ISO 12354:2017 FOR HOMOGENEOUS STRUCTURES

Typically, this formula has been considered for lightweight wood structures, i.e. considering the connections between elements, which are considered rigid and homogeneous. For CLT structures this is certainly an approximation.

K_{ij} depends on the shape of the junction and the type of elements composing it, especially their surface mass. In case of T- or X-joints, use the following expressions, shown aside.

For both cases:

$$K_{ij} = K_{ij\text{rigid}} + \Delta L$$

if the flanking transmission path passes through a junction

$$K_{ij} = K_{ij\text{rigid}} + 2\Delta L$$

if the flanking transmission path passes through two joints

$$M = 10 \log(m_{i\perp}/m_i)$$

where:

$m_{i\perp}$ is the mass of one of the elements, the one placed perpendicular to the other.

Therefore, the transmitted vibration reduction value is:

$$\Delta Lw = 10 \log(1/f_t)$$

for loads exceeding 750 kN/m² on a resilient layer with $\Delta L_{\min} = 5$ dB

$$f_t = ((G/t_i)(\rho_1 \rho_2))^{1/5}$$

where:

G is the Young tangential module (MN/m²)

t_i is the thickness of the resilient material (m)

ρ_1 and ρ_2 are, respectively, the density of connected elements 1 and 2

METHOD 2 F.3 EMPIRICAL DATA FOR JUNCTIONS CHARACTERIZED BY K_{ij} ISO 12354-1:2017

CLT construction elements are elements in which the structural reverberation time is, in most cases, mainly

determined by the connecting elements.


In the case of CLT structures weakly bound together, the side transmission contribution can be determined according to the following relations, valid if $0,5 < (m_1/m_2) < 2$.

METHOD 1 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 5,7 + 14,1 M + 5,7 M^2 \text{ dB}$$


$$K_{12} = 5,7 + 5,7 M^2 = K_{23} \text{ dB}$$



Solution 2 - T-SHAPED JOINT with resilient layer

$$K_{23} = 5,7 + 14,1 M + 5,7 M^2 \text{ dB}$$

$$K_{12} = 5,7 + 5,7 M^2 = K_{23} \text{ dB}$$




Solution 3 - X-SHAPED JOINT

$$K_{13} = 8,7 + 17,1 M + 5,7 M^2 \text{ dB}$$

$$K_{12} = 8,7 + 5,7 M^2 = K_{23} \text{ dB}$$

$$K_{24} = 3,7 + 14,1 M + 5,7 M^2 \text{ dB}$$

$$0 \leq K_{24} \leq -4 \text{ dB}$$




METHOD 2 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 22 + 3,3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{23} = 15 + 3,3 \log(f/f_k)$$




Solution 1 - X-SHAPED JOINT

$$K_{13} = 10 - 3,3 \log(f/f_k) + 10 M$$

$$K_{24} = 23 - 3,3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{14} = 18 - 3,3 \log(f/f_k)$$



THE SIMPLIFIED METHOD

A CALCULATION EXAMPLE USING EN ISO 12354

INPUT DATA


The EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method.

Regarding airborne sound insulation, the simplified calculation model predicts the apparent sound energy as a single value based on the acoustic performance of the elements involved in the junction. Below is an example of a calculation evaluating the apparent sound reduction index between two adjacent rooms.


In order to determine the acoustic performance of assembly from the acoustic performance of its components, it is important to determine for every junction element:

- the geometry of the assembly (S)
- the acoustic properties of the assembly (R_w)
- the connection between structural elements (K_{ij})
- the characteristics of each layer composing the assembly

PLAN

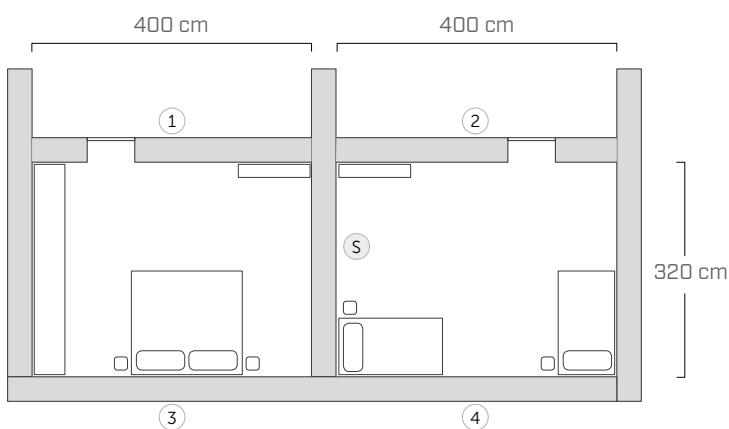

SECTION

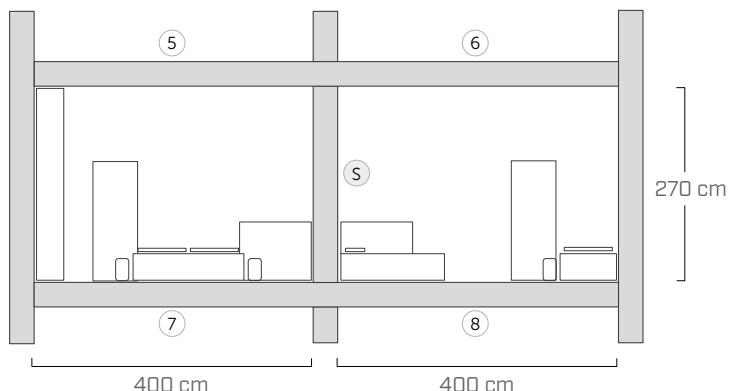

PARTITION CHARACTERISTICS

SEPARATING WALL (S)

25 mm	plasterboard
50 mm	mineral wool
75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

INTERNAL WALLS (1)

12,5 mm	gypsum fibreboard
78 mm	CLT
12,5 mm	gypsum fibreboard

INTERNAL WALLS (2)

75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

EXTERNAL WALLS (3) (4)

6 mm	plaster
60 mm	wood fibre panel
160 mm	mineral wool
90 mm	CLT
70 mm	fir panels
50 mm	mineral wool
15 mm	plasterboard
25 mm	plasterboard

FLOORS (5) (6) (7) (8)

70 mm	concrete screed
0.2 mm	PE membrane
30 mm	under floor membrane
50 mm	backfill (loose)
140 mm	CLT
60 mm	mineral wool
15 mm	plasterboard

Data for acoustic characterisation of the assemblies was taken from DataHolz.

www.dataholz.com

CALCULATION OF DIRECT AND FLANKING TRANSMISSION COMPONENTS

The apparent sound reduction index is obtained from the contribution of the direct component and the flanking transmission paths, based on the following equation:

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{nj,w}}{10}} \right] (dB)$$

Considering only the first order transmission, there are three flanking transmission paths for each combination of assemblies i-j, for a total of 12 R_{ij} calculated using the equation:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{I_0 I_{ij}} (dB)$$

DETERMINING THE APPARENT SOUND REDUCTION INDEX

The simplified calculation model has the unquestioned advantage of providing an easy-to-use tool to predict sound insulation.

On the other hand, its application is quite delicate for CLT structures because the damping of each structural element is strongly affected by the assembly. It really deserves a dedicated modelling approach. Moreover, CLT panels provide poor insulation at low frequencies, thus the use of frequency weighted indices might return results which do not provide an accurate representation of actual behaviour in the low frequency region. Therefore the use of the detailed method is advised for accurate predictive analysis.

In the example provided, sound insulation for direct transmission gives R_w of 53 dB, if the contributions of flanking transmission are considered, R'_w decreases to 51 dB.

$$R'_w = \mathbf{51 \, dB} \quad R_w = \mathbf{53 \, dB}$$

ACOUSTIC CHARACTERISTICS OF THE ASSEMBLIES

Path of transmission	S [m ²]	R _w [dB]	m' [kg/m ²]
S	8,64	53	69
1	10,8	38	68
2	10,8	49	57
3	10,8	55	94
4	10,8	55	94
5	12,8	63	268
6	12,8	63	268
7	12,8	63	268
8	12,8	63	268

CALCULATING R_{ij}

Path of transmission	R _{ij} [dB]	Path of transmission	R _{ij} [dB]
1-S	60	S-6	83
3-S	68	S-8	75
5-S	83	1-2	64
7-S	75	3-4	77
S-2	66	5-6	75
S-4	68	7-8	75

CHARACTERISATION OF THE JOINTS

JOINT 1-2-S

X-shaped joint detail 12

JOINT 3-4-S

T-shaped joint, detail 5

JOINT 5-6-S

X-shaped joint with resilient profile detail 43

JOINT 7-8-S

X-shaped joint with resilient profile detail 43

Download all the documentation about the project from www.rothoblaas.com

Download all the documentation about the FLANSOUND project!
[https://www.rothoblaas.com/technical-insights](http://www.rothoblaas.com/technical-insights)



FLANKSOUND PROJECT

EXPERIMENTAL MEASUREMENTS OF K_{ij} FOR CLT JOINTS

Rothoblaas has therefore promoted research aimed at measuring the K_{ij} vibration reduction index for a variety of CLT panel joints, with the dual objective of providing specific experimental data for the acoustic design of CLT buildings and contributing to the development of calculation methods.

L, T and X-shaped joints were tested during the measurement project.

CLT panels were provided by seven different manufacturers and therefore underwent different production processes, showing different characteristics such as the number and thickness of lamellas, side gluing of layers, and anti-shrinkage kerf cuts in the core. Different kinds of screws and connectors were tested, as well as different resilient layers at the wall-floor junction.

The test set-up was arranged in the warehouse at Rothoblaas headquarters in Cortaccia (prov. Bolzano).

The vibration reduction index measurements were carried out in compliance with EN ISO 10848.



K_{ij} for 15 different types of joint


- 7 different CLT manufacturers
- L, T, X-shaped vertical and horizontal joints
- influence of type and number of screws
- influence of type and number of angle brackets
- influence of type and number of hold-downs
- use of resilient layers

FASTENING


HBS
countersunk screw




VGZ
fully threaded screw
with cylindrical head




TITAN N
angle bracket for shear loads in
solid walls



TITAN F
angle bracket for shear loads
on frame walls



WHT
angle bracket for tensile
loads




SOUNDPROOFING

XYLOFON
high performance
resilient profile



ALADIN STRIPE
resilient profile




CONSTRUCTION SEALING
airtight profile




X-RAD

X-ONE
universal connector for CLT
panels



X-PLATE
complete range of connection
plates



MEASUREMENT CONFIGURATION

MEASUREMENT SETUP: EQUIPMENT AND DATA PROCESSING

The vibration reduction index K_{ij} is calculated as:

$$K_{ij} = \frac{D_{v,ij} + D_{v,ji}}{2} + 10 \log \frac{l_{ij}}{\sqrt{a_i a_j}} \text{ (dB)}$$

where:


- $D_{v,ij}$ ($D_{v,ji}$) is the difference in vibration velocity between the elements i and j (j and i) when element i (j) is excited (dB)
 l_{ij} is the length of the junction shared between the elements i and j
 a are the equivalent absorption lengths elements of i and j

$$a = \frac{2.2\pi^2 S}{c_0 T_s} \sqrt{\frac{f_{ref}}{f}} \text{ (m)}$$

- S is the panel surface
 f is the frequency
 T_s is the structural reverberation time

The sound source consisted of an electrodynamic shaker with sinusoidal peak force of 200 N, which was mounted on a heavyweight base and screwed to the CLT panels using a plate.

The velocity levels were measured using a pink noise source signal, filtered at 30 Hz in order to get reliable results from 50 Hz onwards. Structural reverberation times were calculated from impulse responses acquired using ESS test signals. The accelerometers were fixed to the panels using magnets. Eyelets were screwed to the panels with screws whose length was at least half of the thickness of the panels, in order to reach the innermost layer of the panel. The vibration reduction indices are reported in the one-third octave bands ranging from 100 to 3150 Hz, together with the value averaged over the one-third octave bands from 200 to 1250 Hz.

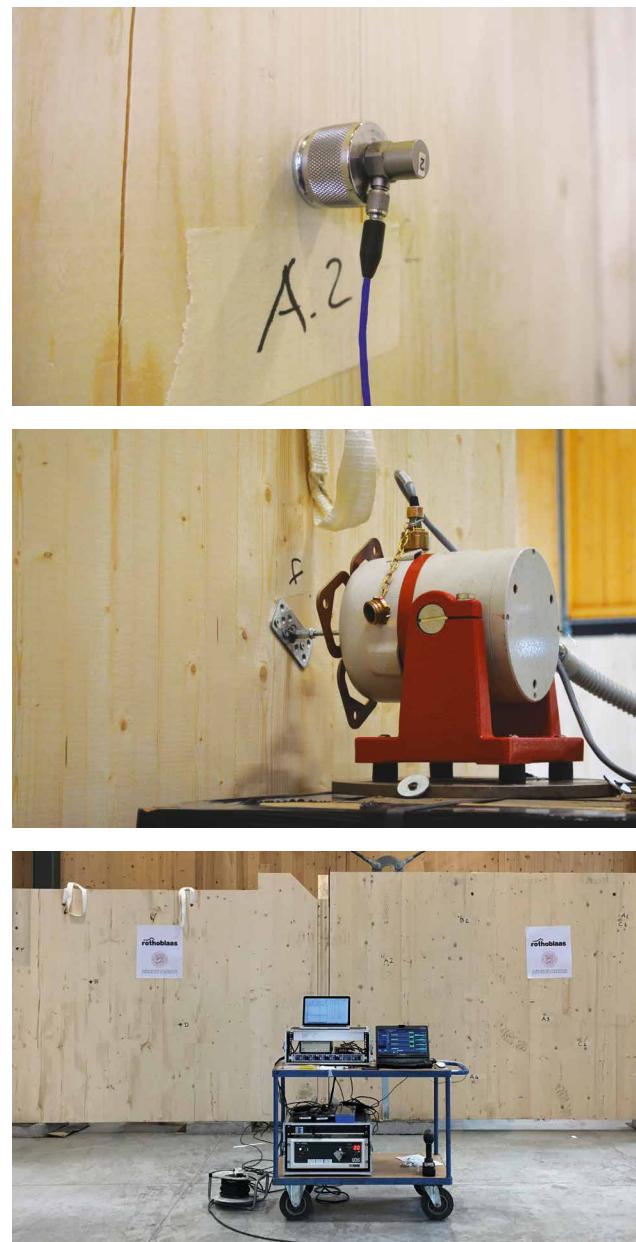

A. Speranza, L. Barbaresi, F. Morandi, "Experimental analysis of flanking transmission of different connection systems for CLT panels" in Proceedings of the World Conference on Timber Engineering 2016, Vienna, August 2016.

L. Barbaresi, F. Morandi, M. Garai, A. Speranza, "Experimental measurements of flanking transmission in CLT structures" in Proceedings of the International Congress on Acoustics 2016, Buenos Aires, September 2016.

L. Barbaresi, F. Morandi, M. Garai, A. Speranza, "Experimental analysis of flanking transmission in CLT structures" of Meetings on Acoustics (POMA), a serial publication of the Acoustical Society of America - POMA-D-17-00015


L. Barbaresi, F. Morandi, J. Belcari, A. Zucchelli, Alice Speranza, "Optimising the mechanical characterisation of a resilient interlayer for the use in timber construction" in Proceedings of the International congress on sound and vibration 2017, London, July 2017

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm - 6 1/4 in) (2,3 m x 4,0 m - 7.55 ft x 13.12 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (4,0 m x 2,3 m - 13.12 ft x 7.55 ft)

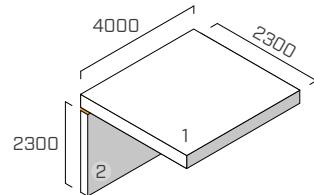

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)

RESILIENT PROFILE


XYLOFON 35

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [kN]: structure self weight

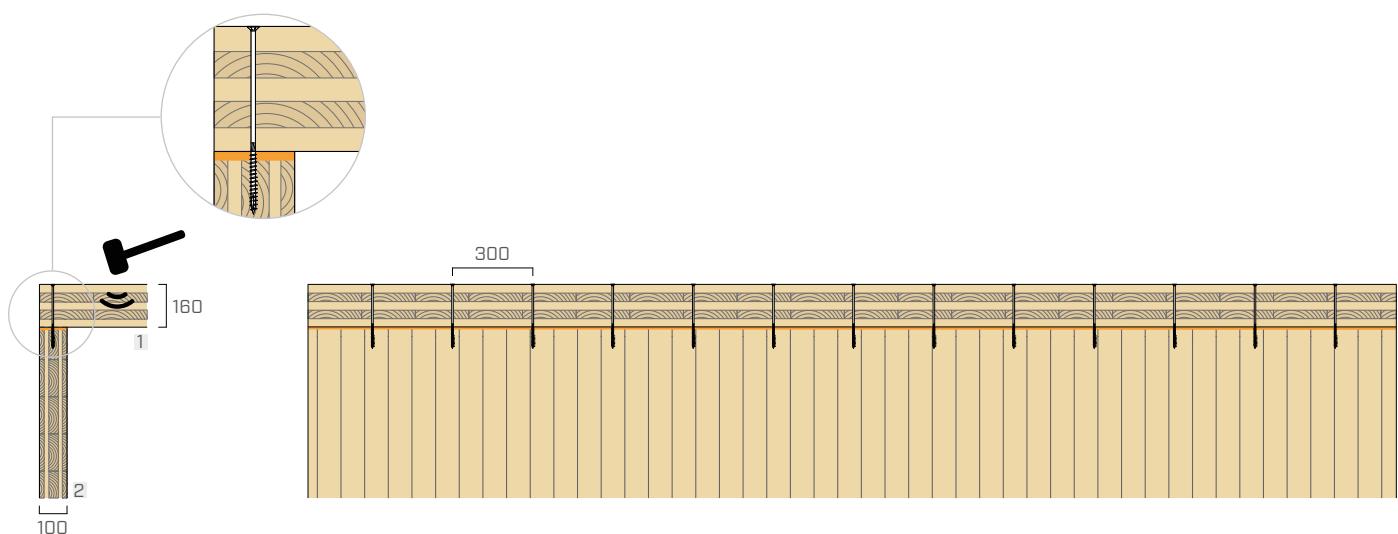

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	12,6	10,8	13,6	11,1	9,2	13,3	11,3	16,5	10,2	14,6	14,9	17,4	19,6	25,0	28,5	25,1


$$\overline{K_{12}} = 13,2 \text{ dB}$$

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm - 6 1/4 in) (2,3 m x 4,0 m - 7.55 ft x 13.12 ft)
 lower wall: CLT 5 layers (s: 100 mm - 4 in) (4,0 m x 2,3 m - 13.12 ft x 7.55 ft)

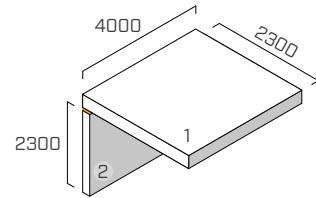

FASTENING SYSTEM

6 HBS partially threaded screws Ø9 x 400 mm (HBS8240), spacing 600 mm (23 5/8 in)

RESILIENT PROFILE


XYLOFON 35

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [kN]: structure self weight

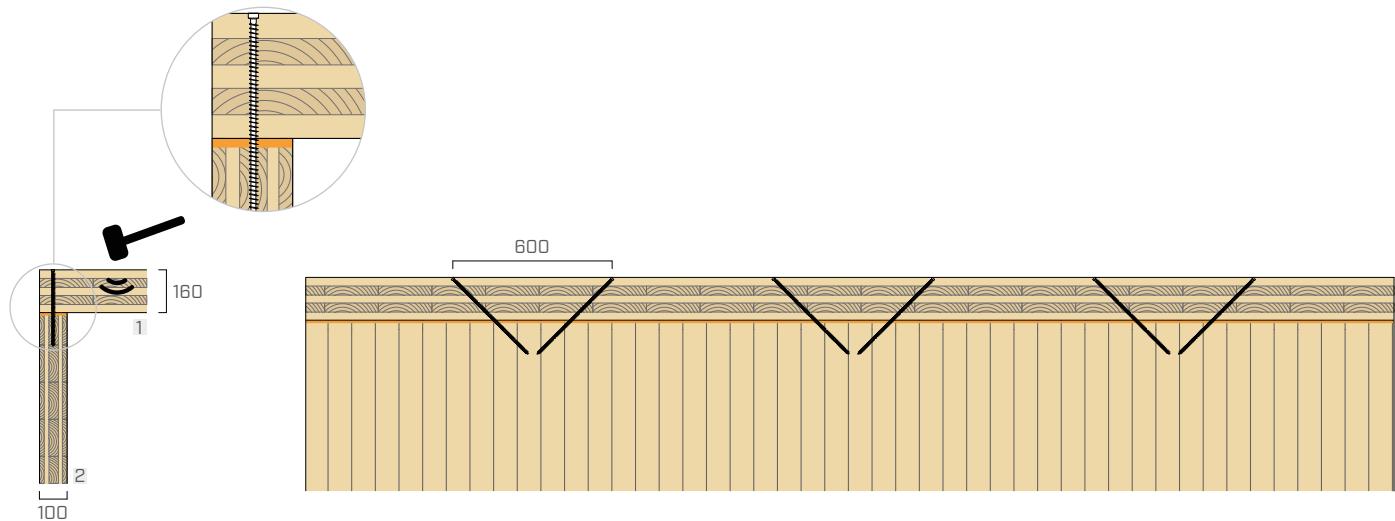

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	15,3	11,2	10,6	9,5	11,7	11,5	13,8	15,1	12,0	14,5	13,0	18,6	21,6	22,0	20,8	23,7


$$\overline{K_{12}} = 13,3 \text{ dB}$$

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm - 6 1/4 in) (2,3 m x 4,0 m - 7.55 ft x 13.12 ft)
lower wall: CLT 5 layers (s: 100 mm - 4 in) (4,0 m x 2,3 m - 13.12 ft x 7.55 ft)

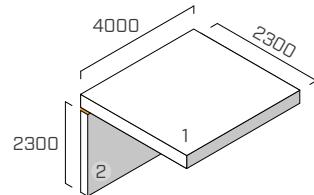

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
5 angle brackets TITAN (TTN240) spacing 800 mm (31 1/2 in)
fastening pattern: total nailing 72 screws Ø5 x 50 mm
2 hold down WHT (WHT440)

RESILIENT PROFILE


XYLOFON 35

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [kN]: structure self weight

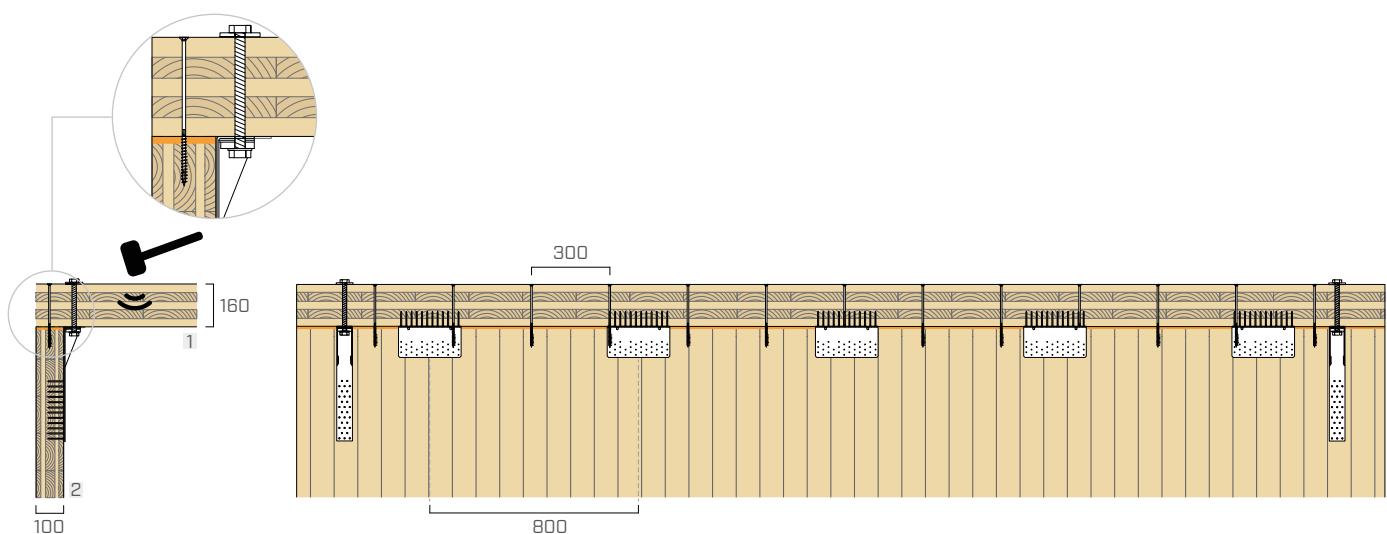

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	10,9	8,9	7,1	10,6	7,4	9,6	10,2	12,5	11,8	14,1	14,8	15,3	17,1	17,4	21,5	21,2

$$\overline{K_{12}} = 11,8 \text{ dB}$$


*data estimated based on experimental measurements

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm - 6 1/4 in) (2,3 m x 4,0 m - 7.55 ft x 13.12 ft)
lower wall: CLT 5 layers (s: 100 mm - 4 in) (4,0 m x 2,3 m - 13.12 ft x 7.55 ft)

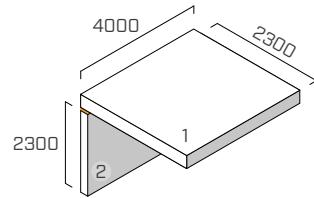

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
5 angle brackets TITAN (TTN240) with resilient profile XYLOFON PLATE (XYL35120240) spacing 800 mm (31 1/2 in)
fastening pattern: total nailing 72 screws Ø5 x 50 mm
2 hold down WHT (WHT440)

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [kN]: structure self weight

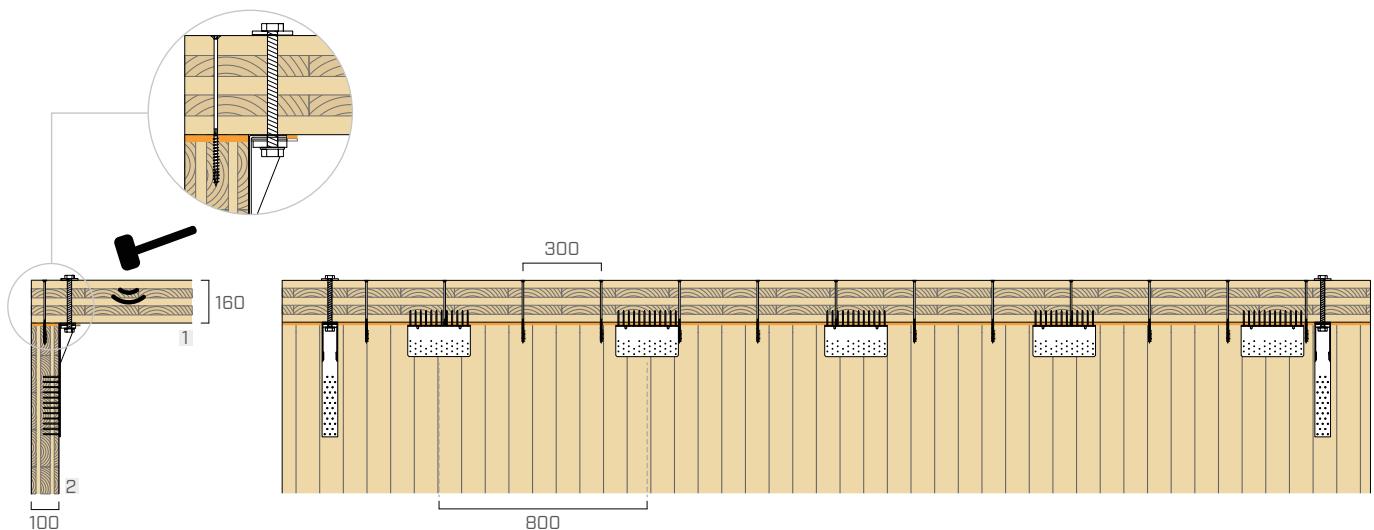

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	
K ₁₂ [dB]	11,6	9,4	11,6	12,0	7,2	11,0	10,3	13,7	11,9	11,9	15,1	15,6	16,7	17,9	22,2	25,6	22,1

$$\overline{K_{12}} = 12,6 \text{ dB}$$


*data estimated based on experimental measurements

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm - 6 1/4 in) (2,3 m x 4,0 m - 7.55 ft x 13.12 ft)
lower wall: CLT 5 layers (s: 100 mm - 4 in) (4,0 m x 2,3 m - 13.12 ft x 7.55 ft)

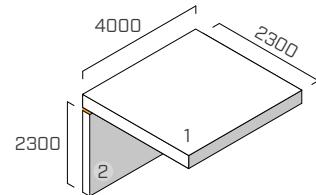

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø9 x 400 mm (HBS8240), spacing 600 mm (23 5/8 in)
5 angle brackets **TITAN** (TTN240) spacing 800 mm (31 1/2 in)
fastening pattern: total nailing 72 screws Ø5 x 50 mm
2 hold down **WHT** (WHT440)

RESILIENT PROFILE


XYLOFON 35

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [kN]: structure self weight

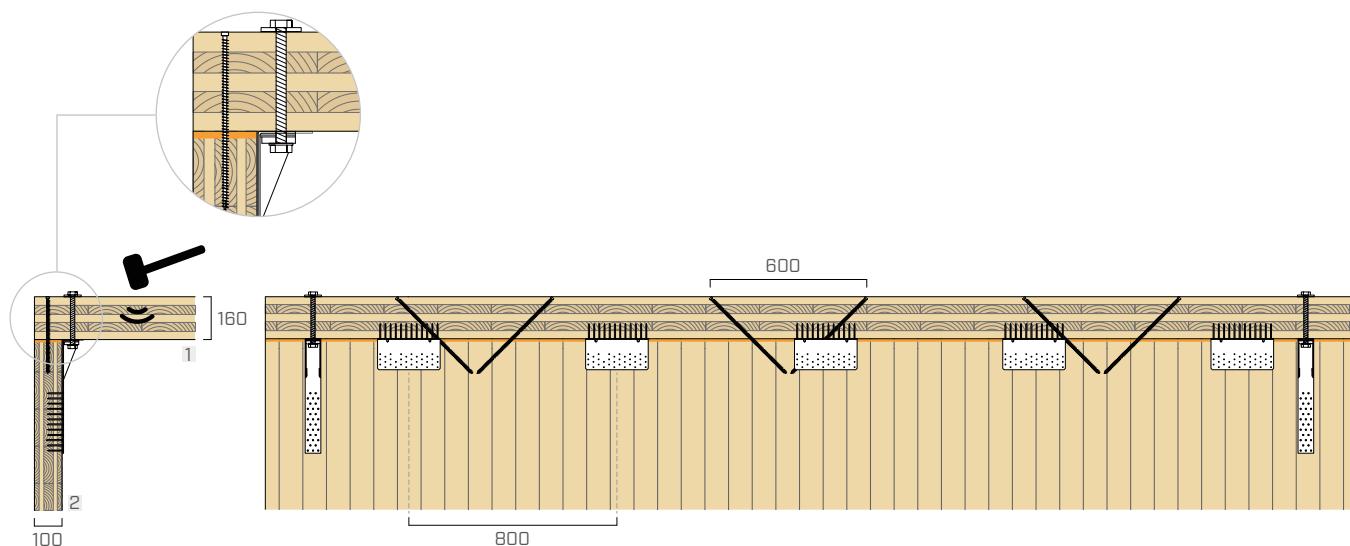

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	10,6	15,0	8,8	9,6	9,2	8,4	7,7	10,0	11,3	14,3	14,2	16,3	20,0	18,6	20,8	18,7

$$\overline{K_{12}} = 11,2 \text{ dB}$$


*data estimated based on experimental measurements

T-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE STRUCTURE

upper wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft)
floor: CLT 5 layers (s: 160 mm- 6 1/4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft),
lower wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 4,0 m- 7.55 ft x 13.12 ft)

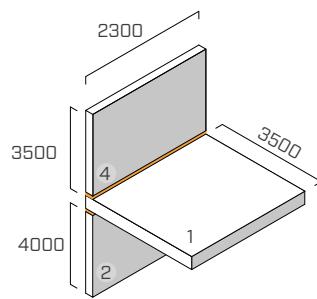

FASTENING SYSTEM

7 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
3 angle brackets TITAN (TTN240), spacing 800 mm (31 1/2 in)
fastening pattern: total nailing 72 screws Ø5 x 50 mm
4 hold down WHT (WHT440)

RESILIENT PROFILE


XYLOFON 35

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

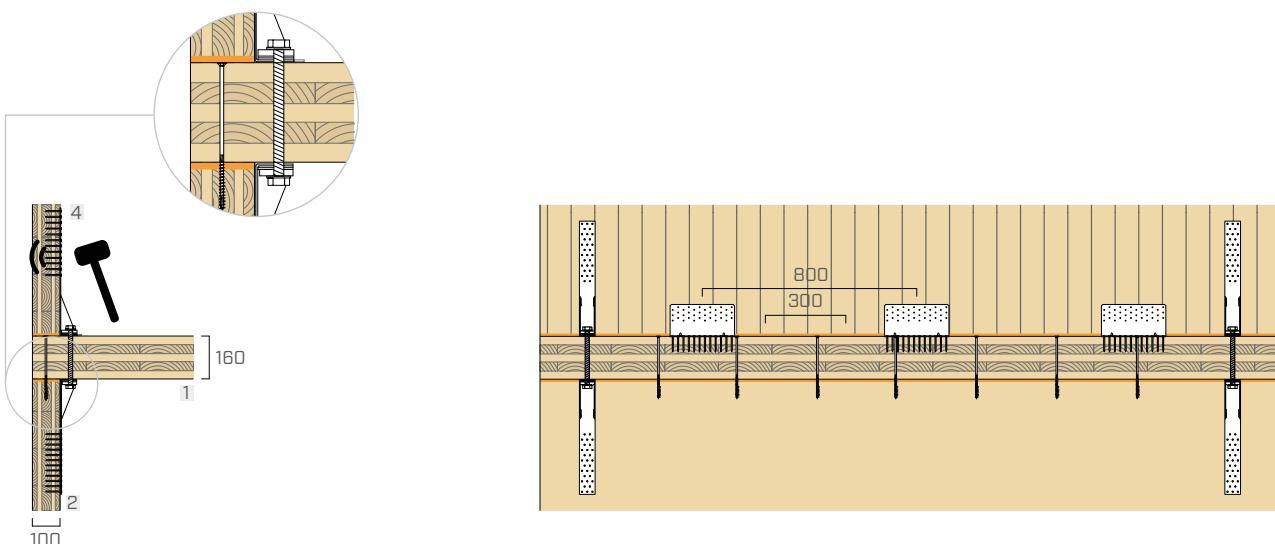

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	17,4	14,8	9,0	15,5	11,9	13,2	9,9	16,2	20,6	22,5	22,9	21,7	24,9	35,1	37,3	41,2

$$\overline{K_{12}} = 17,2 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	24,4	21,8	16,0	22,5	18,9	20,2	16,9	23,2	27,6	29,5	29,9	28,7	31,9	42,1	44,3	48,2

$$\overline{K_{24}} = 24,2 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	12,5	0,5	0,7	7,2	4,6	7,5	0,7	9,7	9,1	12,3	12,8	18,8	19,5	21,3	25,1	26,3

$$\overline{K_{14}} = 9,2 \text{ dB}$$


*data estimated based on experimental measurements

T-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft)
 floor: CLT 5 layers (s: 160 mm- 6 1/4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft),
 lower wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 4,0 m- 7.55 ft x 13.12 ft)

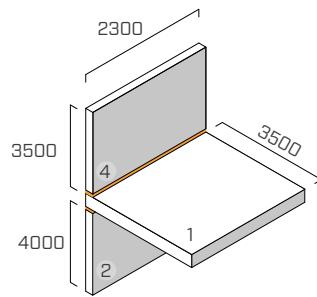

FASTENING SYSTEM

7 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
 3 angle brackets **TITAN** (TTN240) with resilient profile **XYLOFON PLATE** (XYL35120240) spacing 800 mm (31 1/2 in)
 fastening pattern: total nailing 72 screws Ø5 x 50 mm
 4 hold down **WHT** (WHT440)

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

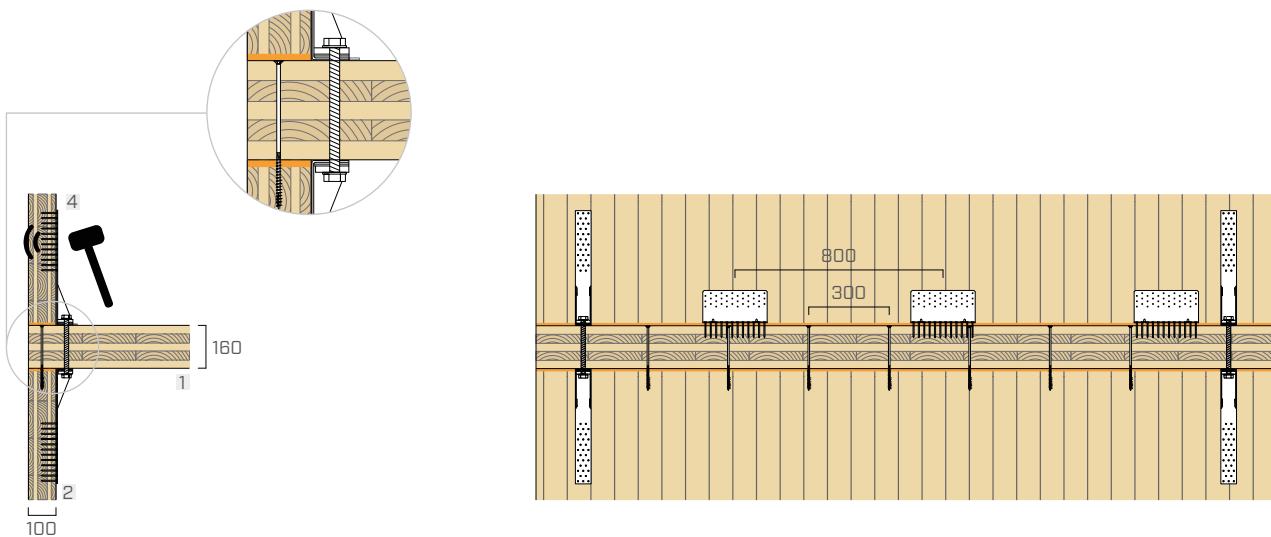

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	23,6	27,1	16,5	18,7	18,0	14,2	10,6	14,6	16,7	22,0	24,0	26,6	29,4	31,4	34,0	32,5

$$\overline{K_{24}} = 18,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	16,6	20,1	9,5	11,7	11,0	7,2	3,6	7,6	9,7	15,0	17,0	19,6	22,4	24,4	27,0	25,5

$$\overline{K_{12}} = 11,4 \text{ dB}$$


*data estimated based on experimental measurements

T-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft)
 floor: CLT 5 layers (s: 160 mm- 6 1/4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft),
 lower wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 4,0 m- 7.55 ft x 13.12 ft)

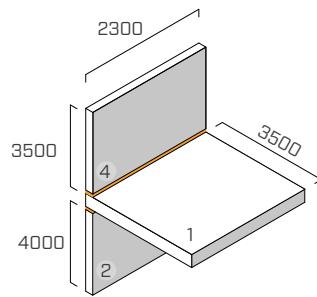

FASTENING SYSTEM

7 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
 3 angle brackets **TITAN** (TTN240) with resilient profile **XYLOFON PLATE** (XYL35120240) spacing 800 mm (31 1/2 in)
 fastening pattern: total nailing 72 screws Ø5 x 50 mm
 2 **LBV** perforated plates (LBV100500)

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

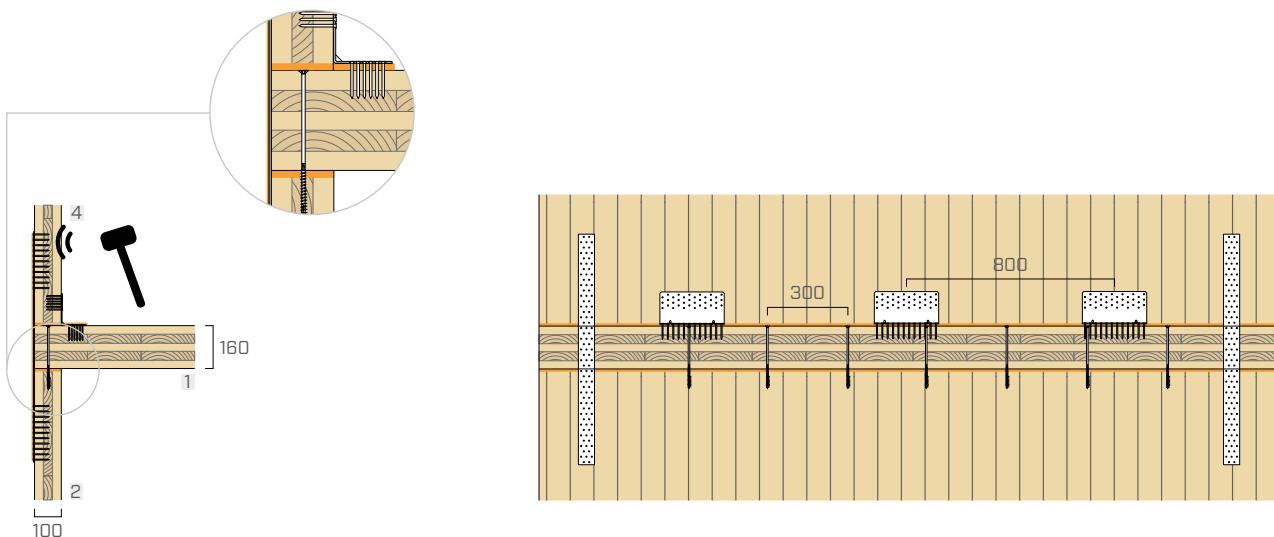

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	17,4	13,1	7,0	11,1	10,8	11,5	10,5	15,6	20,4	22,4	21,9	24,7	24,5	38,4	38,6	41,0

$$\overline{K_{12}} = 16,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	23,9	24,5	18,3	20,6	16,3	18,2	19,4	19,6	25,7	27,2	25,6	21,9	24,5	41,7	44,9	49,0

$$\overline{K_{24}} = 21,6 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	7,1	- 3,1	- 2,5	6,2	6,0	6,4	0,7	9,7	9,5	12,5	12,7	19,3	16,8	21,8	25,2	27,2

$$\overline{K_{14}} = 9,2 \text{ dB}$$


Data estimated based on experimental measurements.

X-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft)
 floor: CLT 5 layers (s: 160 mm- 6 1/4 in) (2,3 m x 7,5 m- 7.55 ft x 25 ft)
 lower wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 4,0 m- 7.55 ft x 13.12 ft)

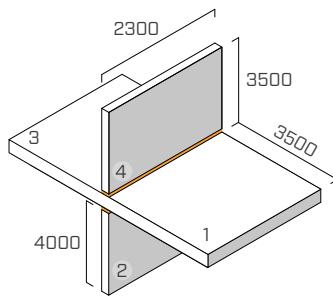

FASTENING SYSTEM

7 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm (11 3/4 in)
 3 angle brackets **TITAN** (TTN240) with resilient profile **XYLOFON PLATE** (XYL35120240) spacing 800 mm (31 1/2 in)
 fastening pattern: total nailing 72 screws Ø5 x 50 mm
 4 hold down **WHT** (WHT440)

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

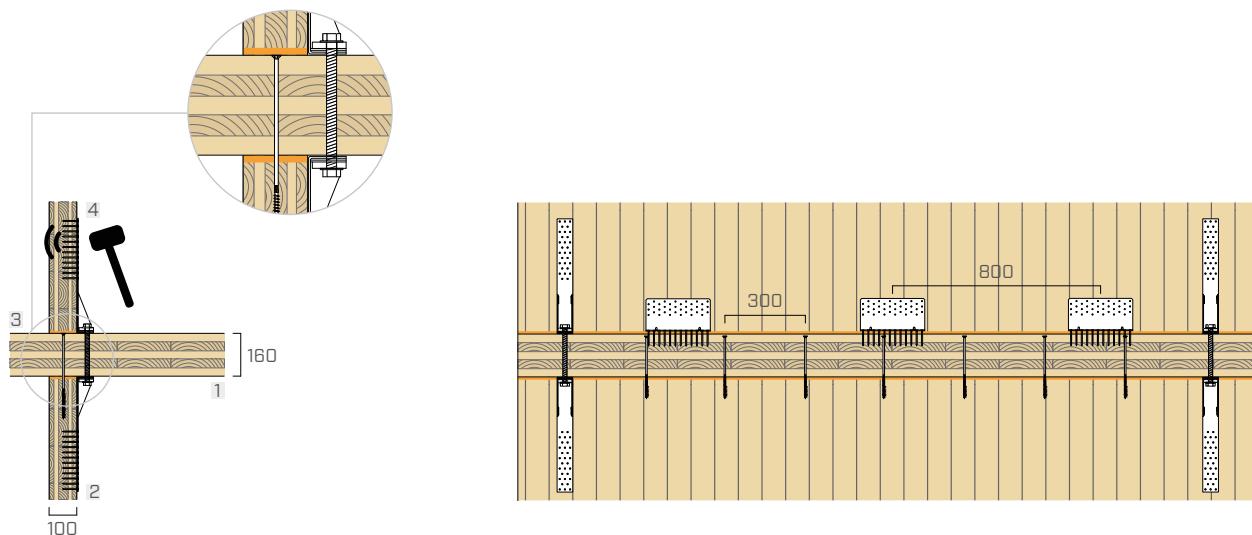

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	20,4	17,8	12,0	18,5	14,9	16,2	12,9	19,2	23,6	25,5	25,9	24,7	27,9	38,1	40,3	44,2

$$\overline{K_{12}} = 20,2 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	15,5	3,5	3,7	10,2	7,6	10,5	3,7	12,7	12,1	15,3	15,8	21,8	22,5	24,3	28,1	29,3

$$\overline{K_{14}} = 12,2 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	25,4	22,8	17,0	23,5	19,9	21,2	17,9	24,2	28,6	30,5	30,9	29,7	32,9	43,1	45,3	49,2

$$\overline{K_{24}} = 25,2 \text{ dB}$$


*data estimated based on experimental measurements

X-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 3,5 m- 7.55 ft x 11 ft)
 floor: CLT 5 layers (s: 160 mm- 6 1/4 in) (2,3 m x 7,5 m- 7.55 ft x 25 ft)
 lower wall: CLT 5 layers (s: 100 mm- 4 in) (2,3 m x 4,0 m- 7.55 ft x 13.12 ft)

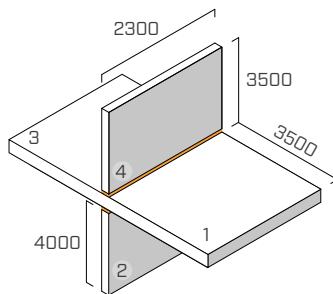

FASTENING SYSTEM

6 angle brackets **TITAN** (TTN240) with resilient profile **XYLOFON PLATE** (XYL35120240) spacing 800 mm (31 1/2 in)
 fastening pattern: 72 screws Ø5 x 50 mm
 4 hold down **WHT** (WHT440)

RESILIENT PROFILE


XYLOFON 35 + XYLOFON PLATE

position: between the lower wall and the floor.

dimensions: width = 100 mm (4 in) thickness = 6 mm (1/4 in) length = 4,0 m (13.12 ft)

contact area: continuous strip (same width as the wall)

applied load [N/m²]: structure self weight

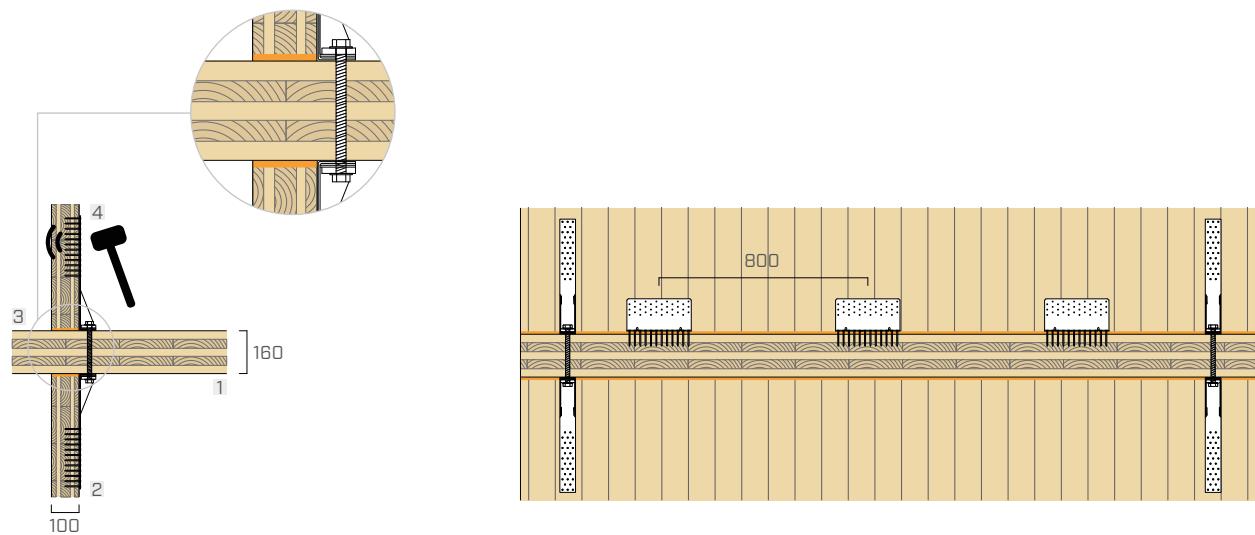

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	24,6	28,1	17,5	19,7	19,0	15,2	11,6	15,6	17,7	23,0	25,0	27,6	30,4	32,4	35,0	33,5

$$\overline{K_{24}} = 19,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	19,6	23,1	12,5	14,7	14,0	10,2	6,6	10,6	12,7	18,0	20,0	22,6	25,4	27,4	30,0	28,5

$$\overline{K_{12}} = 14,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₃ [dB]	10,3	10,0	9,6	9,3	9,0	8,6	8,3	8,0	7,6	7,3	7,0	6,7	6,3	6,0	5,7	5,3

$$\overline{K_{13}} = 8,0 \text{ dB}$$

*data estimated based on experimental measurements.

SOUND REDUCTION INDEX AND IMPACT SOUND LEVEL

A predictive study of the sound insulation of airborne and impact noise in buildings cannot be determined by calculations alone, but must be supported by experimental data and measurements in the laboratory and on site.


In mass timber construction, as in light-framed construction, the contribution of flanking sound transmission can be significant and it is important to be able to estimate this correctly because regulations require compliance with passive acoustic requirements measured on site.

For this reason, the analysis of the assembly of the separating element cannot be limited, but also the behavior of the resilient profiles must be considered.


In the laboratory in Innsbruck, the upper floor and the ceiling can be raised by up to 30 cm by means of hydraulic jacks, in order to carry out tests, with and without XYLOFON, and thus test its effectiveness.

The laboratory also provides the possibility of loading the structure with threaded tie rods to simulate different loads (e.g. several floors).

For the tests, a load of 17 kN/m (approximately one floor) was applied to the ceiling element and thus also XYLOFON 35

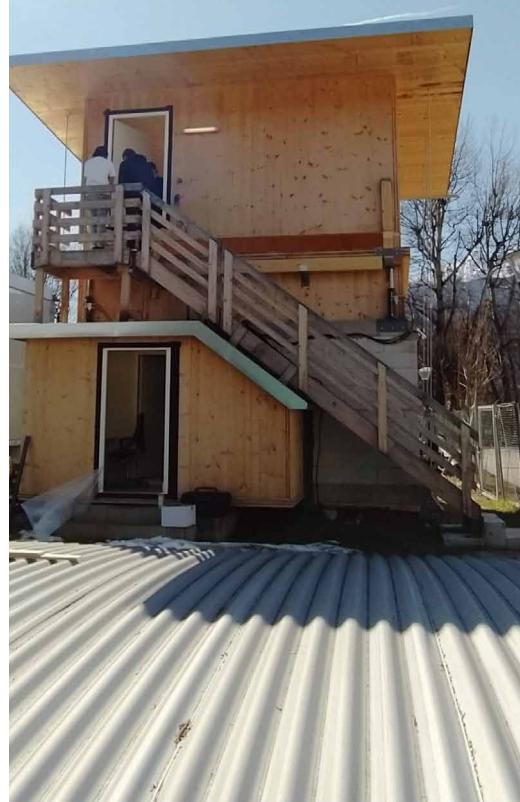

SET UP

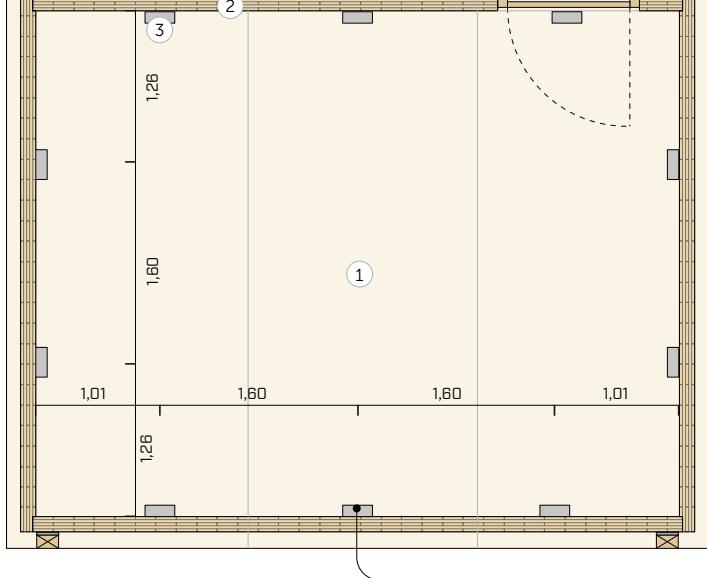


The receiving and transmitting rooms have a floor area of 21,5 m² (5,24 m length; 4,10 m width).

The volume of the transmitting room is 53,0 m³, and the volume of the receiving room 85,0 m³.

The floor (1) is made of 160 mm 5-layer CLT, while the walls (2) are made of 100 mm 5-layer CLT panels.

The floor was fixed with **HBS** 6 x 240 mm screws at a distance of 300 mm and 10 **TITAN** (3) TTN240 angle brackets with **LBS** 5 x 70 screws (72 screws each angle bracket).

NOTE: a blower door test was performed prior to measurement to prevent air leaks from affecting the measurement results.

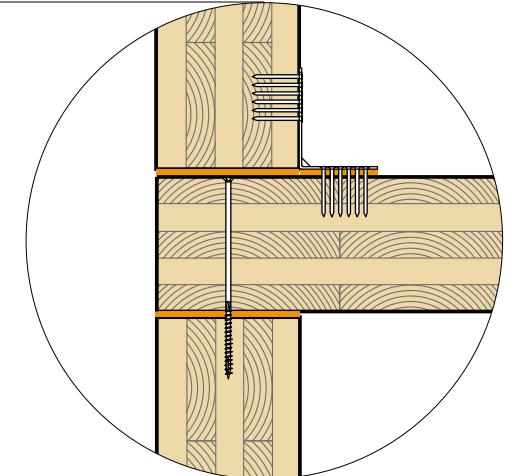

THE RESULTS

For the evaluation of flanking sound transmission, both the dodecahedron and the impact sound machine were used as sources, while accelerometers were applied to the wall in the receiving room.


The results obtained were implemented in the formula shown below to determine $R_{ij,situ}$

$$R_S(0) = R_{ij,situ}$$

$$R_S(0) = LS(f) - Lb(f) - K56 + 20\log(f \text{ in Hz}) - 10\log\sigma(1)$$


where:

LS (f)	sound pressure level in the transmitting room, function of frequency [dB].
Lb (f)	flanking sound pressure level, function of frequency [dB].
K56	accelerometer calibration coefficient
f	frequency [Hz]
10log σ	radiation coefficient, function of frequency

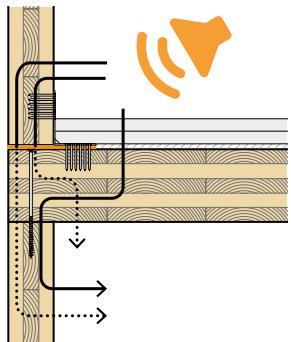


$$\Delta R_{Df+Ff,situ} = 5 \text{ dB}$$

$$\Delta STC_{Df+Ff,situ} = 4 \text{ dB}$$

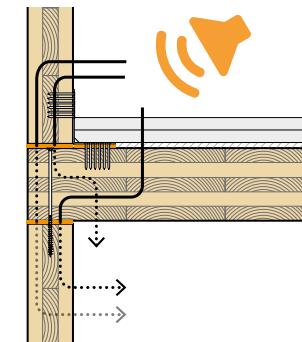


$$\Delta R_{Df+Ff,situ} = 10 \text{ dB}$$

$$\Delta STC_{Df+Ff,situ} = 10 \text{ dB}$$

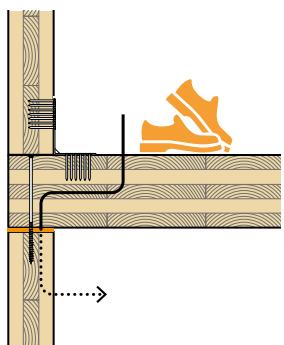

$$\Delta L_{n,Df+Ff,situ} = 7 \text{ dB}$$

$$\Delta IIC_{Df+Ff,situ} = 7 \text{ dB}$$

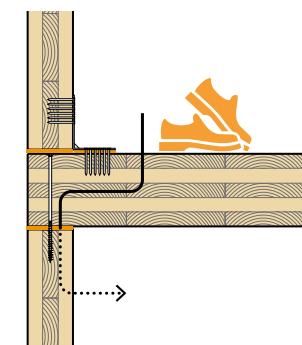

$$\Delta L_{n,Df+Ff,situ} = 8 \text{ dB}$$

$$\Delta IIC_{Df+Ff,situ} = 8 \text{ dB}$$


reduction of flanking
airborne sound transmission

A. Kräler, P. Brugnara, "Acoustic behaviour of CLT structures: influence of decoupling bearing stripes, floor assembly and connectors under storey-like loads", Internoise Glasgow 21-24 August 2022



ON-SITE MEASUREMENT | CLT FLOOR


AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

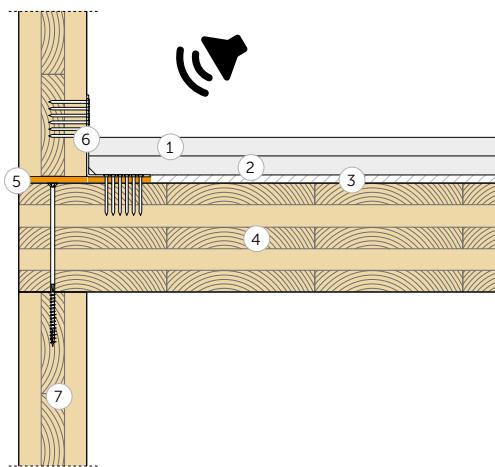

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- ① reinforced gypsum-fibre board (44 kg/m²) (s: 32 mm- 1 1/4 in)
- ② high density cardboard and sand panels (34,6 kg/m²) (s: 30 mm- 1 3/16 in)
- ③ SILENT FLOOR PUR (s: 10 mm- 3/8 in)
- ④ CLT (s: 160 mm- 6 1/4 in)
- ⑤ **XYLOFON**
- ⑥ TITAN SILENT
- ⑦ CLT (s: 160 m- 6 1/4 in)

AIRBORNE SOUND INSULATION

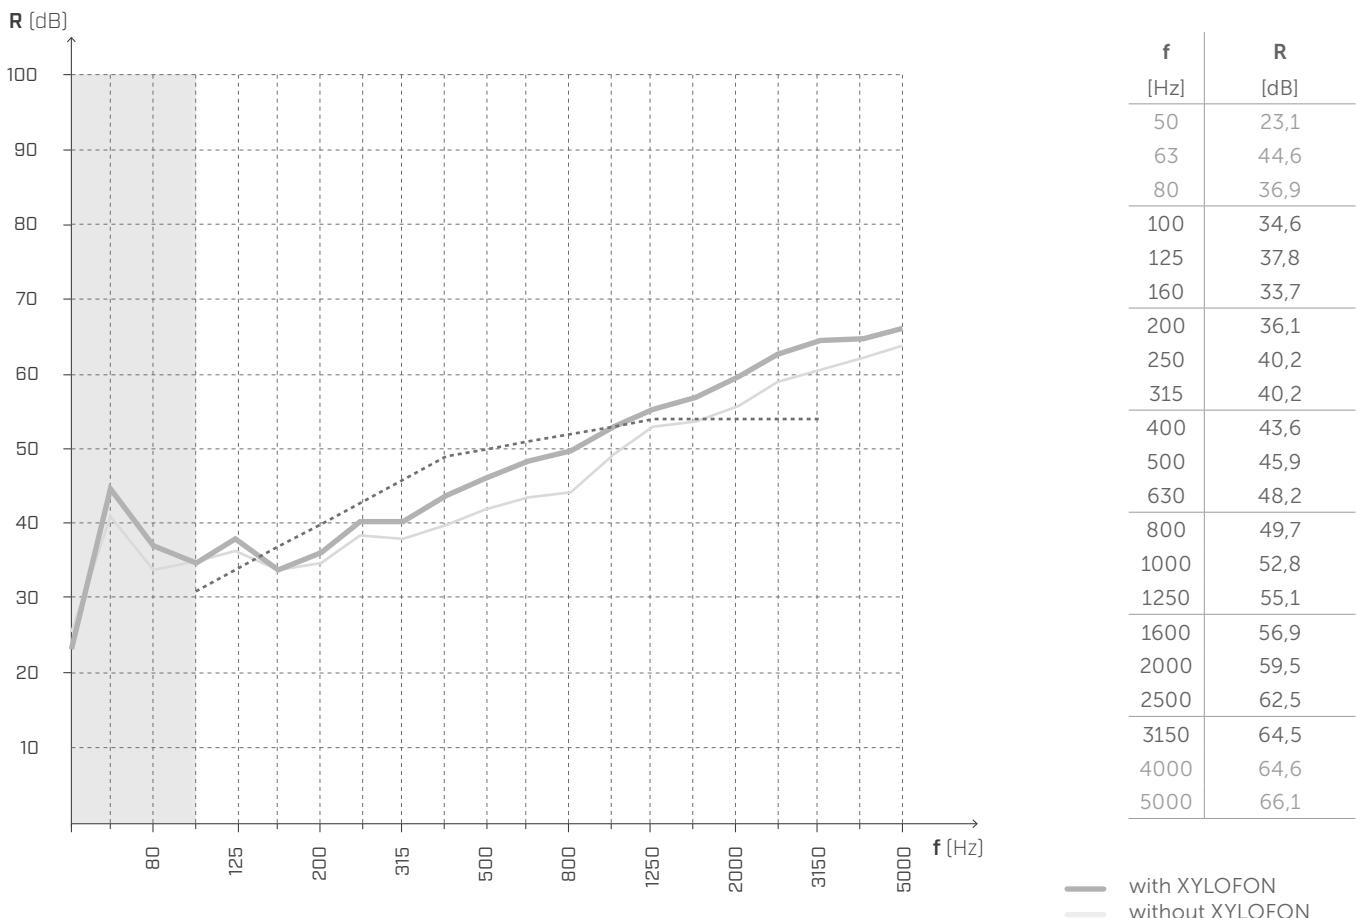

$$R'_w(C;C_{tr}) = \mathbf{50 \ (0;-6) dB}$$

$$R'_{w,0}(C;C_{tr}) = \mathbf{47 \ (0;-6) dB}$$


$$STC = \mathbf{50}$$

$$STC_0 = \mathbf{48}$$

Testing laboratory: Universität Innsbruck | Arbeitsbereich für Holzbau | Technikerstraße 13A - 602 Innsbruck.
Test protocol: M03B_L211217_m-Bodenaufbau.

ON-SITE MEASUREMENT | CLT FLOOR


AIRBORNE FLANKING TRANSMISSION ACCORDING TO ISO 16283-1

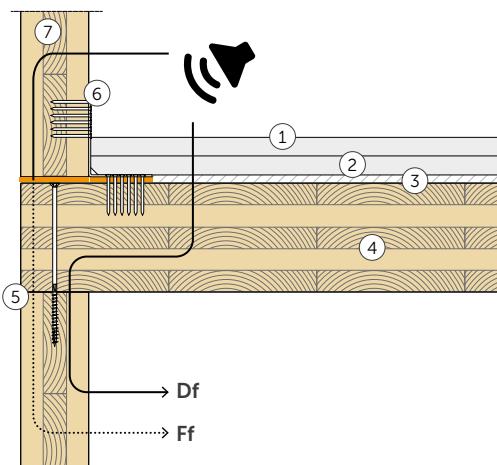

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- ① reinforced gypsum-fibre board (44 kg/m²) (s: 32 mm- 1 1/4 in)
- ② high density cardboard and sand panels (34,6 kg/m²) (s: 30 mm- 1 3/16 in)
- ③ SILENT FLOOR PUR (s: 10 mm- 3/8 in)
- ④ CLT (s: 160 mm- 6 1/4 in)
- ⑤ XYLOFON
- ⑥ TITAN SILENT
- ⑦ CLT (s: 160 m- 6 1/4 in)

AIRBORNE FLANKING TRANSMISSION

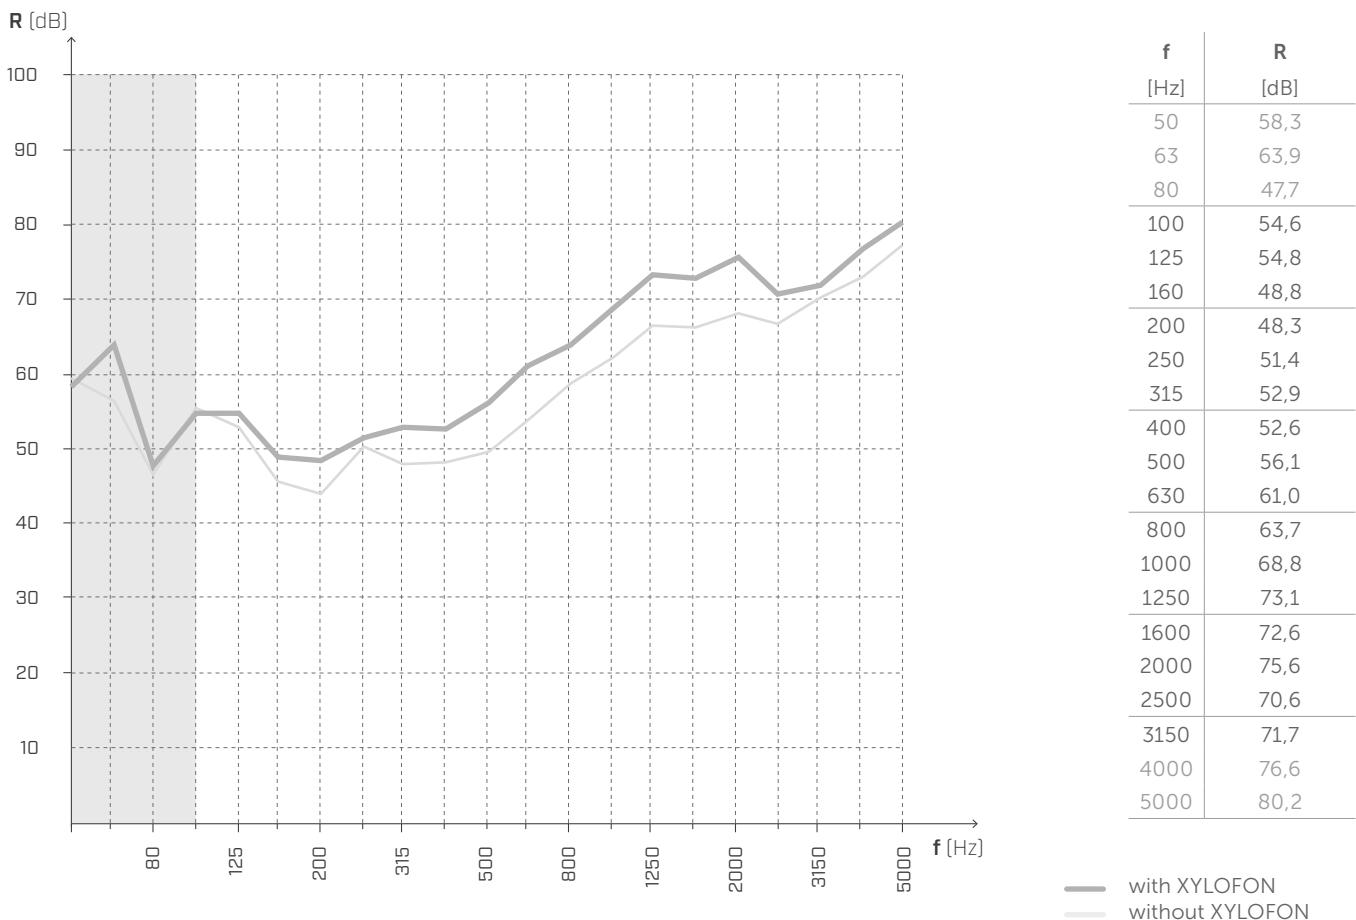

$$R_{Df+Ff,situ} = 62 \text{ dB}$$

$$R_{Df+Ff,situ,0} = 57 \text{ dB}$$


$$STC_{Df+Ff, situ} = 61$$

$$STC_{Df+Ff,situ,0} = 57$$

Testing laboratory: Universität Innsbruck / Arbeitsbereich für Holzbau / Technikerstraße 13A - 602 Innsbruck.
Test protocol: M03B_L211217_m-Bodenaufbau

ON-SITE MEASUREMENT | CLT FLOOR


AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

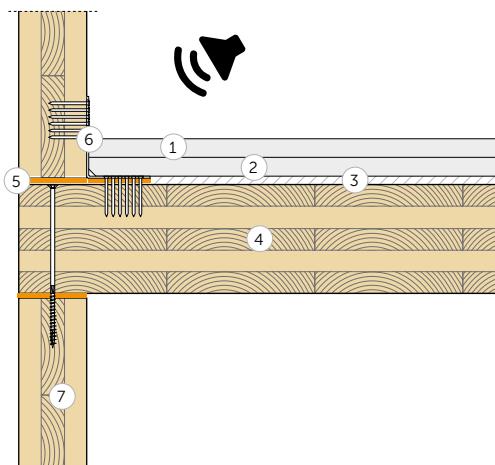

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- ① reinforced gypsum-fibre board (44 kg/m²) (s: 32 mm- 1 1/4 in)
- ② high density cardboard and sand panels (34,6 kg/m²) (s: 30 mm- 1 3/16 in)
- ③ SILENT FLOOR PUR (s: 10 mm- 3/8 in)
- ④ CLT (s: 160 mm- 6 1/4 in)
- ⑤ XYLOFON
- ⑥ TITAN SILENT
- ⑦ CLT (s: 160 m- 6 1/4 in)

AIRBORNE SOUND INSULATION

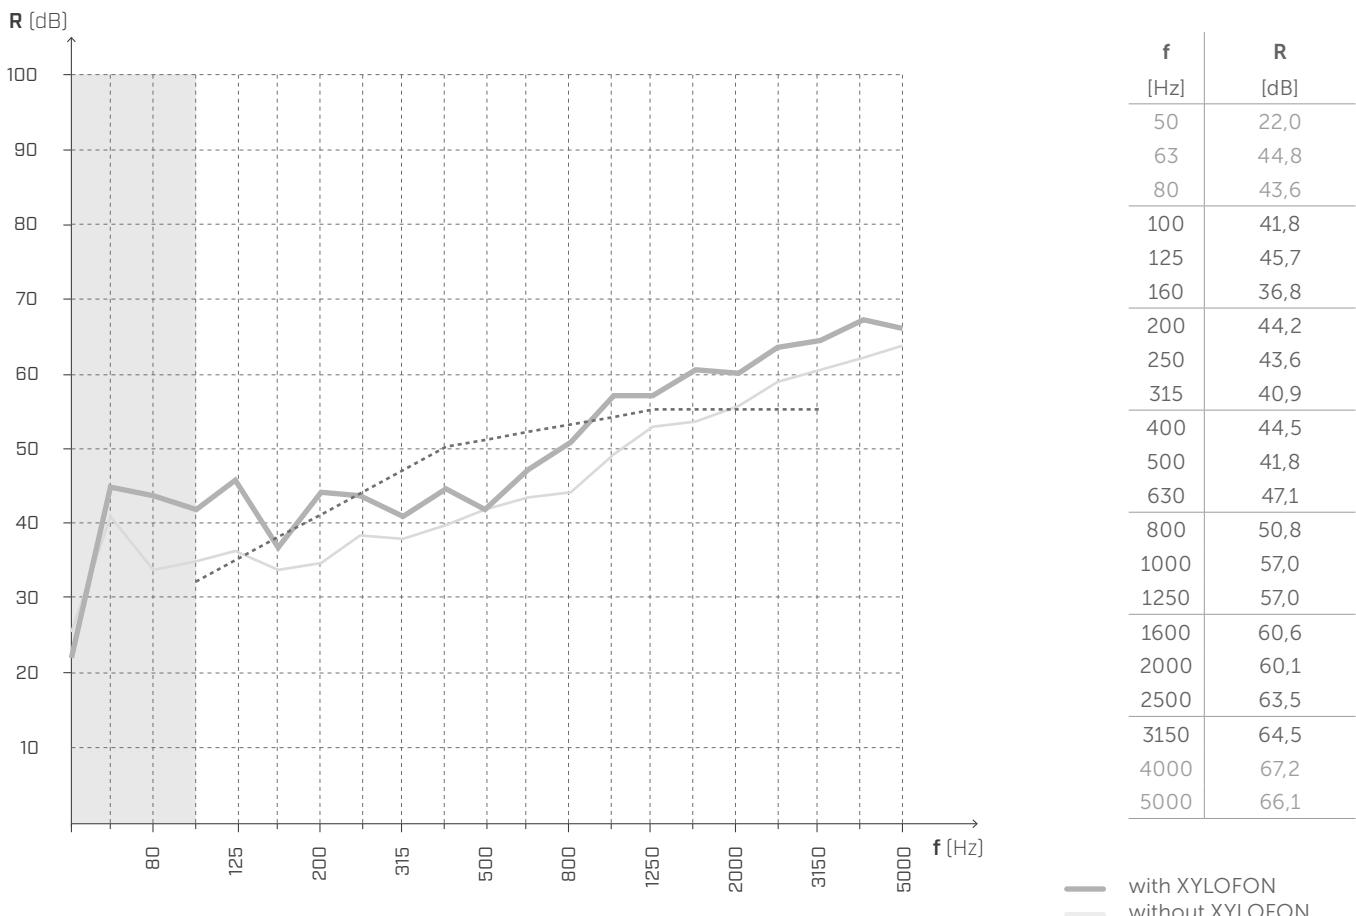

$$R'_w(C;C_{tr}) = \mathbf{51} \, (0;-6) \, dB$$

$$R'_{w,0}(C;C_{tr}) = 47 \, (0;-6) \, dB$$


$$STC = \mathbf{51}$$

$$STC_0 = 48$$

Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau Technikerstraße 13A - 6020 Innsbruck.
Test protocol: M07B_L211217_m-Bodenaufbau

ON-SITE MEASUREMENT | CLT FLOOR

AIRBORNE FLANKING TRANSMISSION ACCORDING TO ISO 16283-1

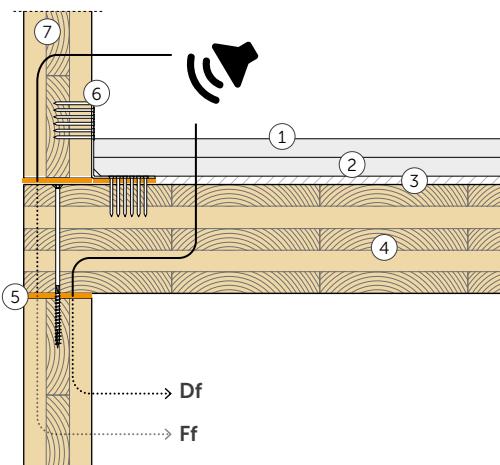

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- ① reinforced gypsum-fibre board (44 kg/m²) (s: 32 mm- 1 1/4 in)
- ② high density cardboard and sand panels (34,6 kg/m²) (s: 30 mm- 1 3/16 in)
- ③ SILENT FLOOR PUR (s: 10 mm- 3/8 in)
- ④ CLT (s: 160 mm- 6 1/4 in)
- ⑤ **XYLOFON**
- ⑥ TITAN SILENT
- ⑦ CLT (s: 160 m- 6 1/4 in)

AIRBORNE FLANKING TRANSMISSION



$$R_{Df+Ff,situ} = 67 \text{ dB}$$

$$R_{Df+Ff,situ,0} = 57 \text{ dB}$$


$$STC_{Df+Ff, situ} = 67$$

$$STC_{Df+Ff,situ,0} = 57$$

Testing laboratory: Universität Innsbruck / Arbeitsbereich für Holzbau / Technikerstraße 13A - 602 Innsbruck.
Test protocol: M07B_T210517_o-Bodenaufbau

ON-SITE MEASUREMENT | CLT FLOOR

IMPACT SOUND INSULATION ACCORDING TO ISO 16283-1

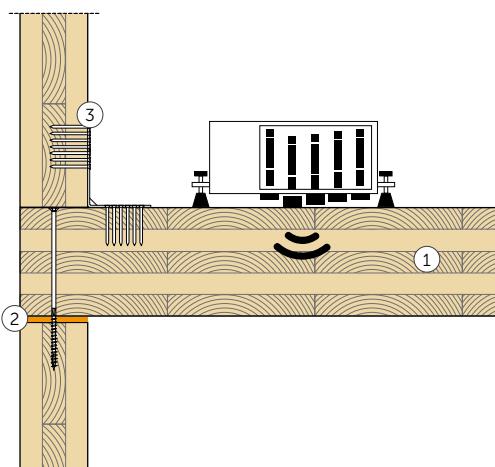

Impact sound NOISE INSULATION




$$L'_{n,w}(C_l) = \mathbf{85 (-4) dB}$$

$$IIC = \mathbf{85}$$

Testing laboratory: Universität Innsbruck | Arbeitsbereich für Holzbau | Technikerstraße 13A - 6020 Innsbruck.
 Test protocol: M06A_T210517_o-Bodenaufbau.

ON-SITE MEASUREMENT | CLT FLOOR


IMPACT FLANKING TRANSMISSION ACCORDING TO ISO 16283-1

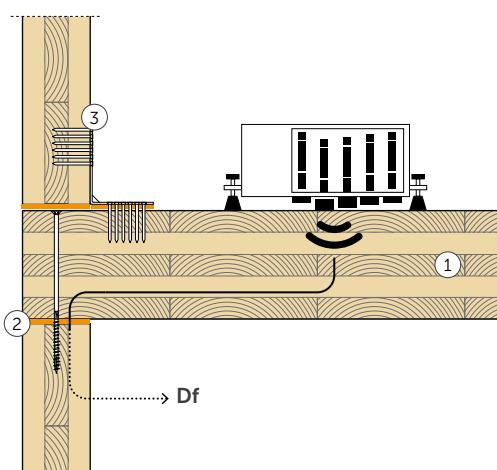

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- (1) CLT (s: 160 mm- 6 1/4 in)
- (2) **XYLOFON**
- (3) TITAN SILENT

IMPACT FLANKING TRANSMISSION

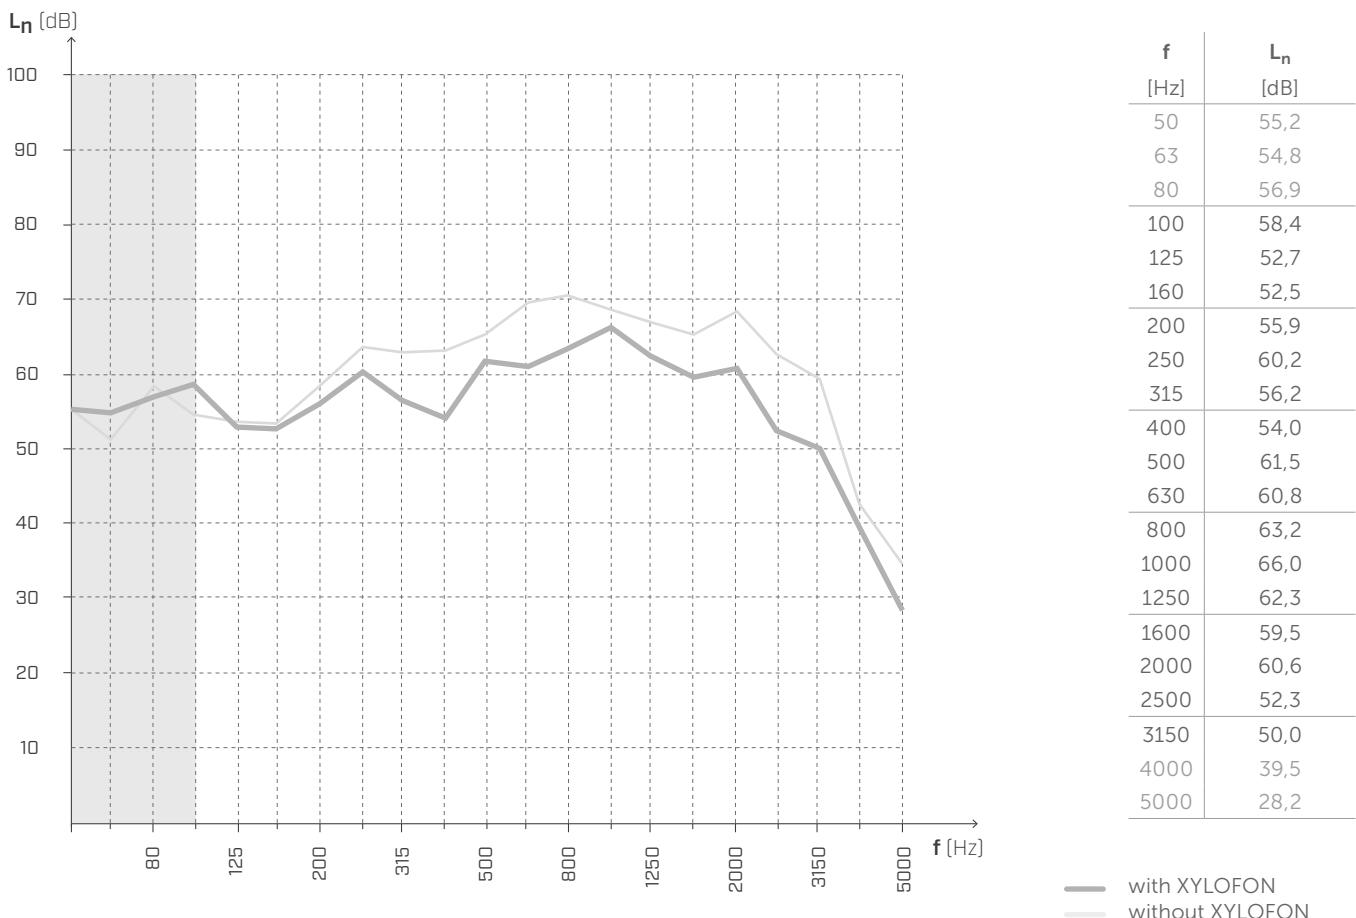

$$L_{n,Df+Ff,situ} = \mathbf{64 \text{ dB}}$$

$$L_{n,Df+Ff,situ,0} = 71 \text{ dB}$$


$$IIC_{Df+Ff, situ} = \mathbf{64}$$

$$IIC_{Df+Ff,situ,0} = 71$$

Testing laboratory: Universität Innsbruck | Arbeitsbereich für Holzbau | Technikerstraße 13A - 602 Innsbruck.
Test protocol: M06A_T210517_o-Bodenaufbau

ON-SITE MEASUREMENT | CLT FLOOR

IMPACT SOUND INSULATION ACCORDING TO ISO 16283-1

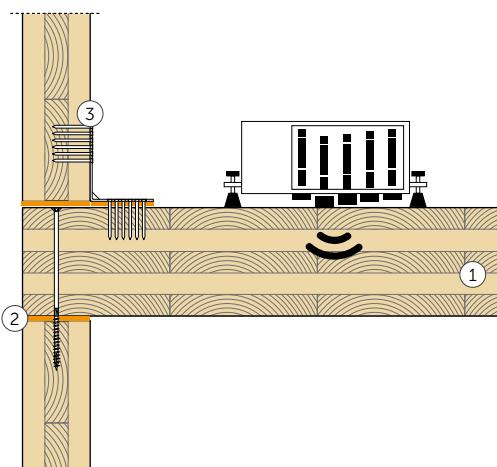

Surface = 21,64 m²
Mass = 72 kg/ m²
Receiving room volume = 75,52 m³

- (1) CLT (s: 160 mm- 6 1/4 in)
- (2) **XYLOFON**
- (3) TITAN SILENT

Impact sound NOISE INSULATION




$$L'_{n,w}(C_l) = \mathbf{84 \, (-4) \, dB}$$

$$IIC = \mathbf{84}$$

Testing laboratory: Universität Innsbruck | Arbeitsbereich für Holzbau | Technikerstraße 13A - 602 Innsbruck.
Test protocol: M07A_T210517_o-Bodenaufbau

ON-SITE MEASUREMENT | CLT FLOOR

IMPACT FLANKING TRANSMISSION ACCORDING TO ISO 16283-1

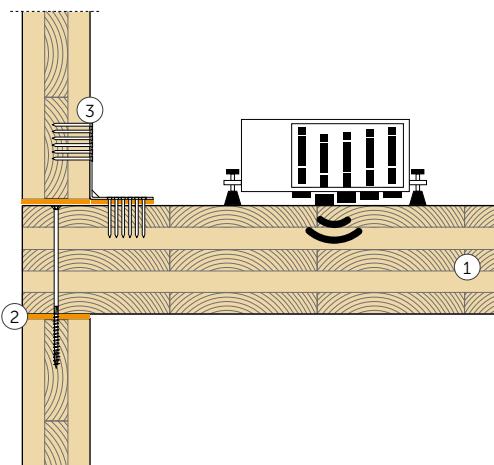

Surface = 21,64 m²
Mass = 167 kg/ m²
Receiving room volume = 75,52 m³

- ① CLT (s: 160 mm- 6 1/4 in)
- ② XYLOFON
- ③ TITAN SILENT

IMPACT FLANKING TRANSMISSION




$$L_{n,Df+Ff,situ} = 63 \text{ dB}$$

$$L_{n,Df+Ff,situ,0} = 71 \text{ dB}$$

$$IIC_{Df+Ff, situ} = 63$$

$$IIC_{Df+Ff,situ,0} = 71$$

Testing laboratory: Universität Innsbruck / Arbeitsbereich für Holzbau / Technikerstraße 13A - 602 Innsbruck.
Test protocol: M07A_T210517_o-Bodenaufbau

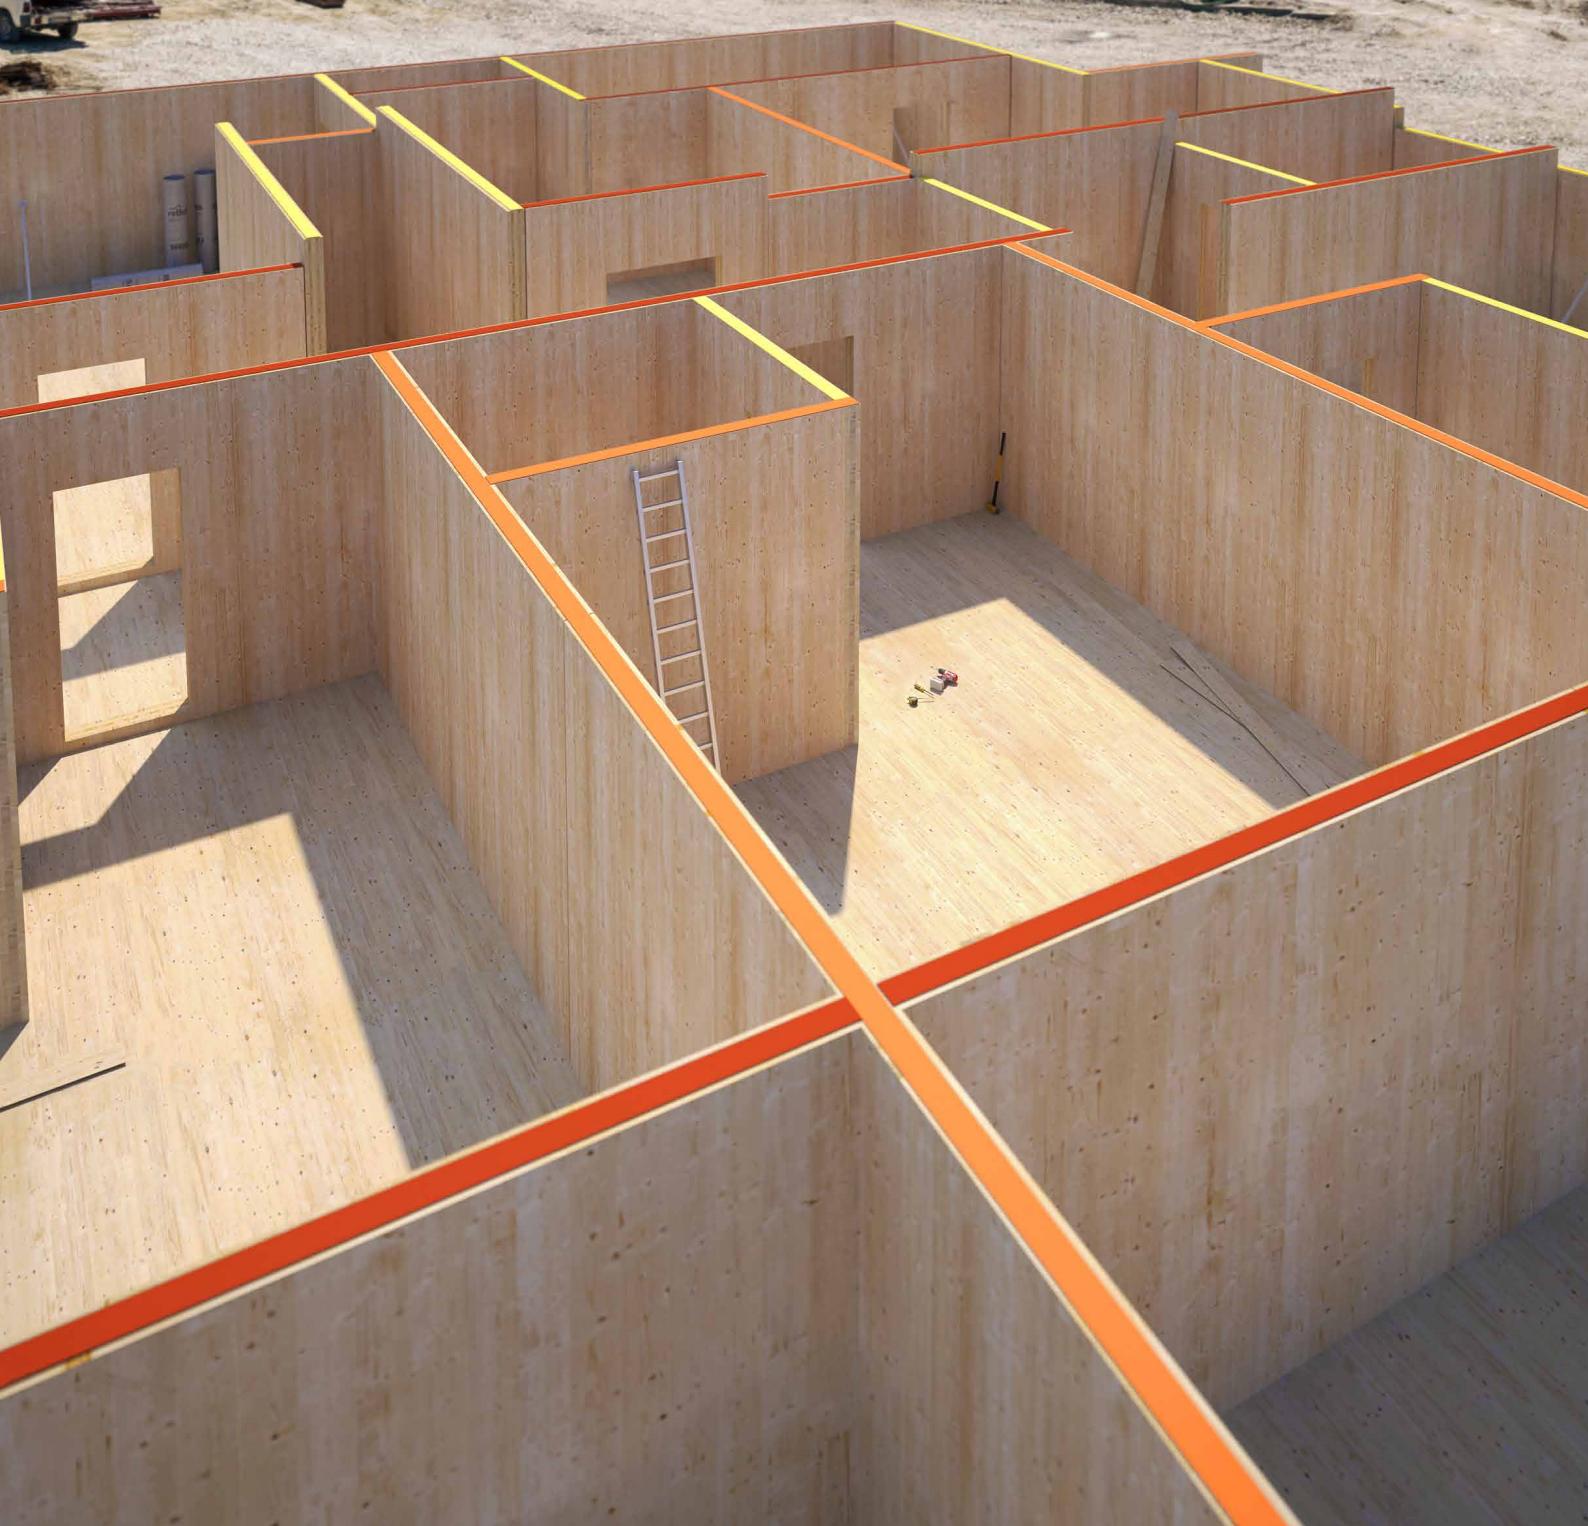

ON SITE MEASUREMENTS

The effectiveness of XYLOFON was also verified by measuring passive acoustic requirements in constructed buildings. XYLOFON has been used in residential buildings, accommodation facilities, university campuses, schools, health centres and mixed-use multi-storey buildings.

The performance achieved did not disappoint expectations and XYLOFON proved to be an excellent partner for reducing flanking sound transmission.



MARIE CURIE SCHULE

Frankfurt (DE)

description	building for school use
type of structure	CLT panels
location	Frankfurt (Germany)
products	XYLOFON



MULTI-STOREY BUILDING

Toronto (CA)

description	6-storey building for residential use
type of structure	CLT panels
location	Toronto (Canada)
products	XYLOFON, ALADIN



SOLHØY

Østlandet (NO)

description	health centre consisting of 67 health-care flats with attached user services
type of structure	CLT panels
location	Østlandet (Norway)
products	XYLOFON



LA BRIOSA HOTEL

Trentino Alto Adige (IT)

description	7-storey building for accommodation use
type of structure	CLT panels
location	Trentino Alto Adige (Italy)
products	XYLOFON, ALADIN, TITAN SILENT

LABORATORY MEASUREMENT | CLT FLOOR 1


AIRBORNE SOUND INSULATION ACCORDING TO ISO 10140-2

FLOOR SLAB

Surface = 31,17 m²

Mass = 418,3 kg/m²

Receiving room volume = 78,4 m³

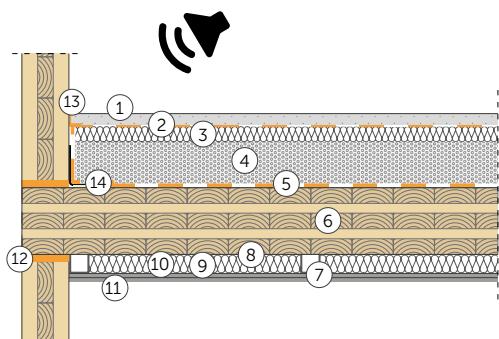

① Concrete screed (2400 kg/m³) (s: 60 mm - 2 3/8 in)

② BARRIER 150

③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)

④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3 1/8 in)

⑤ **SILENT FLOOR BYTUM** (s: 5 mm - 8 mil)

⑥ CLT (s: 160 mm - 6 1/4 in)

⑦ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)

⑧ Metal structure for plasterboard

⑨ Air chamber (s: 10 mm - 3/8 in)

⑩ Low density mineral wool insulation (25 kg/m³) (s: 50 mm - 2 in)

⑪ Plasterboard panel x2 (s: 25 mm - 1 in)

⑫ **XYLOFON**


⑬ **SILENT EDGE**

⑭ Fastening system:

HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing

TITAN SILENT 800 mm (31 1/2 in) spacing

AIRBORNE SOUND INSULATION

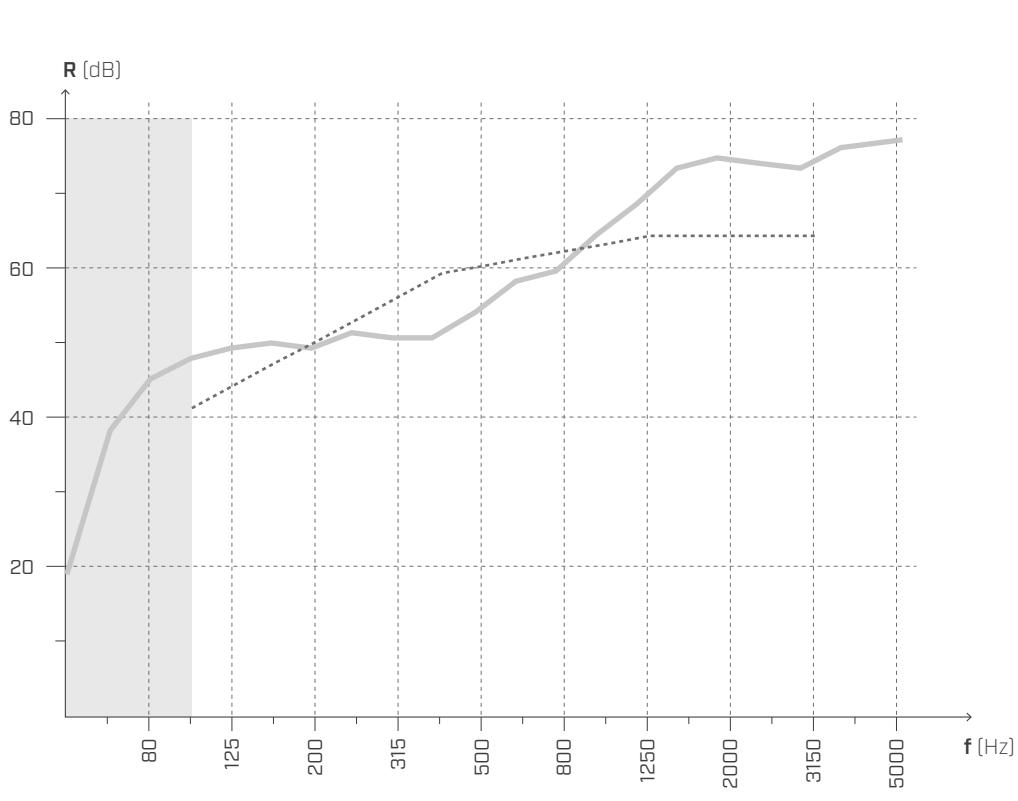

R_w (C;C_{tr}) = 60 (-1; -4) dB

STC = 59

Testing laboratory: Akustik Center Austria, Holzforschung Austria.

Test protocol: 2440_01_2017_M01.

LABORATORY MEASUREMENT | CLT FLOOR 1


IMPACT SOUND INSULATION ACCORDING TO ISO 10140-3

FLOOR SLAB

Surface = 31,17 m²

Mass = 418,3 kg/m²

Receiving room volume = 78,4 m³

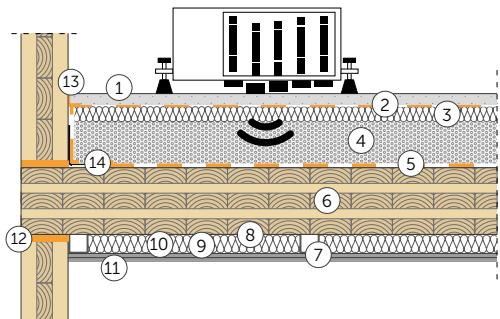

① Concrete screed (2400 kg/m³) (s: 60 mm - 2 3/8 in)

② BARRIER 150

③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)

④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3.15 i)

⑤ SILENT FLOOR BYTUM (s: 5 mm - 8 mil)

⑥ CLT (s: 160 mm - 6 1/4 in)

⑦ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)

⑧ Metal structure for plasterboard

⑨ Air chamber (s: 10 mm - 3/8 in)

⑩ Low density mineral wool insulation (25 kg/m³) (s: 50 mm - 2 in)

⑪ Plasterboard panel x2 (s: 25 mm - 1 in)

⑫ XYLOFON

⑬ SILENT EDGE

⑭ Fastening system:

HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing

TITAN SILENT 800 mm (31 1/2 in) spacing

IMPACT SOUND INSULATION



$$L_{n,w} (C_l) = \mathbf{42 (0)} \text{ dB}$$


$$IIC = \mathbf{67}$$

Testing laboratory: Akustik Center Austria, Holzforschung Austria.

Test protocol: 2440_01_2017_M01.

LABORATORY MEASUREMENT | CLT FLOOR 2

AIRBORNE SOUND INSULATION ACCORDING TO ISO 10140-2

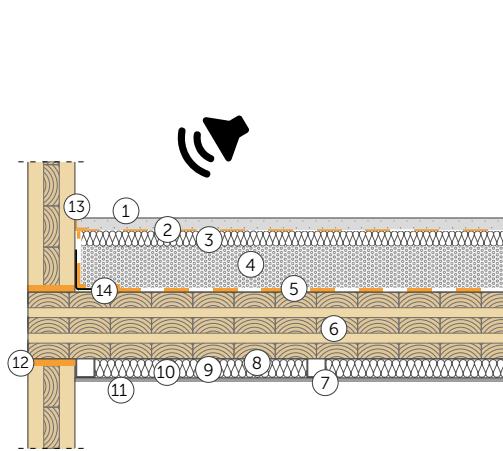

FLOOR SLAB

Surface = 31,17 m²

Mass = 418,3 kg/m²


Receiving room volume = 78,4 m³

- ① Concrete screed (2400 kg/m³) (s: 60 mm - 2 3/8 in)
- ② BARRIER 150
- ③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- ④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3 1/8 in)
- ⑤ SILENT FLOOR BYTUM (s: 5 mm - 8 mil)
- ⑥ CLT (s: 160 mm - 6 1/4 in)
- ⑦ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)
- ⑧ Metal structure for plasterboard
- ⑨ Air chamber (s: 10 mm - 3/8 in)
- ⑩ Low density mineral wool insulation (25 kg/m³) (s: 50 mm - 2 in)
- ⑪ Plasterboard panel (s: 12,5 mm - 1/2 in)
- ⑫ XYLOFON
- ⑬ SILENT EDGE
- ⑭ Fastening system:

HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing

TITAN SILENT 800 mm (31 1/2 in) spacing

AIRBORNE SOUND INSULATION

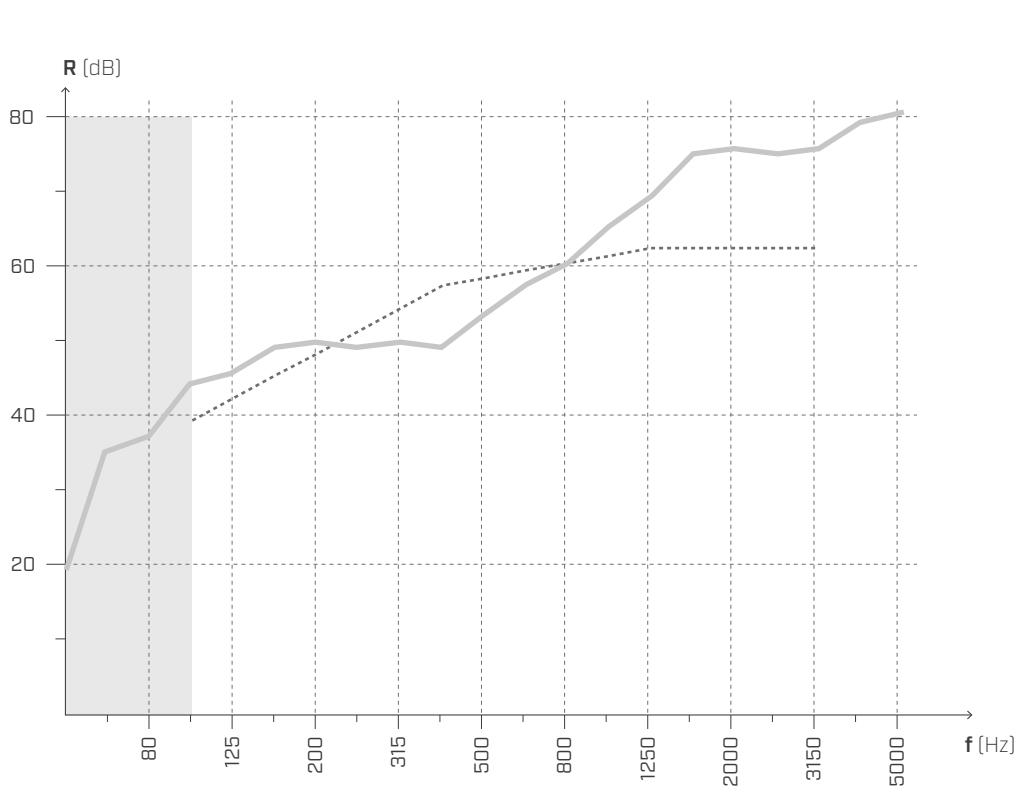

$$R_w (C; C_{tr}) = \mathbf{59} \, (-1; -4) \, \text{dB}$$

$$\text{STC} = \mathbf{57}$$

Testing laboratory: Akustik Center Austria, Holzforschung Austria.

Test protocol: 2440_03_2017_M02.

LABORATORY MEASUREMENT | CLT FLOOR 2


IMPACT SOUND INSULATION ACCORDING TO ISO 10140-3

FLOOR SLAB

Surface = 31,17 m²

Mass = 418,3 kg/m²

Receiving room volume = 78,4 m³

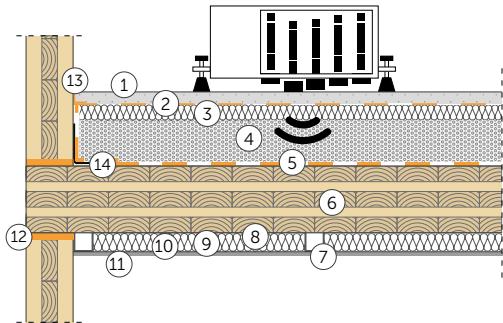

① Concrete screed (2400 kg/m³) (s: 60 mm - 2.36 i)

② BARRIER 150

③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)

④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3 1/8 in)

⑤ SILENT FLOOR BYTUM (s: 5 mm - 8 mil)

⑥ CLT (s: 160 mm - 6 1/4 in)

⑦ Resilient plasterboard connectors (s: 60 mm- 2.36 i)

⑧ Metal structure for plasterboard

⑨ Air chamber (s: 10 mm- 3/8 in)

⑩ Low density mineral wool insulation (25 kg/m³) (s: 50 mm - 2 in)

⑪ Plasterboard panel x2 (s: 25 mm- 1 in)

⑫ XYLOFON


⑬ SILENT EDGE

⑭ Fastening system:

HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing

TITAN SILENT 800 mm (31 1/2 in) spacing

IMPACT SOUND INSULATION

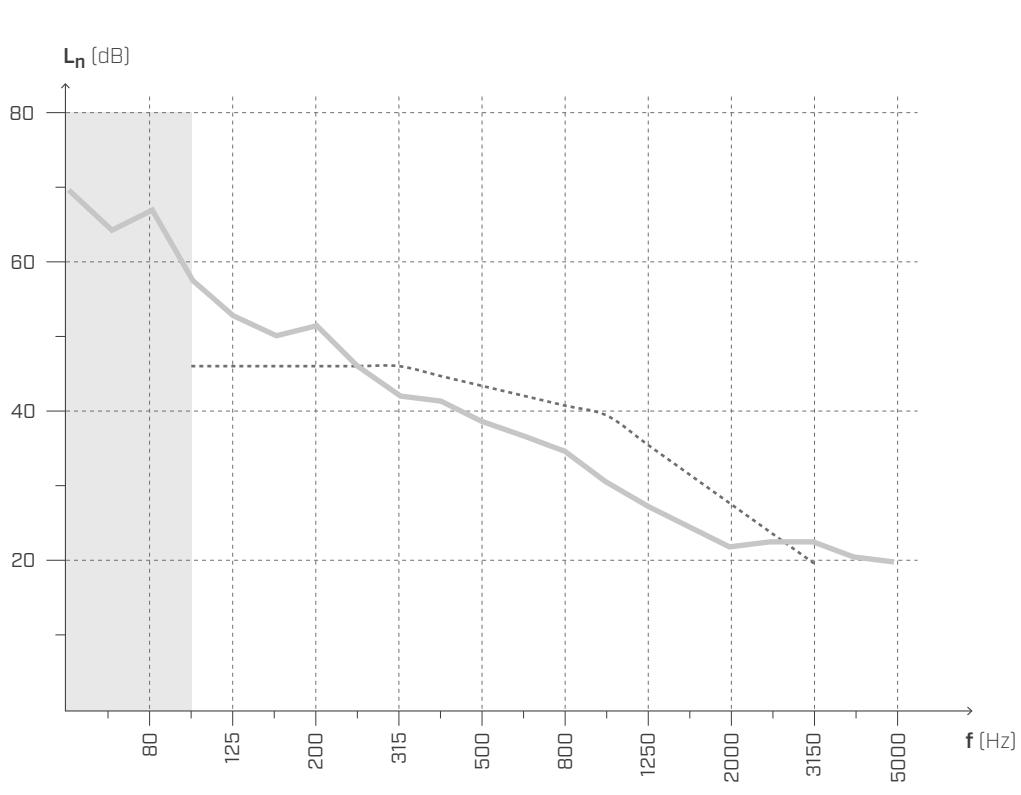

$$L_{n,w} (C_l) = 44 \text{ (1) dB}$$


$$IIC = 62$$

Testing laboratory: Akustik Center Austria, Holzforschung Austria.

Test protocol: 2440_03_2017_M02.

LABORATORY MEASUREMENT | CLT FLOOR 3

AIRBORNE SOUND INSULATION ACCORDING TO ISO 10140-2

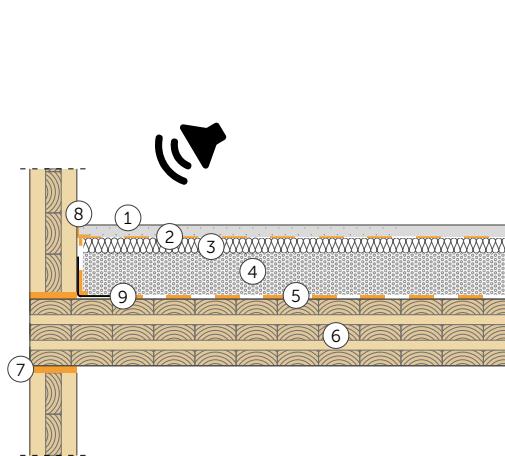

FLOOR SLAB


Surface = 31,17 m²

Mass = 418,3 kg/m²

Receiving room volume = 78,4 m³

- ① Concrete screed (2400 kg/m³) (s: 60 mm - 2 3/8 in)
- ② BARRIER 150
- ③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- ④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3 1/8 in)
- ⑤ SILENT FLOOR BYTUM (s: 5 mm - 8 mil)
- ⑥ CLT (s: 160 mm - 6 1/4 in)
- ⑦ XYLOFON
- ⑧ SILENT EDGE
- ⑨ Fastening system:
HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing
TITAN SILENT 800 mm (31 1/2 in) spacing

AIRBORNE SOUND INSULATION

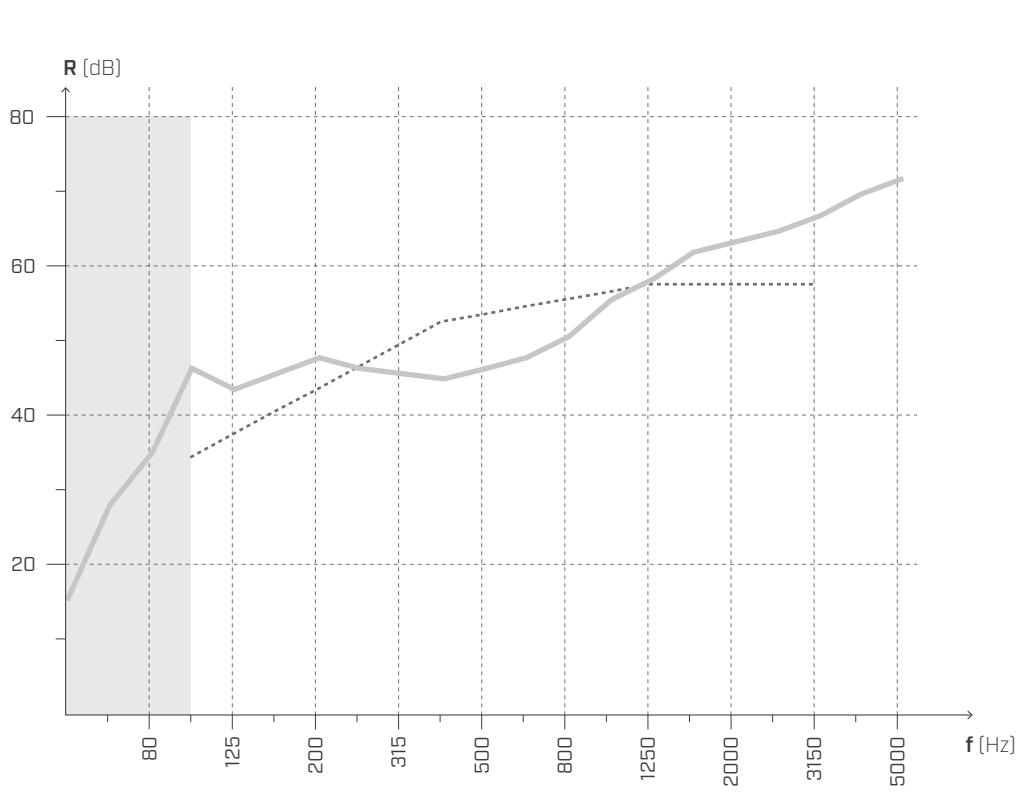

$$R_w (C; C_{tr}) = \mathbf{53} \, (-1; -3) \, \text{dB}$$

$$\text{STC} = \mathbf{53}$$

Testing laboratory: Akustik Center Austria, Holzforschung Austria.
Test protocol: 2440_05_2017_M03.

LABORATORY MEASUREMENT | CLT FLOOR 3


IMPACT SOUND INSULATION ACCORDING TO ISO 10140-3

FLOOR SLAB

Surface = 31,17 m²

Mass = 418,3 kg/m²

Receiving room volume = 78,4 m³

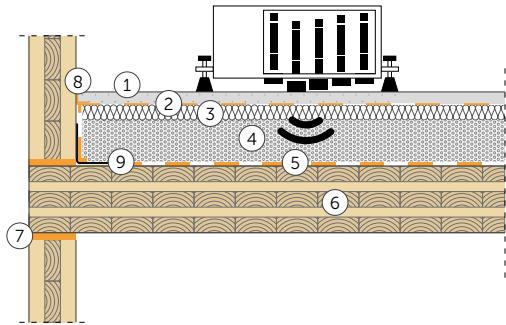

① Concrete screed (2400 kg/m³) (s: 60 mm - 2 3/8 in)

② BARRIER 150

③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)

④ Compact gravel fill with cement (1800 kg/m³) (s: 80 mm - 3 1/8 in)

⑤ **SILENT FLOOR BYTUM** (s: 5 mm - 8 mil)

⑥ CLT (s: 160 mm - 6 1/4 in)

⑦ **XYLOFON**


⑧ **SILENT EDGE**

⑨ Fastening system:

HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing

TITAN SILENT 800 mm (31 1/2 in) spacing

IMPACT SOUND INSULATION

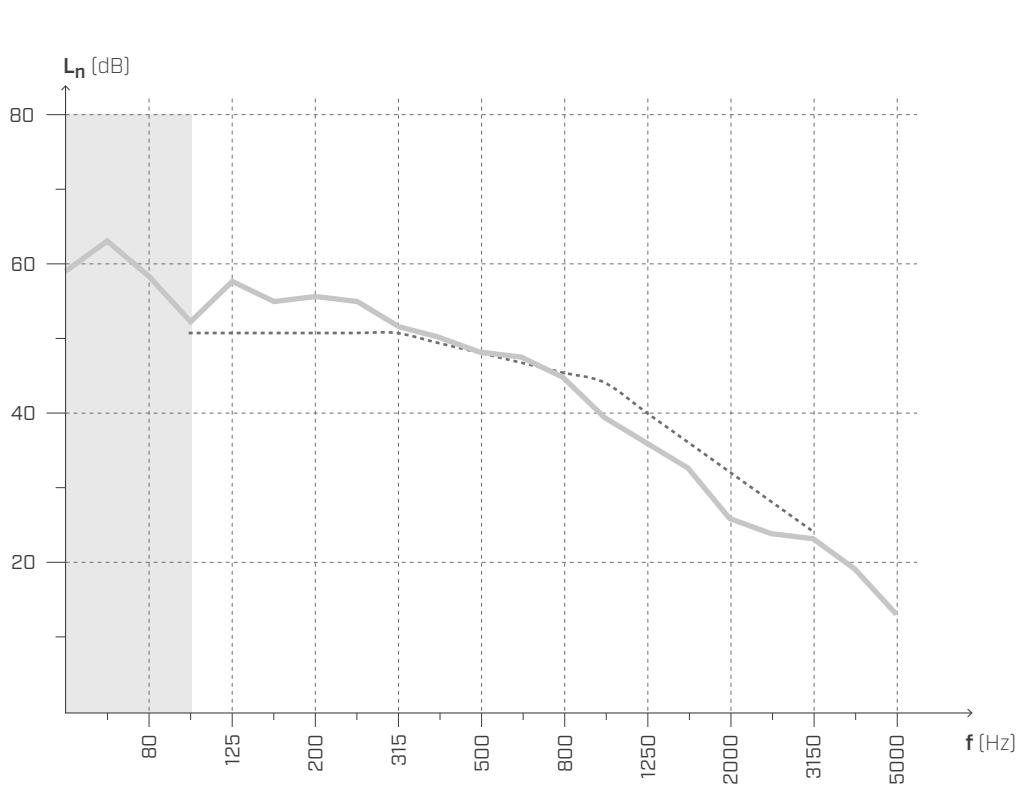

f [Hz]	L _n [dB]
50	59,3
63	63,1
80	58,4
100	51,9
125	57,5
160	55,1
200	55,4
250	55,0
315	51,4
400	50,0
500	47,9
630	47,3
800	44,9
1000	39,3
1250	36,0
1600	32,6
2000	26,0
2500	24,2
3150	23,1
4000	19,1
5000	13,3
-	48

$$L_{n,w} (C_l) = \mathbf{48 (0) dB}$$


$$IIC = \mathbf{62}$$

Testing laboratory: Akustik Center Austria, Holzforschung Austria.

Test protocol: 2440_06_2017_M03.

ON-SITE MEASUREMENT | CLT FLOOR 5

AIRBORNE SOUND INSULATION ACCORDING TO ISO 140-4

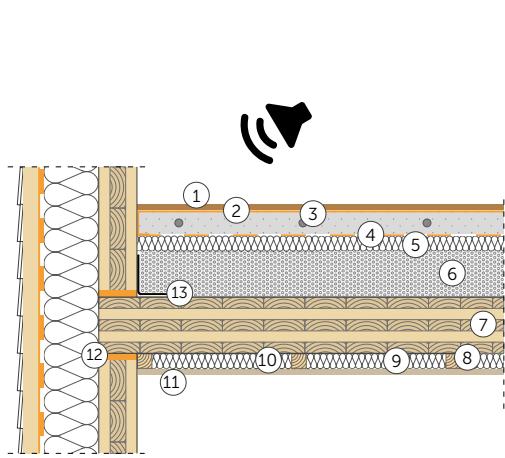

FLOOR SLAB


Surface = 35,14 m²

Mass = 384 kg/m²

Receiving room volume = 88 m³

- (1) Timber floor (s: 15 mm - 9/16 in)
- (2) **SILENT STEP** (s: 2 mm - 8 mil)
- (3) In-floor heating system (s: 70 mm - 2 3/4 in)
- (4) **BARRIER 150**
- (5) Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- (6) Compact gravel fill (s: 85 mm - 3 3/8 in)
- (7) CLT (s: 150 mm - 6 in)
- (8) Solid wood batten with resilient connectors
- (9) Air chamber (s: 6 mm - 1/4 in)
- (10) Low density mineral wool insulation (25 kg/m³) (s: 40 mm - 1 9/16 in)
- (11) Fir covering (s: 19 mm - 3/4 in)
- (12) **XYLOFON**
- (13) Fastening system:
HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing
TITAN SILENT 1000 mm (40 in) spacing

AIRBORNE SOUND INSULATION

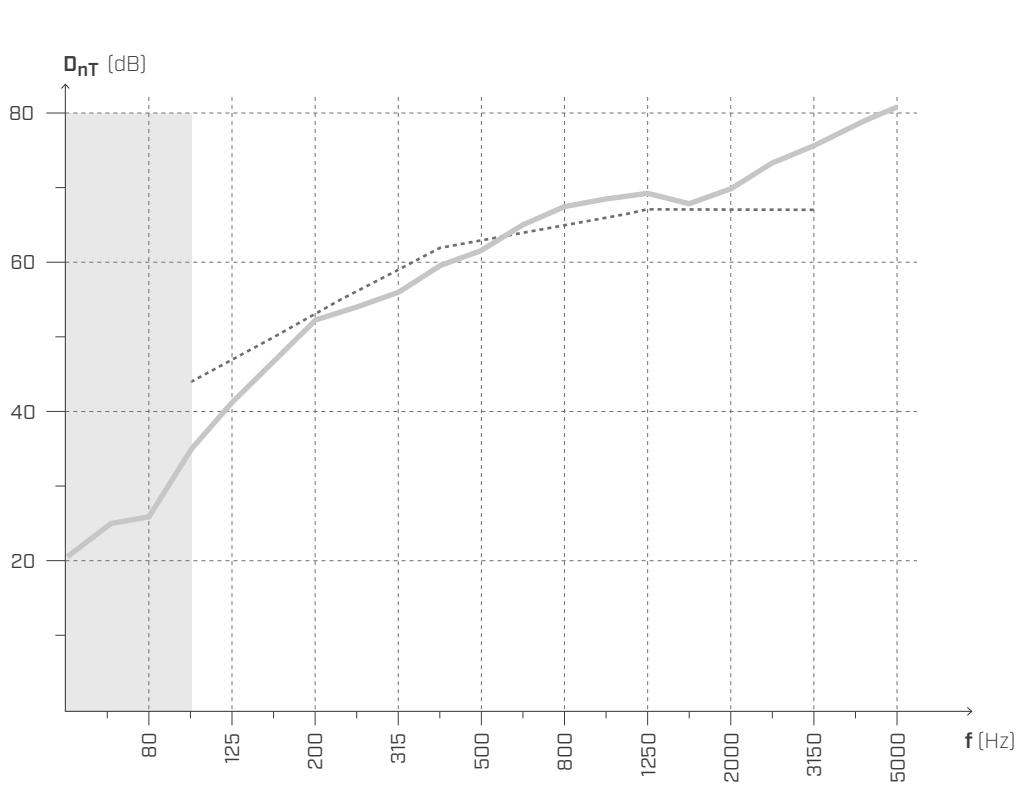

f [Hz]	D _{nT} [dB]
50	20,5
63	24,6
80	25,5
100	34,8
125	41,2
160	46,6
200	52,2
250	53,9
315	56
400	59,5
500	61,5
630	64,9
800	67,4
1000	68,4
1250	69,2
1600	67,8
2000	69,9
2500	73,3
3150	75,6
4000	79,6
5000	80,3
-	63


$$D_{nT,W} (C; C_{tr}) = \text{63 (-3; -10) dB}$$

$$\text{NNIC} = \text{64}$$

Testing laboratory: INGENIEURBÜRO ROTHBACHER GmbH.
Test protocol: 17-466.

ON-SITE MEASUREMENT | CLT FLOOR 5

IMPACT SOUND INSULATION ACCORDING TO ISO 10140-3

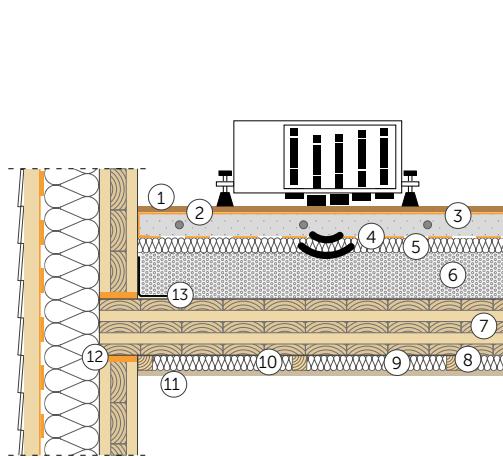

FLOOR SLAB


Surface = 35,14 m²

Mass = 384 kg/m²

Receiving room volume = 88 m³

- (1) Timber floor (s: 15 mm - 9/16 in)
- (2) **SILENT STEP** (s: 2 mm - 8 mil)
- (3) In-floor heating system (s: 70 mm - 2 3/4 in)
- (4) **BARRIER 100**
- (5) Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- (6) Compact gravel fill (s: 85 mm - 3 3/8 in)
- (7) CLT (s: 150 mm - 6 in)
- (8) Solid wood batten with resilient connectors
- (9) Air chamber (s: 6 mm - 1/4 in)
- (10) Low density mineral wool insulation (25 kg/m³) (s: 40 mm - 1 9/16 in)
- (11) Fir covering (s: 19 mm - 3/4 in)
- (12) **XYLOFON**
- (13) Fastening system:
HBS 8 x 240 mm, 300 mm (11 3/4 in) spacing
TITAN SILENT 1000 mm (40 in) spacing

IMPACT SOUND INSULATION

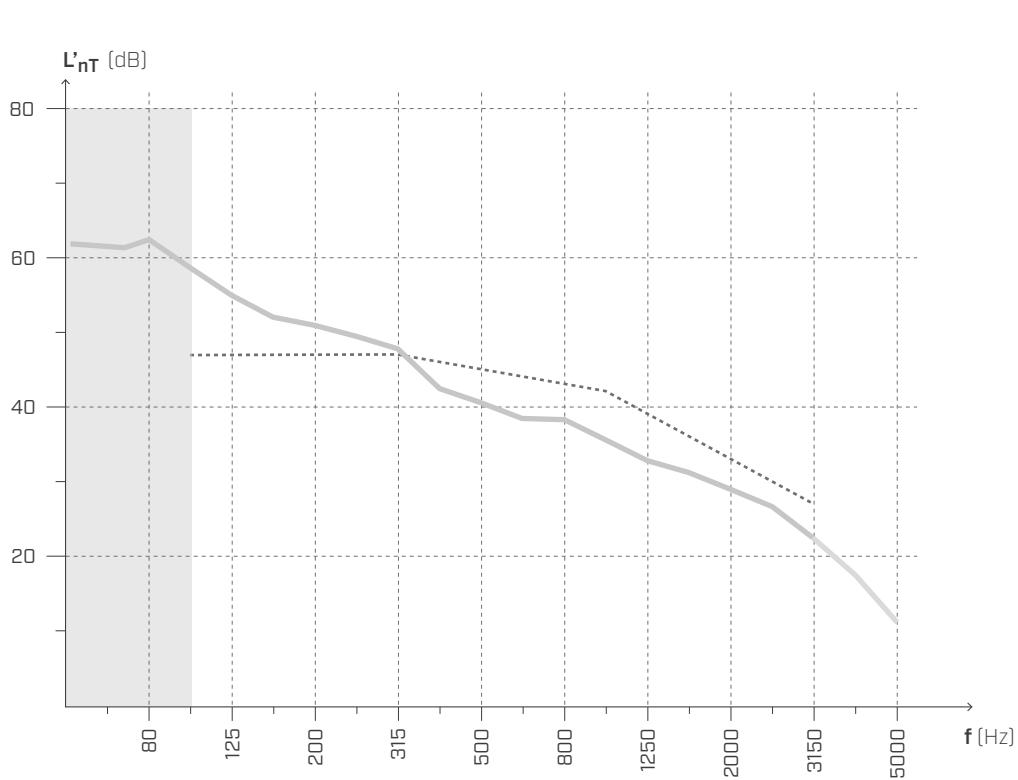

$$L'_{nT,w} (C_l) = \mathbf{45 (2) dB}$$

$$NIRS = \mathbf{61}$$

Testing laboratory: INGENIEURBÜRO ROTHBACHER GmbH.
Test protocol: 17-466.


ON-SITE MEASUREMENT | CLT WALL 8

AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

WALL

Surface = 9,6 m²

Receiving room volume = 67 m³

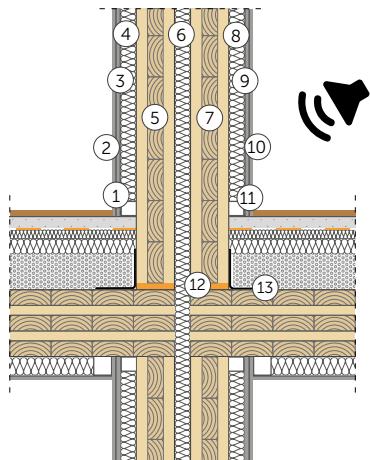

① Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)

② Plasterboard panel x2 (s: 25 mm - 1 in)

③ Metal structure with plasterboard (s: 50 mm - 2 in)

④ Low density mineral wool insulation (s: 50 mm - 2 in)

⑤ CLT (s: 100 mm - 4 in)

⑥ High density mineral wool insulation (s: 30 mm - 1 3/16 in)

⑦ CLT (s: 100 mm - 4 in)

⑧ Low density mineral wool insulation (s: 50 mm - 2 in)

⑨ Metal structure with plasterboard (s: 50 mm - 2 in)

⑩ Plasterboard panel x2 (s: 25 mm - 1 in)

⑪ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)


⑫ XYLOFON

⑬ Fastening system:

HBS 8 x 240 mm, 500 (20 in) mm spacing

WBR 100, 1000 (40 in) mm spacing

AIRBORNE SOUND INSULATION

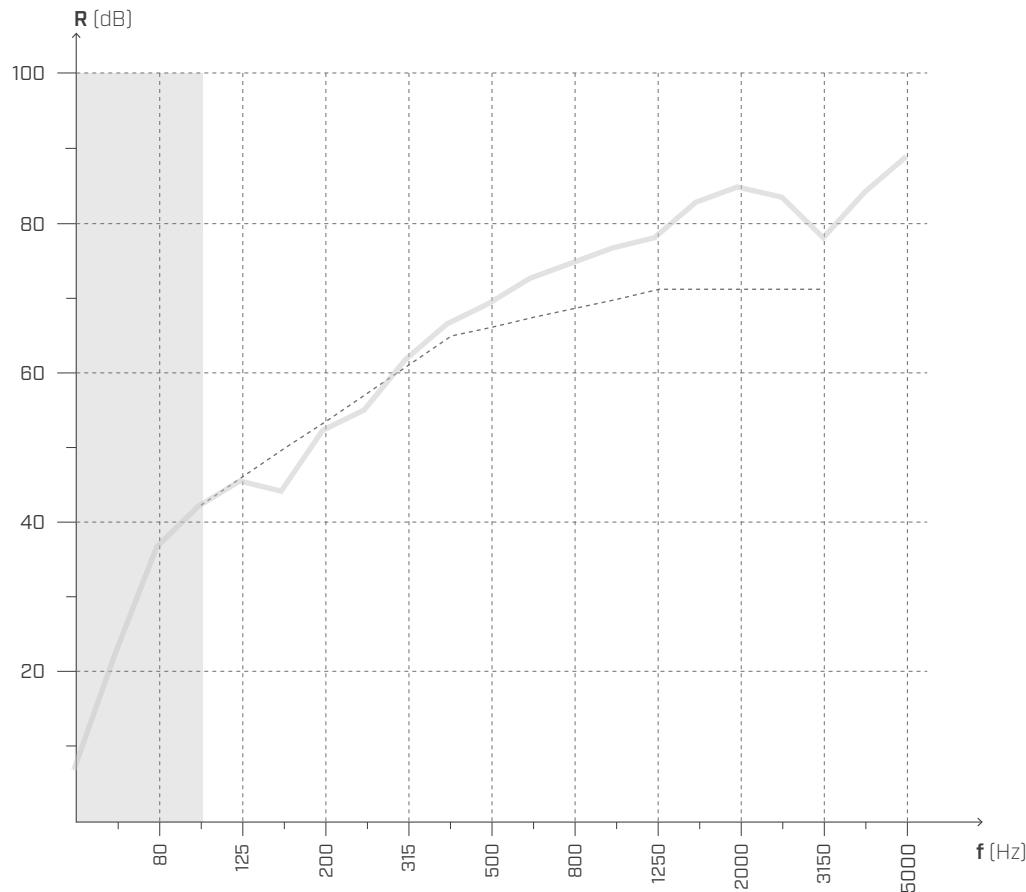

f [Hz]	R [dB]
50	6,9
63	22,7
80	36,6
100	41,9
125	45,2
160	44,0
200	52,1
250	55,0
315	61,5
400	66,3
500	69,3
630	72,5
800	74,4
1000	76,4
1250	78,1
1600	≥ 82,6
2000	≥ 84,9
2500	≥ 83,0
3150	≥ 77,6
4000	≥ 83,6
5000	≥ 88,7

$$R'_w (C; C_{tr}) = \text{66} \text{ (-3; -9) dB}$$

$$\text{FSTC} = \text{67}$$

Responsible for measurements: University of Bologna.

Test protocol: test 26/09/2017.


ON-SITE MEASUREMENT | CLT WALL 8

AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

FLOOR SLAB

Surface = 9,6 m²

Receiving room volume = 67 m³

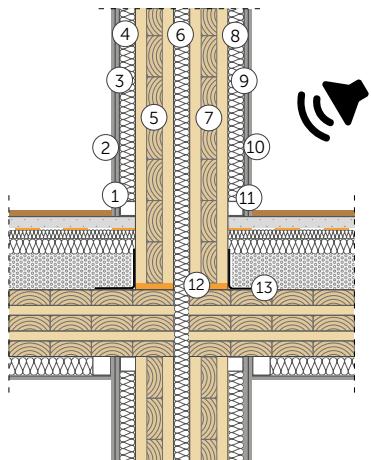

① Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)

② Plasterboard panel x2 (s: 25 mm - 1 in)

③ Metal structure with plasterboard (s: 50 mm - 2 in)

④ Low density mineral wool insulation (s: 50 mm - 2 in)

⑤ CLT (s: 100 mm - 4 in)

⑥ High density mineral wool insulation (s: 30 mm - 1 3/16 in)

⑦ CLT (s: 100 mm - 4 in)

⑧ Low density mineral wool insulation (s: 50 mm - 2 in)

⑨ Metal structure with plasterboard (s: 50 mm - 2 in)


⑩ Plasterboard panel x2 (s: 25 mm - 1 in)

⑪ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)

⑫ XYLOFON

⑬ Fastening system:
HBS 8 x 240 mm, 500 (20 in) mm spacing
WBR 100, 1000 (40 in) mm spacing

AIRBORNE SOUND INSULATION

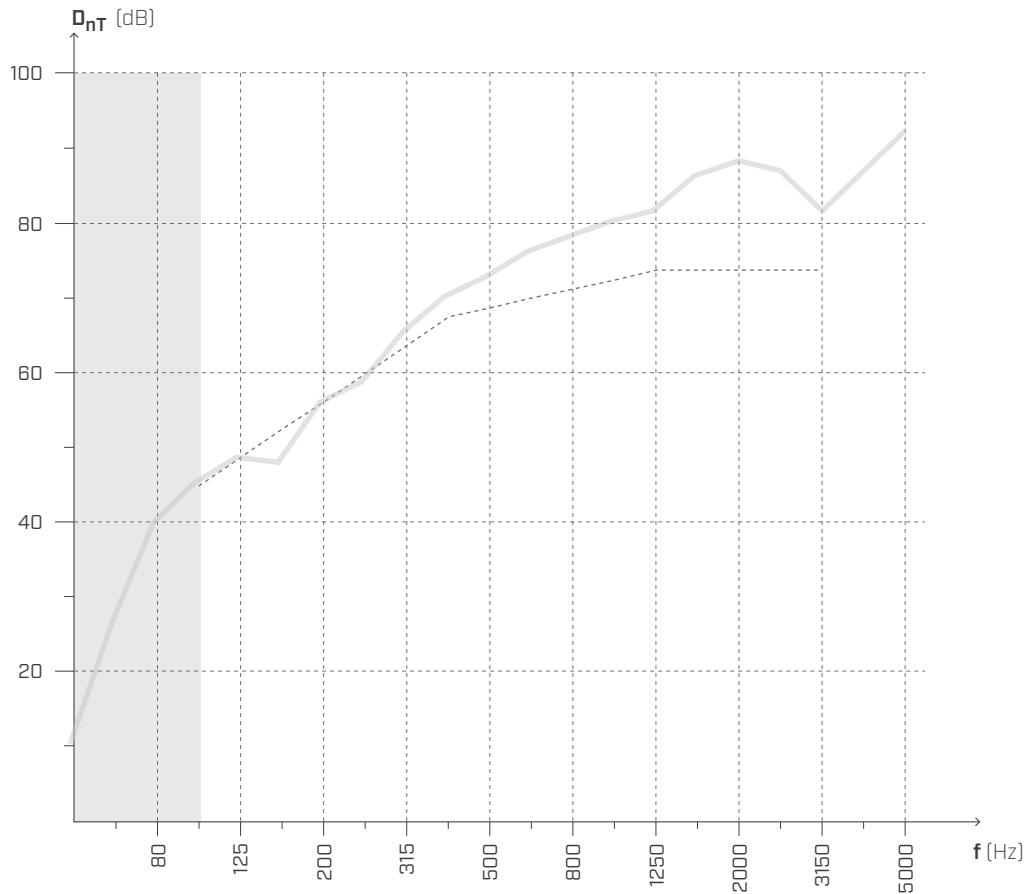

$$D_{nT,w} (C; C_{tr}) = \mathbf{70} \text{ (-3;-9) dB}$$


$$FSTC = \mathbf{67}$$

Responsible for measurements: University of Bologna.


Test protocol: test 26/09/2017.

ON-SITE MEASUREMENT | CLT FLOOR 8

AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

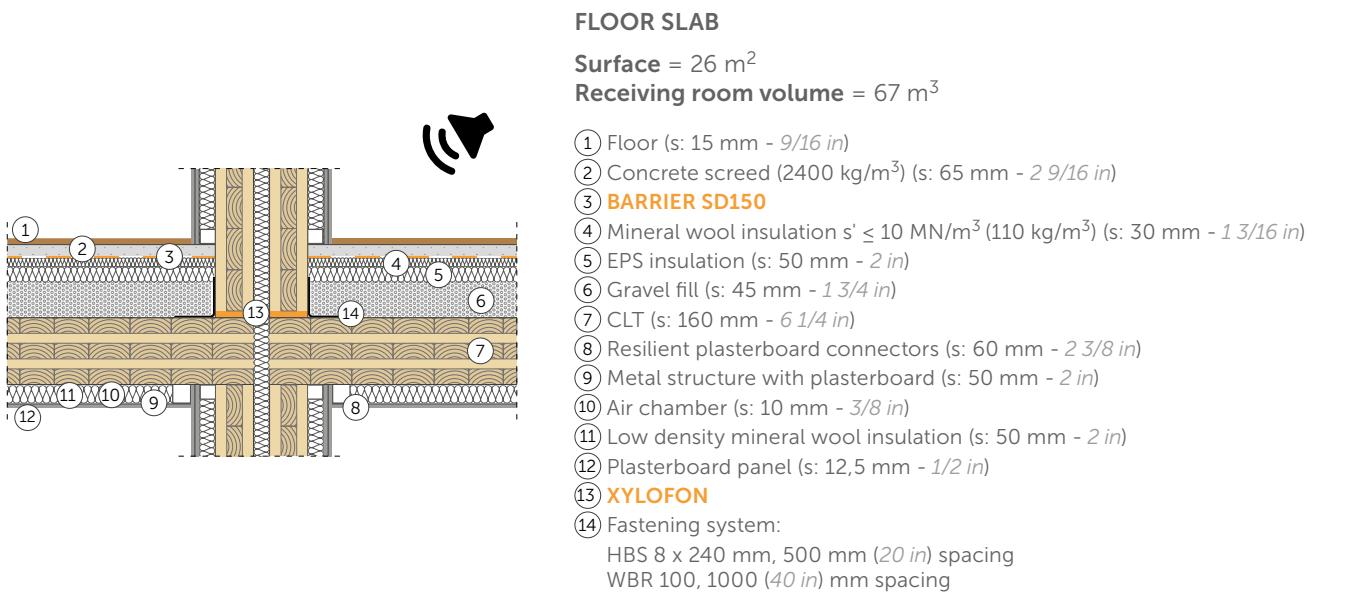

AIRBORNE SOUND INSULATION

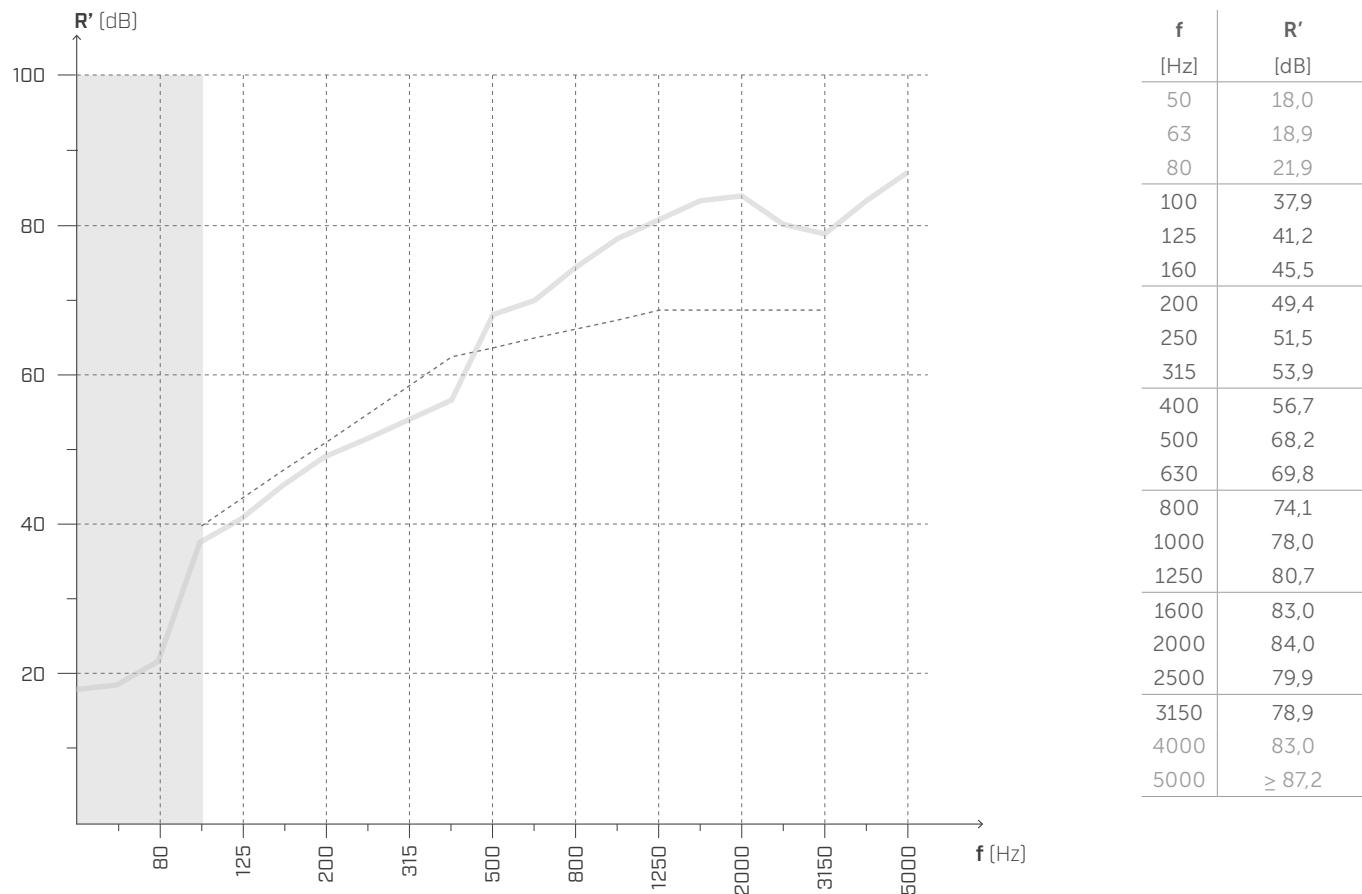


$$R'_w (C; C_{tr}) = \mathbf{62} \, (-1; -8) \, \text{dB}$$

$$\text{FSTC} = \mathbf{63}$$


Responsible for measurements: University of Bologna.
Test protocol: test 26/09/2017.

ON-SITE MEASUREMENT | CLT FLOOR 8

AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

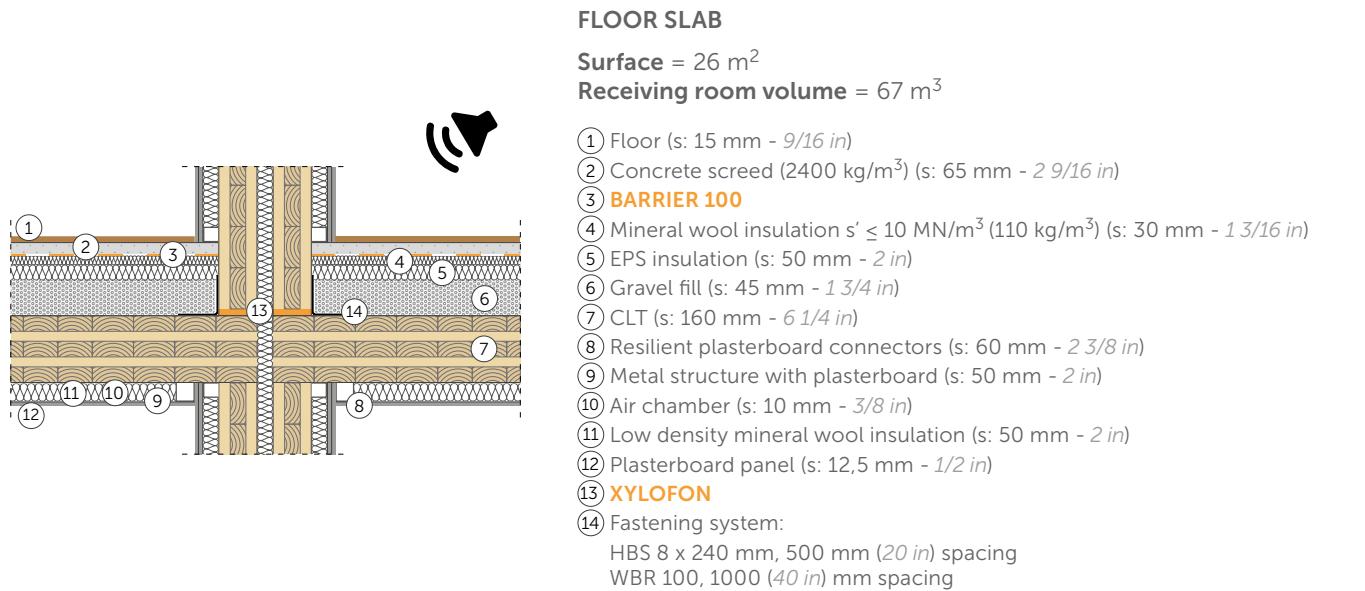

AIRBORNE SOUND INSULATION

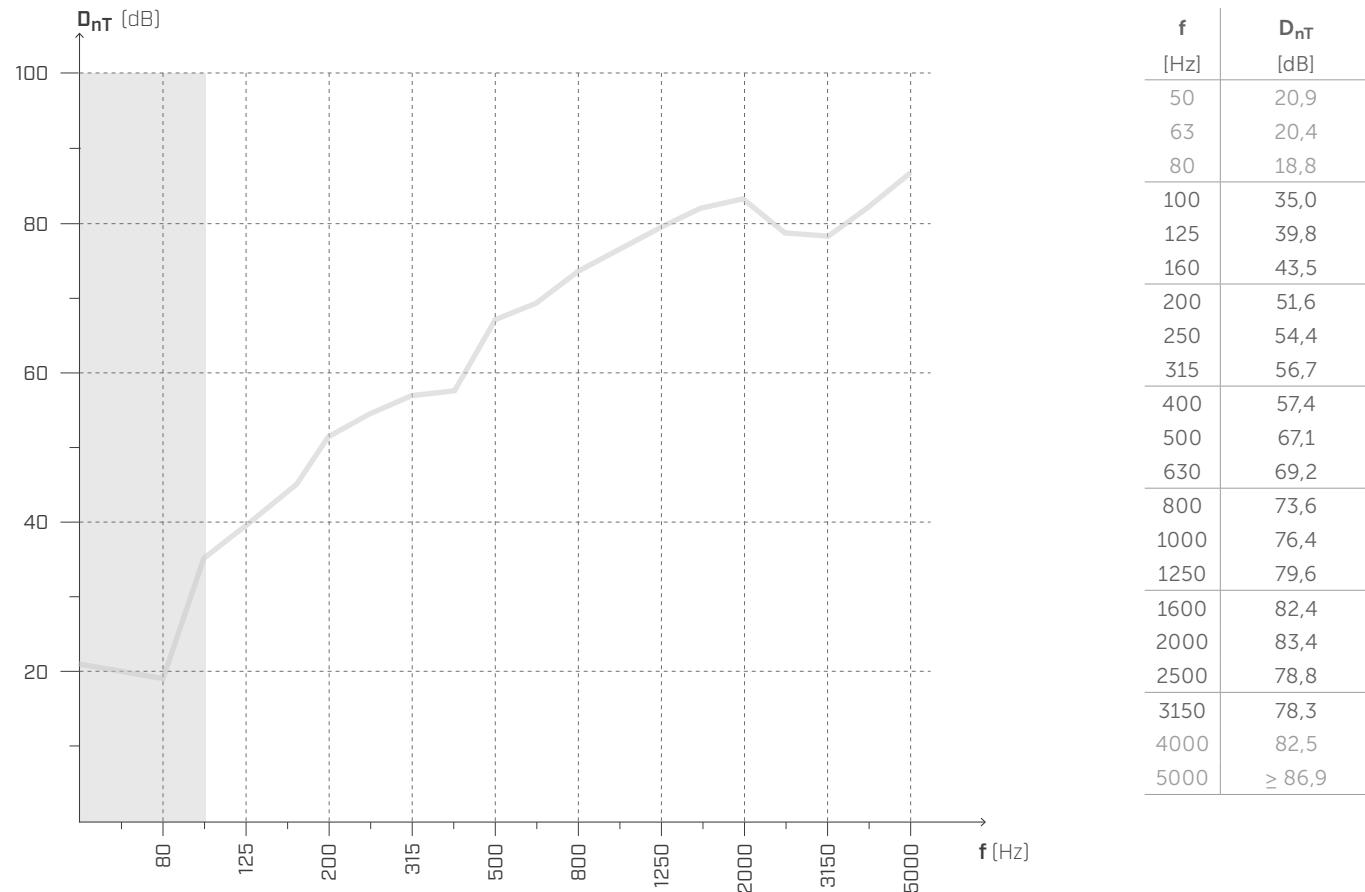

$$D_{nT,w} (C; C_{tr}) = \mathbf{62 \, (-2;-9) \, dB}$$

$$FSTC = \mathbf{63}$$

Responsible for measurements: University of Bologna.
 Test protocol: test 26/09/2017.


ON-SITE MEASUREMENT | CLT FLOOR 8

IMPACT SOUND INSULATION ACCORDING TO ISO 16283-2

FLOOR SLAB


Surface = 26 m²

Receiving room volume = 67 m³

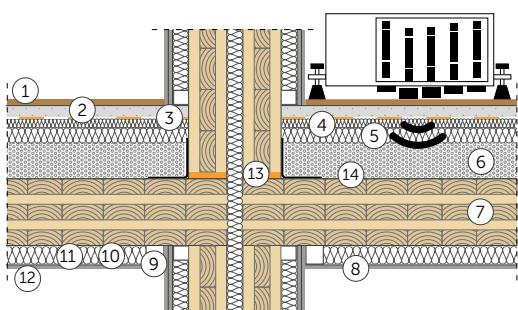

- ① Floor (s: 15 mm - 9/16 in)
- ② Concrete screed (2400 kg/m³) (s: 65 mm - 2 9/16 in)
- ③ **BARRIER 100**
- ④ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- ⑤ EPS insulation (s: 50 mm - 2 in)
- ⑥ Gravel fill (s: 45 mm - 1 3/4 in)
- ⑦ CLT (s: 160 mm - 6 1/4 in)
- ⑧ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)
- ⑨ Metal structure with plasterboard (s: 50 mm - 2 in)
- ⑩ Air chamber (s: 10 mm - 3/8 in)
- ⑪ Low density mineral wool insulation (s: 50 mm - 2 in)
- ⑫ Plasterboard panel (s: 12,5 mm - 1/2 in)
- ⑬ **XYLOFON**
- ⑭ Fastening system:
HBS 8 x 240 mm, 500 mm (20 in) spacing
WBR 100, 1000 (40 in) mm spacing

IMPACT SOUND INSULATION

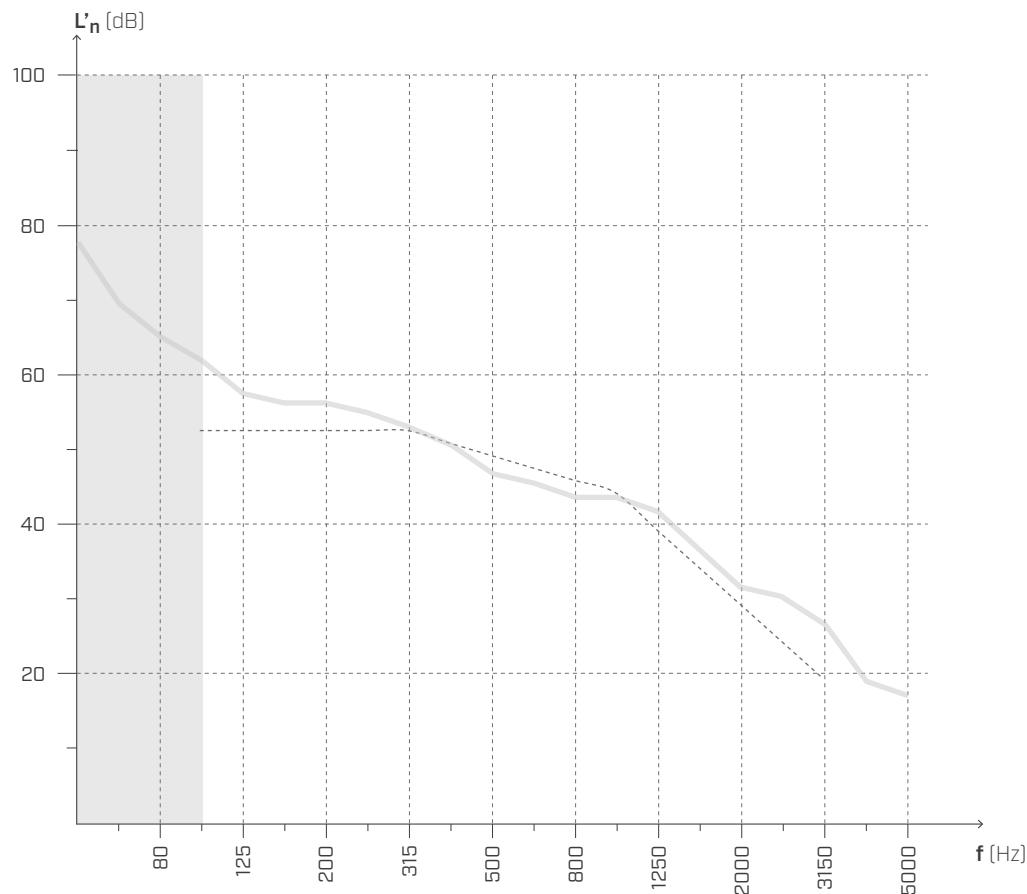

$$L'_{n,w} (C_l) = \mathbf{50 (1;) dB}$$

$$IIC = \mathbf{58}$$

Responsible for measurements: University of Bologna.
Test protocol: test 26/09/2017.


ON-SITE MEASUREMENT | CLT FLOOR 8

IMPACT SOUND INSULATION ACCORDING TO ISO 16283-2

FLOOR SLAB


Surface = 26 m²

Receiving room volume = 67 m³

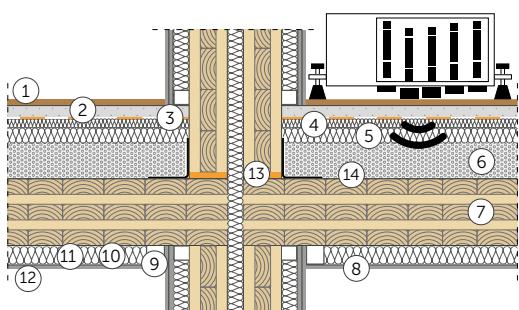

- ① Floor (s: 15 mm - 9/16 in)
- ② Concrete screed (2400 kg/m³) (s: 65 mm - 2 9/16 in)
- ③ **BARRIER 100**
- ④ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (s: 30 mm - 1 3/16 in)
- ⑤ EPS insulation (s: 50 mm - 2 in)
- ⑥ Gravel fill (s: 45 mm - 1 3/4 in)
- ⑦ CLT (s: 160 mm - 6 1/4 in)
- ⑧ Resilient plasterboard connectors (s: 60 mm - 2 3/8 in)
- ⑨ Metal structure with plasterboard (s: 50 mm - 2 in)
- ⑩ Air chamber (s: 10 mm - 3/8 in)
- ⑪ Low density mineral wool insulation (s: 50 mm - 2 in)
- ⑫ Plasterboard panel (s: 12,5 mm - 1/2 in)
- ⑬ **XYLOFON**
- ⑭ Fastening system:
HBS 8 x 240 mm, 500 mm (20 in) spacing
WBR 100, 1000 (40 in) mm spacing

IMPACT SOUND INSULATION

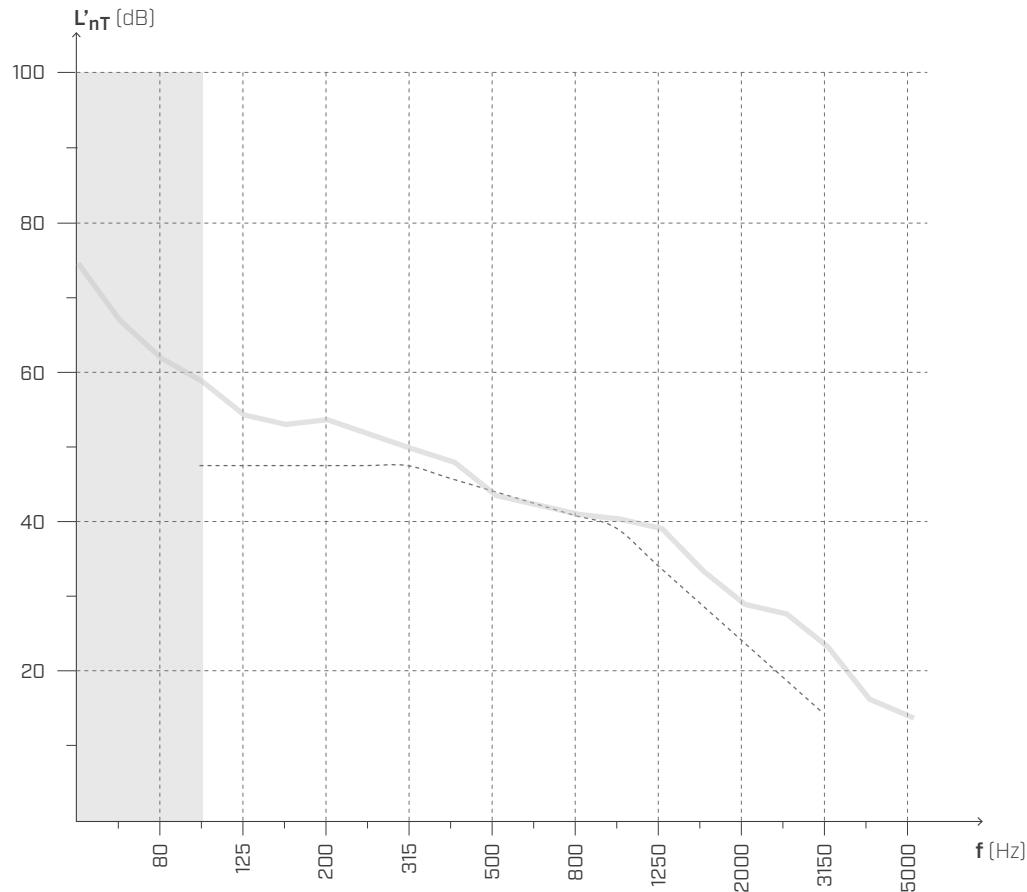

$$L'_{nT,w} (C_l) = \mathbf{47 (1) dB}$$


$$AIC = \mathbf{58}$$

Responsible for measurements: University of Bologna.
Test protocol: test 26/09/2017.

ACOUSTIC AND MECHANICAL INTERACTION

ACOUSTIC - MECHANICAL BEHAVIOR OF TITAN SILENT

The TITAN SILENT system has been tested in order to determine its mechanical and acoustic behaviour. The experimental campaigns carried out within the Seismic-Rev project and in collaboration with multiple research institutes, have shown how the characteristics of the resilient profile influence the mechanical performance of the connection. From an acoustic point of view, with the Flanksound project, it has been demonstrated that the ability to dampen vibrations through the joint is strongly influenced by the type and number of connections.

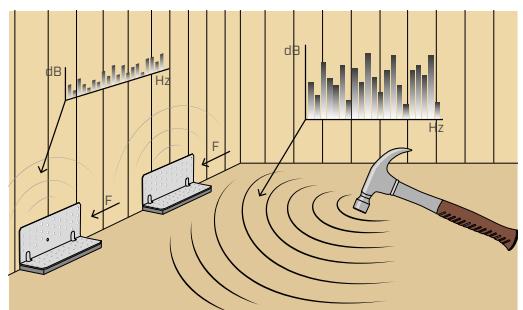


EXPERIMENTAL INVESTIGATION: MECHANICAL BEHAVIOUR

Within the Seismic-Rev project, in collaboration with the University of Trento and the Institute for BioEconomy (IBE - San Michele all'Adige), an investigation project was launched to evaluate the mechanical behaviour of TITAN angle brackets used in combination with different soundproofing profiles.



FIRST LABORATORY PHASE

Monotonic shear tests were carried out, in the first experimental phase, using linear loading procedures in displacement control, aimed at evaluating the variation in ultimate strength and stiffness offered by the TTF200 connection with LBA Ø4 x 60 mm nails.

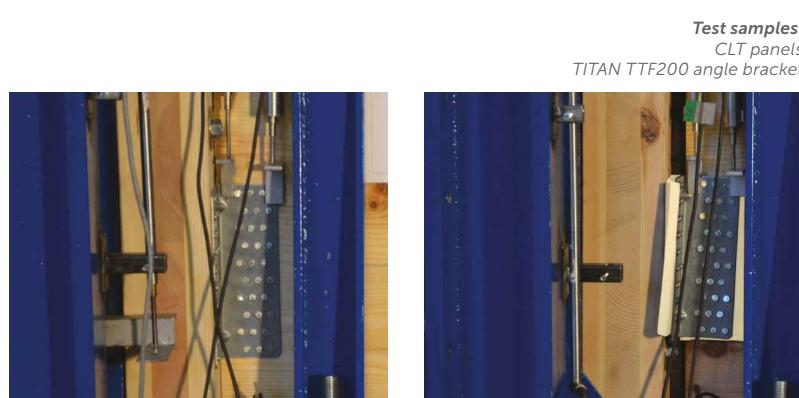


NUMERIC MODELLING

The results of the preliminary investigation campaign highlighted the importance of carrying out more accurate analyses of the influence of acoustic profiles on the mechanical behaviour of TTF200 and TTN240 metal angle brackets in terms of overall strength and stiffness. For this reason it was decided to carry out further evaluations by means of finite element numerical modelling, starting from the behaviour of the individual nail. In the case under study, the influence of three different resilient profiles were analyzed: XYLOFON 35 (6 mm), ALADIN STRIPE SOFT (5 mm) and ALADIN STRIPE EXTRA SOFT (7 mm).

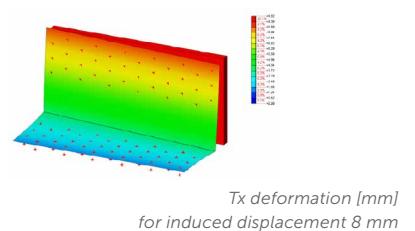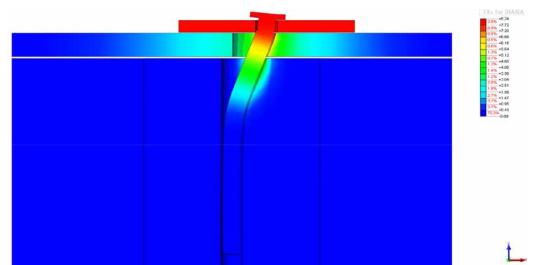

SECOND LABORATORY PHASE

Laboratory tests were carried out at this phase in accordance with requirements of EN 26891. The TITAN SILENT mock-up, assembled with different TITAN angle brackets in combination with the resilient profile XYLOFON 35 (6 mm), have been brought to failure to investigate the maximum load, the load at 15 mm and the relative displacements, without load influence and therefore crushing effects on the acoustic profile (maximum gap between the plate and the timber panel).

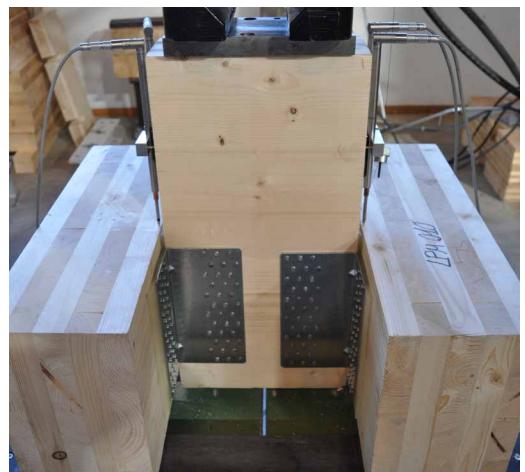

Test samples:
5-layer CLT panels
TITAN angle brackets with full fastening
TTF200 - TTN240 - TTS240 - TTV240
XYLOFON 35 resilient profile


VARIATION OF MECHANICAL SHEAR STRENGTH AS A FUNCTION OF SOUNDPROOFING PROFILE

The comparison of the results between the different configurations analysed is reported in terms of load variation at 15 mm displacement ($F_{15 \text{ mm}}$) and elastic stiffness at 5 mm ($K_{s,5 \text{ mm}}$).

TITAN TTF200

configurations	sp [mm]	$F_{15 \text{ mm}}$ [kN]	$\Delta F_{15 \text{ mm}}$	$K_{5 \text{ mm}}$ [kN/mm]	$\Delta K_{5 \text{ mm}}$
TTF200	-	68,4	-	9,55	-
TTF200 + ALADIN STRIPE SOFT red.*	3	59,0	-14 %	8,58	-10 %
TTF200 + ALADIN STRIPE EXTRA SOFT red.*	4	56,4	-18 %	8,25	-14 %
TTF200 + ALADIN STRIPE SOFT	5	55,0	-20 %	7,98	-16 %
TTF200 + XYLOFON PLATE	6	54,3	-21 %	7,79	-18 %
TTF200 + ALADIN STRIPE EXTRA SOFT	7	47,0	-31 %	7,30	-24 %
TTF200 + XYLOFON PLATE - test 003	6	54,2	-21 %	5,49	-43 %


* Reduced thickness: reduced profile height due to the trapezoidal section and consequent crushing induced by the head of the nail during operation.

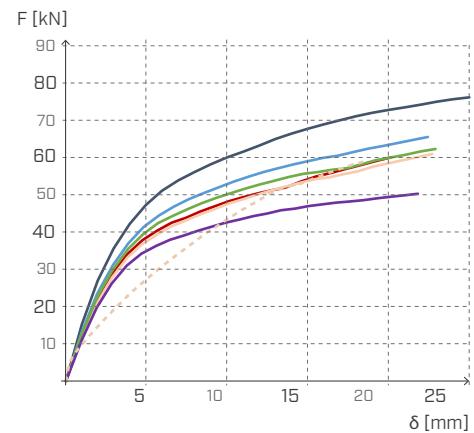

TITAN TTN240

configurations	sp [mm]	$F_{15 \text{ mm}}$ [kN]	$\Delta F_{15 \text{ mm}}$	$K_{5 \text{ mm}}$ [kN/mm]	$\Delta K_{5 \text{ mm}}$
TTN240	-	71,9	-	9,16	-
TTN240 + ALADIN STRIPE SOFT red.*	3	64,0	-11 %	8,40	-8 %
TTN240 + ALADIN STRIPE EXTRA SOFT red.*	4	61,0	-15 %	8,17	-11 %
TTN240 + ALADIN STRIPE SOFT	5	59,0	-18 %	8,00	-13 %
TTN240 + XYLOFON PLATE	6	58,0	-19 %	7,81	-15 %
TTN240 + ALADIN STRIPE EXTRA SOFT	7	53,5	-26 %	7,47	-18 %
TTN240 + XYLOFON PLATE - test 001	6	61,5	-15%	6,19	-32%

* Reduced thickness: reduced profile height due to the trapezoidal section and consequent crushing induced by the head of the nail during operation.

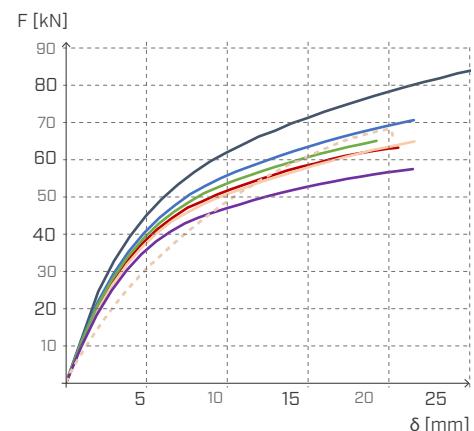

EXPERIMENTAL RESULTS

The results obtained show a reduction in the strength and stiffness of the devices following the interposition of the soundproofing profiles. This variation is highly dependent on the thickness of the profile. In order to limit the reduction of strength it is necessary to adopt profiles with real thickness of approximately 6 mm or less.

SHEAR AND TENSILE STRENGTH OF NINO AND TITAN SILENT CERTIFIED IN ETA

Not only experimental tests, but also values certified by independent assessment bodies that certify the performance characteristics of non-standard construction products.

TITAN

The strength of TITAN coupled with XYLOFON PLATE below the horizontal flange was calculated from the load-carrying capacity of nails or screws according to "Blaß, H.J. und Laskewitz, B. (2000); Load-Carrying Capacity of Joints with Dowel-Type fasteners and Interlayers.", conservatively neglecting the profile stiffness.


Being an innovative angle bracket and one of the first certified on the market, a highly conservative approach was chosen and XYLOFON was simulated as an equivalent air layer. The angular capacity is therefore largely underestimated.



ANGLE BRACKET	type	fastening			$F_{2/3,Rk}$ [kN]
		$\varnothing \times L$ [mm]	n_V [pcs]	n_H [pcs]	
TTN240 + XYLOFON PLATE	LBA nails	4 x 60	36	36	24,8
	LBS screws	5 x 50	36	36	22,8
TTS240 + XYLOFON PLATE	HBS PLATE screws	8 x 80	14	14	12,5
TTF200 + XYLOFON PLATE	LBA nails	4 x 60	30	30	17,2
	LBS screws	5 x 50	30	30	15,8


TIMBER-TO-TIMBER FASTENING PATTERN

TTN240




36 LBA nails/LBS screws

TTS240




14 LBA nails/LBS screws

TTF200




30 LBA nails/LBS screws



30 LBA nails/LBS screws

Discover the complete **TITAN** range on our website or request the catalogue from your salesman.

www.rothoblaas.com

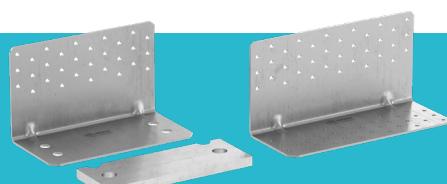


NINO

The strength of NINO coupled with XYLOFON PLATE was defined through a series of experimental tests carried out in collaboration with the Institute for BioEconomy (CNR-IBE in San Michele all'Adige). This made it possible to increase the technical know-how and refine the assessment method, thus obtaining resistances that take into account the real behaviour of the angle bracket.


ANGLE BRACKET	type	fastening				$F_{1,Rk}$	$F_{2/3,Rk}$
		$\varnothing \times L$ [mm]	n_V [pcs]	n_H [pcs]	n VGS Ø9		
NINO100100 + XYLOFON PLATE	LBA nails	4 x 60	14	13	2	20	34,6
	LBS screws	5 x 50	14	13	2	20	16,9
NINO15080 + XYLOFON PLATE	LBA nails	4 x 60	20	11	3	37,2	34,6
	LBS screws	5 x 50	20	11	3	37,2	25,5
NINO100200 + XYLOFON PLATE	LBA nails	4 x 60	21	13	3	41,2	18,7
	LBS screws	5 x 50	21	13	3	41,2	17,2

TIMBER-TO-TIMBER FASTENING PATTERN

NINO100100




14 LBA nails/LBS screws




2 VGS screws Ø9

13 LBA nails/LBS screws

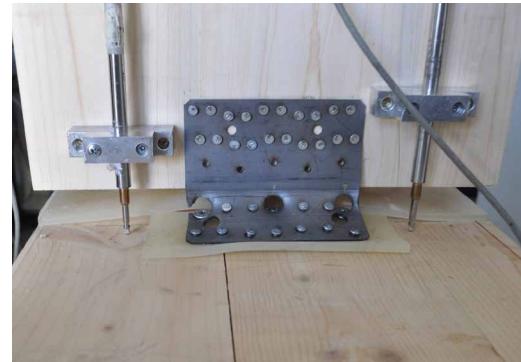


Monotonic tensile test (F_1) on NINO15080 in timber-to-timber configuration.

NINO15080



21 LBA nails/LBS screws




3 VGS screws Ø9

13 LBA nails/LBS screws




Monotonic shear test ($F_{2/3}$) on NINO15080 in timber-to-timber configuration.

NINO100200




20 LBA nails/LBS screws



3 VGS screws Ø9

11 LBA nails/LBS screws

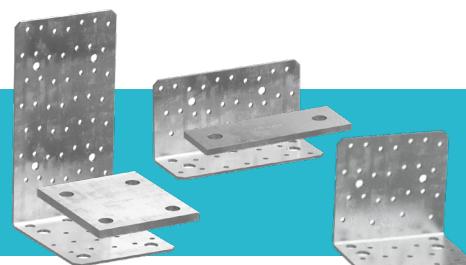

Discover the complete **NINO** range on our website or request the catalogue from your salesman.

www.rothoblaas.com


MECHANICAL INTERACTION AND FRICTION

For Rothoblaas, identifying the mechanical behaviour of solutions used in wood structures is a subject that doesn't allow for compromise. In this view, two research projects were developed in cooperation with two Austrian universities: Technische Universität Graz in Graz and Fakultät für Technische Wissenschaften in Innsbruck.


XYLOFON WOOD FRICTION

With the University of Graz, the goal was to characterise the static friction coefficient between wood and XYLOFON. In particular, XYLOFON profiles of various shores, combining different timber species. CLT elements (5 layers with 20 mm thick planks) made of spruce, classified as a soft wood, and of birch, from the semi-hardwood family, were used for the test setups. In addition to investigating the various wood types, an attempt was also made to understand how wood humidity influences the friction coefficient.

Below are some example values obtained from the tests performed on XYLOFON 70. An additional variable was then considered, representing the vertical load acting upon the acoustic profiles, reproduced in the test through a pre-load induced on the CLT panel system being evaluated.

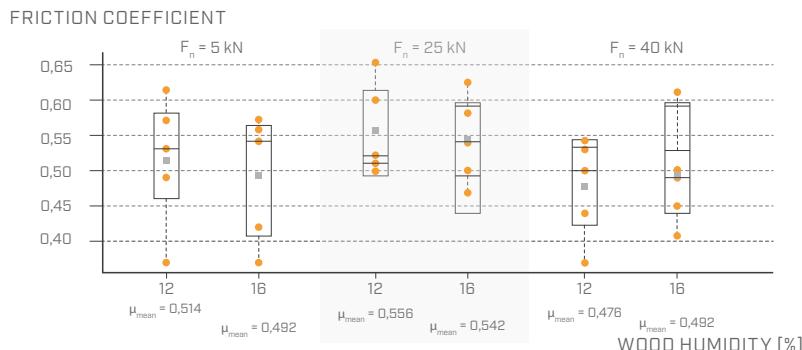

For each configuration, graphs demonstrating the movement/friction coefficient μ were plotted, to understand to what degree it is useful to consider the contribution of friction for static purposes.

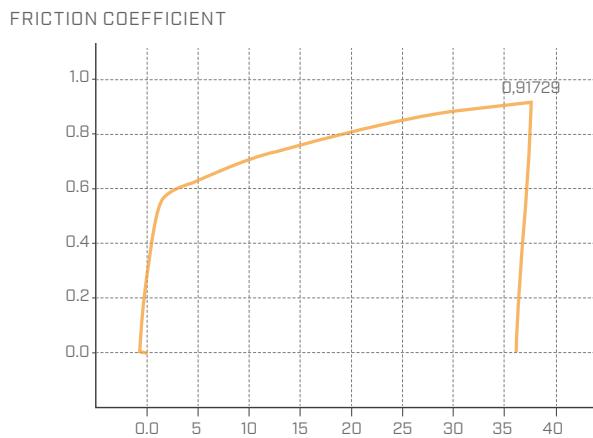


MECHANICAL INTERACTION XYLOFON AND HBS PARTIAL THREAD SCREWS


Having investigated the influence of the resilient profile on the mechanical strengths of the shear angle brackets (TITAN), the behaviour of partially threaded screws was investigated in the same context.

The test completes the investigation into the characterisation of acoustic behaviour under static and/or mechanical stress.

The image below shows the test set-up used for the research. It was decided to investigate various XYLOFON shores, also in order to understand how much the hardness of the material affects the variation in the resistance and stiffness to shearing of the connection with partial thread screws.

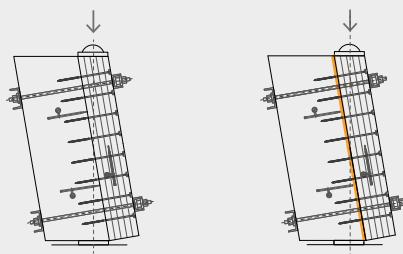

Through experimental testing and analytical approaches, the mechanical and deformation performance of connections between CLT panels — made with 8x280 HBS screws installed with/without XYLOFON WASHER separating washers — was analysed with and without the use of resilient, intermediate XYLOFON35 decoupling profiles.

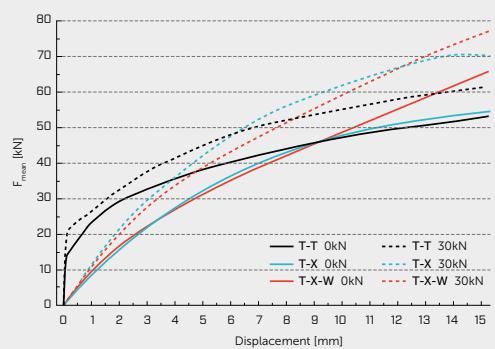

- The full scientific report on the experimental testing is available at Rothoblaas.
- Experimental testing conducted in collaboration with Technische Versuchs und Forschungsanstalt (TVFA), Innsbruck.

INFLUENCE OF MECHANICAL FASTENING USING STAPLES

This test had the aim of determining the influence of the staples used to fasten the XYLOFON product onto CLT panels during construction.

Tests were carried out by the University of Bologna - Industrial Engineering Department, completing the tests begun during the first edition of the Flanksound Project.

TEST SETUP

The measurement system consisted of a horizontal CLT panel to which two vertical panels were applied, as in the diagram (figure 1). Each panel was connected with 6 vertical HBS 8 x 240 screws and 2 TITAN SILENT TTF220 angle brackets with LBS 5 x 50 screws per side (figure 2).

A strip of XYLOFON 35 resilient material was applied on the contact surface of both panels.

On the left panel, the XYLOFON was fastened with staples applied in pairs stepped 20 cm, while they were not used on the panel on the right.

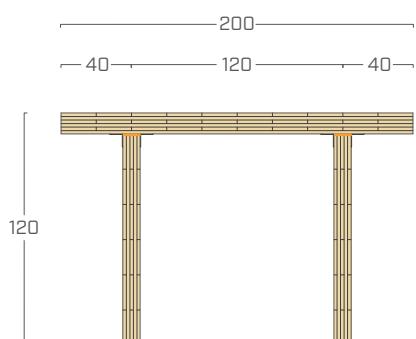


fig. 1


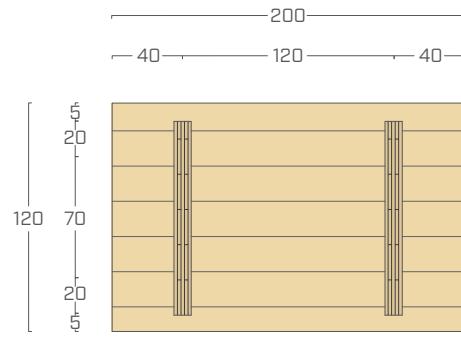


fig. 2

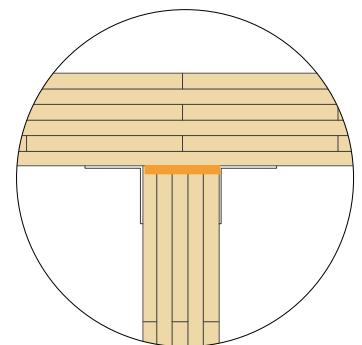


CONSIDERATIONS

Given the smaller size of the panels, it was decided to use $D_{v,ij,n}$ as the index, given that only geometric dimensions are used to average out the difference in vibration speed levels.

Precisely due to the small size, use of K_{ij} as the comparison parameter is not recommended, given the effect of internal resonance between the panels.

The values were averaged between 125 and 1000 Hz.

It is also worth remembering that the uncertainty associated with the testing method used is ± 2 dB, as indicated in ISO/FDIS 12354-1:2017.

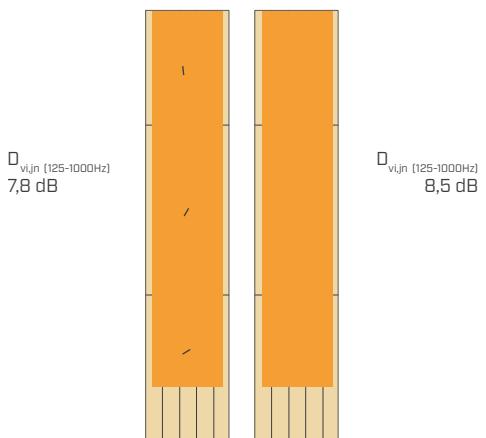

The results show that the use of staples for prefixing the resilient strip **does not result in a substantial difference** between the $D_{v,ij,n}$ values for the same panel fixing systems.

$D_{v,ij,n} (125-1000Hz) = 7,8 \text{ dB}$
panel **with staples**

$D_{v,ij,n} (125-1000Hz) = 8,5 \text{ dB}$
panel **without staples**

FIRE SAFETY IN MULTI-STORY BUILDINGS

Rothoblaas participated in the research project "**Fire Safe implementation of visible mass timber in tall buildings - compartment fire testing**" coordinated by Research Institutes of Sweden (RISE).

The project aims to perform a series of tests on CLT compartments in order to define the fire performance of timber structures and, if necessary, identify additional measures to ensure fire safety.

The objectives also included the definition of protection criteria for multi-storey buildings and the verification of timber joints directly exposed to fire.

TEST SETUP

For this study, five tests were performed on compartments with internal dimensions 23.0 x 22.5 x 9.0 ft (7,0 x 6,85 x 2,73 m).

Four of these compartments (test ①, ②, ③ and ⑤) had two ventilation openings of 7.4 x 5.8 ft (2,25 x 1,78 m) resulting in an opening factor of 0.112 ft^{1/2} (0,062 m^{1/2}).

The remaining test (④) had six larger openings, resulting in an opening factor of 0.453 ft^{1/2} (0.25 m^{1/2}), which is approximately the average of office compartment opening factors.

The matrix of the tests performed is shown on the following page.



Photo of the compartment at the end of assembly, before starting the test




Photo of the compartment after switching on



Photo of the compartment during the test

The tests were stopped after 4 hours and the test is considered passed if the following requirements are fulfilled:



after 4 hours temperatures are below 300°C



no secondary flashover after 3 hours



D. Brandon, J. Sjöström, A. Temple, E. Hallberg, F. Kahl, "**Fire Safe implementation of visible mass timber in tall buildings – compartment fire testing**", RISE Report 2021:40




MATRIX OF THE TESTS PERFORMED

TEST 1 - configuration

Exposed surface


ceiling	100%
beam	100%
left wall	0%
right wall	0%
front wall	0%
column	0%

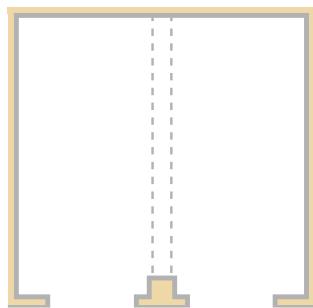

TEST 2 - configuration

Exposed surface


ceiling	100%
beam	100%
left wall	100%
right wall	100%
front wall	0%
column	0%

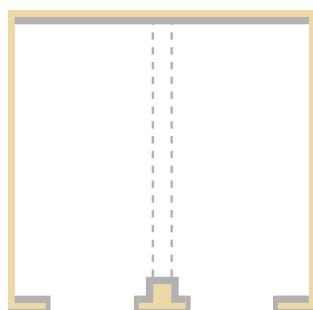

TEST 3 - configuration

Exposed surface


ceiling	100%
beam	100%
left wall	100%
right wall	78%
front wall	100%
column	100%

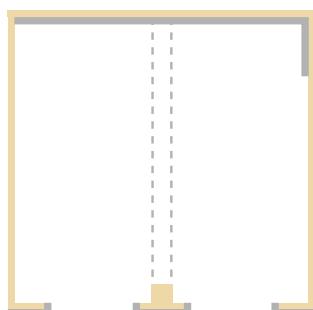

TEST 4 - configuration

Exposed surface


ceiling	100%
beam	100%
left wall	100%
right wall	100%
front wall	100%
column	100%

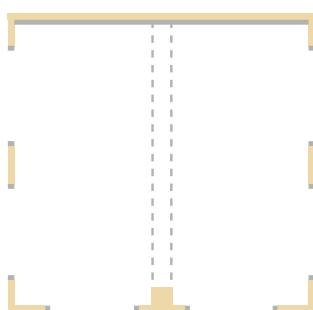

TEST 5 - configuration


Exposed surface

ceiling	100%
beam	100%
left wall	100%
right wall	100%
front wall	60%
column	100%

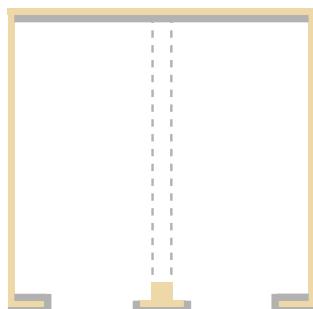

JOINTS AND INTERFACES

Various Rothoblaas sealants were used for the test, some of which were developed to improve air-tightness and/or acoustic performance. The test results show that these products are suitable for preventing the spread of fire through joints.

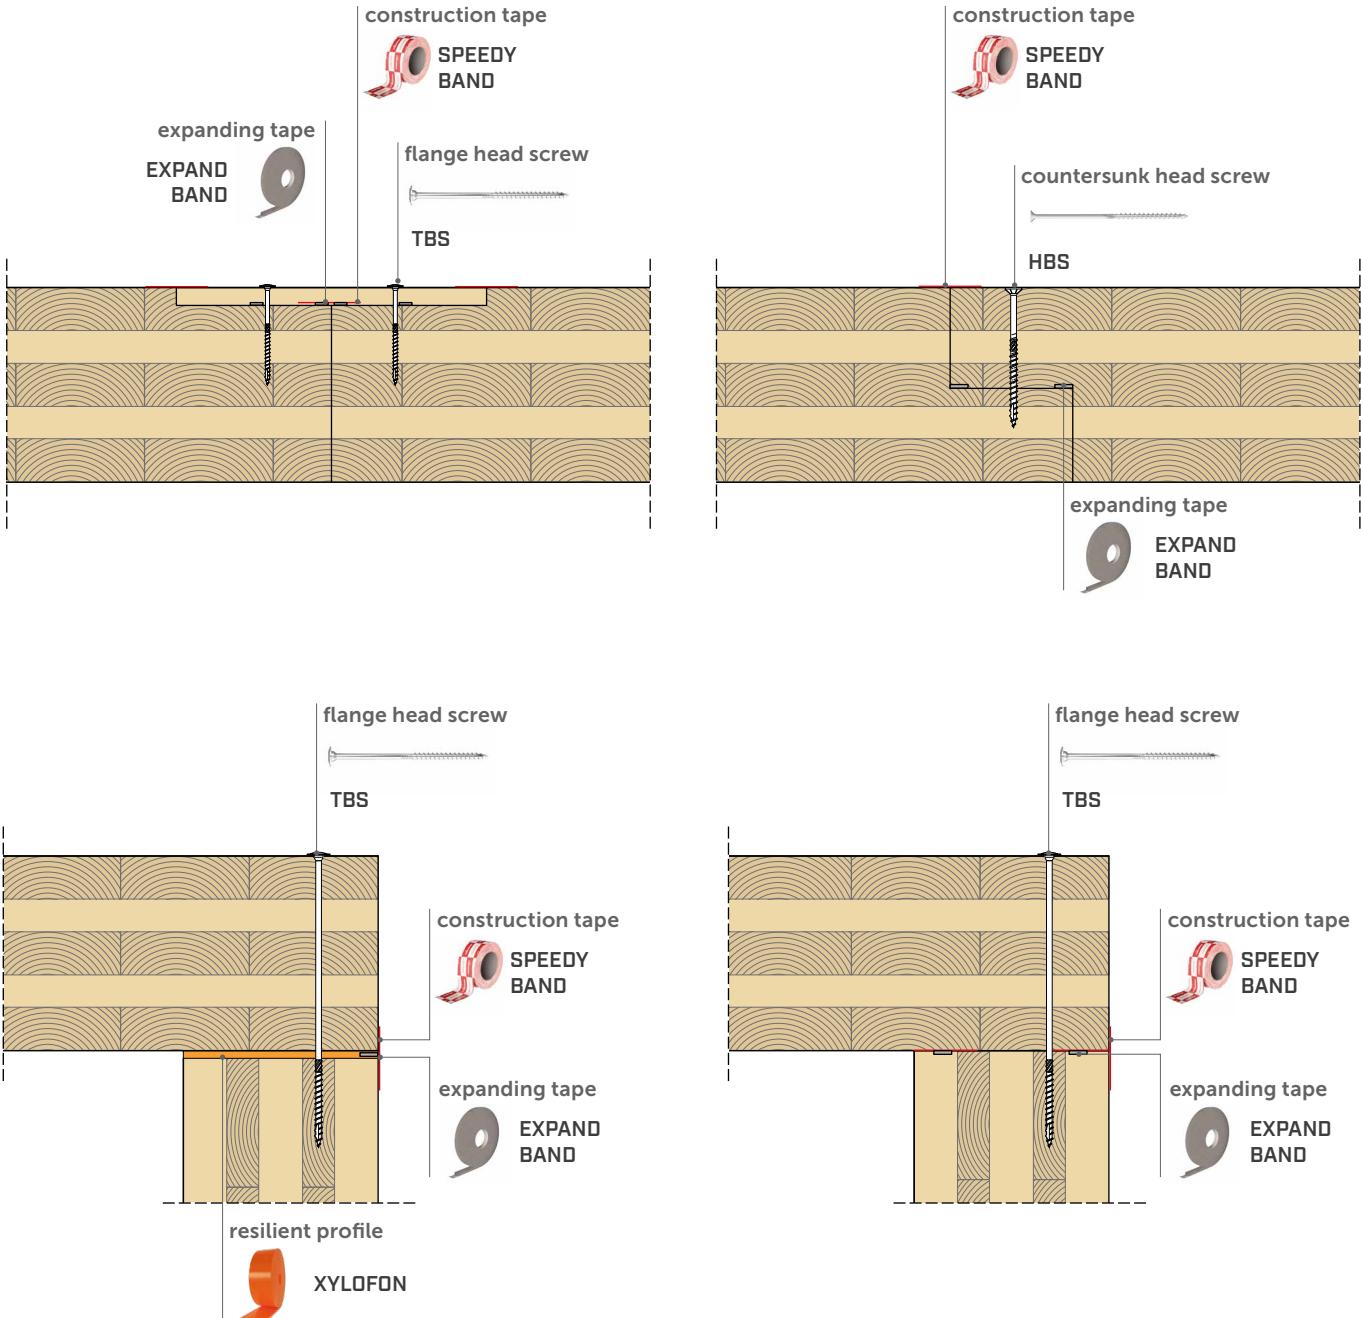

XYLOFON AND FIRE

Over the last few years, an architectural need to keep CLT visible for aesthetic reasons has developed. In this case, the XYLOFON product should be placed slightly set back from the wood surface, creating a shadow effect. In this configuration, XYLOFON contributes to the structure's fire resistance.

To test this feature, tests were performed to characterise its airtightness and fire insulation behaviour (EI) at ETH Zürich and the Institute of Structural Engineering (IBK) & Swiss Timber Solutions AG.

TEST SETUP

It was decided to test both XYLOFON on its own and the product with two different flame retardant sealants. The sample was prepared by dividing a laminated panel into 4 pieces, so as to create 3 openings to accommodate the 3 different configurations:


XYLOFON
XYLOFON + SEALANT 1
XYLOFON + FIRE SEALING SILICONE

During assembly, thermocouples were inserted to record the change in temperatures at various depths of the sample during the fire phase. Once the fire was started, the data was registered and the trend in the thermal change was tracked on a temperature/time graph, which was also compared to the standardised EN ISO curve. The graph at the right shows the temperatures recorded on the PT1, PT2, PT3, PT4 and PT5 thermocouples.




TEST JOINTS

XYLOFON

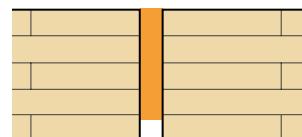


XYLOFON + FIRE SEALING

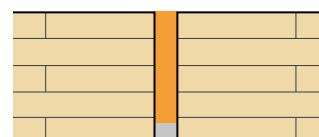


REAL JOINTS

XYLOFON



XYLOFON + FIRE SEALING



CONSIDERATIONS

The test was stopped after 60 minutes of exposure to fire, based on the EN ISO standard. For all configurations tested, the temperature of the surface not exposed to fire remained approximately at room temperature, not showing any colour alteration. The opening which contained solely 100 mm XYLOFON, as predicted, showed the greatest loss of thickness due to carbonisation. The junctions with 20 mm of sealant 1 and FIRE SEALING SILICONE, together with the 100 mm XYLOFON strip showed similar temperature gradients. The presence of XYLOFON does not affect the fire behaviour of the joint.

It can be stated that the solution with 100 mm wide **XYLOFON** can achieve **EI 60** without the need for additional flame retardant protection



IPIANO

TECHNICAL MANUAL



rothoblaas

Solutions for Building Technology

CONTENTS

PRODUCT CHOICE AND DETERMINATION OF K_{ij}	106
EUROPEAN TECHNICAL ASSESSMENT (ETA)	108
THE CEN MODEL (EN ISO 12354)	130
DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES	131
THE SIMPLIFIED METHOD	132
<i>T-JOINT PERIMETER WALLS</i>	134
<i>T-JOINT PERIMETER WALLS</i>	135
SOLUTIONS FOR LIGHTWEIGHT FLOORS	136
<i>LABORATORY MEASUREMENT DRY FLOOR SLAB_1</i>	137
<i>LABORATORY MEASUREMENT DRY FLOOR SLAB_2</i>	138
<i>COMPARATIVE ANALYSIS DRY FLOOR SLAB_2</i>	139



CODES AND DIMENSIONS

CODE	B [mm]	L [m]	s [mm]	pcs
PIANO A4040	80	10	6	1
PIANO A5050	100	10	6	1
PIANO A6060	120	10	6	1
PIANO A140	140	10	6	1
PIANO B4040	80	10	6	1
PIANO B5050	100	10	6	1
PIANO B6060	120	10	6	1
PIANO B140	140	10	6	1
PIANO C080	80	10	6	1
PIANO C100	100	10	6	1
PIANO C120	120	10	6	1
PIANO C140	140	10	6	1
PIANO D080	80	10	6	1
PIANO D100	100	10	6	1
PIANO D120	120	10	6	1
PIANO D140	140	10	6	1
PIANO E080	80	10	6	1
PIANO E100	100	10	6	1
PIANO E120	120	10	6	1
PIANO E140	140	10	6	1



Mechanical performance and elastic behaviour **tested** according to **ETA**

- elastic response of the profile applied in buildings
- elastic response of the profile as vibration damping

page 10



Anti-vibration

PIANO dampens vibrations in both static and dynamic conditions due to its ability to absorb and dissipate the energy of the system.

- application with static loads (e.g. buildings)
- application with dynamic loads (e.g. machines, bridges)

page 12




K_{ij} values entered in ETA

K_{ij} tested for all hardness values and with appropriate fastening system

page 36

$\Delta_{l,ij} > 4 \text{ dB}$



Lightweight floors

PIANO A was tested in combination with the ribbing strips of the lightweight floors.

Measured improvement **7 dB**.

page 40




PRODUCT COMPARISON

products	thickness	acoustic improvement $\Delta_{i,ij}^{(1)}$	elastic modulus in compression E_c
PIANO A	6 mm	> 4 dB	0,23 N/mm ²
PIANO B	6 mm	> 4 dB	1,08 N/mm ²
PIANO C	6 mm	> 4 dB	7,92 N/mm ²
PIANO D	6 mm	> 4 dB	22,1 N/mm ²
PIANO E	6 mm	> 4 dB	24,76 N/mm ²

LEGEND:

- load for acoustic optimisation
- compression at 3 mm deformation (ultimate limit state)

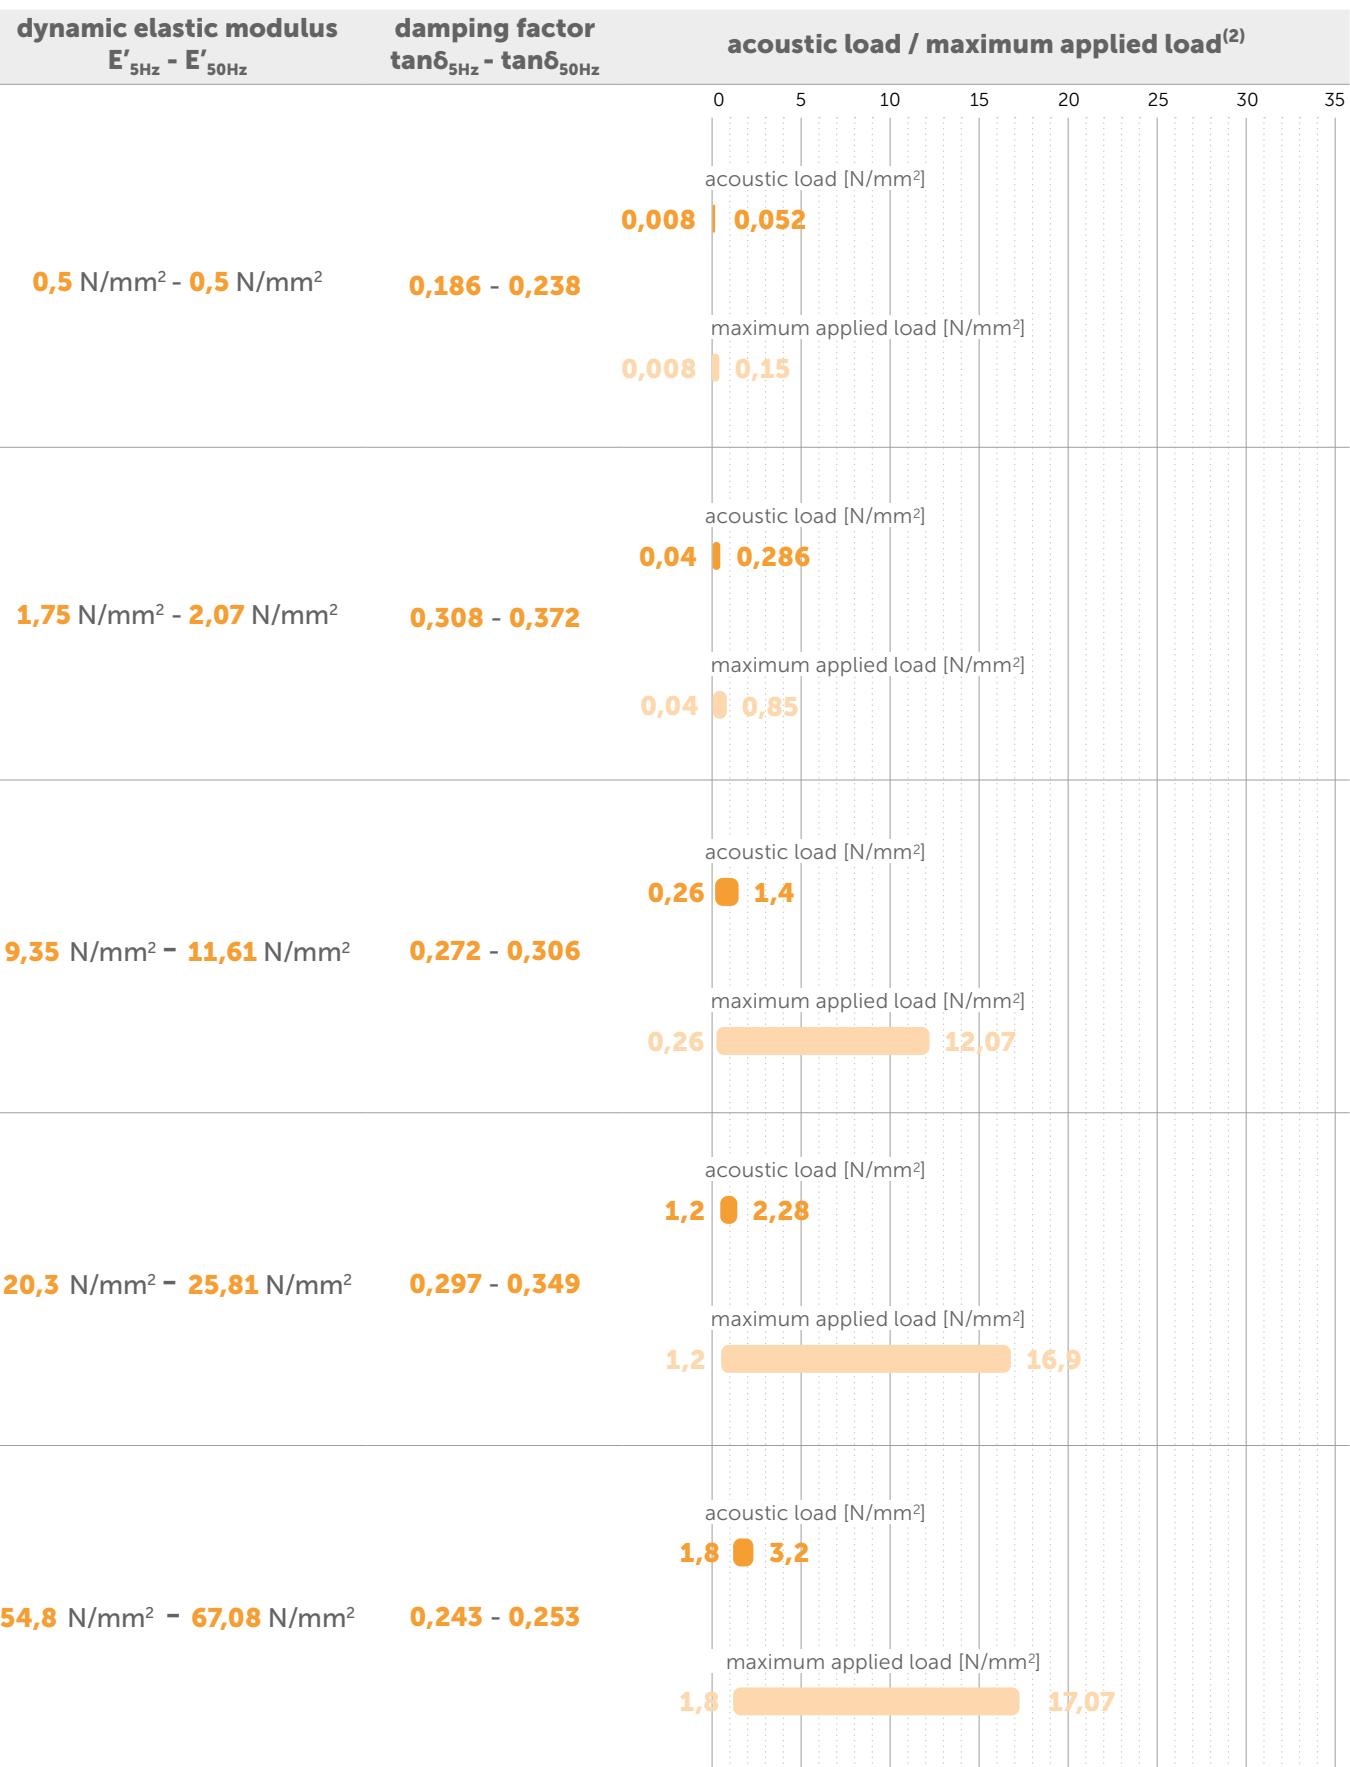

⁽¹⁾ $\Delta_{i,j} = K_{i,j,\text{with}} - K_{i,j,\text{without}}$

⁽²⁾ The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression.

PRODUCT CHOICE AND DETERMINATION OF K_{IJ}

DESIGNING THE CORRECT PROFILE ACCORDING TO THE LOAD

Resilient profiles must be correctly loaded in order to isolate the low to medium frequencies of structurally transmitted vibrations: guidance on how to proceed with the evaluation of the product are given below.

It is advisable to add the permanent load value at 50% of the characteristic value of the accidental load.

$$Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$$

It is necessary to focus on the operating conditions and not the ultimate limit state conditions. This is because the goal is to insulate the building from noise during normal operating conditions and not during design limit states.

PRODUCT SELECTION



The product can also be selected using the application tables (see for example the following table for PIANO).

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m] [lb/ft]			compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]		reduction [mm] [mil]		compressive stress at 3 mm (ultimate limit state) [N/mm ²] [psi]
		min	max	min	max	min	max		
PIANO A4040	80	0,64	472	4,16	3068	0,008 1,2	0,052 7,5	0,2 8	1,35 53
	40 (divided)	0,32	236	2,08	1534				
PIANO A5050	100	0,8	590	5,2	3835	0,008 1,2	0,052 7,5	0,2 8	1,35 53
	50 (divided)	0,4	295	2,6	1918				
PIANO A6060	120	0,96	708	6,24	4602	0,008 1,2	0,052 7,5	0,2 8	1,35 53
	60 (divided)	0,48	354	3,12	2301				
PIANO A140	140	1,12	826	7,28	5369				


Note: The static behaviour of the material in compression is evaluated, considering that the deformations due to the loads are static. This is because a building is not affected by significant movement phenomena, nor dynamic deformation.

Rothoblaas has chosen to define a load range that allows good acoustic performance and avoids excessive deformation and differential movements in the materials, including the building's final architectural finishes. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

DETERMINATION OF PERFORMANCE

Once the loads have been identified, it is necessary to determine the design frequency - that is the stimulating frequency for the element from which the structure needs to be isolated. Below is an example, to make the explanation easier and simple to understand.

Suppose there is a load of 0,025 N/mm² acting on the profile. In this case, we used the PIANO A product, because the load is not particularly high. Reading the graph, it can be seen that the profile has a resonance frequency of around 19 Hz.

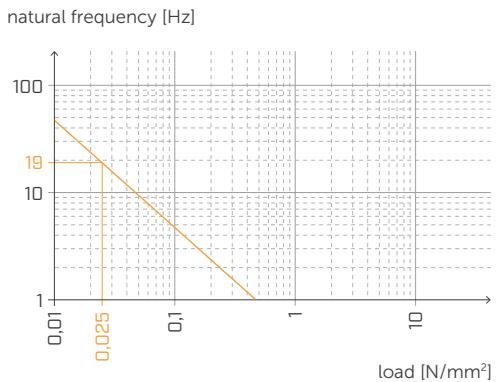


At this point, the degree of transmission for the product under these load conditions can be calculated, referring to the design frequency of 100 Hz.

$$\text{transmission} = f/f_0 = 5,26$$

Then the transmission graph is used, placing the value 5,26 obtained on the x-axis and intersecting the degree of the transmission curve. It follows that the transmission of the material is negative i.e. that the material is able to insulate around -13 dB.


TRANSMISSION IS POSITIVE WHEN THE MATERIAL TRANSMITS AND IS NEGATIVE WHEN THE PROFILE BEGINS TO INSULATE. This means this figure shows that the product, loaded in this way, insulates 13 dB at a reference frequency of 100 Hz.

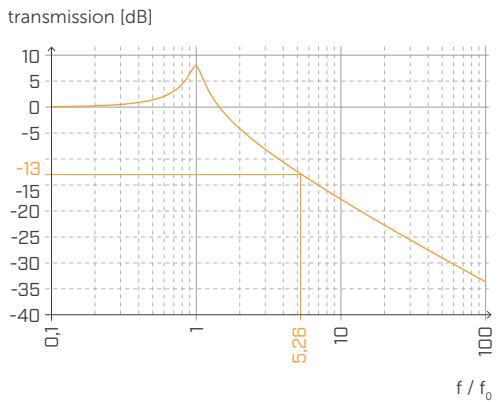

The same thing can be done using the attenuation graph. The percentage of vibration attenuated at the initial design frequency is obtained. The attenuation is also calculated with the load conditions referring to the design frequency of 100 Hz.

$$\text{attenuation} = f/f_0 = 5,26$$

The graph is used by placing the calculated value of 5,26 on the x-axis and intersecting the attenuation curve. It follows that the material's attenuation is optimal, i.e., the material can isolate more than 95 % of the transmission.

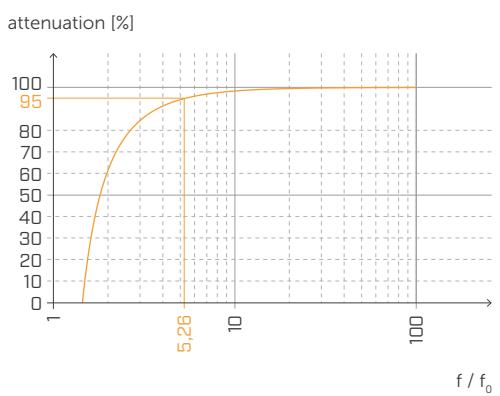

Essentially, the same result is obtained with two different inputs, but when deformation is set, the starting point is the mechanical performance, not the acoustic one.

In the light of this fact, Rothoblaas always recommends starting with the design frequency and the loads to optimise the material based on the real conditions.

EUROPEAN TECHNICAL ASSESSMENT (ETA)

The European Technical Assessment (ETA) provides an **independent procedure at European level** for assessing the essential performance characteristics of non-standard construction products.



OBJECTIVITY AND INDEPENDENCE

Only independent Technical Assessment Bodies (TAB) can issue ETAs. Third-party evaluation enhances the credibility of product performance information, improves **market transparency**, and ensures that the stated values are tested to **precise standards** appropriate for the intended use of the product.



TRANSPARENCY

ETAs provide **reliable product performance information** that can be compared across Europe on the basis of harmonised technical specifications, the European Assessment Documents (EADs). ETAs have made construction products **comparable throughout the European Economic Area** through the provision of detailed product performance information.

PARAMETERS TESTED ACCORDING TO ETA

STATIC AND DYNAMIC MODULUS OF ELASTICITY

Many products on the market have been tested to determine the dynamic elastic modulus and damping factor in order to provide transmissibility graphs according to the natural frequency of the resilient profile.

Since there is no common standard, each manufacturer follows a different procedure, and often the standard used and the test setup are not stated.




Considering the intended use of **PIANO**, the dynamic elastic modulus and damping factor must be determined in compression (there would be no point in defining them according to other deformation methods).

Dynamic elastic modulus and damping factor are measured under dynamic conditions and are relevant for vibration reduction in service equipment or other vibration sources.



In buildings, **PIANO** is subject to static and quasi-static loading, so the dynamic elastic modulus is not as representative of the product's actual behaviour.




Tests show that profile friction could affect the elastic modulus value, and that is why it is necessary to always perform measurements with and without a lubricant to have a value that is independent of boundary conditions (without friction) and a value that is representative of the in situ operating conditions (with friction).



VIBRATION REDUCTION INDEX - K_{ij}

Due to the lack of a common standard, each manufacturer provides K_{ij} values tested in a different configuration (type of joint, number of fastening systems, etc.). Clarifying the test setup and boundary conditions being used is important because the result is strongly influenced by the many variables that define the joint.

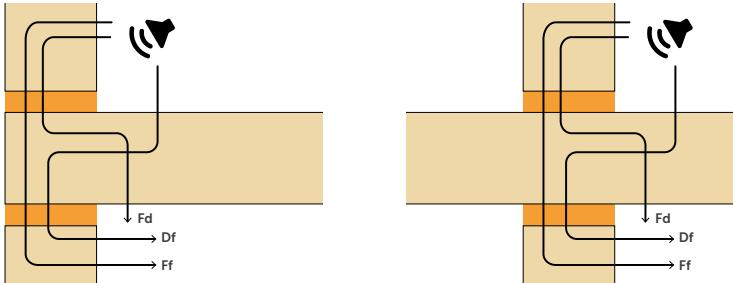


In the European Technical Assessment, the results are expressed clearly to avoid ambiguity in the configuration.



STRESS AND DEFORMATION IN COMPRESSION

From a static point of view, it is important to provide the **compressive stress according to the deformation** (e.g., 1 mm, 2 mm and 3 mm compression) so as to limit the maximum deformation and possible structural failure.

Resilient profiles are subjected to constant loading during their working life, so it is important to estimate the **long-term behaviour** for both static reasons (to avoid differential failure in the structure) and acoustic reasons (a flattened resilient strip does not have the same elastic response and consequently the acoustic performance declines).

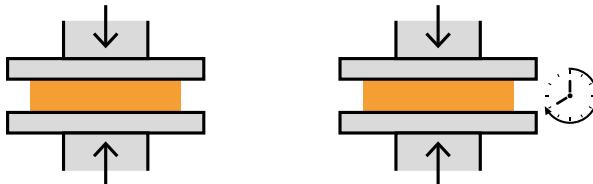

For the same reason, it is important to assess the **final thickness of the product** after compression for a given time and after a recovery period.



Rothoblaas has invested in the development of solutions that follow a multidisciplinary approach and take into account the real conditions of the construction site. Laboratory measurements, static tests and moisture control checks allow the designer to benefit from real performance data and not just theoretical values that have limited practical applications.



PIANO A

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m] from to	compression for acoustic optimisation ⁽²⁾ [N/mm ²] from to	deformation [mm] from to	compression at 3 mm deformation (ultimate limit state) [N/mm ²]
PIANO A4040	80	0,64 4,16			
	40 (divided)	0,32 2,08			
PIANO A5050	100	0,8 5,2	0,008 0,052	0,2 1,35	0,15
	50 (divided)	0,4 2,6			
PIANO A6060	120	0,96 6,24			
	60 (divided)	0,48 3,12			
PIANO A140	140	1,12 7,28			

(1) The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{\text{gk}} + 0.5 q_{\text{vk}}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta_{l,ij}^{(3)}$	ISO 10848	> 4 dB
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	0,23 MPa (0,19 MPa)
Dynamic elastic modulus $E'_{1\text{Hz} - E''1\text{Hz}}$	ISO 4664-1	0,4 - 0,07 MPa
Dynamic elastic modulus $E'_{5\text{Hz} - E''5\text{Hz}}$	ISO 4664-1	0,50 - 0,08 MPa
Dynamic elastic modulus $E'_{10\text{Hz} - E''10\text{Hz}}$	ISO 4664-1	0,5 - 0,09 MPa
Dynamic elastic modulus $E'_{50\text{Hz} - E''50\text{Hz}}$	ISO 4664-1	0,5 - 0,13 MPa
Damping factor $\tan \delta_{1\text{Hz}}$	ISO 4664-1	0,177
Damping factor $\tan \delta_{5\text{Hz}}$	ISO 4664-1	0,186
Damping factor $\tan \delta_{10\text{Hz}}$	ISO 4664-1	0,192
Damping factor $\tan \delta_{50\text{Hz}}$	ISO 4664-1	0,238
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013 / ISO 16534	0,24
Compression set c.s.	ISO 1856	26,4%
Compression at 1 mm deformation $\sigma_{1\text{mm}}$	ISO 844	0,04 N/mm ²
Compressive stress at 2 mm strain $\sigma_{2\text{mm}}$	ISO 844	0,08 N/mm ²
Compressive stress at 3 mm strain $\sigma_{3\text{mm}}$	ISO 844	0,15 N/mm ²
Reaction to fire	EN 13501-1	class E
Water absorption after 48h	ISO 62	4,25%

(3) $\Delta_{l,ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$



PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 4 \text{ dB}$

Maximum applicable load (deformation 3 mm):

0,15 N/mm²

Acoustic service load:

from 0,008 to 0,052 N/mm²

■ STATIC LOAD [buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

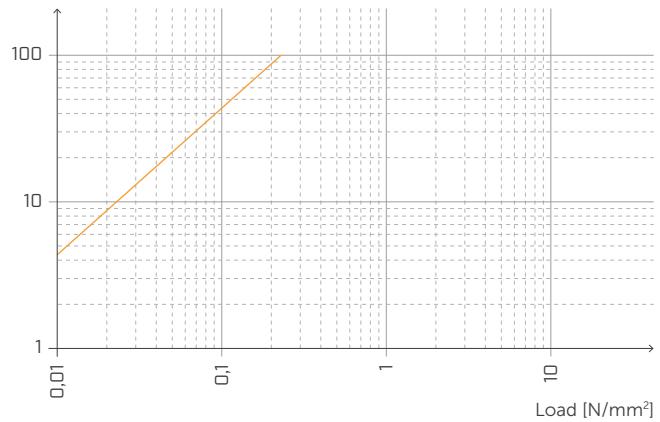


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

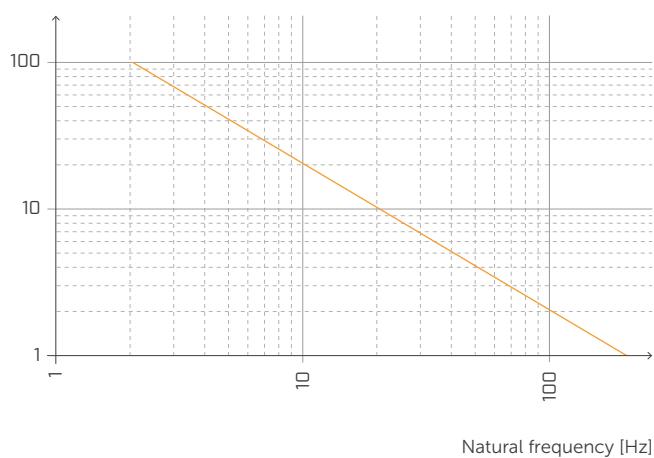


TRANSMISSIBILITY

Transmission [dB]

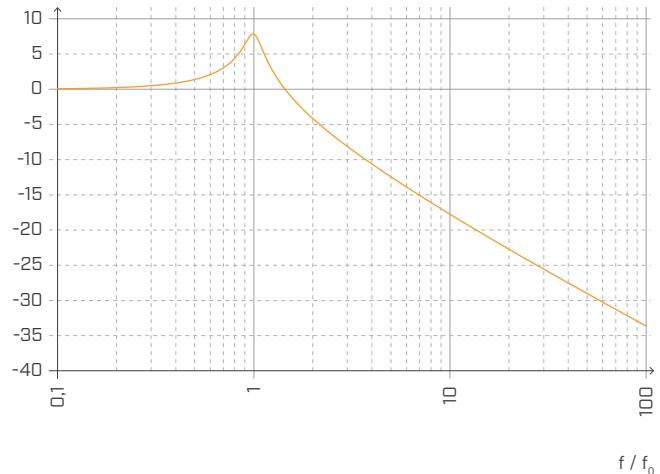

ATTENUATION


Attenuation [%]

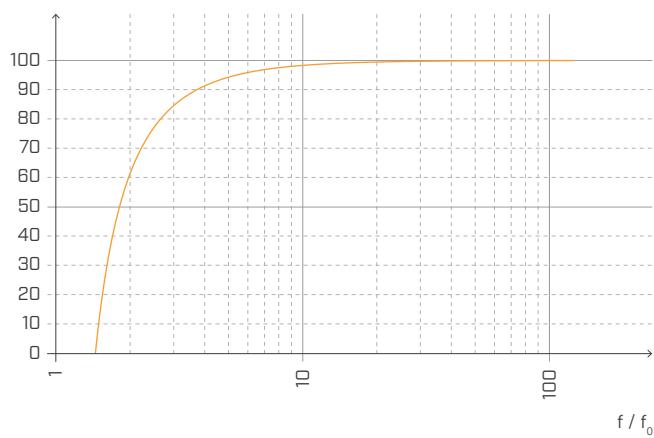

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

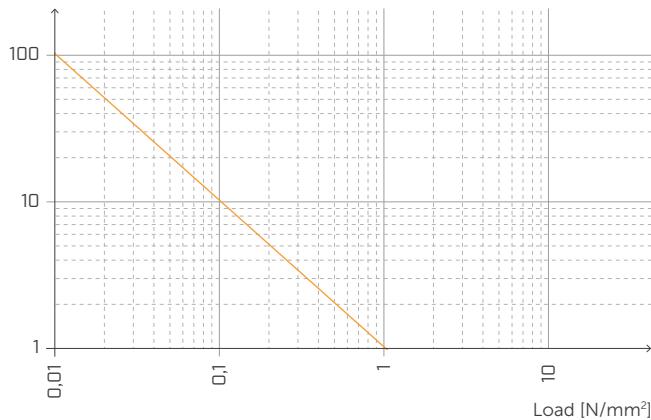


DEFORMATION AND LOAD

Deformation [%]

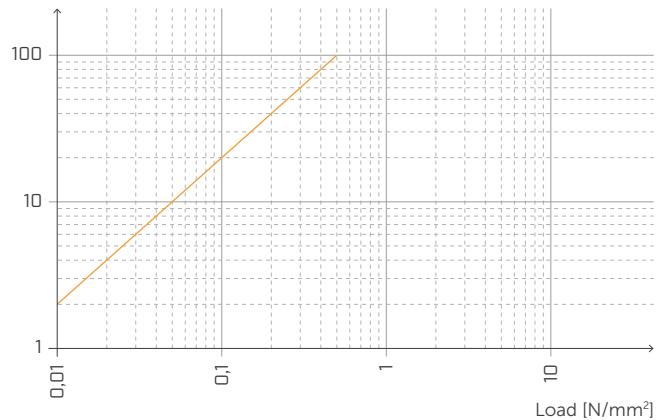


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

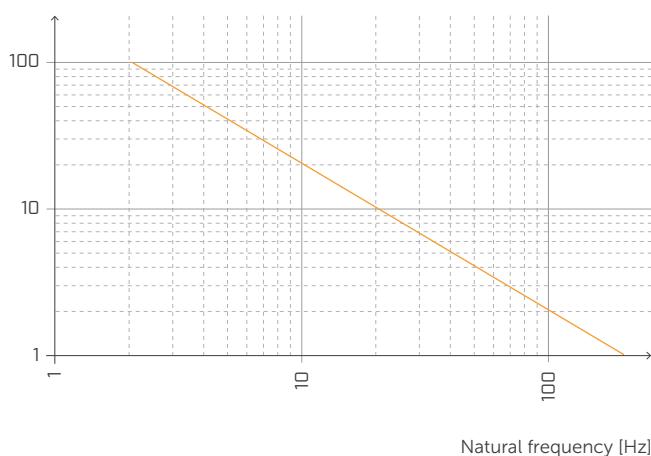


TRANSMISSIBILITY

Transmission [dB]

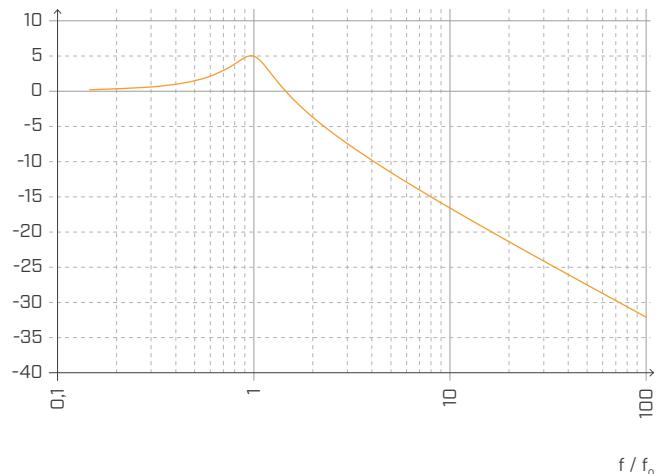

ATTENUATION


Attenuation [%]

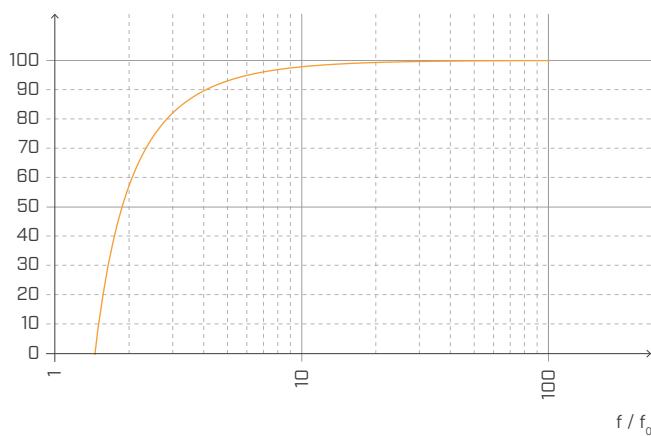

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

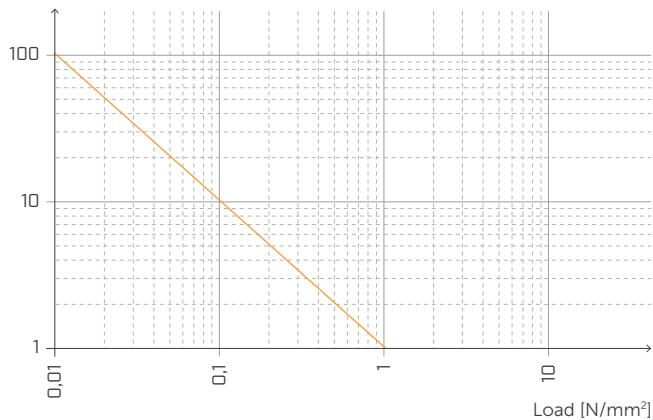


DEFORMATION AND LOAD

Deformation [%]

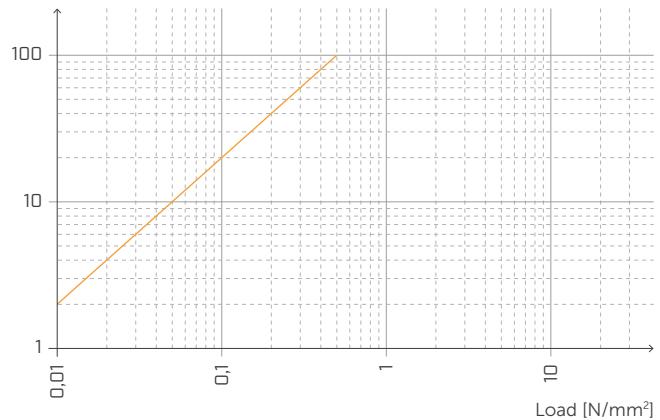


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

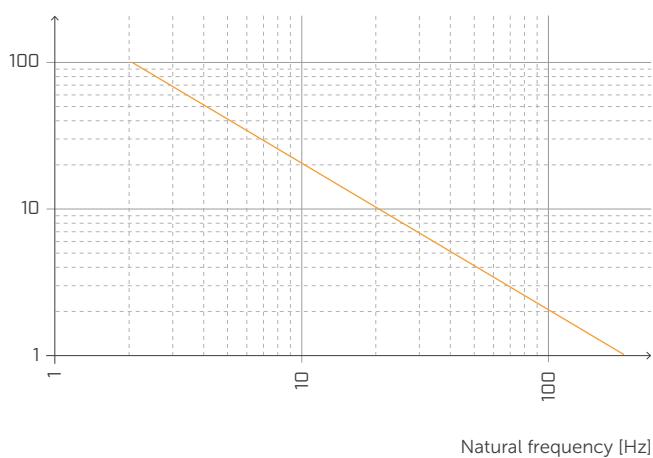


TRANSMISSIBILITY

Transmission [dB]

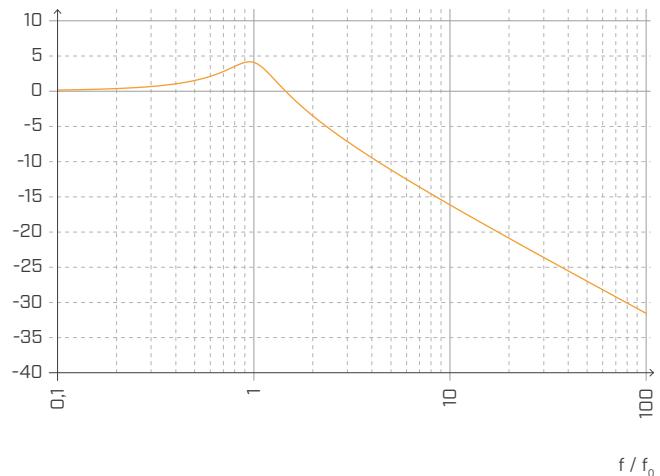

ATTENUATION

Attenuation [%]

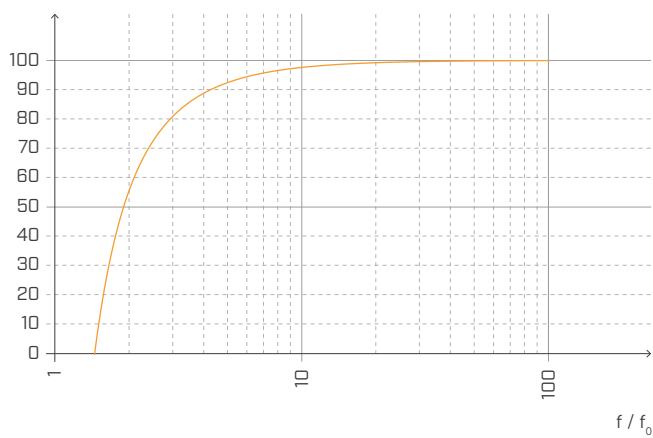

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.

PIANO B

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m] from to	compression for acoustic optimisation ⁽²⁾ [N/mm ²] from to	deformation [mm] from to	compression at 3 mm deformation (ultimate limit state) [N/mm ²]
PIANO B 4040	80	3,2 21,6			
	40 (divided)	1,6 10,8			
PIANO B 5050	100	4 27	0,04 0,27	0,2 1,49	0,85
	50 (divided)	2 13,5			
PIANO B 6060	120	4,8 32,4			
	60 (divided)	2,4 16,2			
PIANO A 140	140	5,6 37,8			


(1) The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{\text{gk}} + 0,5 q_{\text{vk}}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta_{l,ij}^{(3)}$	ISO 10848	> 4 dB
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	1,08 MPa (1,08 MPa)
Dynamic elastic modulus $E'_{1\text{Hz}} - E''_{1\text{Hz}}$	ISO 4664-1	1,54 - 0,42 MPa
Dynamic elastic modulus $E'_{5\text{Hz}} - E''_{5\text{Hz}}$	ISO 4664-1	1,75 - 0,55 MPa
Dynamic elastic modulus $E'_{10\text{Hz}} - E''_{10\text{Hz}}$	ISO 4664-1	1,87 - 0,59 MPa
Dynamic elastic modulus $E'_{50\text{Hz}} - E''_{50\text{Hz}}$	ISO 4664-1	2,07 - 0,79 MPa
Damping factor $\tan \delta_{1\text{Hz}}$	ISO 4664-1	0,270
Damping factor $\tan \delta_{5\text{Hz}}$	ISO 4664-1	0,308
Damping factor $\tan \delta_{10\text{Hz}}$	ISO 4664-1	0,314
Damping factor $\tan \delta_{50\text{Hz}}$	ISO 4664-1	0,372
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013 / ISO 16534	0,34
Compression set c.s.	ISO 1856	37,5%
Compression at 1 mm deformation $\sigma_{1\text{mm}}$	ISO 844	0,14 N/mm ²
Compressive stress at 2 mm strain $\sigma_{2\text{mm}}$	ISO 844	0,31 N/mm ²
Compressive stress at 3 mm strain $\sigma_{3\text{mm}}$	ISO 844	0,85 N/mm ²
Reaction to fire	EN 13501-1	class E
Water absorption after 48h	ISO 62	1,50%

(3) $\Delta_{l,ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$

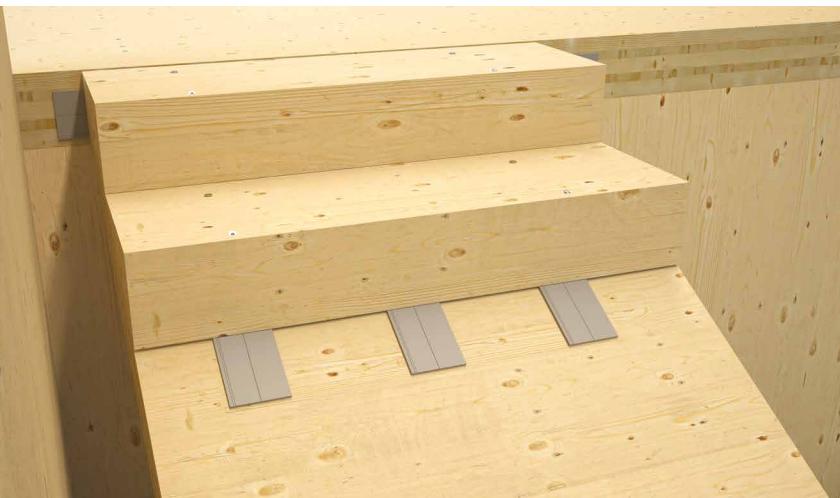

PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 4 \text{ dB}$

Maximum applicable load (deformation 3 mm):

0,85 N/mm²

Acoustic service load:

from 0,04 to 0,27 N/mm²

STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

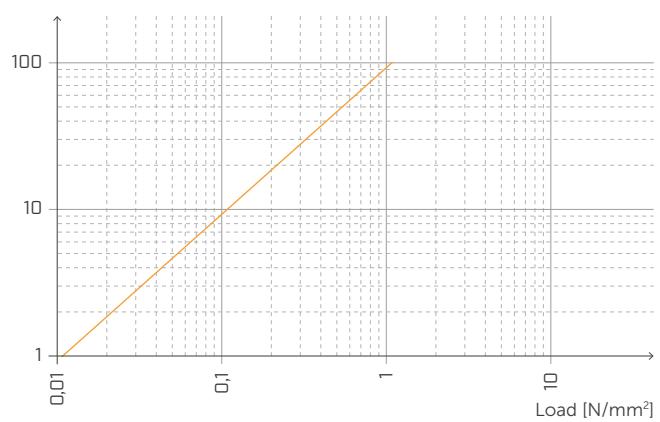


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

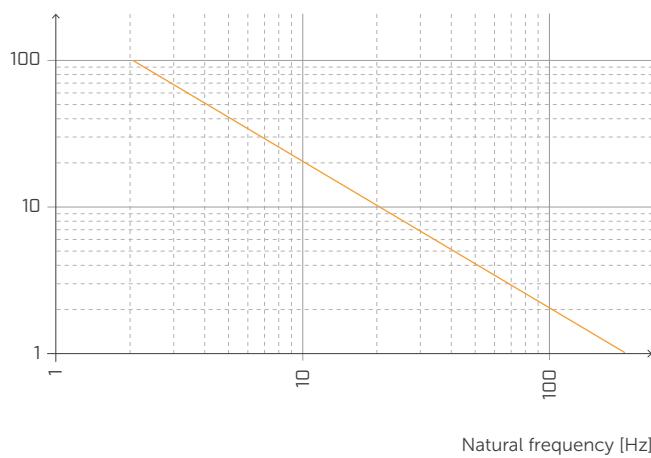


TRANSMISSIBILITY

Transmission [dB]

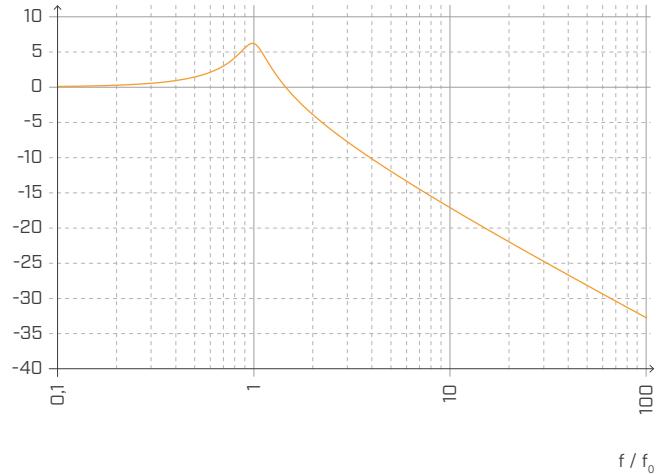

ATTENUATION

Attenuation [%]

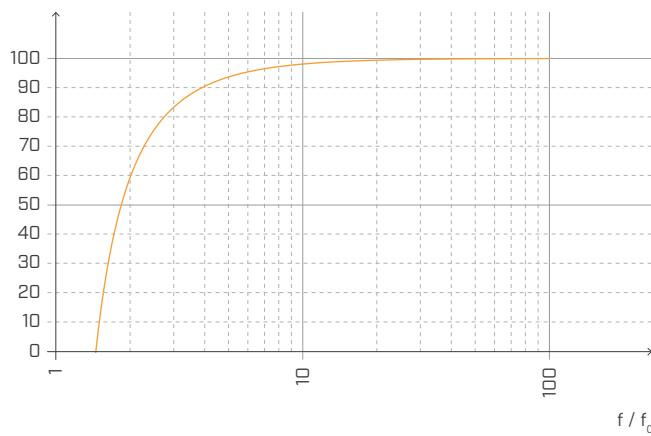

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

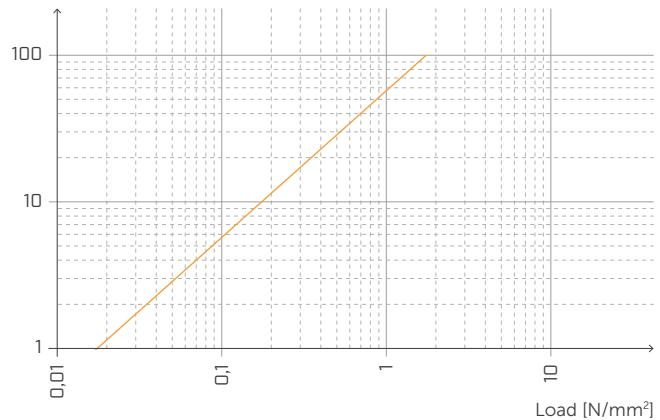


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

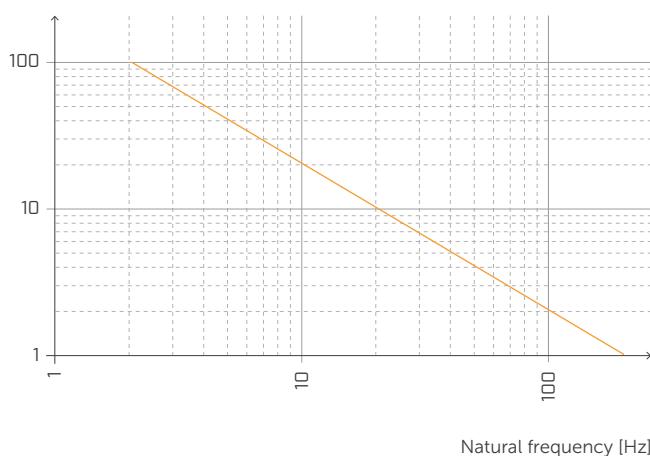


TRANSMISSIBILITY

Transmission [dB]

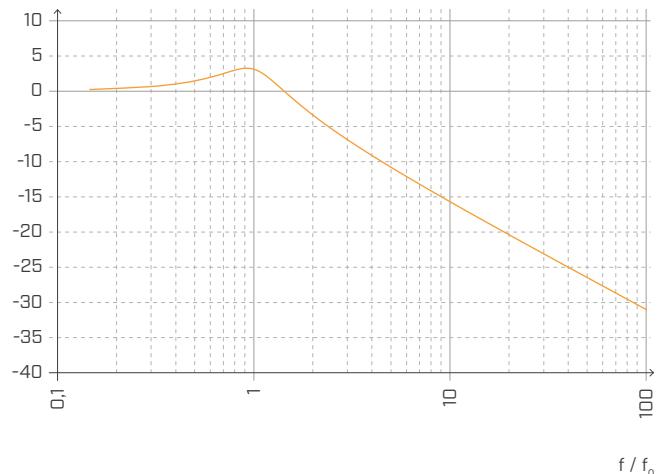

ATTENUATION


Attenuation [%]

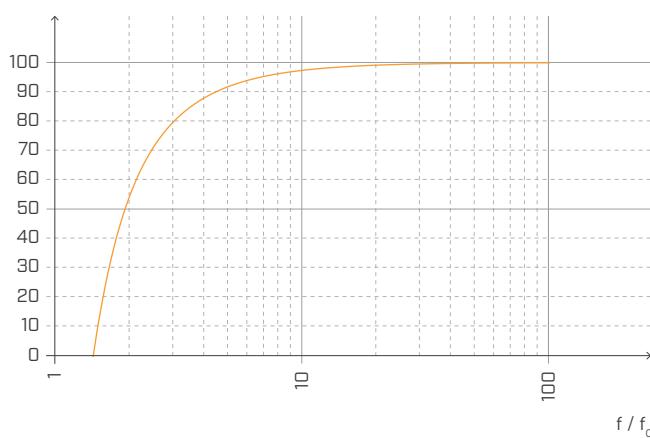

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

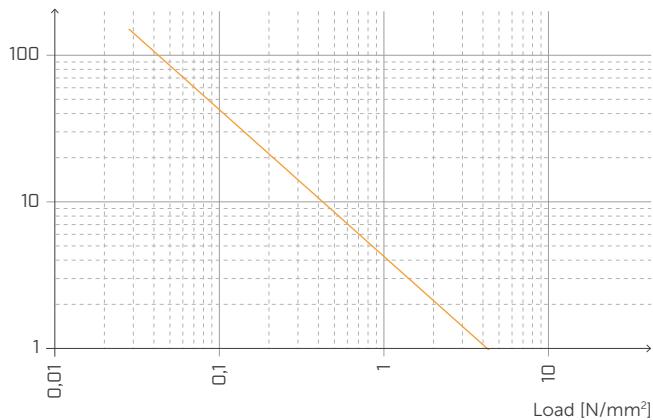


DEFORMATION AND LOAD

Deformation [%]

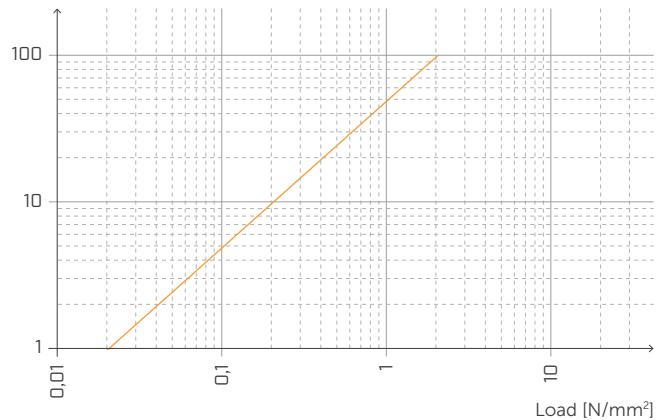


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

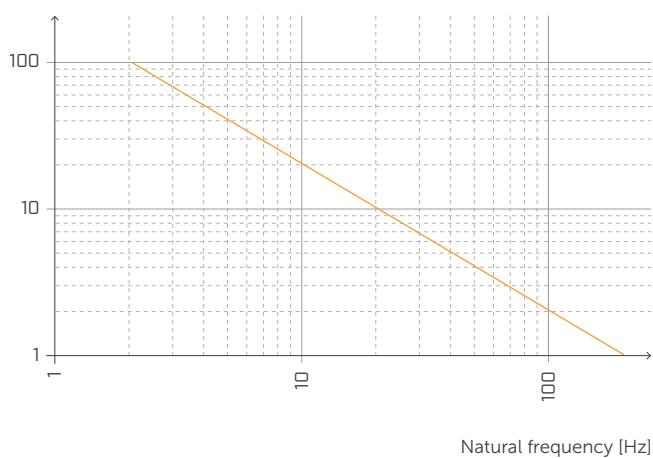


TRANSMISSIBILITY

Transmission [dB]

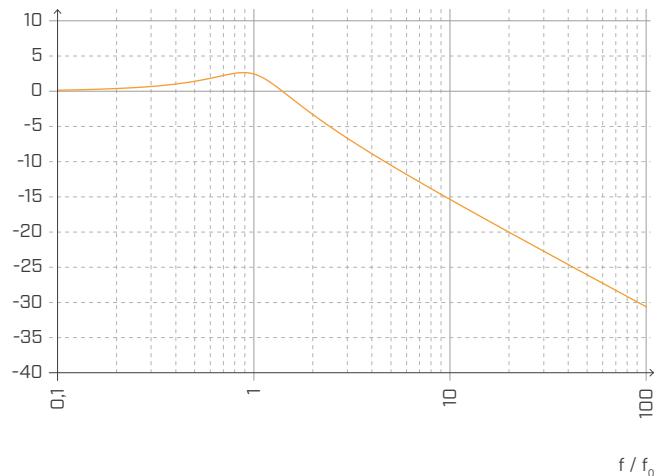

ATTENUATION

Attenuation [%]

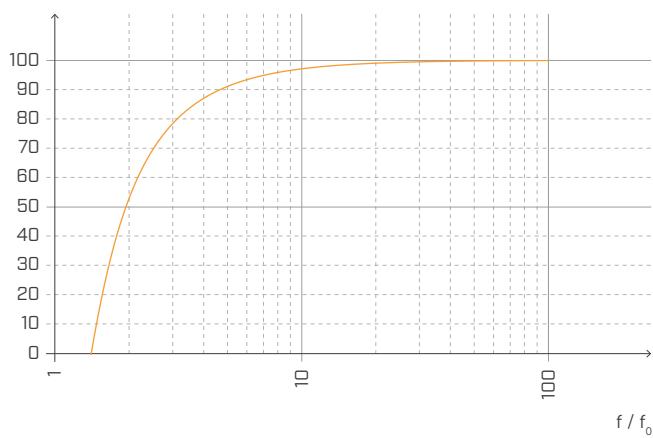

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.

PIANO C

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m]		compression for acoustic optimisation ⁽²⁾ [N/mm ²]		deformation [mm]		compression at 3 mm deformation (ultimate limit state) [N/mm ²]
		from	to	from	to	from	to	
PIANOC080	80	9,6	112					
PIANOC100	100	12	140					
PIANOC120	120	14,4	168	0,12	1,4	0,12	0,63	9,23
PIANOC140	140	16,8	196					

(1) The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta_{l,ij}^{(3)}$	ISO 10848	> 4 dB
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	7,92 MPa (3,67 MPa)
Dynamic elastic modulus $E'_1\text{Hz} - E''1\text{Hz}$	ISO 4664-1	8,35 - 2,15 MPa
Dynamic elastic modulus $E'_5\text{Hz} - E''5\text{Hz}$	ISO 4664-1	9,35 - 2,55 MPa
Dynamic elastic modulus $E'_{10\text{Hz}} - E''10\text{Hz}$	ISO 4664-1	9,91 - 2,81 MPa
Dynamic elastic modulus $E'_{50\text{Hz}} - E''50\text{Hz}$	ISO 4664-1	11,61 - 3,56 MPa
Damping factor tan $\delta_{1\text{Hz}}$	ISO 4664-1	0,258
Damping factor tan $\delta_{5\text{Hz}}$	ISO 4664-1	0,272
Damping factor tan $\delta_{10\text{Hz}}$	ISO 4664-1	0,283
Damping factor tan $\delta_{50\text{Hz}}$	ISO 4664-1	0,306
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013/ ISO 16534	0,18
Compression set c.s.	ISO 1856	11,95%
Compression at 1 mm deformation $\sigma_{1\text{mm}}$	ISO 844	1,50 N/mm ²
Compressive stress at 2 mm strain $\sigma_{2\text{mm}}$	ISO 844	3,55 N/mm ²
Compressive stress at 3 mm strain $\sigma_{3\text{mm}}$	ISO 844	9,23 N/mm ²
Reaction to fire	EN 13501-1	class E
Water absorption after 48h	ISO 62	< 1 %

(3) $\Delta_{l,ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$



PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 4 \text{ dB}$

Maximum applicable load (deformation 3 mm):

12,07 N/mm²

Acoustic service load:

from 0,12 to 1,4 N/mm²

STATIC LOAD

[buildings]



NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]




DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

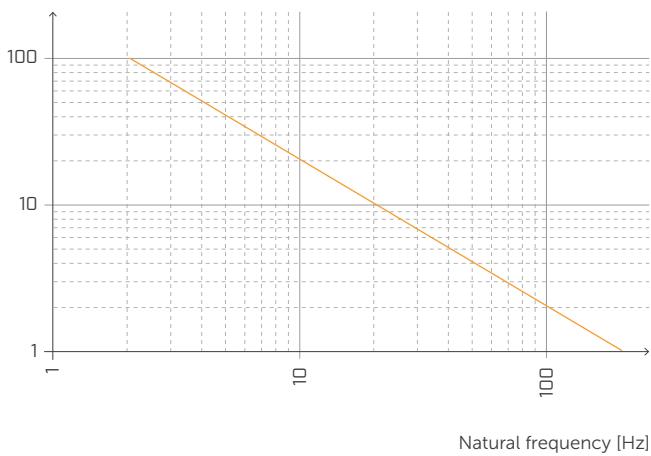


TRANSMISSIBILITY

Transmission [dB]

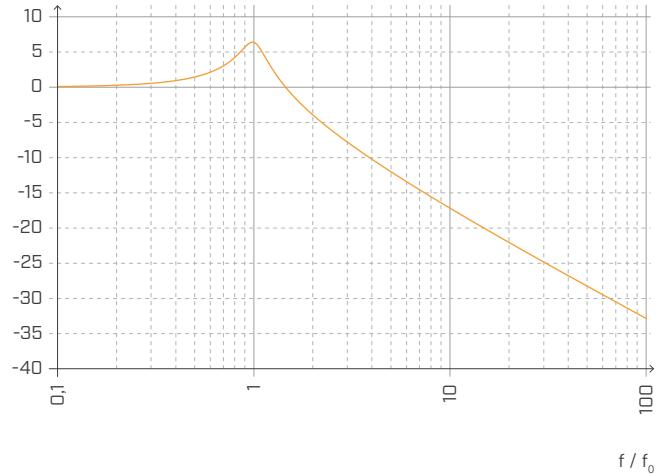

ATTENUATION


Attenuation [%]

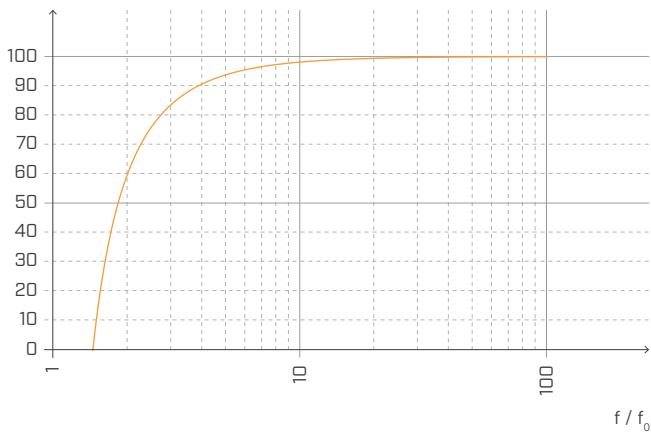

Normalised with respect to the resonance frequency with $f = 20 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

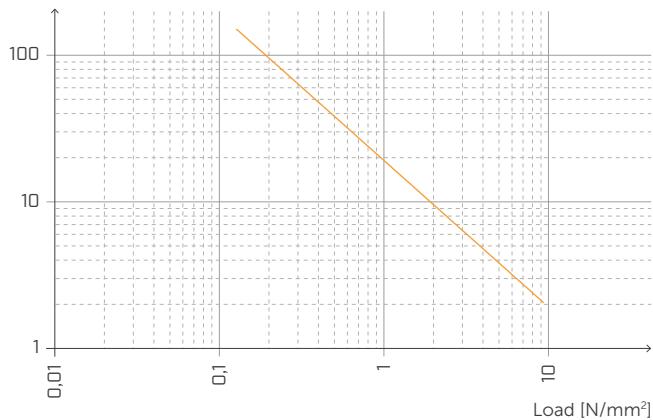


DEFORMATION AND LOAD

Deformation [%]

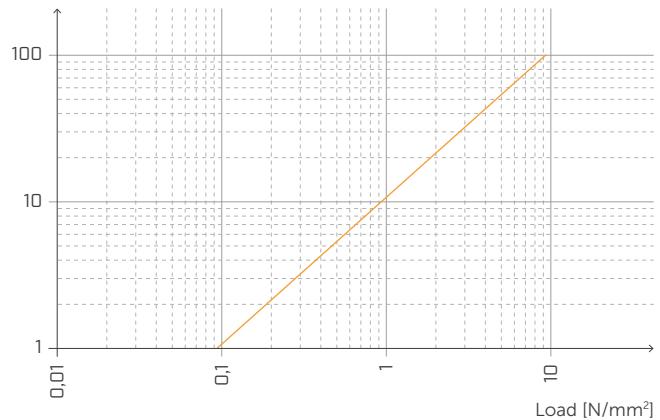


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

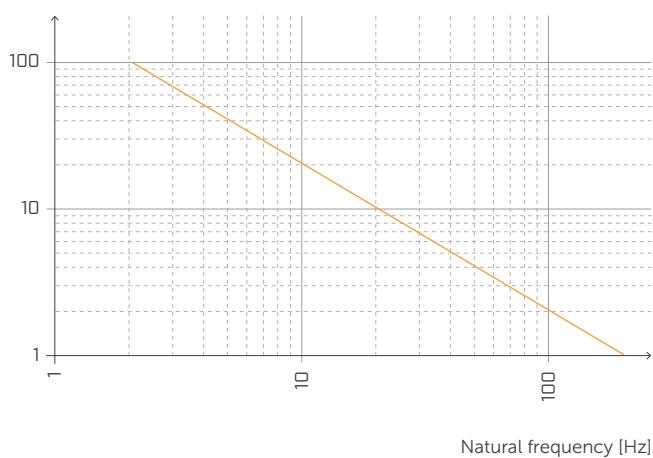


TRANSMISSIBILITY

Transmission [dB]

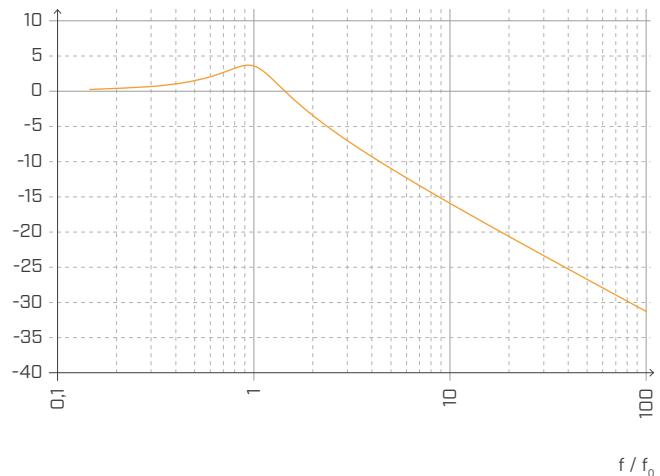

ATTENUATION

Attenuation [%]

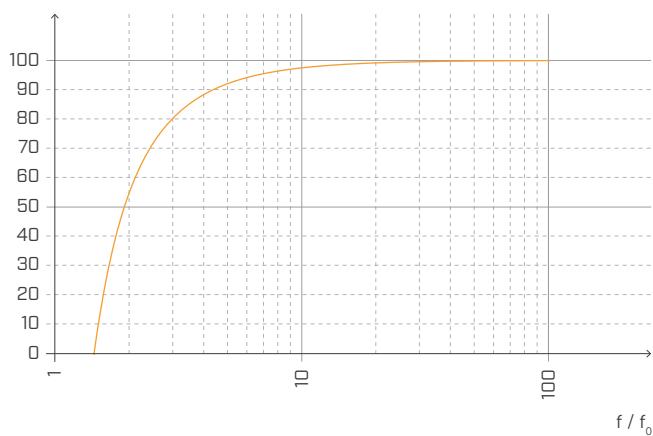

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

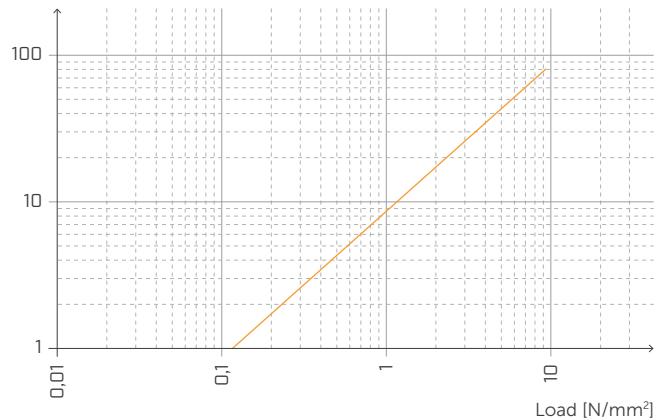


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

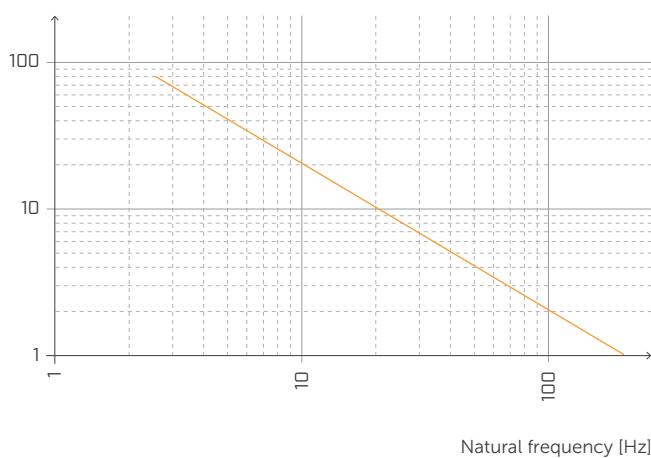


TRANSMISSIBILITY

Transmission [dB]

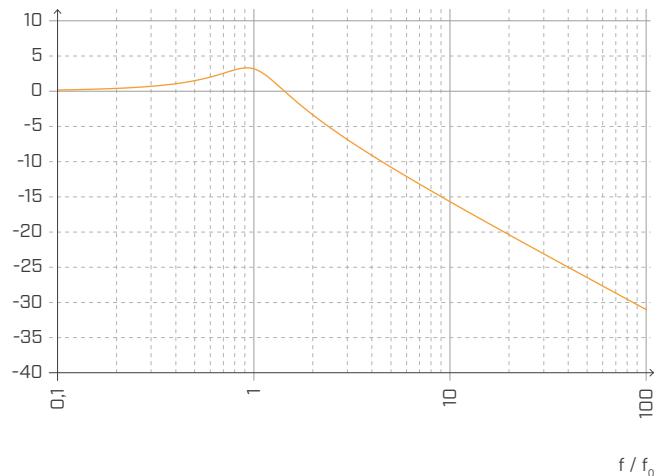

ATTENUATION

Attenuation [%]

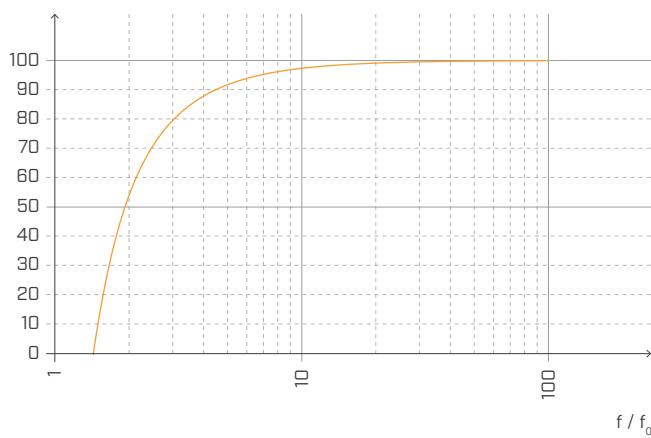

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.

PIANO D

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m] from to	compression for acoustic optimisation ⁽²⁾ [N/mm ²] from to	deformation [mm] from to	compression at 3 mm deformation (ultimate limit state) [N/mm ²]
PIANOD080	80	96 182,4			
PIANOD100	100	120 228			
PIANOD120	120	144 273,6	1,2 2,28	0,33 0,62	16,9
PIANOD140	140	168 319,2			


(1) The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta_{l,ij}^{(3)}$	ISO 10848	> 4 dB
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	22,10 MPa (7,92 MPa)
Dynamic elastic modulus $E'_{1\text{Hz} - E''1\text{Hz}}$	ISO 4664-1	18,23 - 4,97 MPa
Dynamic elastic modulus $E'_{5\text{Hz} - E''5\text{Hz}}$	ISO 4664-1	20,30 - 6,03 MPa
Dynamic elastic modulus $E'_{10\text{Hz} - E''10\text{Hz}}$	ISO 4664-1	21,62 - 6,71 MPa
Dynamic elastic modulus $E'_{50\text{Hz} - E''50\text{Hz}}$	ISO 4664-1	25,81 - 9,01 MPa
Damping factor tan $\delta_{1\text{Hz}}$	ISO 4664-1	0,273
Damping factor tan $\delta_{5\text{Hz}}$	ISO 4664-1	0,297
Damping factor tan $\delta_{10\text{Hz}}$	ISO 4664-1	0,31
Damping factor tan $\delta_{50\text{Hz}}$	ISO 4664-1	0,349
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013 / ISO 16534	0,45
Compression set c.s.	ISO 1856	14,75%
Compression at 1 mm deformation $\sigma_{1\text{mm}}$	ISO 844	4,40 N/mm ²
Compressive stress at 2 mm strain $\sigma_{2\text{mm}}$	ISO 844	10,49 N/mm ²
Compressive stress at 3 mm strain $\sigma_{3\text{mm}}$	ISO 844	16,9 N/mm ²
Reaction to fire	EN 13501-1	class E
Water absorption after 48h	ISO 62	< 1 %

(3) $\Delta_{l,ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$

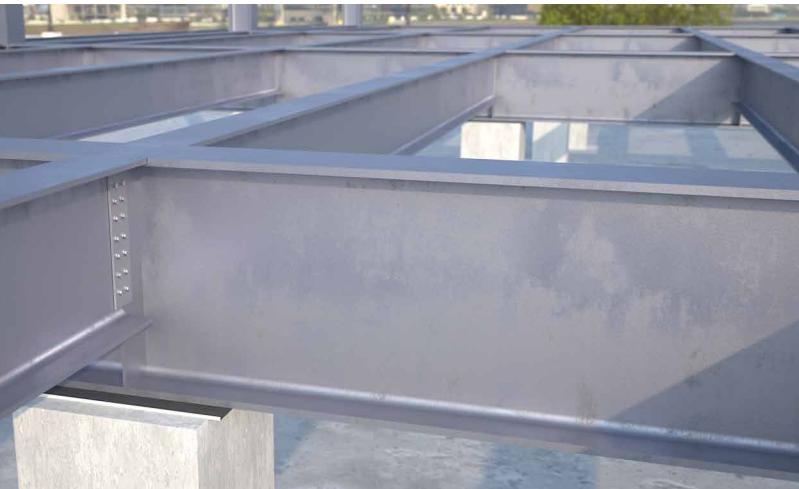

PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 4 \text{ dB}$

Maximum applicable load (deformation 3 mm):

16,9 N/mm²

Acoustic service load:

from 1,2 to 2,28 N/mm²


STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

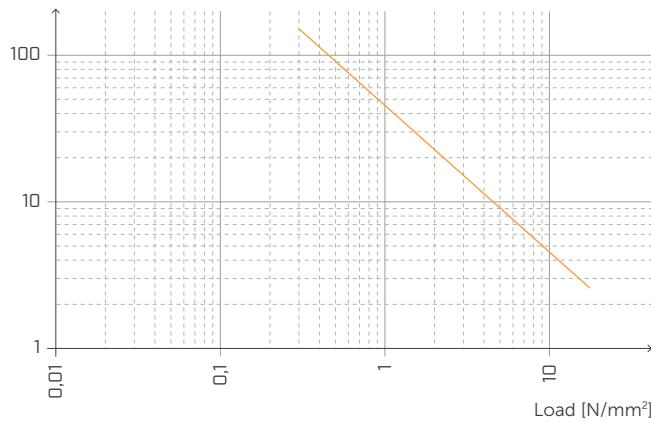


DEFORMATION AND LOAD

Deformation [%]

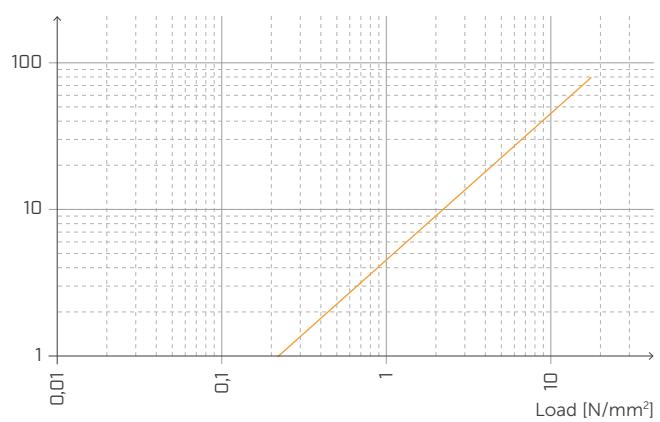


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

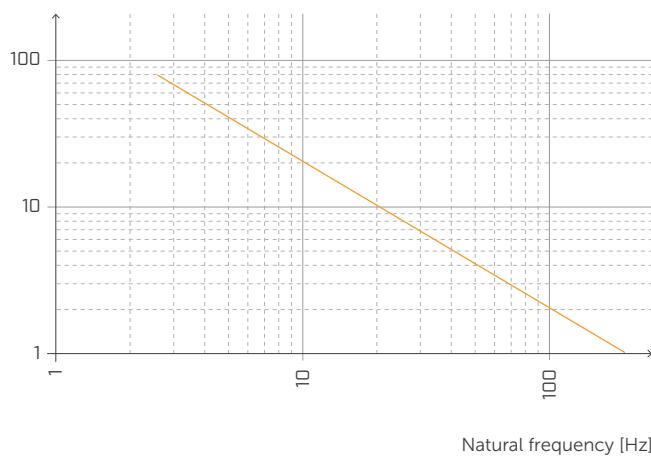


TRANSMISSIBILITY

Transmission [dB]

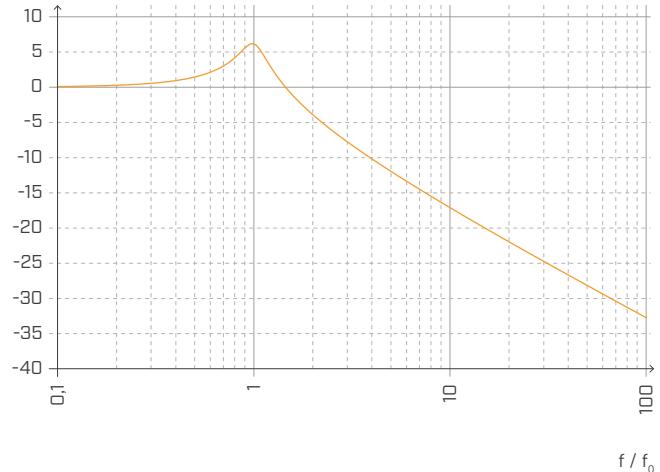

ATTENUATION

Attenuation [%]

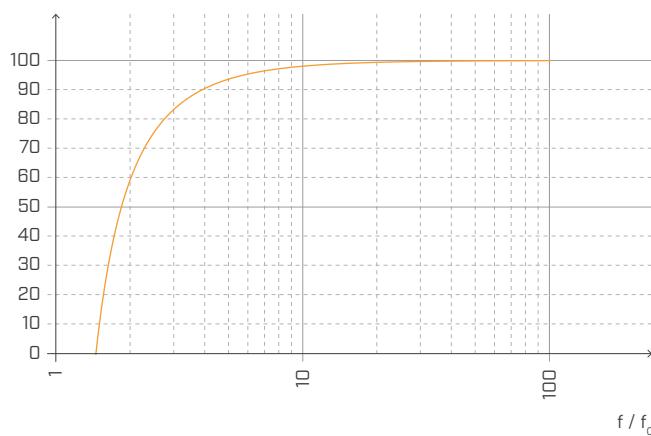

Normalised with respect to the resonance frequency with $f = 20$ Hz.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

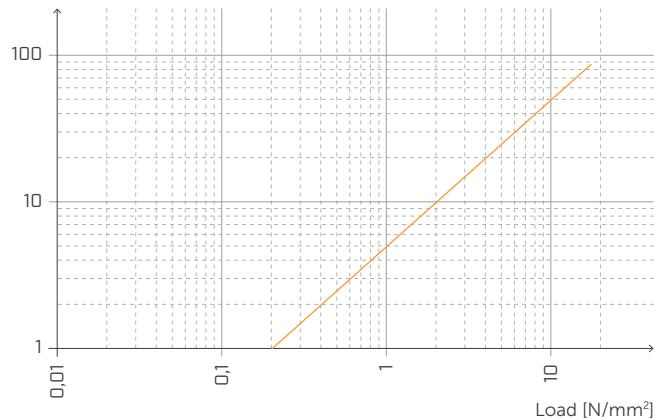


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

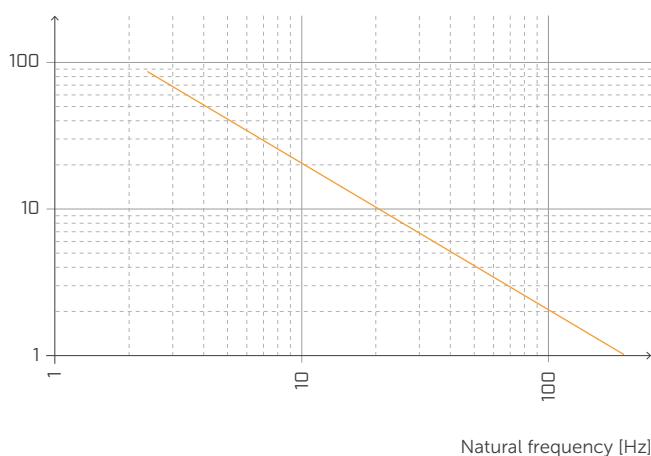


TRANSMISSIBILITY

Transmission [dB]

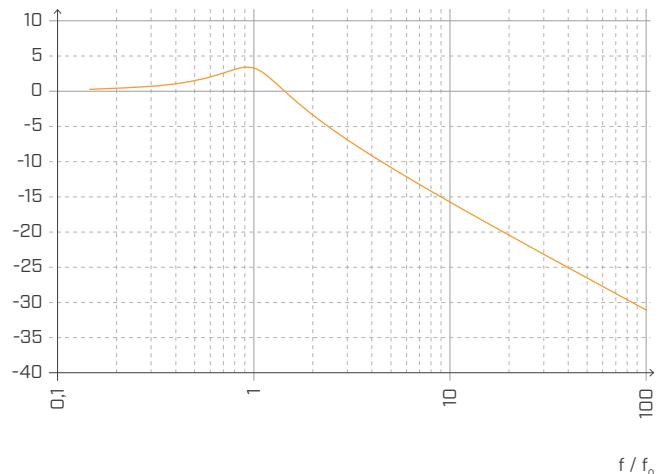

ATTENUATION


Attenuation [%]

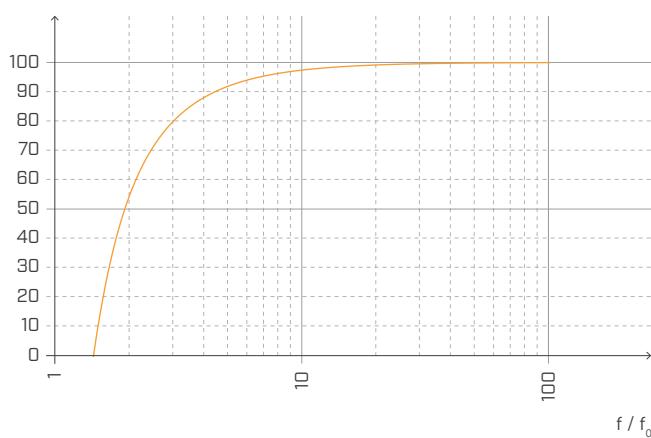

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

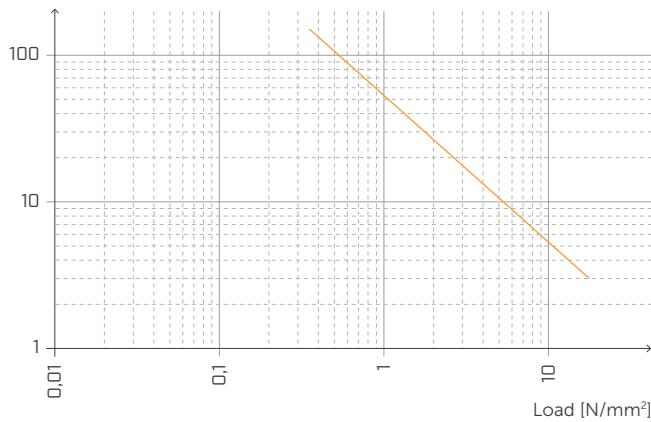


DEFORMATION AND LOAD

Deformation [%]

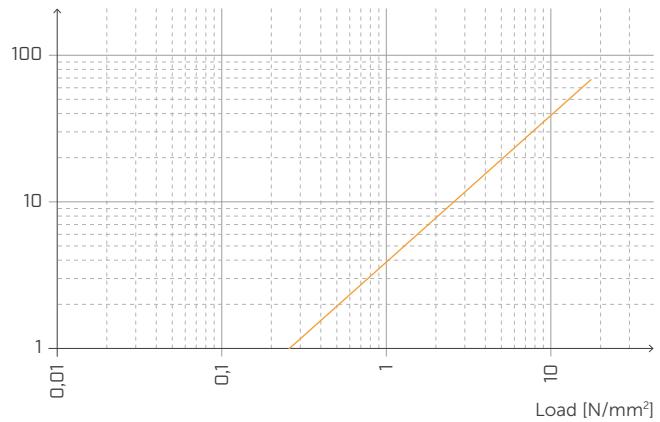


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

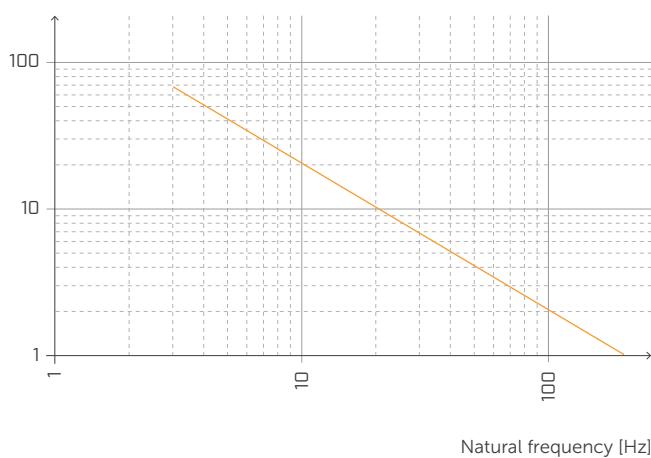


TRANSMISSIBILITY

Transmission [dB]

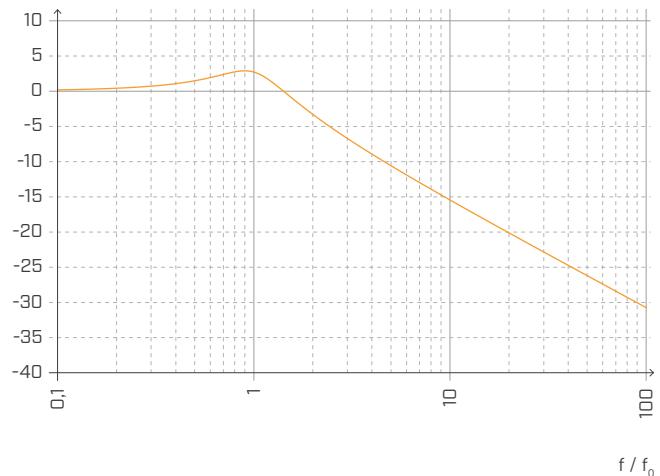

ATTENUATION

Attenuation [%]

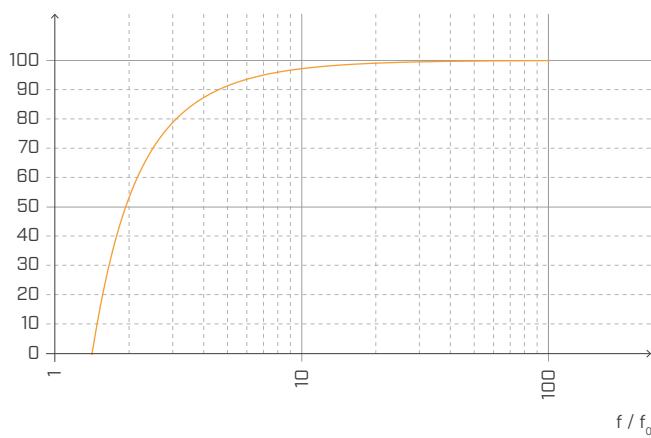

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.

PIANO E

TABLE OF USE⁽¹⁾

CODE	B [mm]	load for acoustic optimisation ⁽²⁾ [kN/m]		compression for acoustic optimisation ⁽²⁾ [N/mm ²]		deformation [mm]		compression at 3 mm deformation (ultimate limit state) [N/mm ²]	
		from	to	from	to	from	to		
PIANO E 80	80	144	256						
PIANO E 100	100	180	320						
PIANO E 120	120	216	384	1,8	3,2	0,44	0,77		17,07
PIANO E 140	140	252	448						

(1) The reported load ranges here are optimised with respect to the acoustic and static behaviour of the material in compression. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

(2) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0.5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta_{l,ij}^{(3)}$	ISO 10848	> 4 dB
Elastic modulus in compression E_c (without friction $E_{c,\text{lubricant}}$)	ISO 844	24,76 MPa (12,03 MPa)
Dynamic elastic modulus $E'_1 \text{Hz} - E''1\text{Hz}$	ISO 4664-1	48,83 - 11,99 MPa
Dynamic elastic modulus $E'_5 \text{Hz} - E''5\text{Hz}$	ISO 4664-1	54,80 - 13,24 MPa
Dynamic elastic modulus $E'_{10\text{Hz}} - E''10\text{Hz}$	ISO 4664-1	58,35 - 14,04 MPa
Dynamic elastic modulus $E'_{50\text{Hz}} - E''50\text{Hz}$	ISO 4664-1	67,08 - 16,85 MPa
Damping factor tan $\delta_{1\text{Hz}}$	ISO 4664-1	0,247
Damping factor tan $\delta_{5\text{Hz}}$	ISO 4664-1	0,243
Damping factor tan $\delta_{10\text{Hz}}$	ISO 4664-1	0,242
Damping factor tan $\delta_{50\text{Hz}}$	ISO 4664-1	0,253
Creep $\Delta\varepsilon/\varepsilon_1$	ISO 8013 / ISO 16534	0,24
Compression set c.s.	ISO 1856	42,08%
Compression at 1 mm deformation $\sigma_{1\text{mm}}$	ISO 844	3,81 N/mm ²
Compressive stress at 2 mm strain $\sigma_{2\text{mm}}$	ISO 844	8,36 N/mm ²
Compressive stress at 3 mm strain $\sigma_{3\text{mm}}$	ISO 844	17,07 N/mm ²
Reaction to fire	EN 13501-1	class E
Water absorption after 48h	ISO 62	< 1 %

(3) $\Delta_{l,ij} = K_{ij,\text{with}} - K_{ij,\text{without}}$



PERFORMANCE

Acoustic improvement tested:

$\Delta_{l,ij}^{(3)} : > 4 \text{ dB}$

Maximum applicable load (deformation 3 mm):

17,07 N/mm²

Acoustic service load:

from 1,8 to 3,2 N/mm²


STATIC LOAD

[buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

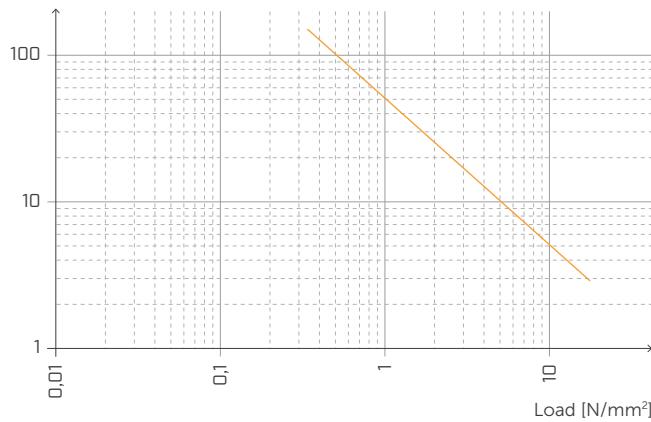


DEFORMATION AND LOAD

Deformation [%]

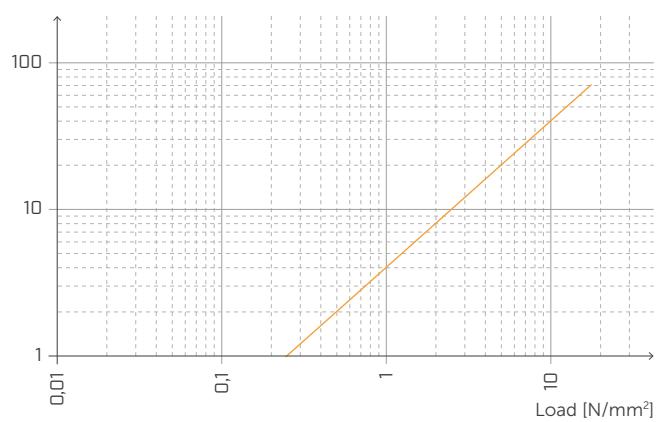


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

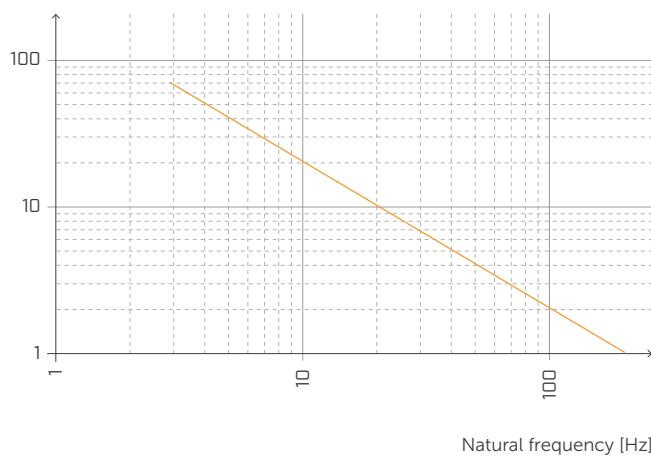


TRANSMISSIBILITY

Transmission [dB]

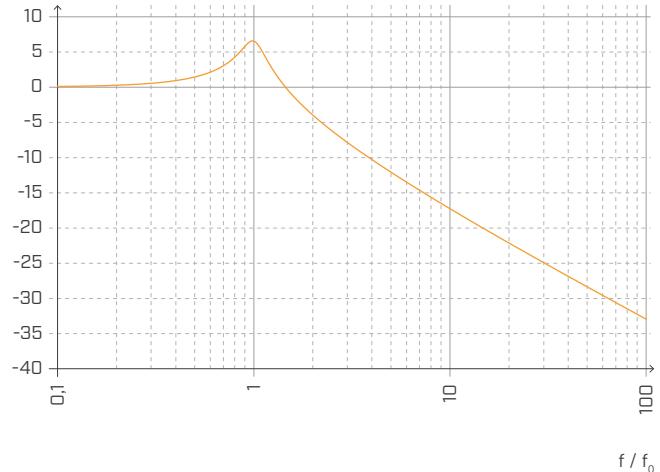

ATTENUATION

Attenuation [%]

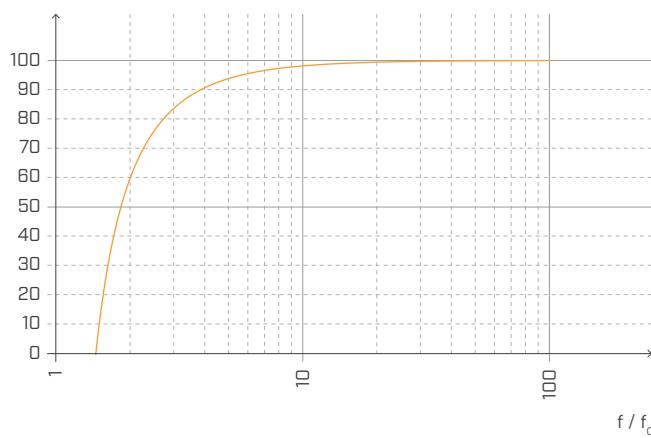

Normalised with respect to the resonance frequency with $f = 20$ Hz.


DYNAMIC LOAD

[machines and vibration]

5 Hz 


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

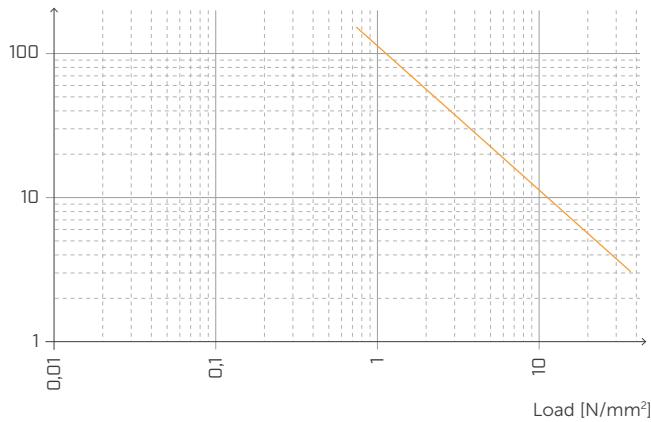


DEFORMATION AND LOAD

Deformation [%]

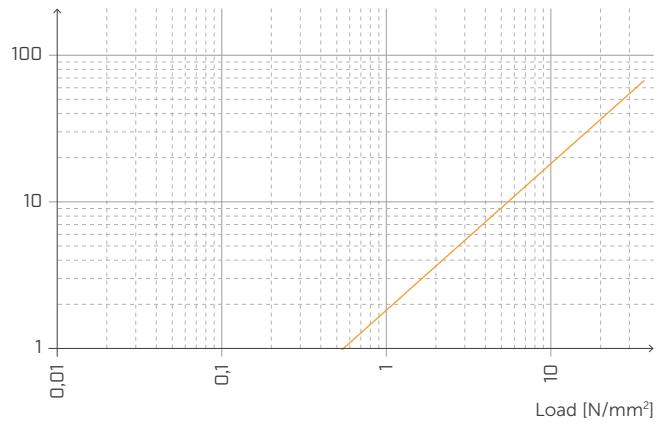


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

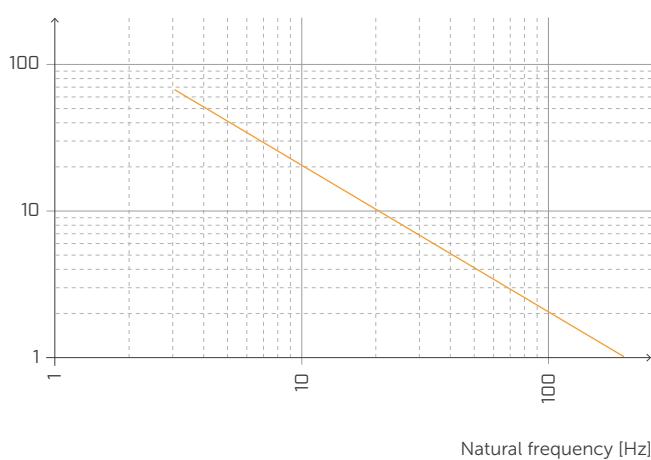


TRANSMISSIBILITY

Transmission [dB]

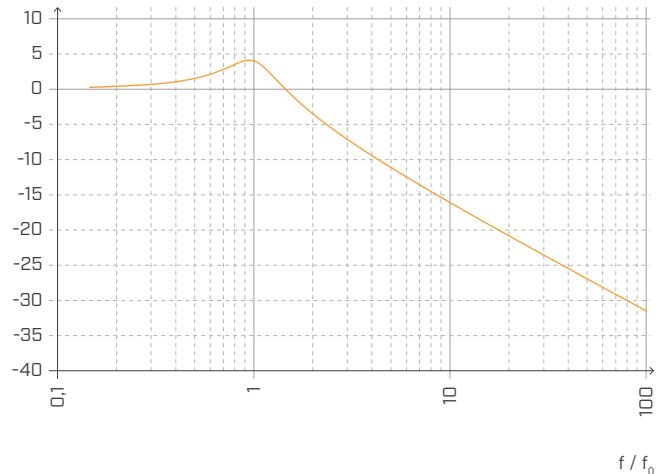

ATTENUATION


Attenuation [%]

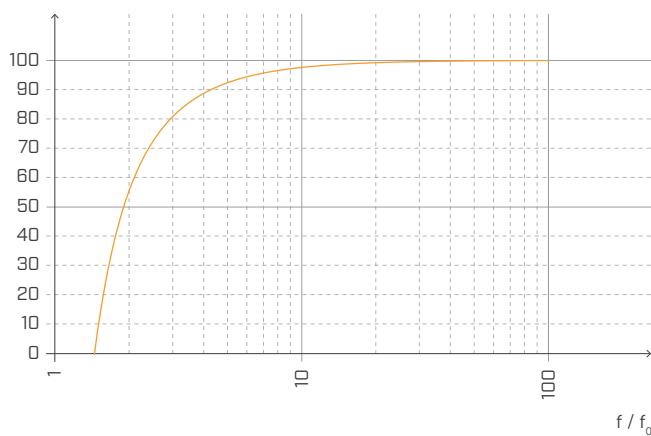

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.


NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]

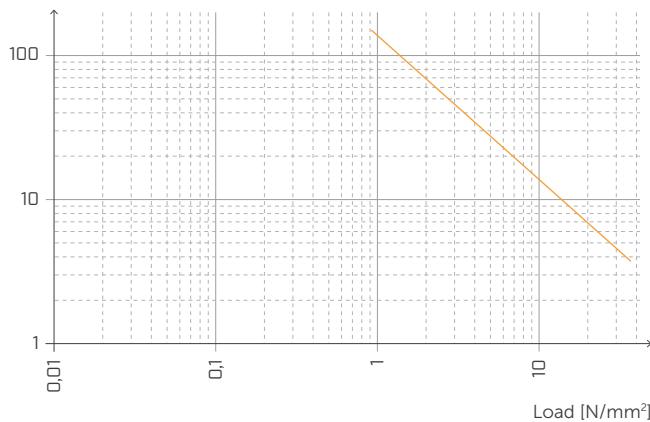


DEFORMATION AND LOAD

Deformation [%]

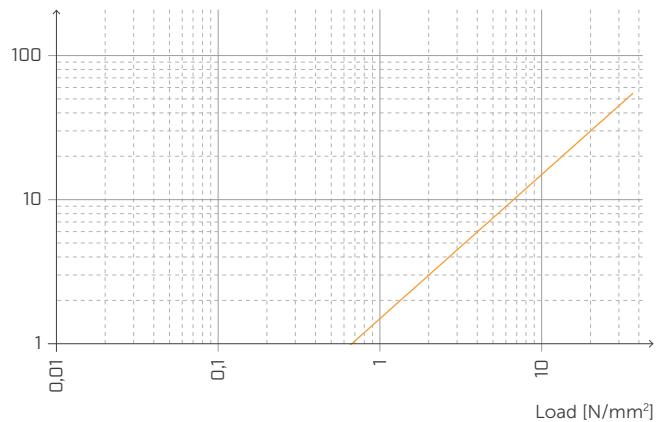


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

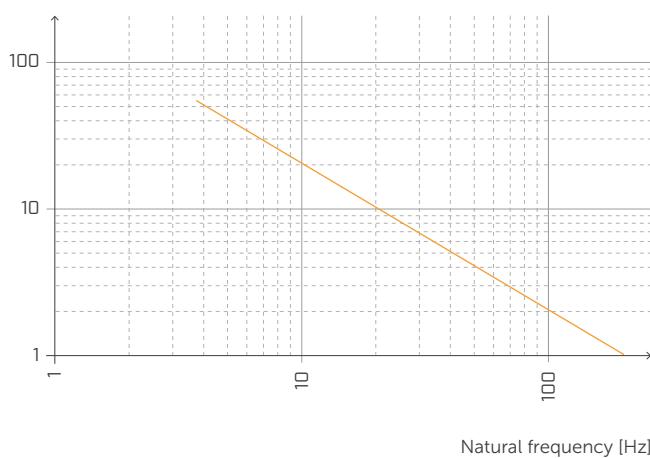


TRANSMISSIBILITY

Transmission [dB]

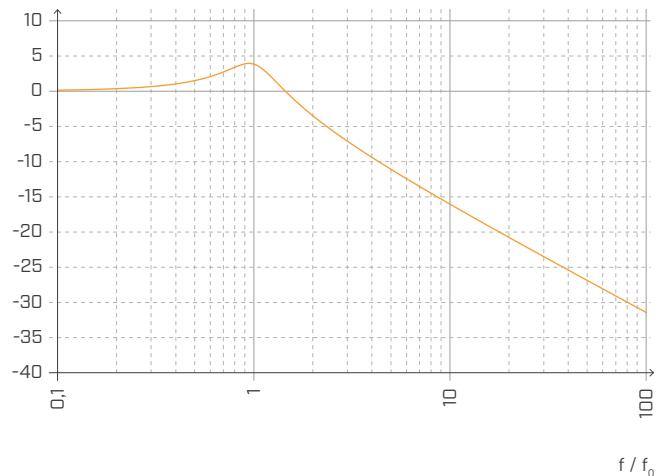

ATTENUATION

Attenuation [%]

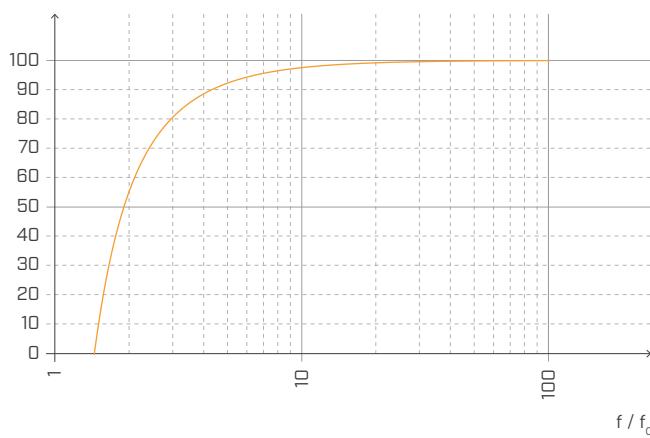

Normalised with respect to the resonance frequency with $f = 6 \text{ Hz}$.

THE CEN MODEL (EN ISO 12354)

The CEN model proposed in the EN ISO 12354 series of standards provides a powerful tool to predict the acoustic performance of a partition from the characteristics of the construction elements. The EN ISO 12354 series has been expanded to provide more specific information regarding timber frame and CLT structures.



EN ISO 12354-1:2017

Airborne sound insulation between rooms.



EN ISO 12354-2:2017

Impact sound soundproofing between rooms.

APPARENT SOUND REDUCTION INDEX

EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method.

When using the simplified calculation model, disregarding the presence of small penetrations and airborne transmission paths $D_{n,j,w}$, the apparent sound reduction index R'_w can be calculated as the logarithmic sum of the direct component $R_{Dd,w}$ and the flanking transmission components $R_{ij,w}$.

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{n,j,w}}{10}} \right] (dB)$$

The sound reduction index for flanking transmission paths $R_{ij,w}$ can be estimated as:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{l_0 l_{ij}} (dB)$$


where:

$R_{i,w}$ e $R_{j,w}$ are sound reduction evaluation indices of flanking elements i and j respectively;

ΔR_i , ΔR_j are sound reduction index increases due to the installation of architectural finishes for element i in the source environment and/or element j in the receiving environment;

K_{ij} vibration reduction index through the joint

S is the area of the separating element and l_{ij} is the length of the joint between the separating wall and the flanking elements i and j, l_0 being a reference length of 1 m.

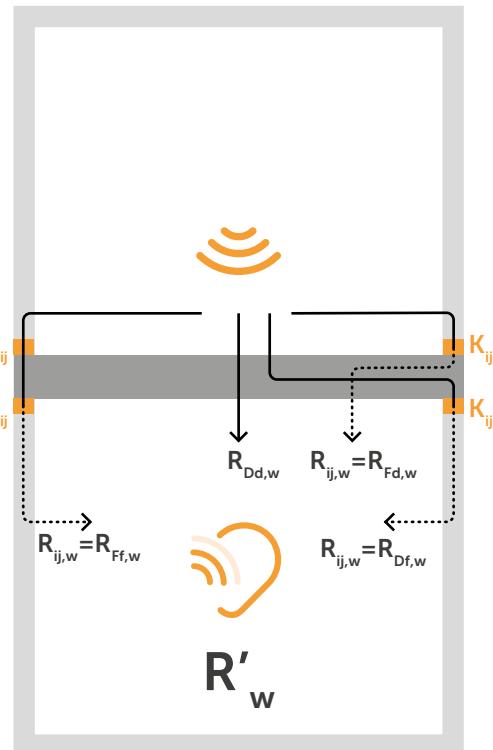

Among the input parameters required by the calculation model, the sound reduction indices can be obtained from accredited laboratory measurements or from the manufacturers of construction elements. Additionally, a number of open-access databases offer data for frequently used construction solutions. The ΔR_w can be estimated by modelling the wall assembly in terms of a mass-spring-mass system (EN ISO 12354 Annex D).

The most critical parameter to estimate is the **VIBRATION REDUCTION INDEX** K_{ij} . This quantity represents the vibration energy dissipating into the junction, and is associated with the structural coupling of the elements. High values of K_{ij} generate the best junction performance. Standard EN ISO 12354 provides some predictive estimates of two standard T and X-shaped joints for CLT structures, which are shown on the right, but the experimental data available is still limited. This is why Rotho-blaas has invested in several measurement campaigns to provide usable data with this calculation model.

The ASTM standards currently do not provide a predictive model for the evaluation of flanking sound transmission, so the ISO 12354 and ISO 10848 standards are used and "translated" into the ASTM metric.

ASTM & K_{ij}

$$STC_{ij} = \frac{STC_i}{2} + \frac{STC_j}{2} + K_{ij} + \max(\Delta STC_i, \Delta STC_j) + \frac{\min(\Delta STC_i, \Delta STC_j)}{2} + 10 \log \frac{S_s}{l_0 l_{ij}}$$

DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES

INCORPORATING OF RESILIENT LAYERS LIKE XYLOFON, PIANO, CORK AND ALADIN STRIPE

The MyProject software can be used during design, or follow one of the methods below, extrapolated from internationally valid standards.

METHOD 1 BASED ON EN ISO 12354:2017 FOR HOMOGENEOUS STRUCTURES

Typically, this formula has been considered for lightweight wood structures, i.e. considering the connections between elements, which are considered rigid and homogeneous. For CLT structures this is certainly an approximation.

K_{ij} depends on the shape of the junction and the type of elements composing it, especially their surface mass. In case of T- or X-joints, use the following expressions, shown aside.

For both cases:

$$K_{ij} = K_{ij\text{rigid}} + \Delta L$$

if the flanking transmission path passes through a junction

$$K_{ij} = K_{ij\text{rigid}} + 2\Delta L$$

if the flanking transmission path passes through two joints

$$M = 10 \log(m_{i\perp}/m_i)$$

where:

$m_{i\perp}$ is the mass of one of the elements, the one placed perpendicular to the other.

Therefore, the transmitted vibration reduction value is:

$$\Delta Lw = 10 \log(1/f_t)$$

for loads exceeding 750 kN/m² on a resilient layer with $\Delta L_{\min} = 5$ dB

$$f_t = ((G/t_i)(\rho_1 \rho_2))^{1/5}$$

where:

G is the Young tangential module (MN/m²)

t_i is the thickness of the resilient material (m)

ρ_1 and ρ_2 are, respectively, the density of connected elements 1 and 2

METHOD 2 F.3 EMPIRICAL DATA FOR JUNCTIONS CHARACTERIZED BY K_{ij} ISO 12354-1:2017

CLT construction elements are elements in which the structural reverberation time is, in most cases, mainly

determined by the connecting elements.


In the case of CLT structures weakly bound together, the side transmission contribution can be determined according to the following relations, valid if $0,5 < (m_1/m_2) < 2$.

METHOD 1 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 5,7 + 14,1 M + 5,7 M^2 \text{ dB}$$


$$K_{12} = 5,7 + 5,7 M^2 = K_{23} \text{ dB}$$



Solution 2 - T-SHAPED JOINT with resilient layer

$$K_{23} = 5,7 + 14,1 M + 5,7 M^2 \text{ dB}$$

$$K_{12} = 5,7 + 5,7 M^2 = K_{23} \text{ dB}$$




Solution 3 - X-SHAPED JOINT

$$K_{13} = 8,7 + 17,1 M + 5,7 M^2 \text{ dB}$$

$$K_{12} = 8,7 + 5,7 M^2 = K_{23} \text{ dB}$$

$$K_{24} = 3,7 + 14,1 M + 5,7 M^2 \text{ dB}$$

$$0 \leq K_{24} \leq -4 \text{ dB}$$




METHOD 2 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 22 + 3,3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{23} = 15 + 3,3 \log(f/f_k)$$




Solution 1 - X-SHAPED JOINT

$$K_{13} = 10 - 3,3 \log(f/f_k) + 10 M$$

$$K_{24} = 23 - 3,3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{14} = 18 - 3,3 \log(f/f_k)$$



THE SIMPLIFIED METHOD

A CALCULATION EXAMPLE USING EN ISO 12354

INPUT DATA


The EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method.

Regarding airborne sound insulation, the simplified calculation model predicts the apparent sound energy as a single value based on the acoustic performance of the elements involved in the junction. Below is an example of a calculation evaluating the apparent sound reduction index between two adjacent rooms.


In order to determine the acoustic performance of assembly from the acoustic performance of its components, it is important to determine for every junction element:

- the geometry of the partition (S)
- the acoustic properties of the partition (R_w)
- the coupling between structural elements (K_{ij})
- the characteristics of each layer composing the partition

PLAN

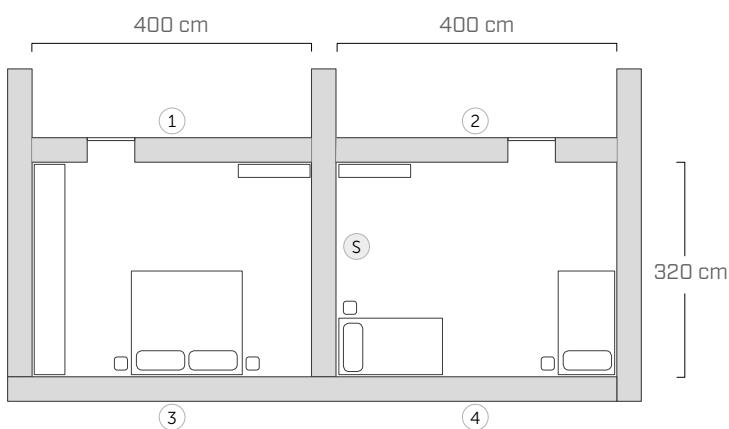

SECTION

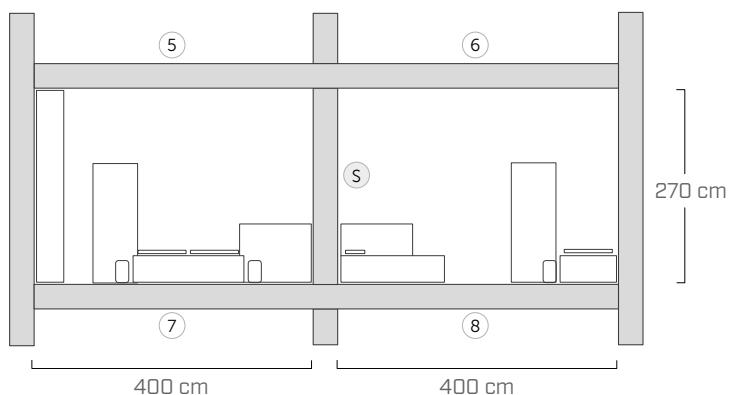

PARTITION CHARACTERISTICS

SEPARATING WALL (S)

25 mm	plasterboard
50 mm	mineral wool
75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

INTERNAL WALLS (1)

12,5 mm	gypsum fibreboard
78 mm	CLT
12,5 mm	gypsum fibreboard

INTERNAL WALLS (2)

75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

EXTERNAL WALLS (3) (4)

6 mm	plaster
60 mm	wood fibre panel
160 mm	mineral wool
90 mm	CLT
70 mm	fir panels
50 mm	mineral wool
15 mm	plasterboard
25 mm	plasterboard

FLOORS (5) (6) (7) (8)

70 mm	concrete screed
0,2 mm	PE membrane
30 mm	under floor membrane
50 mm	backfill (loose)
140 mm	CLT
60 mm	mineral wool
15 mm	plasterboard

Data for acoustic characterisation of the assemblies was taken from DataHolz.

www.dataholz.com

CALCULATION OF DIRECT AND FLANKING TRANSMISSION COMPONENTS

The apparent sound reduction index is obtained from the contribution of the direct component and the flanking transmission paths, based on the following equation:

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{nj,w}}{10}} \right] (dB)$$

Considering only the first order transmission, there are three flanking transmission paths for each combination of assemblies i-j, for a total of 12 R_{ij} calculated using the equation:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{I_0 I_{ij}} (dB)$$

DETERMINING THE APPARENT SOUND REDUCTION INDEX

The simplified calculation model has the unquestioned advantage of providing an easy-to-use tool to predict sound insulation.

On the other hand, its application is quite delicate for CLT structures because the damping of each structural element is strongly affected by the assembly. It really deserves a dedicated modelling approach. Moreover, CLT panels provide poor insulation at low frequencies, thus the use of frequency weighted indices might return results which do not provide an accurate representation of actual behaviour in the low frequency region. Therefore the use of the detailed method is advised for accurate predictive analysis.

In the example provided, sound insulation for direct transmission gives R_w of 53 dB, if the contributions of flanking transmission are considered, R'_w decreases to 51 dB.

$$R'_w = \mathbf{51 \text{ dB}} \quad R_w = \mathbf{53 \text{ dB}}$$

ACOUSTIC CHARACTERISTICS OF THE ASSEMBLIES

Path of transmission	S [m ²]	R _w [dB]	m' [kg/m ²]
S	8,64	53	69
1	10,8	38	68
2	10,8	49	57
3	10,8	55	94
4	10,8	55	94
5	12,8	63	268
6	12,8	63	268
7	12,8	63	268
8	12,8	63	268

CALCULATING R_{ij}

Path of transmission	R _{ij} [dB]	Path of transmission	R _{ij} [dB]
1-S	60	S-6	83
3-S	68	S-8	75
5-S	83	1-2	64
7-S	75	3-4	77
S-2	66	5-6	75
S-4	68	7-8	75

CHARACTERISATION OF THE JOINTS

JUNCTION 1-2-S

X-shaped joint detail 12

JOINT 3-4-S

T-shaped joint, detail 5

JOINT 5-6-S

X-shaped joint with resilient profile detail 43

JOINT 7-8-S

X-shaped joint with resilient profile detail 43


Download all the documentation about the project from www.rothoblaas.com

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm) (2,4 m x 3 m)
 floor: CLT 5 layers (s: 100 mm) (2,4 m x 3,5 m)
 lower wall: CLT 5 layers (s: 100 mm) (2,4 m x 3 m)

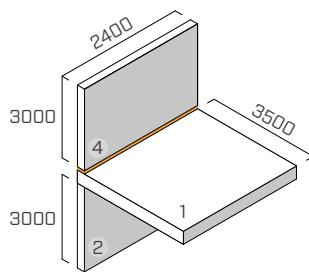

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm

fastening pattern on CLT: 31 screws 5 x 50 mm

RESILIENT PROFILE


PIANO A

position: between the upper wall and the floor

dimensions: width = 100 mm thickness = 6 mm length = 2,40 m

contact area: continuous strip (same width as the wall)

applied load [N/m²]: 22000

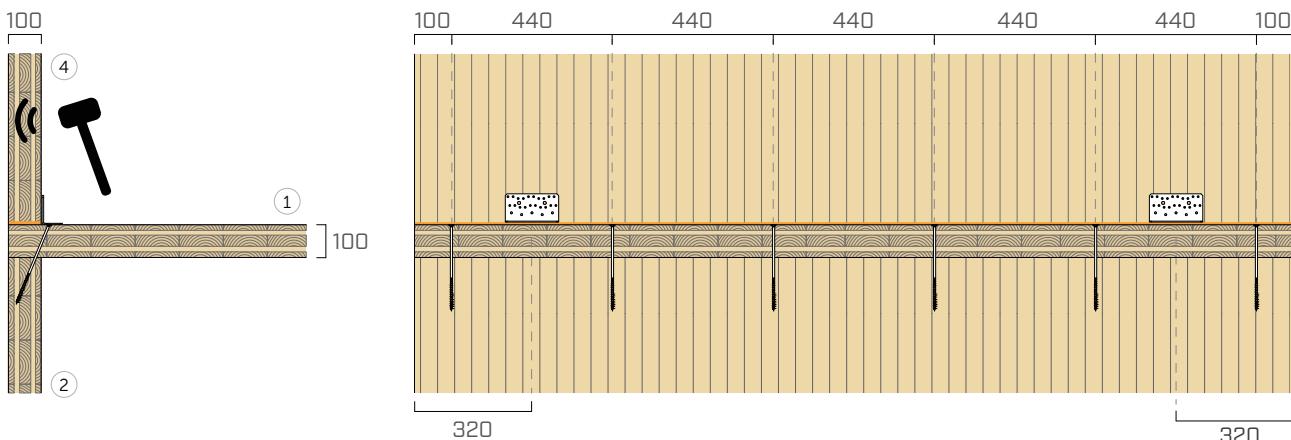

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	13,5	19,0	13,3	13,4	15,4	17,5	17,8	14,9	19,3	18,5	24,8	26,2	22,6	20,8	21,0	21,6

$$\overline{K_{14}} = 18,7 \text{ dB}$$

$$\overline{K_{14,0}} = 14,4 \text{ dB}$$

$$\Delta_{l,14} = 4,4 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	15,1	18,5	13,2	10,1	14,2	12,0	13,0	10,0	13,9	10,9	15,0	15,4	16,6	17,8	18,0	20,0

$$\overline{K_{12}} = 13,9 \text{ dB}$$

$$\overline{K_{12,0}} = 14,6 \text{ dB}$$

$$\Delta_{l,12} = -0,7 \text{ dB}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	15,1	25,5	23,3	22,1	17,9	20,9	17,3	16,9	21,3	25,1	30,0	32,6	30,7	31,8	31,4	31,0

$$\overline{K_{24}} = 24,3 \text{ dB}$$

$$\overline{K_{24,0}} = 20,4 \text{ dB}$$


$$\Delta_{l,24} = 3,9 \text{ dB}$$

T-JOINT | PERIMETER WALLS

EN ISO 10848-1/4

STRUCTURE

upper wall: CLT 5 layers (s: 100 mm) (2,4 m x 3 m)
 floor: CLT 5 layers (s: 100 mm) (2,4 m x 3,5 m)
 lower wall: CLT 5 layers (s: 100 mm) (2,4 m x 3 m)

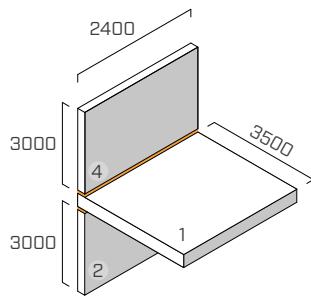

FASTENING SYSTEM

6 **HBS** partially threaded screws Ø8 x 240 mm (HBS8240), spacing 440 mm

2 angle brackets **NINO** (NINO15080) with resilient profile **XYLOFON PLATE** (XYL3555150), 146 x 55 x 77 x 2,5 mm, spacing 1760 mm

fastening pattern on CLT: 31 screws 5 x 50

RESILIENT PROFILE


PIANO C

position: between the upper wall and the floor + between the floor and the lower wall

dimensions: width = 100 mm thickness = 6 mm length = 2,40 m

contact area: continuous strip (same width as the wall)

applied load [kN/m²]: 1300

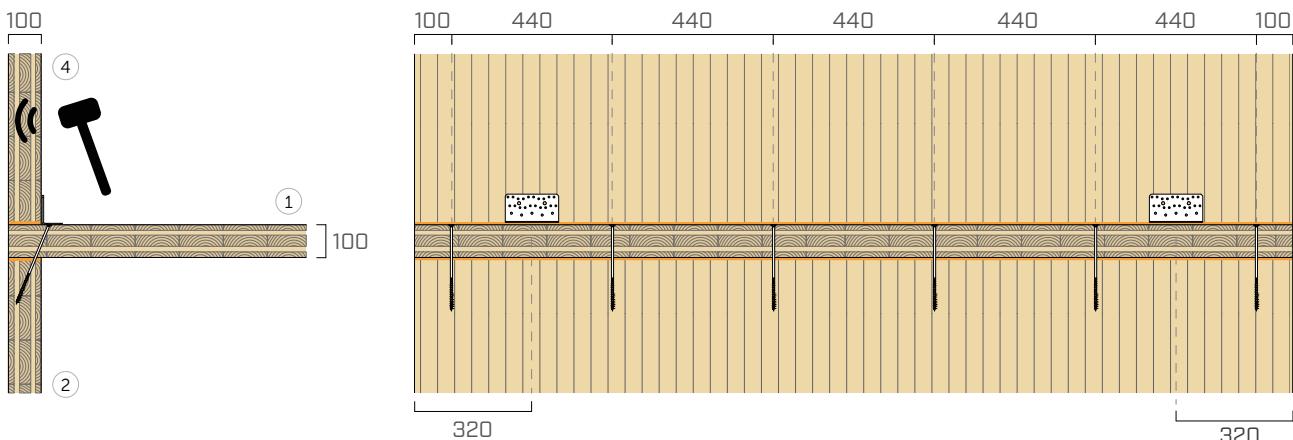

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₄ [dB]	15,5	16,0	16,1	17,7	16,9	19,1	18,0	16,6	17,6	18,8	17,1	19,1	19,8	16,1	17,8	21,1

$$\overline{K_{14}} = \mathbf{17,6 \text{ dB}} \quad \overline{K_{14,0}} = \mathbf{13,3 \text{ dB}} \quad \Delta_{l,14} = \mathbf{4,3 \text{ dB}}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	16,4	17,2	12,6	18,4	16,5	16,3	19,2	14,9	17,1	17,5	16,1	19,8	23,6	19,3	21,1	26,5

$$\overline{K_{12}} = \mathbf{17,6 \text{ dB}} \quad \overline{K_{12,0}} = \mathbf{14,5 \text{ dB}} \quad \Delta_{l,12} = \mathbf{3,1 \text{ dB}}$$

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₂₄ [dB]	15,4	26,0	18,0	20,1	21,5	23,4	21,3	16,4	19,3	23,5	23,5	31,1	30,3	30,4	31,7	29,7


$$\overline{K_{24}} = \mathbf{23,4 \text{ dB}} \quad \overline{K_{24,0}} = \mathbf{17,3 \text{ dB}} \quad \Delta_{l,24} = \mathbf{6,1 \text{ dB}}$$

I SOLUTIONS FOR LIGHTWEIGHT FLOORS

PIANO A is a resilient profile that works with reduced loads, which can be used to reduce vibrations even in floors with little construction mass.


Its effectiveness has also been tested at the University of Innsbruck as a desolidarising profile for ribs in dry floors.

SET UP

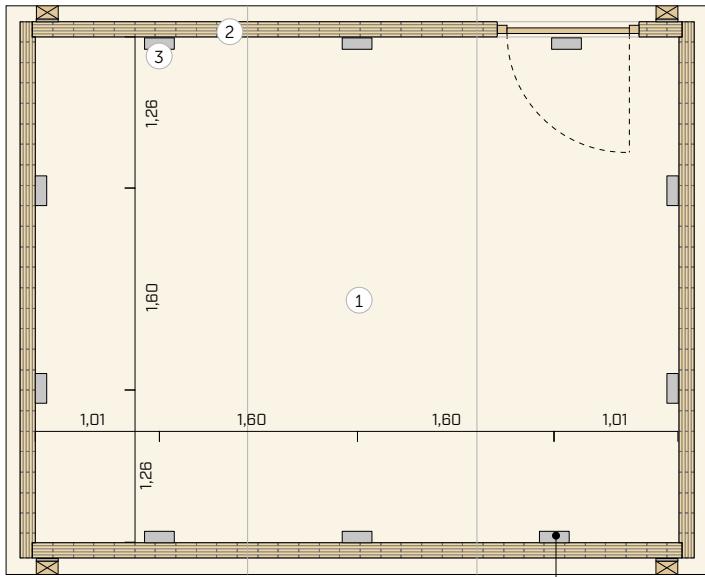


The receiving and transmitting rooms have a floor area of 21.5 m^2 (5.24 m length; 4.10 m width).


The volume of the transmitting room is 53.0 m^3 , and the volume of the receiving room 85.0 m^3 .

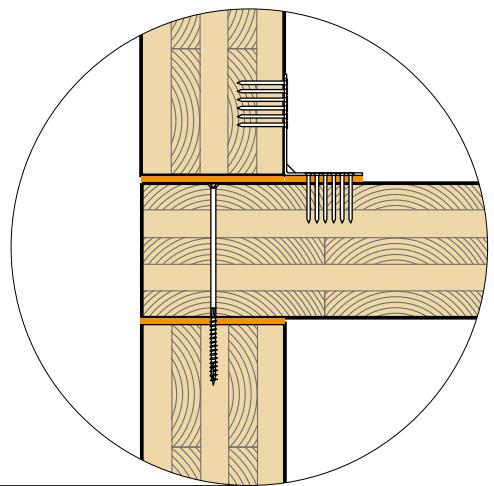

addition of the dry system
with PIANO

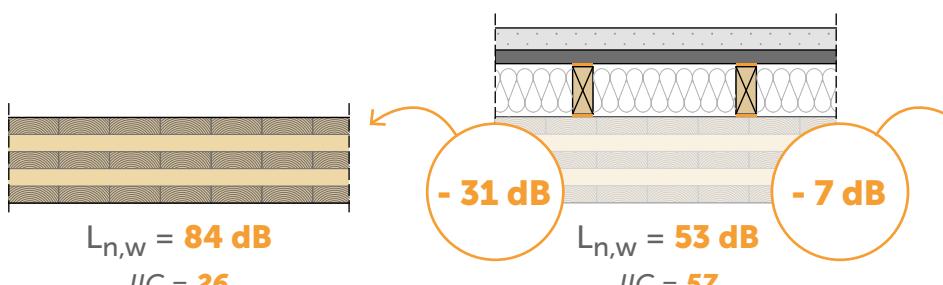

addition of dry system
without PIANO

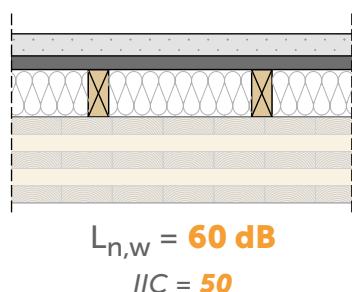

LABORATORY MEASUREMENT | DRY FLOOR SLAB_1

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX


REFERENCE STANDARD: ISO 16283-1

FLOOR SLAB

Surface = 21,5 m²

Mass = 167 kg/m²

Receiving room volume = 75,52 m³

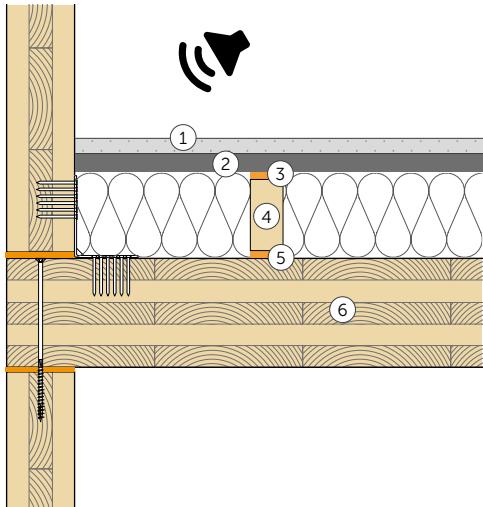

① reinforced gypsum-fibre board (44 kg/m²) (thickness: 32 mm)

② high density cardboard and sand panels (34,6 kg/m²) (thickness: 30 mm)


③ **PIANO A**

④ wood batten 50 x 100 mm

⑤ **PIANO A**

⑥ CLT (thickness: 160 mm)

AIRBORNE SOUND INSULATION

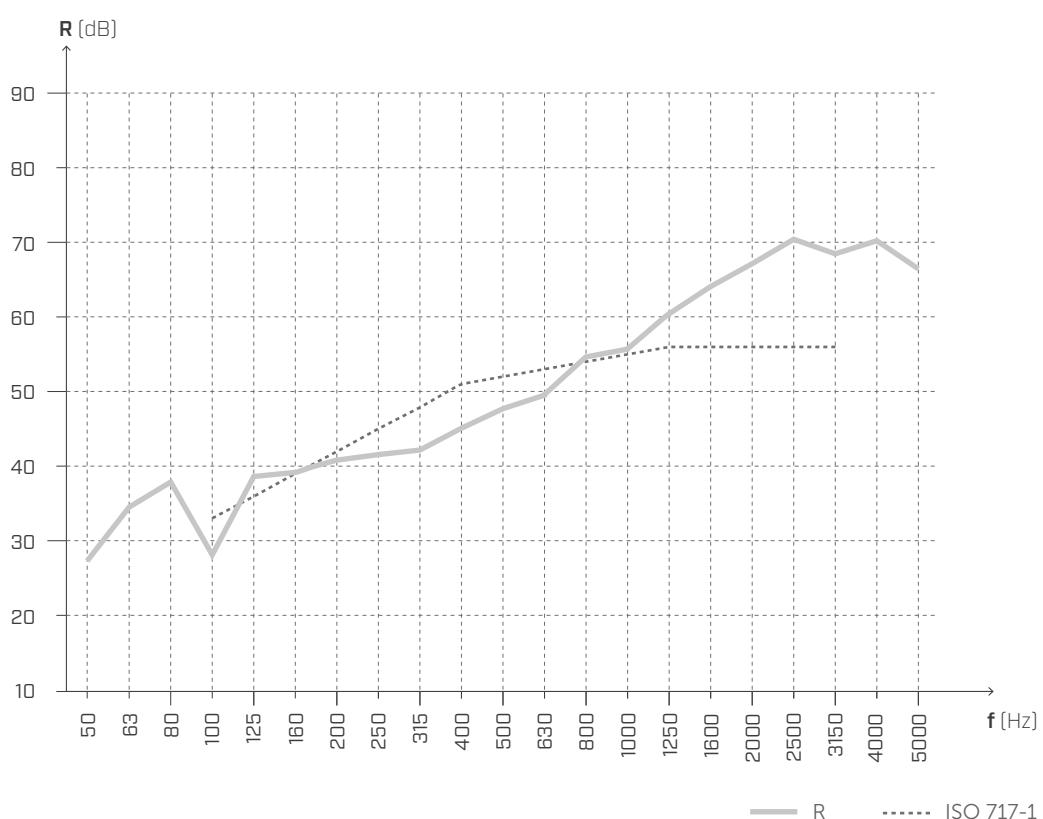

$$R_w (C; C_{tr}) = \text{52 (0; -7) dB}$$


Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau Technikerstraße 13A - 602 Innsbruck.

Test protocol: M02_L_220906_Balkenaufbau-Entkoppelung_oben_unten.

LABORATORY MEASUREMENT | DRY FLOOR SLAB_2

MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD ISO 10140-3

FLOOR SLAB

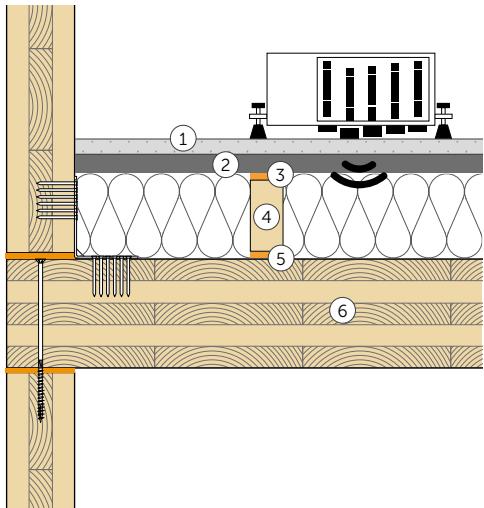

Surface = 21,5 m²
Mass = 167 kg/m²
Receiving room volume = 75,52 m³

- ① reinforced gypsum-fibre board (44 kg/m²) (thickness: 32 mm)
- ② high density cardboard and sand panels (34,6 kg/m²) (thickness: 30 mm)
- ③ **PIANO A**
- ④ wood batten 50 x 100 mm
- ⑤ **PIANO A**
- ⑥ CLT (thickness: 160 mm)

IMPACT SOUND INSULATION




$$L'_{n,w,PIANO} (C_l) = \textcolor{orange}{53 (-1) dB}$$

$$IIC = \textcolor{orange}{57}$$

Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau Technikerstraße 13A - 602 Innsbruck.
Test protocol: M02_L_220906_Balkenaufbau-Entkoppelung_oben_unten.

COMPARATIVE ANALYSIS | DRY FLOOR SLAB_2

MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD ISO 10140-3

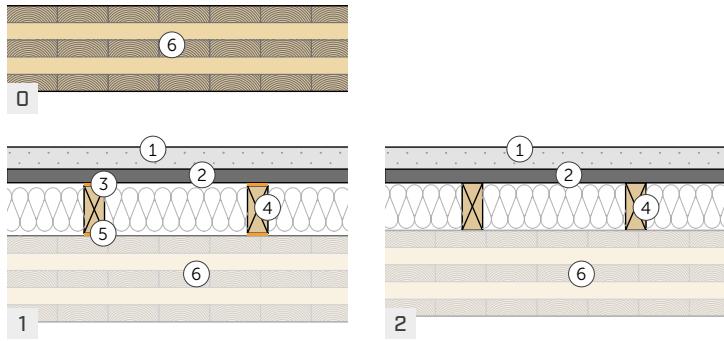

FLOOR SLAB

Surface = $21,5 \text{ m}^2$

Mass = 167 kg/m^2

Receiving room volume = $75,52 \text{ m}^3$

- (1) reinforced gypsum-fibre board (44 kg/m^2) (thickness: 32 mm)
- (2) high density cardboard and sand panels ($34,6 \text{ kg/m}^2$) (thickness: 30 mm)
- (3) PIANO A
- (4) wood batten $50 \times 100 \text{ mm}$
- (5) PIANO A
- (6) CLT (thickness: 160 mm)

IMPACT SOUND INSULATION



CLT (thickness: 160 mm)

Dry floor without PIANO

$$L'_{n,w,0} (C_l)^{(0)} = 84 (-4) \text{ dB}$$

$$\text{IIC}_0 = 26$$

$$L'_{n,w,\text{PIANO}} (C_l)^{(1)} = 53 (-1) \text{ dB}$$

$$\text{IIC} = 57$$

$$L'_{n,w} (C_l)^{(2)} = 60 (-1) \text{ dB}$$

$$\text{IIC} = 50$$

Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau Technikerstraße 13A - 602 Innsbruck.

Test protocol: M02_L_220906_Balkenaufbau-Entkoppelung_oben_unten.

ALADIN

TECHNICAL MANUAL



rothoblaas

Solutions for Building Technology

CONTENTS

PRODUCT CHOICE AND DETERMINATION OF K_{ij}	146
ALADIN EXTRA SOFT	148
ALADIN SOFT	150
THE CEN MODEL (EN ISO 12354)	152
DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES	153
THE SIMPLIFIED METHOD	154
FLANKSOUND PROJECT	156
MEASUREMENT CONFIGURATION	157
L-SHAPED JOINT	158
L-SHAPED JOINT	159
L-SHAPED JOINT	160
ON SITE MEASUREMENTS	161
ON-SITE MEASUREMENT CLT FLOOR	162
ON-SITE MEASUREMENT CLT FLOOR	163
ACOUSTIC AND MECHANICAL INTERACTION	164
SHEAR AND TENSILE STRENGTH TITAN + ALADIN CERTIFIED IN ETA	166
ALADIN RECOMMENDATIONS FOR INSTALLATION	167

ALADIN



RESILIENT SOUNDPROOFING PROFILE



CODES AND DIMENSIONS

CODE	version	B [mm]	L [m]	s [mm]	pcs
ALADIN115	EXTRA SOFT	115	50	7	1
ALADIN95	SOFT	95	50	5	1

PRODUCT COMPARISON

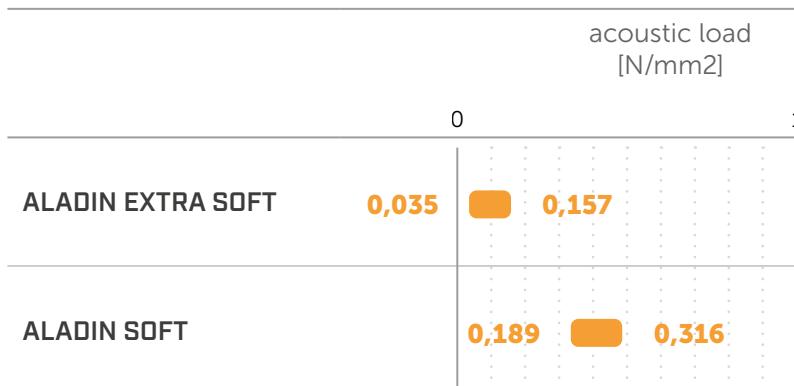

Anti-vibration

ALADIN dampens vibrations due to its ability to absorb and dissipate the energy of the system

page 7



FLANKSOUND PROJECT

K_{ij} measured according to ISO EN 10848

page 16



On site measurements

effectiveness verified through the measurement of passive acoustic requirements in constructed buildings

page 21



Static to acoustic interaction

Experimental data on the static performance of a timber-to-steel connection with ALADIN interposed

page 24



PRODUCT CHOICE AND DETERMINATION OF K_{IJ}

DESIGNING THE CORRECT PROFILE ACCORDING TO THE LOAD

Resilient profiles must be correctly loaded in order to isolate the low to medium frequencies of structurally transmitted vibrations: guidance on how to proceed with the evaluation of the product are given below.

It is advisable to add the permanent load value at 50% of the characteristic value of the accidental load.

$$Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$$

It is necessary to focus on the operating conditions and not the ultimate limit state conditions. This is because the goal is to insulate the building from noise during normal operating conditions and not during design limit states.

PRODUCT SELECTION



The product can also be selected using the application tables (see for example the following table for ALADIN EXTRA SOFT).

TABLE OF USE⁽¹⁾

CODE	B		load for acoustic optimisation ⁽²⁾ [kN/m] [lb/ft]				compression for acoustic optimisation ⁽²⁾ [N/mm ²] [psi]				reduction [mm] [mil]									
	[mm]	[in]	from	a	from	a	from	a	from	a	from	a								
ALADIN115	115	4 1/2	4	2969	18	13317	0,035	0,157	0,7	2	57,5 (divided)	2 1/4	2	1484	9	6658	5,1	22,8	28	79



To properly evaluate the product using MyProject, simply follow the step-by-step instructions provided by the software.




Note: The static behaviour of the material in compression is evaluated, considering that the deformations due to the loads are static. This is because a building is not affected by significant movement phenomena, nor dynamic deformation.

Rothoblaas has chosen to define a load range that allows good acoustic performance and avoids excessive deformation and differential movements in the materials, including the building's final architectural finishes. It is possible to use profiles with loads outside the indicated range if the resonance frequency of the system and the deformation of the profile at the ultimate limit state are assessed.

DETERMINATION OF PERFORMANCE

Once the loads have been identified, it is necessary to determine the design frequency - that is the stimulating frequency for the element from which the structure needs to be isolated. Below is an example, to make the explanation easier and simple to understand.

Suppose there is a load of $0,015 \text{ N/mm}^2$ acting on the profile. In this case, we used the ALADIN EXTRA SOFT product, because the load is not particularly high. Reading the graph, it can be seen that the profile has a resonance frequency of around 21 Hz.

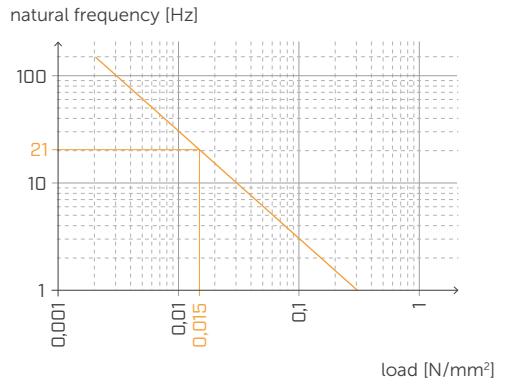


At this point, the degree of transmission for the product under these load conditions can be calculated, referring to the design frequency of 100 Hz.

$$\text{transmission} = f/f_0 = 5$$

Then the transmission graph is used, placing the value 5 obtained on the x-axis and intersecting the degree of the transmission curve. It follows that the transmission of the material is negative i.e. that the material is able to insulate around -11 dB.


TRANSMISSION IS POSITIVE WHEN THE MATERIAL TRANSMITS AND IS NEGATIVE WHEN THE PROFILE BEGINS TO INSULATE. This means this figure shows that the product, loaded in this way, insulates 11 dB at a reference frequency of 100 Hz.

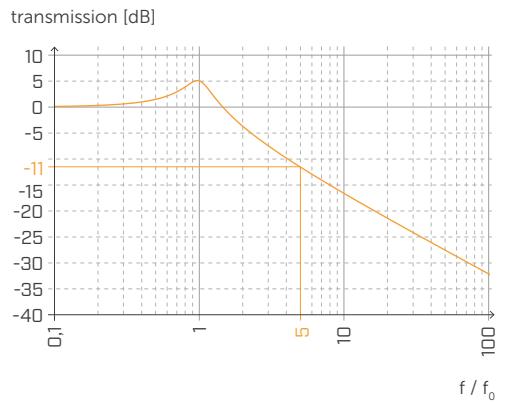

The same thing can be done using the attenuation graph. The percentage of vibration attenuated at the initial design frequency is obtained. The attenuation is also calculated with the load conditions referring to the design frequency of 100 Hz.

$$\text{attenuation} = f/f_0 = 5$$

The graph is used by placing the calculated value of 5 on the x-axis and intersecting the attenuation curve. It follows that the material's attenuation is optimal, i.e., the material can isolate more than 93 % of the transmission.

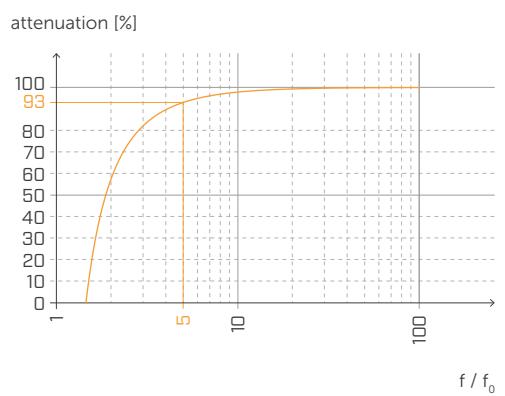

Essentially, the same result is obtained with two different inputs, but when deformation is set, the starting point is the mechanical performance, not the acoustic one. In the light of this fact, Rothoblaas always recommends starting with the design frequency and the loads to optimise the material based on the real conditions.

ALADIN EXTRA SOFT

TABLE OF USE

CODE	B [mm]	load for acoustic optimisation ⁽¹⁾		compression for acoustic optimisation ⁽¹⁾		deformation	
		[kN/m] from	to	[N/mm ²] from	to	[mm] from	to
ALADIN115	115	4	18	0,035	0,157	0,7	2
	57,5 (divided)	2	9				

(1) Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta L'_{nT,w}$	ISO 10848	4 dB
Dynamic stiffness s' (airtight condition) ⁽²⁾	UNI 29052	76 MN/m ³
Dynamic stiffness s' (non-airtight condition) ⁽²⁾	UNI 29052	23 MN/m ³
Density	ASTM D 297	0,50 g/cm ³
Compression set 50% (22h, 23°C)	EN ISO 815	≤ 25%
Compression set 50% (22h, 40°C)	EN ISO 815	≤ 35%
Water absorption 48h	-	3%
Reaction to fire	EN 13501-1	class E
Max processing temperature	-	100°C

(2) ISO standards require for measurement with loads between 0.4 and 4 kPa and not with the product operating load. The contribution of air is not calculated because the product is extremely impermeable to air (extremely high flow resistance figures).



HIGH PERFORMANCE

Soundproofing up to 4 dB in accordance with EN ISO 140-7, thanks to the innovative composition of the mixture; reduced application thickness.

STATIC LOAD [buildings]




NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]

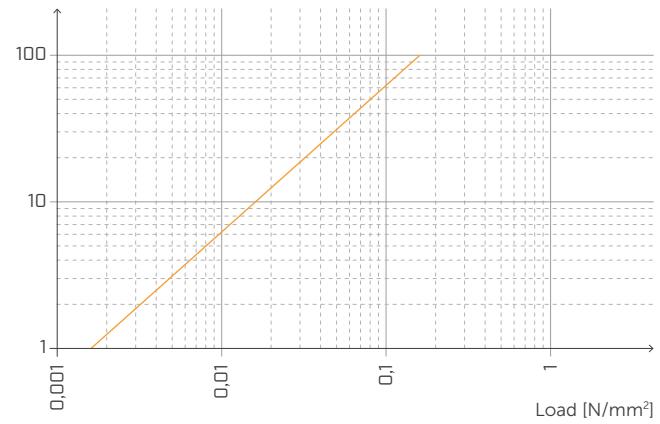


DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

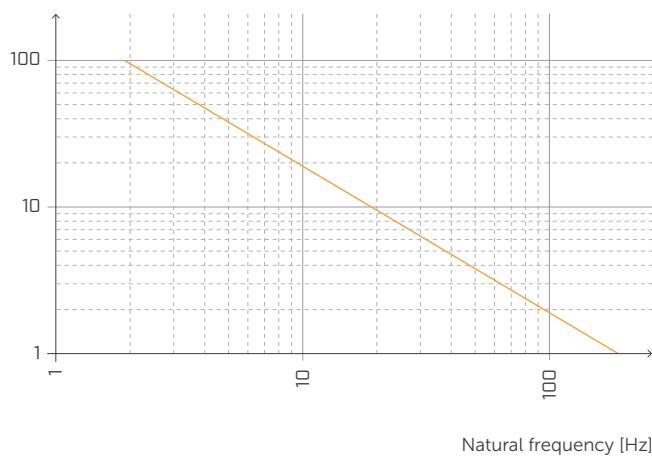


TRANSMISSIBILITY

Transmission [dB]

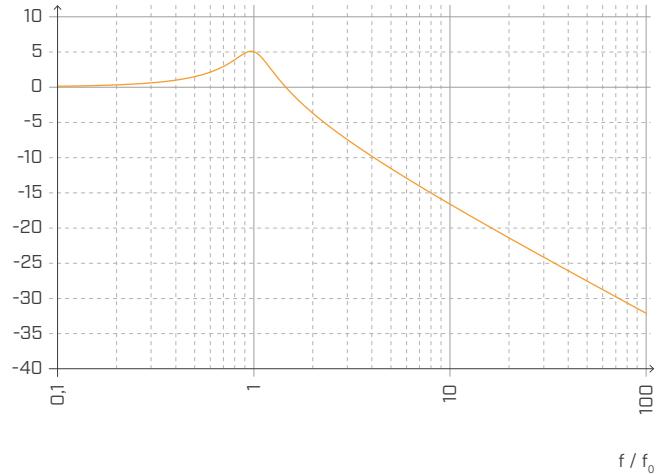

ATTENUATION

Attenuation [%]

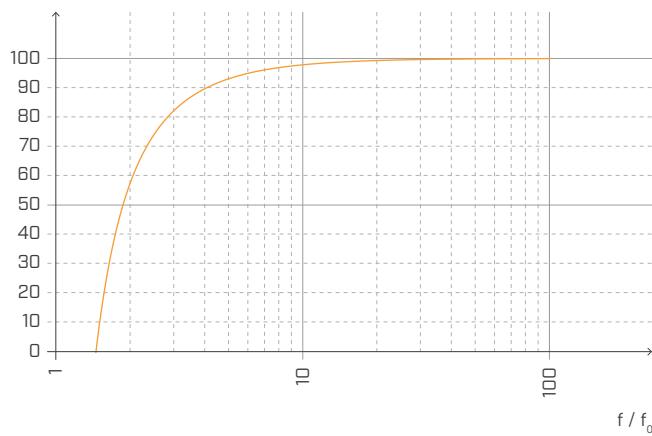

Normalised with respect to the resonance frequency with $f = 20$ Hz.

TABLE OF USE

CODE	B [mm]	load for acoustic optimisation ⁽¹⁾		compression for acoustic optimisation ⁽¹⁾		deformation	
		[kN/m] from	to	[N/mm ²] from	to	[mm] from	to
ALADIN95	95	18	30	0,189	0,316	0,5	1,5
	47,5 (divided)	9	15				

⁽¹⁾Resilient profiles must be properly loaded in order to isolate medium/low frequency vibrations transmitted structurally. It is advisable to assess the load according to the operating conditions because the building must be acoustically insulated under everyday load conditions (add the value of the permanent load to 50 per cent of the characteristic value of the incidental load $Q_{\text{linear}} = q_{gk} + 0,5 q_{vk}$).

TECHNICAL DATA

Properties	standard	value
Acoustic improvement $\Delta L'_{nT,w}$	ISO 10848	3 dB
Dynamic stiffness s' (airtight condition) ⁽²⁾	UNI 29052	221 MN/m ³
Dynamic stiffness s' (non-airtight condition) ⁽²⁾	UNI 29052	115 MN/m ³
Density	ASTM D 297	1,1 g/cm ³
Compression set 50% (22h, 70°C)	EN ISO 815	50%
Tensile strength	EN ISO 37	$\geq 9 \text{ N/mm}^2$
Elongation at failure	EN ISO 37	$\geq 500\%$
Water absorption 48h	-	< 1 %
Reaction to fire	EN 13501-1	class E
Max processing temperature	-	100°C

⁽²⁾ISO standards require for measurement with loads between 0,4 and 4 kPa and not with the product operating load. The contribution of air is not calculated because the product is extremely impermeable to air (extremely high flow resistance figures).



RELIABLE

Extruded EPDM compound to optimise sound absorption. It also offers high chemical stability and is VOC-frees.

STATIC LOAD [buildings]



NATURAL FREQUENCY AND LOAD

Natural frequency [Hz]




DEFORMATION AND LOAD

Deformation [%]




DEFORMATION AND NATURAL FREQUENCY

Deformation [%]

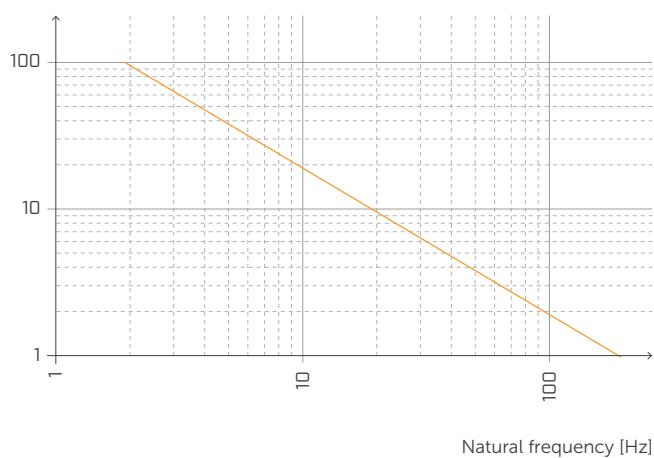


TRANSMISSIBILITY

Transmission [dB]

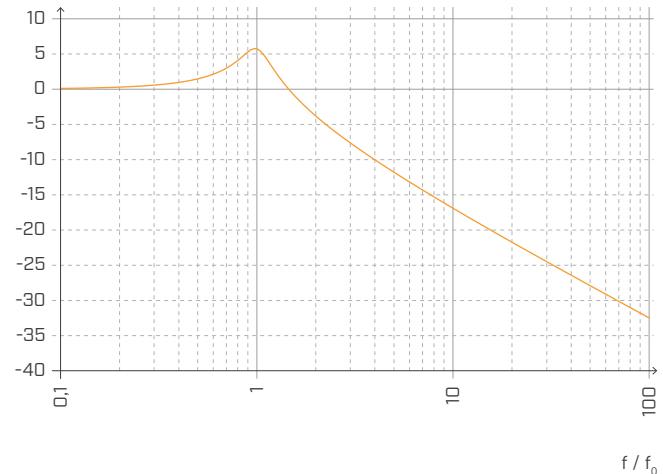

ATTENUATION

Attenuation [%]

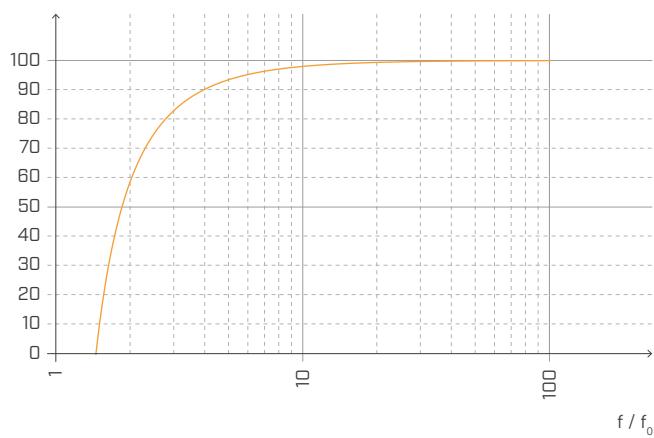

Normalised with respect to the resonance frequency with $f = 20$ Hz.

THE CEN MODEL (EN ISO 12354)

The CEN model proposed in the EN ISO 12354 series of standards provides a powerful tool to predict the acoustic performance of a partition from the characteristics of the construction elements. The EN ISO 12354 series has been expanded to provide more specific information regarding timber frame and CLT structures.



EN ISO 12354-1:2017

Airborne sound insulation between rooms.



EN ISO 12354-2:2017

Impact sound soundproofing between rooms.

APPARENT SOUND REDUCTION INDEX

EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method. When using the simplified calculation model, disregarding the presence of small penetrations and airborne transmission paths $D_{n,j,w}$, the apparent sound reduction index R'_w can be calculated as the logarithmic sum of the direct component $R_{Dd,w}$ and the flanking transmission components $R_{ij,w}$.

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{n,j,w}}{10}} \right] (dB)$$

The sound reduction index for flanking transmission paths $R_{ij,w}$ can be estimated as:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{l_0 l_{ij}} (dB)$$


where:

$R_{i,w}$ e $R_{j,w}$ are sound reduction evaluation indices of flanking elements i and j respectively;

ΔR_i , ΔR_j are sound reduction index increases due to the installation of architectural finishes for element i in the source environment and/or element j in the receiving environment;

K_{ij} vibration reduction index through the joint

S is the area of the separating element and l_{ij} is the length of the joint between the separating wall and the flanking elements i and j, l_0 being a reference length of 1 m.

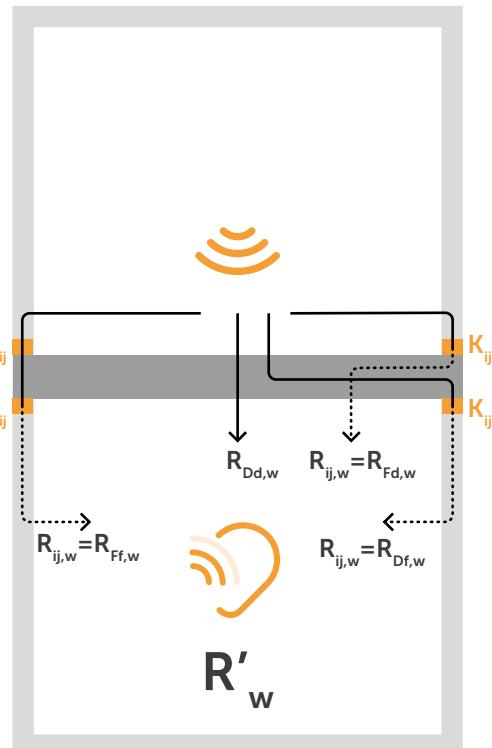

Among the input parameters required by the calculation model, the sound reduction indices can be obtained from accredited laboratory measurements or from the manufacturers of construction elements. Additionally, a number of open-access databases offer data for frequently used construction solutions. The ΔR_w can be estimated by modelling the wall assembly in terms of a mass-spring-mass system (EN ISO 12354 Annex D).

The most critical parameter to estimate is the **VIBRATION REDUCTION INDEX** K_{ij} . This quantity represents the vibration energy dissipating into the junction, and is associated with the structural coupling of the elements. High values of K_{ij} generate the best junction performance. Standard EN ISO 12354 provides some predictive estimates of two standard T and X-shaped joints for CLT structures, which are shown on the right, but the experimental data available is still limited. This is why Rothoblaas has invested in several measurement campaigns to provide usable data with this calculation model.

The ASTM standards currently do not provide a predictive model for the evaluation of flanking sound transmission, so the ISO 12354 and ISO 10848 standards are used and "translated" into the ASTM metric.

ASTM & K_{ij}

$$STC_{ij} = \frac{STC_i}{2} + \frac{STC_j}{2} + K_{ij} + \max(\Delta STC_i, \Delta STC_j) + \frac{\min(\Delta STC_i, \Delta STC_j)}{2} + 10 \log \frac{S}{l_0 l_{ij}}$$

DETERMINING THE VIBRATION REDUCTION INDEX K_{ij} IN TIMBER STRUCTURES

INCORPORATING OF RESILIENT LAYERS LIKE XYLOFON, PIANO, CORK AND ALADIN

The MyProject software can be used during design, or follow one of the methods below, extrapolated from internationally valid standards.

METHOD 1 BASED ON EN ISO 12354:2017 FOR HOMOGENEOUS STRUCTURES

Typically, this formula has been considered for lightweight wood structures, i.e. considering the connections between elements, which are considered rigid and homogeneous. For CLT structures this is certainly an approximation.

K_{ij} depends on the shape of the junction and the type of elements composing it, especially their surface mass. In case of T- or X-joints, use the following expressions, shown aside.

For both cases:

$$K_{ij} = K_{ij\text{rigid}} + \Delta L$$

if the flanking transmission path passes through a junction

$$K_{ij} = K_{ij\text{rigid}} + 2\Delta L$$

if the flanking transmission path passes through two joints

$$M = 10 \log(m_{i\perp}/m_i)$$

where:

$m_{i\perp}$ is the mass of one of the elements, the one placed perpendicular to the other.

Therefore, the transmitted vibration reduction value is:

$$\Delta L_w = 10 \log(1/f_t)$$

for loads exceeding 750 kN/m² on a resilient layer with $\Delta L_{\min} = 5$ dB

$$f_t = ((G/t_i)(\rho_1 \rho_2))^{1.5}$$

where:

G is the Young tangential module (MN/m²)

t_i is the thickness of the resilient material (m)

ρ_1 and ρ_2 are, respectively, the density of connected elements 1 and 2

METHOD 2 F.3 EMPIRICAL DATA FOR JUNCTIONS CHARACTERIZED BY K_{ij} ISO 12354-1:2017

CLT construction elements are elements in which the structural reverberation time is, in most cases, mainly

determined by the connecting elements.


In the case of CLT structures weakly bound together, the side transmission contribution can be determined according to the following relations, valid if $0.5 < (m_1/m_2) < 2$.

METHOD 1 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 5.7 + 14.1 M + 5.7 M^2 \text{ dB}$$


$$K_{12} = 5.7 + 5.7 M^2 = K_{23} \text{ dB}$$



Solution 2 - T-SHAPED JOINT with resilient layer

$$K_{23} = 5.7 + 14.1 M + 5.7 M^2 \text{ dB}$$

$$K_{12} = 5.7 + 5.7 M^2 = K_{23} \text{ dB}$$




Solution 3 - X-SHAPED JOINT

$$K_{13} = 8.7 + 17.1 M + 5.7 M^2 \text{ dB}$$

$$K_{12} = 8.7 + 5.7 M^2 = K_{23} \text{ dB}$$

$$K_{24} = 3.7 + 14.1 M + 5.7 M^2 \text{ dB}$$

$$0 \leq K_{24} \leq -4 \text{ dB}$$




METHOD 2 - CALCULATING $K_{ij\text{rigid}}$

Solution 1 - T-SHAPED JOINT

$$K_{13} = 22 + 3.3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{23} = 15 + 3.3 \log(f/f_k)$$




Solution 1 - X-SHAPED JOINT

$$K_{13} = 10 - 3.3 \log(f/f_k) + 10 M$$

$$K_{24} = 23 - 3.3 \log(f/f_k)$$

$$f_k = 500 \text{ Hz}$$

$$K_{14} = 18 - 3.3 \log(f/f_k)$$



THE SIMPLIFIED METHOD

A CALCULATION EXAMPLE USING EN ISO 12354

INPUT DATA


The EN ISO 12354 norms provide two methods to calculate the acoustic performance of a partition: a detailed method and the simplified method.

Regarding airborne sound insulation, the simplified calculation model predicts the apparent sound energy as a single value based on the acoustic performance of the elements involved in the junction. Below is an example of a calculation evaluating the apparent sound reduction index between two adjacent rooms.


In order to determine the acoustic performance of assembly from the acoustic performance of its components, it is important to determine for every junction element:

- the geometry of the partition (S)
- the acoustic properties of the assembly (R_w)
- the connection between structural elements (K_{ij})
- the characteristics of each layer composing the assembly

PLAN

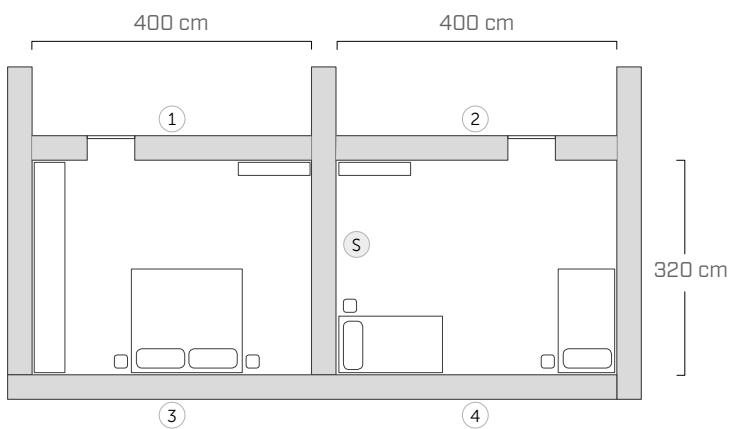

SECTION

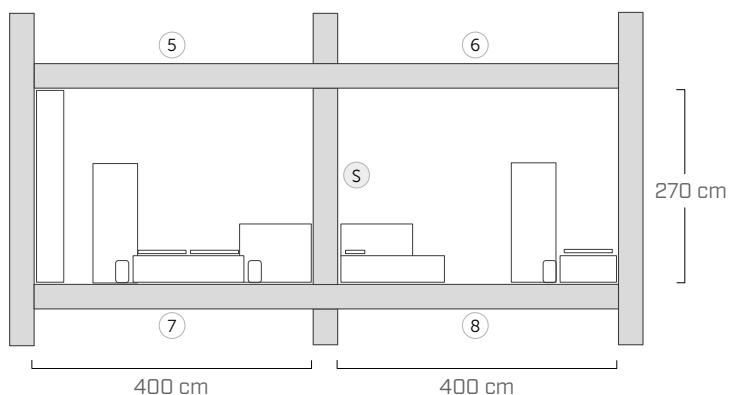

PARTITION CHARACTERISTICS

SEPARATING WALL (S)

25 mm	plasterboard
50 mm	mineral wool
75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

INTERNAL WALLS (1)

12,5 mm	gypsum fibreboard
78 mm	CLT
12,5 mm	gypsum fibreboard

INTERNAL WALLS (2)

75 mm	CLT
50 mm	mineral wool
25 mm	plasterboard

EXTERNAL WALLS (3) (4)

6 mm	plaster
60 mm	wood fibre panel
160 mm	mineral wool
90 mm	CLT
70 mm	fir panels
50 mm	mineral wool
15 mm	plasterboard
25 mm	plasterboard

FLOORS (5) (6) (7) (8)

70 mm	concrete screed
0,2 mm	PE membrane
30 mm	under floor membrane
50 mm	backfill (loose)
140 mm	CLT
60 mm	mineral wool
15 mm	plasterboard

Data for acoustic characterisation of the assemblies was taken from DataHolz.

www.dataholz.com

CALCULATION OF DIRECT AND FLANKING TRANSMISSION COMPONENTS

The apparent sound reduction index is obtained from the contribution of the direct component and the flanking transmission paths, based on the following equation:

$$R'_w = -10 \log \left[10^{-\frac{R_{Dd,w}}{10}} + \sum_{i,j=1}^n 10^{-\frac{R_{ij,w}}{10}} + \frac{A_0}{S_s} \sum_{j=1}^n 10^{-\frac{D_{nj,w}}{10}} \right] (dB)$$

Considering only the first order transmission, there are three flanking transmission paths for each combination of partitions i-j, for a total of 12 R_{ij} calculated using the equation:

$$R_{ij,w} = \frac{R_{i,w} + R_{j,w}}{2} + \Delta R_{ij,w} + K_{ij} + 10 \log \frac{S}{I_0 I_{ij}} (dB)$$

DETERMINING THE APPARENT SOUND REDUCTION INDEX

The simplified calculation model has the unquestioned advantage of providing an easy-to-use tool to predict sound insulation.

On the other hand, its application is quite delicate for CLT structures because the damping of each structural element is strongly affected by the assembly. It really deserves a dedicated modelling approach. Moreover, CLT panels provide poor insulation at low frequencies, thus the use of frequency weighted indices might return results which do not provide an accurate representation of actual behaviour in the low frequency region. Therefore the use of the detailed method is advised for accurate predictive analysis.

In the example provided, sound insulation for direct transmission gives R_w of 53 dB, if the contributions of flanking transmission are considered, R'_w decreases to 51 dB.

$$R'_w = \mathbf{51 \, dB} \quad R_w = \mathbf{53 \, dB}$$

ACOUSTIC CHARACTERISTICS OF THE ASSEMBLIES

Path of transmission	S [m ²]	R _w [dB]	m' [kg/m ²]
S	8,64	53	69
1	10,8	38	68
2	10,8	49	57
3	10,8	55	94
4	10,8	55	94
5	12,8	63	268
6	12,8	63	268
7	12,8	63	268
8	12,8	63	268

CALCULATING R_{ij}

Path of transmission	R _{ij} [dB]	Path of transmission	R _{ij} [dB]
1-S	60	S-6	83
3-S	68	S-8	75
5-S	83	1-2	64
7-S	75	3-4	77
S-2	66	5-6	75
S-4	68	7-8	75

CHARACTERISATION OF THE JOINTS

JUNCTION 1-2-S

X-shaped joint
detail 12

JOINT 3-4-S

T-shaped joint,
detail 5

JOINT 5-6-S

X-shaped joint with resilient profile
detail 43

JOINT 7-8-S

X-shaped joint with resilient profile
detail 43

Download all the documentation about the project from www.rothoblaas.com

FLANKSOUND PROJECT

EXPERIMENTAL MEASUREMENTS OF K_{ij} FOR CLT JOINTS

Rothoblaas has therefore promoted research aimed at measuring the K_{ij} vibration reduction index for a variety of CLT panel joints, with the dual objective of providing specific experimental data for the acoustic design of CLT buildings and contributing to the development of calculation methods.

L, T and X-shaped joints were tested during the measurement project.

CLT panels were provided by seven different manufacturers and therefore underwent different production processes, showing different characteristics such as the number and thickness of lamellas, side gluing of layers, and anti-shrinkage kerf cuts in the core. Different kinds of screws and connectors were tested, as well as different resilient layers at the wall-floor junction.

The test set-up was arranged in the warehouse at Rothoblaas headquarters in Cortaccia (prov. Bolzano).

The vibration reduction index measurements were carried out in compliance with EN ISO 10848.



K_{ij} for different types of joint


- 7 different CLT manufacturers
- L, T, X-shaped vertical and horizontal joints
- influence of type and number of screws
- influence of type and number of angle brackets
- influence of type and number of hold-downs
- use of resilient layers

FASTENING


HBS
countersunk screw




VGZ
fully threaded screw
with cylindrical head




TITAN N
angle bracket for shear loads in
solid walls



TITAN F
angle bracket for shear loads
on frame walls



WHT
angle bracket for tensile
loads




SOUNDPROOFING

XYLOFON
high performance
resilient profile



ALADIN
resilient profile




CONSTRUCTION SEALING
airtight profile




X-RAD

X-ONE
universal connector
for CLT panel



X-PLATE
complete range
of connection plates



MEASUREMENT CONFIGURATION

MEASUREMENT SETUP: EQUIPMENT AND DATA PROCESSING

The vibration reduction index K_{ij} is calculated as:

$$K_{ij} = \frac{D_{v,ij} + D_{v,ji}}{2} + 10 \log \frac{l_{ij}}{\sqrt{a_i a_j}} \text{ (dB)}$$

where:


- $D_{v,ij}$ ($D_{v,ji}$) is the difference in vibration velocity between the elements i and j (j and i) when element i (j) is excited (dB)
 l_{ij} is the length of the junction shared between the elements i and j
 a are the equivalent absorption lengths elements of i and j

$$a = \frac{2.2\pi^2 S}{c_0 T_s} \sqrt{\frac{f_{ref}}{f}} \text{ (m)}$$

- S is the panel surface
 f is the frequency
 T_s is the structural reverberation time

The sound source consisted of an electrodynamic shaker with sinusoidal peak force of 200 N, which was mounted on a heavyweight base and screwed to the CLT panels using a plate.

The velocity levels were measured using a pink noise source signal, filtered at 30 Hz in order to get reliable results from 50 Hz onwards. Structural reverberation times were calculated from impulse responses acquired using ESS test signals. The accelerometers were fixed to the panels using magnets. Eyelets were screwed to the panels with screws whose length was at least half of the thickness of the panels, in order to reach the innermost layer of the panel. The vibration reduction indices are reported in the one-third octave bands ranging from 100 to 3150 Hz, together with the value averaged over the one-third octave bands from 200 to 1250 Hz.

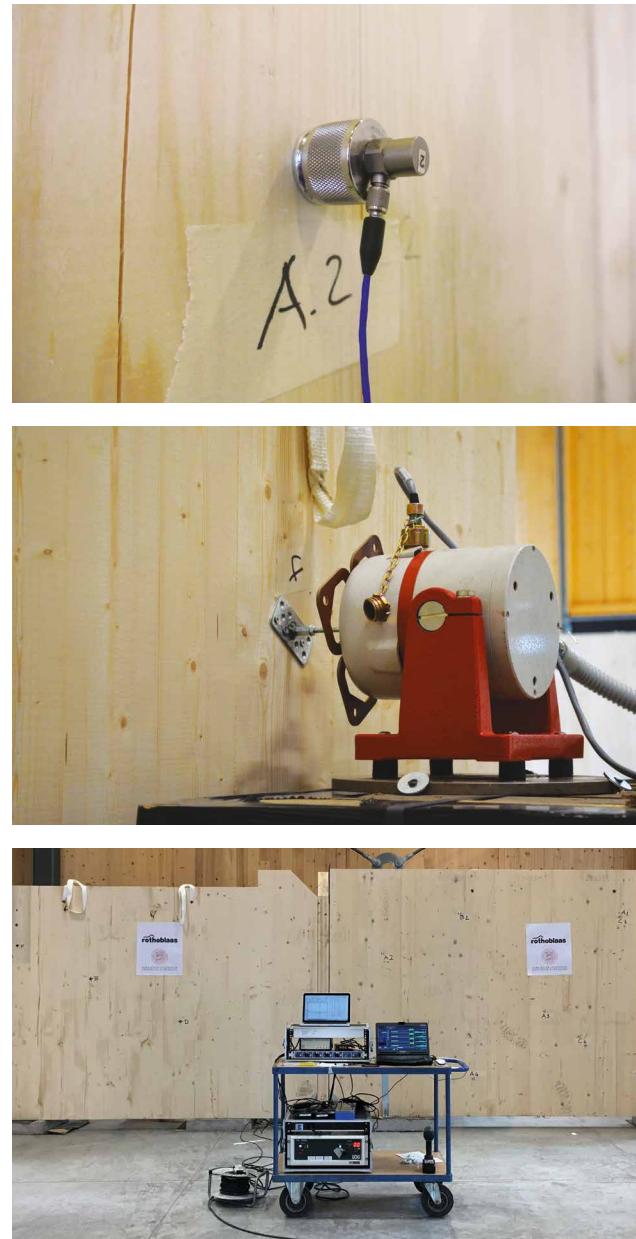

A. Speranza, L. Barbaresi, F. Morandi, "Experimental analysis of flanking transmission of different connection systems for CLT panels" in Proceedings of the World Conference on Timber Engineering 2016, Vienna, August 2016.

L. Barbaresi, F. Morandi, M. Garai, A. Speranza, "Experimental measurements of flanking transmission in CLT structures" in Proceedings of the International Congress on Acoustics 2016, Buenos Aires, September 2016.

L. Barbaresi, F. Morandi, M. Garai, A. Speranza, "Experimental analysis of flanking transmission in CLT structures" of Meetings on Acoustics (POMA), a serial publication of the Acoustical Society of America - POMA-D-17-00015.


L. Barbaresi, F. Morandi, J. Belcari, A. Zucchelli, Alice Speranza, "Optimising the mechanical characterisation of a resilient interlayer for the use in timber construction" in Proceedings of the International congress on sound and vibration 2017, London, July 2017.

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm) (2,3 m x 4,0 m)
lower wall: CLT 5 layers (s: 100 mm) (4,0 m x 2,3 m)

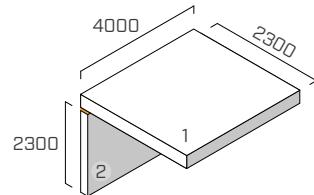

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm
5 angle brackets TITAN (TTN240) spacing 800 mm
fastening pattern: total nailing 72 screws 5 x 50
2 hold down WHT (WHT440)

RESILIENT PROFILE


ALADIN SOFT

position: between the lower wall and the floor.

dimensions: width = 95 mm thickness = 6 mm length = 4,0 m

contact area: continuous strip (same width as the wall)

applied load [kN/m]: structure self weight

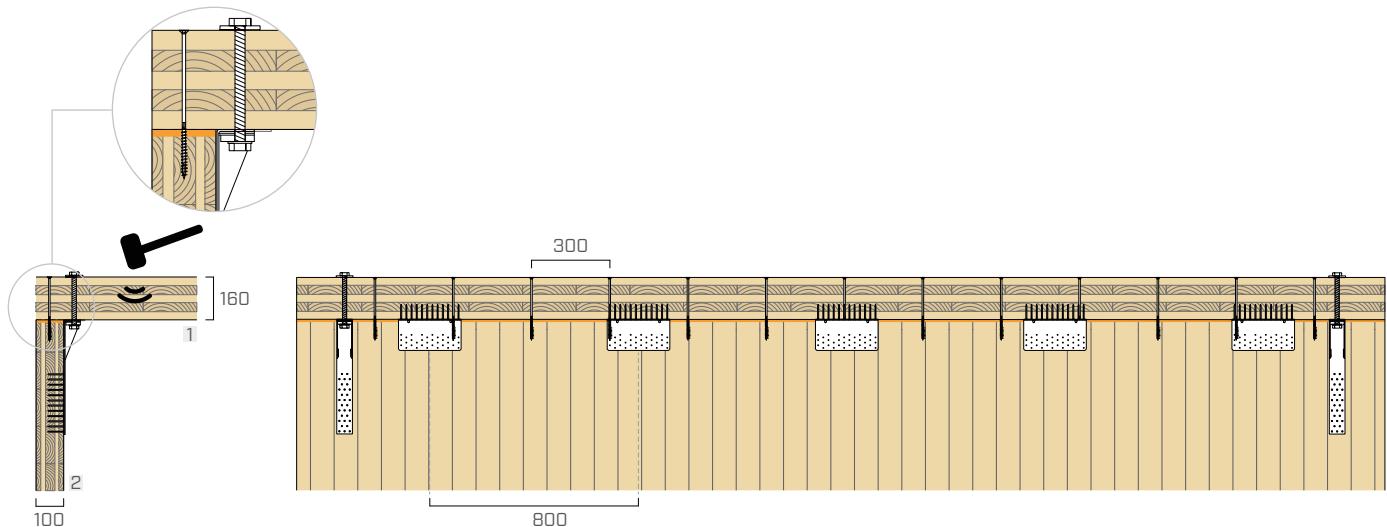

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	8,7	14,4	8,7	10,0	10,7	9,5	6,1	9,8	9,4	14,1	16,1	18,1	18,1	17,8	21,3	19,1


$$\overline{K_{12}} = 11,5 \text{ dB}$$

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm) (2,3 m x 4,0 m)
lower wall: CLT 5 layers (s: 100 mm) (4,0 m x 2,3 m)

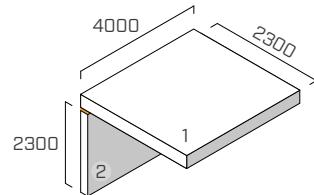

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm
5 angle brackets TITAN (TTN240) spacing 800 mm
fastening pattern: total nailing 72 screws 5 x 50
2 hold down WHT (WHT440)

RESILIENT PROFILE


ALADIN SOFT

position: between the lower wall and the floor.

dimensions: width = 95 mm thickness = 6 mm length = 4,0 m

contact area: continuous strip (same width as the wall)

applied load [kN/m]: 2

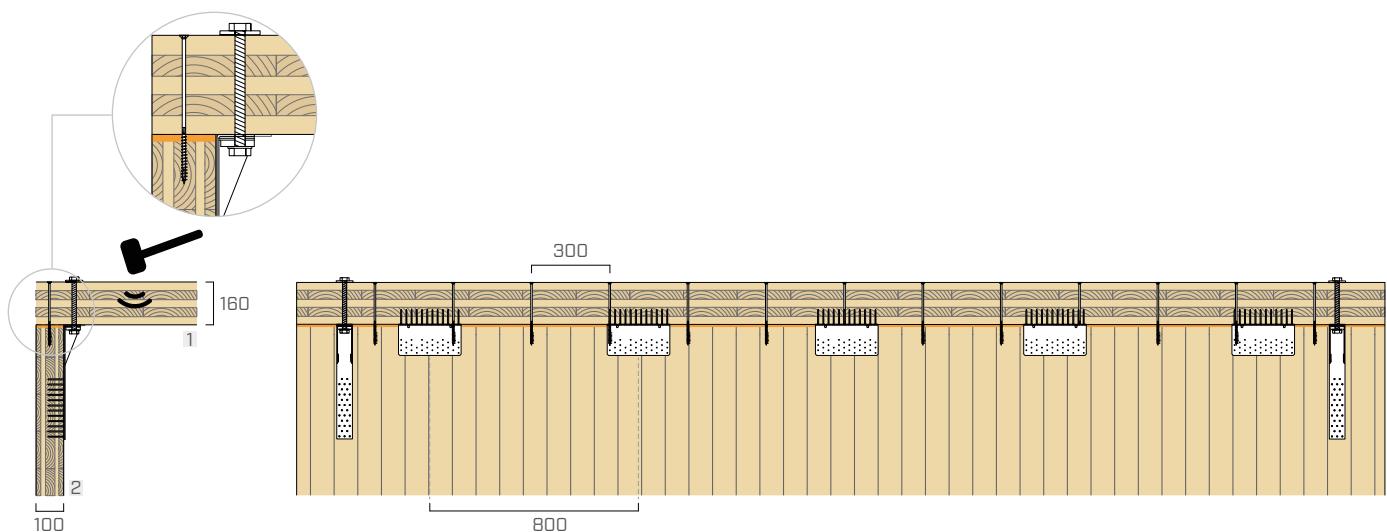

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	9,5	13,6	8,7	11,8	9,0	10,1	7,2	8,7	10,4	14,2	17,0	16,5	18,4	20,0	23,1	19,7


$$\overline{K_{12}} = 11,7 \text{ dB}$$

L-SHAPED JOINT

EN ISO 10848-1/4

STRUCTURE

floor: CLT 5 layers (s: 160 mm) (2,3 m x 4,0 m)
lower wall: CLT 5 layers (s: 100 mm) (4,0 m x 2,3 m)

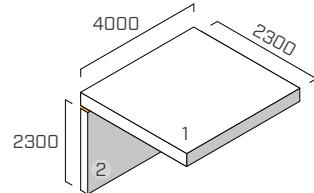

FASTENING SYSTEM

13 HBS partially threaded screws Ø8 x 240 mm (HBS8240), spacing 300 mm
5 angle brackets TITAN (TTN240) with resilient profile ALADIN spacing 800 mm
fastening pattern: total nailing 72 screws 5 x 50
2 hold down WHT (WHT440)

RESILIENT PROFILE


ALADIN SOFT

position: between the lower wall and the floor.

dimensions: width = 95 mm thickness = 6 mm length = 4,0 m

contact area: continuous strip (same width as the wall)

applied load [kN/m]: structure self weight

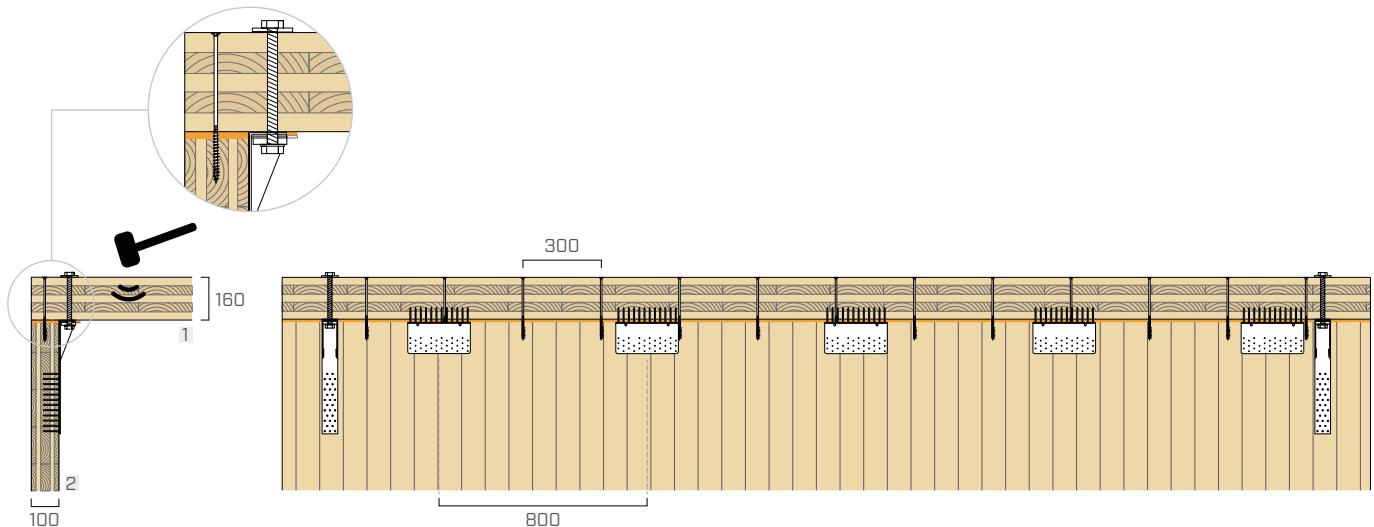

f [Hz]	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
K ₁₂ [dB]	9,7	15,3	9,0	11,2	9,2	9,3	6,6	10,6	9,7	14,0	16,3	15,8	16,7	17,8	22,1	21,8

$$\overline{K_{12}} = \mathbf{11,4 \text{ dB}}$$

ON SITE MEASUREMENTS

The effectiveness of ALADIN was also verified by measuring passive acoustic requirements in constructed buildings. ALADIN has been used in residential buildings, accommodation facilities, university campuses, schools, health centres and mixed-use multi-storey buildings. The performance achieved did not disappoint expectations and ALADIN proved to be an excellent partner for reducing flanking sound transmission.

UNIVERSITY CAMPUS

Victoria [AU]

description	university student residence with 150 beds
type of structure	CLT panels
location	Victoria (Australia)
products	ALADIN, XYLOFON



MULTI-STOREY BUILDING

Toronto [CA]

description	6-storey building for residential use
type of structure	CLT panels
location	Toronto (Canada)
products	ALADIN, XYLOFON




ON-SITE MEASUREMENT | CLT FLOOR

MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARDS: ISO 140-7

FLOOR SLAB

Surface = 31 m²

Receiving room volume = 75 m³

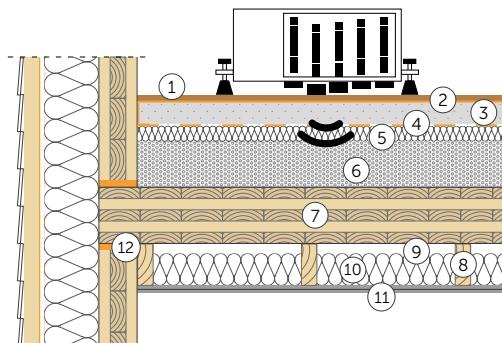

(1) Timber floor (thickness: 15 mm)

(2) **SILENT STEP** (thickness: 2 mm)

(3) Concrete screed (thickness: 70 mm)

(4) **BARRIER 100**

(5) Mineral wool insulation (thickness: 30 mm) $s' \leq 10 \text{ MN/m}^3$

(6) Gravel fill (thickness: 80 mm) (1600 kg/m³)

(7) CLT (thickness: 146 mm)

(8) Solid wood batten (thickness: 50 mm base: 150 mm)


(9) Air chamber

(10) Low density mineral wool insulation (thickness: 120 mm)

(11) Plasterboard panel x2 (thickness: 25 mm)

(12) **ALADIN EXTRA SOFT**

IMPACT SOUND INSULATION

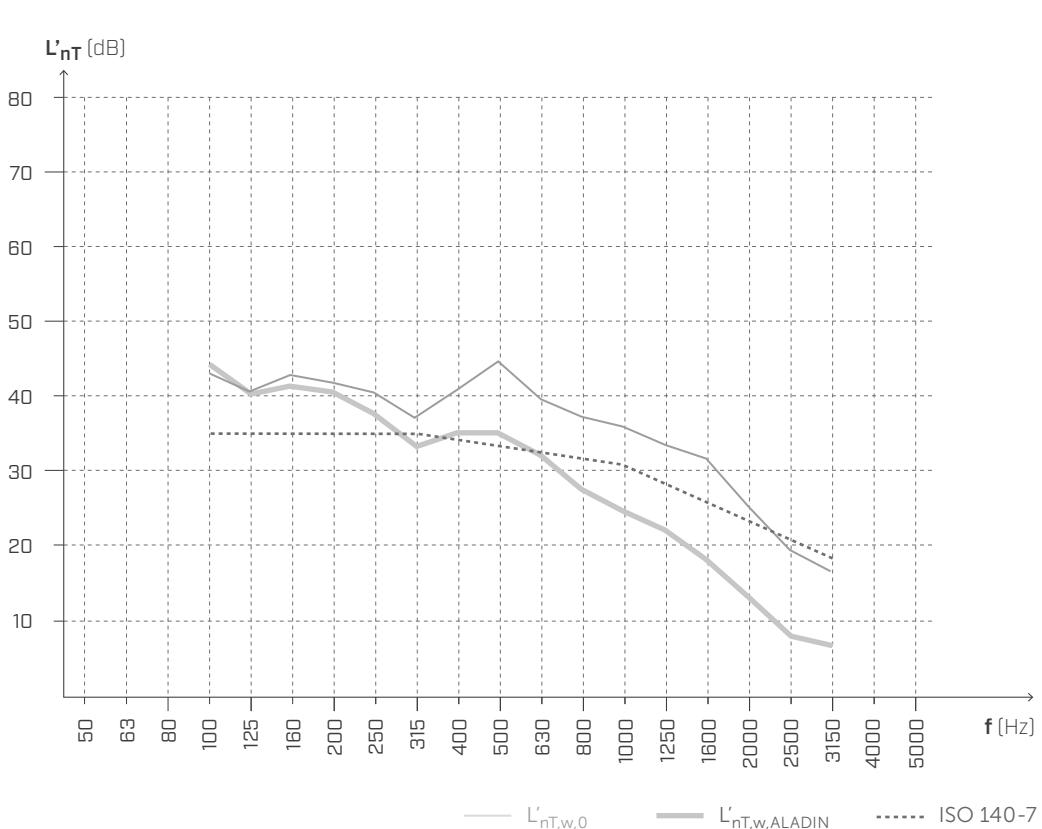

without ALADIN EXTRA SOFT

$$L'_{nT,w,0} (C_l) = 38 (1) \text{ dB}$$

$$NISR_{ASTM} = 73$$

with ALADIN EXTRA SOFT

$$L'_{nT,w,ALADIN} (C_l) = 34 (0) \text{ dB}$$

$$NISR_{ASTM} = 75$$


ON-SITE MEASUREMENT | CLT FLOOR

MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARDS: ISO 140-7

FLOOR SLAB

Surface = 31 m²

Receiving room volume = 75 m³

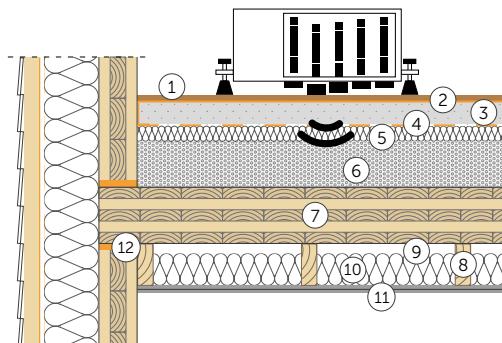

① Timber floor (thickness: 15 mm)

② **SILENT STEP** (thickness: 2 mm)

③ Concrete screed (thickness: 70 mm)

④ **BARRIER 100**

⑤ Mineral wool insulation (thickness: 30 mm) $s' \leq 10 \text{ MN/m}^3$

⑥ Gravel fill (thickness: 80 mm) (1600 kg/m^3)

⑦ CLT (thickness: 146 mm)

⑧ Solid wood batten (thickness: 50 mm base: 150 mm)


⑨ Air chamber

⑩ Low density mineral wool insulation (thickness: 120 mm)

⑪ Plasterboard panel x2 (thickness: 25 mm)

⑫ **ALADIN SOFT**

IMPACT SOUND INSULATION

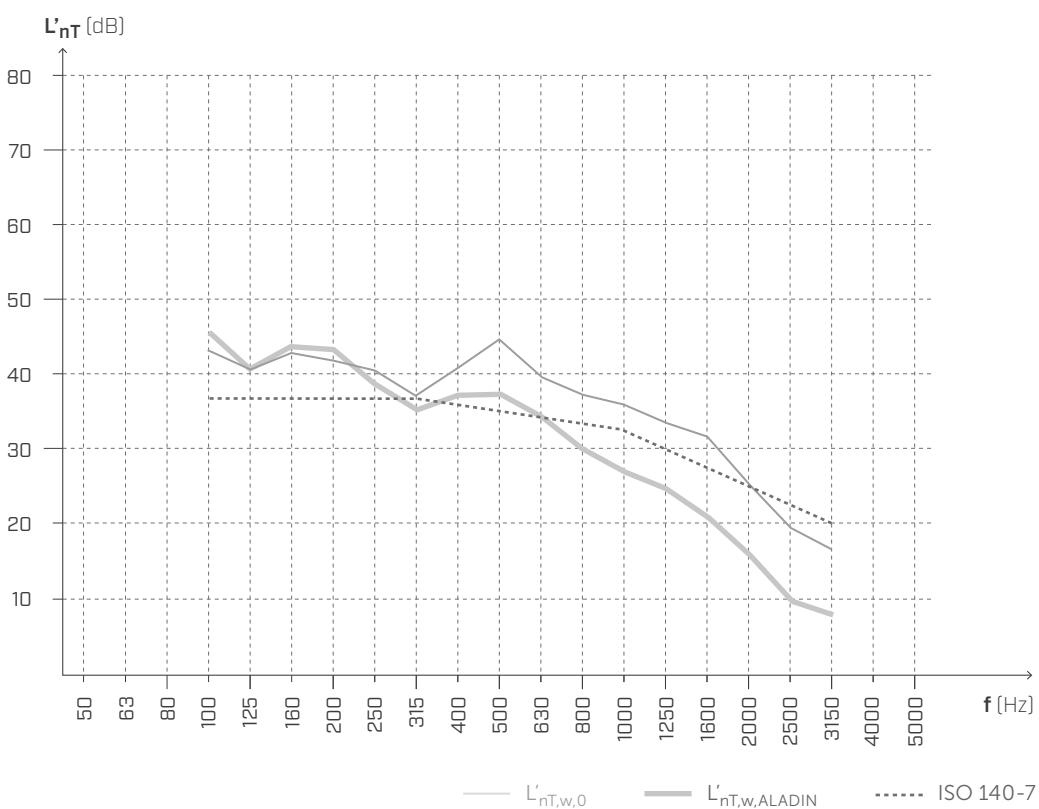

without ALADIN EXTRA SOFT

$$L'_{nT,w,0} (C_l) = 38 (1) \text{ dB}$$

$$NISR_{ASTM} = 73$$

with ALADIN EXTRA SOFT


$$L'_{nT,w,ALADIN} (C_l) = 35 (0) \text{ dB}$$

$$NISR_{ASTM} = 74$$

ACOUSTIC AND MECHANICAL INTERACTION

ACOUSTIC - MECHANICAL BEHAVIOR OF TITAN + ALADIN

The TITAN + ALADIN system has been tested in order to determine its mechanical and acoustic behaviour. The experimental campaigns carried out within the Seismic-Rev project and in collaboration with multiple research institutes, have shown how the characteristics of the resilient profile influence the mechanical performance of the connection. From an acoustic point of view, with the Flanksound project, it has been demonstrated that the ability to dampen vibrations through the joint is strongly influenced by the type and number of connections.

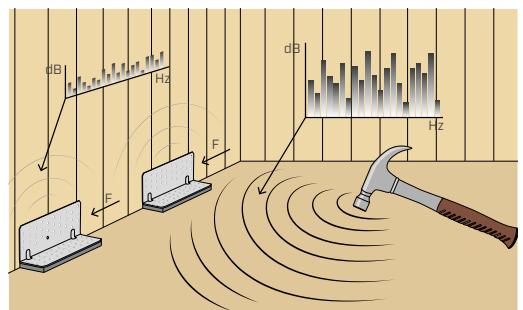


EXPERIMENTAL INVESTIGATION: MECHANICAL BEHAVIOUR

Within the Seismic-Rev project, in collaboration with the University of Trento and the Institute for BioEconomy (IBE - San Michele all'Adige), an investigation project was launched to evaluate the mechanical behaviour of TITAN angle brackets used in combination with different soundproofing profiles.



FIRST LABORATORY PHASE

Monotonic shear tests were carried out, in the first experimental phase, using linear loading procedures in displacement control, aimed at evaluating the variation in ultimate strength and stiffness offered by the TTF200 connection with LBA Ø4 x 60 mm nails.

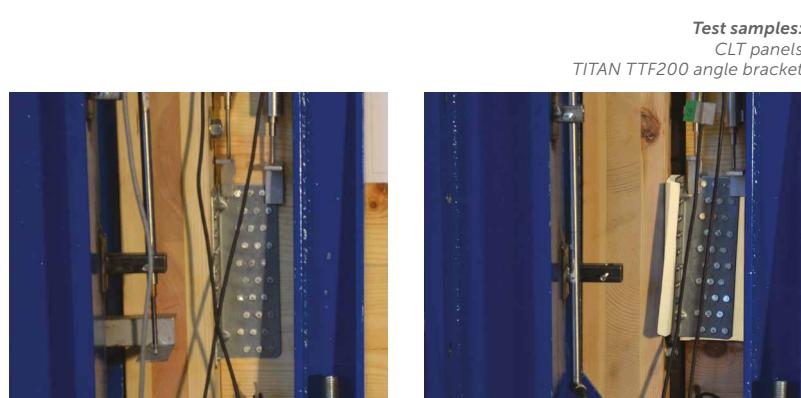

NUMERIC MODELLING

The results of the preliminary investigation campaign highlighted the importance of carrying out more accurate analyses of the influence of acoustic profiles on the mechanical behaviour of TTF200 and TTN240 metal angle brackets in terms of overall strength and stiffness. For this reason it was decided to carry out further evaluations by means of finite element numerical modelling, starting from the behaviour of the individual nail. In the case under study, the influence of three different resilient profiles were analysed: XYLOFON 35 (6 mm), ALADIN SOFT (5 mm) and ALADIN EXTRA SOFT (7 mm).

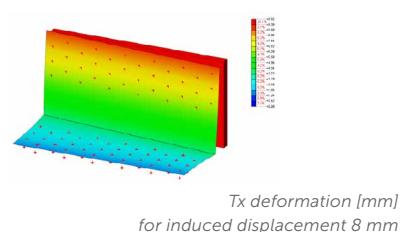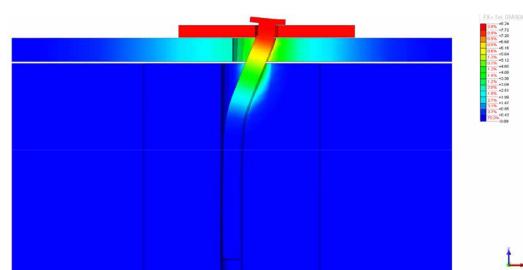


VARIATION OF MECHANICAL SHEAR STRENGTH AS A FUNCTION OF SOUNDPOROFING PROFILE

The comparison of the results of the different configurations analysed is reported in terms of load variation at 15 mm displacement ($F_{15 \text{ mm}}$) and elastic stiffness at 5 mm ($K_{5 \text{ mm}}$).

TITAN TTF200

configurations	sp	$F_{15 \text{ mm}}$	$\Delta F_{15 \text{ mm}}$	$K_{5 \text{ mm}}$	$\Delta K_{5 \text{ mm}}$
	[mm]	[kN]		[kN/mm]	
TTF200	-	68,4	-	9,55	-
TTF200 + ALADIN SOFT red.*	3	59,0	-14 %	8,58	-10 %
TTF200 + ALADIN EXTRA SOFT red.*	4	56,4	-18 %	8,25	-14 %
TTF200 + ALADIN SOFT	5	55,0	-20 %	7,98	-16 %
TTF200 + XYLOFON PLATE	6	54,3	-21 %	7,79	-18 %
TTF200 + ALADIN EXTRA SOFT	7	47,0	-31 %	7,30	-24 %


* Reduced thickness: reduced profile height due to the trapezoidal section and consequent crushing induced by the head of the nail during operation.

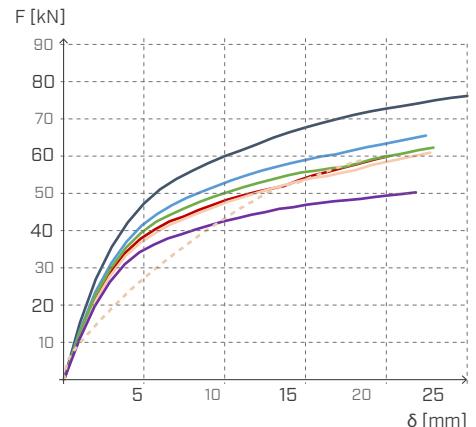

TITAN TTN240

configurations	sp	$F_{15 \text{ mm}}$	$\Delta F_{15 \text{ mm}}$	$K_{5 \text{ mm}}$	$\Delta K_{5 \text{ mm}}$
	[mm]	[kN]		[kN/mm]	
TTN240	-	71,9	-	9,16	-
TTN240 + ALADIN SOFT red.*	3	64,0	-11 %	8,40	-8 %
TTN240 + ALADIN EXTRA SOFT red.*	4	61,0	-15 %	8,17	-11 %
TTN240 + ALADIN SOFT	5	59,0	-18 %	8,00	-13 %
TTN240 + XYLOFON PLATE	6	58,0	-19 %	7,81	-15 %
TTN240 + ALADIN EXTRA SOFT	7	53,5	-26 %	7,47	-18 %

* Reduced thickness: reduced profile height due to the trapezoidal section and consequent crushing induced by the head of the nail during operation.

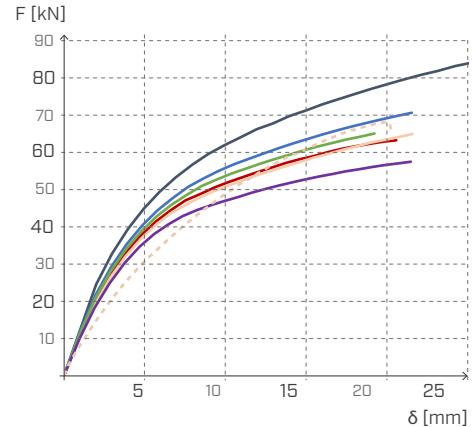

EXPERIMENTAL RESULTS

The results obtained show a reduction in the strength and stiffness of the devices following the interposition of the soundproofing profiles. This variation is highly dependent on the thickness of the profile. In order to limit the reduction of strength it is necessary to adopt profiles with real thickness of approximately 6 mm or less.

SHEAR AND TENSILE STRENGTH TITAN + ALADIN CERTIFIED IN ETA

Not only experimental tests, but also values certified by independent assessment bodies that certify the performance characteristics of non-standard construction products.

TITAN

The strength of TITAN coupled with ALADIN below the horizontal flange was calculated from the load-carrying capacity of nails or screws according to "Blaß, H.J. und Laskewitz, B. (2000); Load-Carrying Capacity of Joints with Dowel-Type fasteners and Interlayers.", conservatively neglecting the profile stiffness.


Being an innovative angle bracket and one of the first certified on the market, a highly conservative approach was chosen and ALADIN was simulated as an equivalent air layer. The angular capacity is therefore largely underestimated.



ANGLE BRACKET	type	fastening			$F_{2/3,Rk}$ [kN]
		$\emptyset \times L$ [mm]	n_V [pcs]	n_H [pcs]	
TTN240 + ALADIN SOFT	LBA nails	4 x 60	36	36	28,9
	LBS screws	5 x 50	36	36	27,5
TTS240 + ALADIN EXTRA SOFT	HBS PLATE screws	8 x 80	14	14	27,5
	LBS screws	5 x 50	36	36	25,8


TIMBER-TO-TIMBER FASTENING PATTERN

TTN240




36 LBA nails/LBS screws

TTS240



14 LBA nails/LBS screws


36 LBA nails/LBS screws



14 LBA nails/LBS screws

Discover the complete **TITAN** range on our website or request the catalogue from your salesman.

www.rothoblaas.com

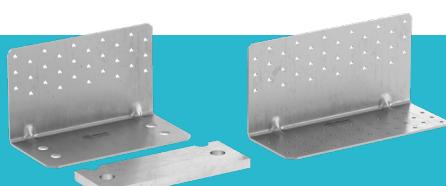


ALADIN | RECOMMENDATIONS FOR INSTALLATION


APPLICATION WITH STAPLES



APPLICATION WITH PRIMER SPRAY

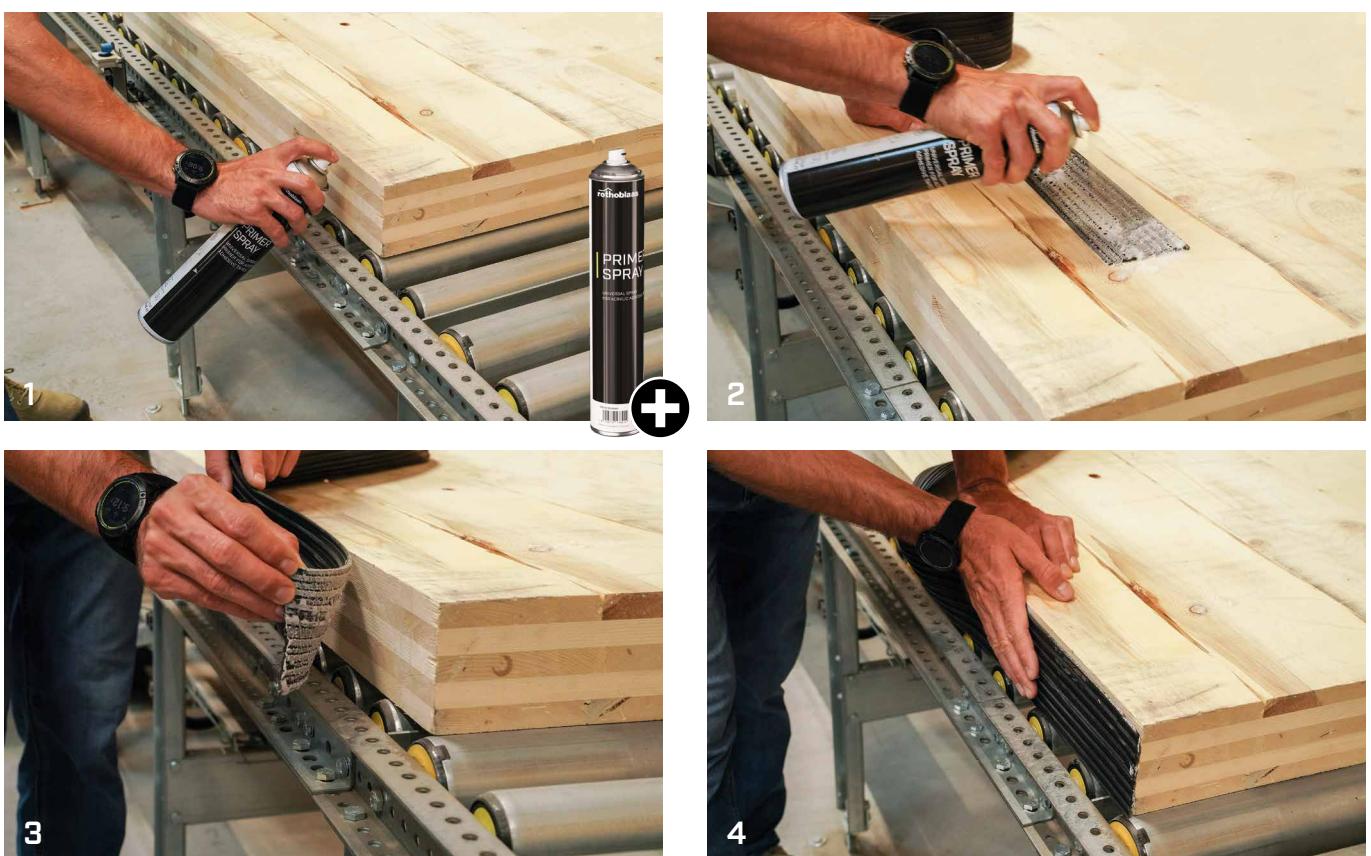


APPLICATION WITH DOUBLE BAND

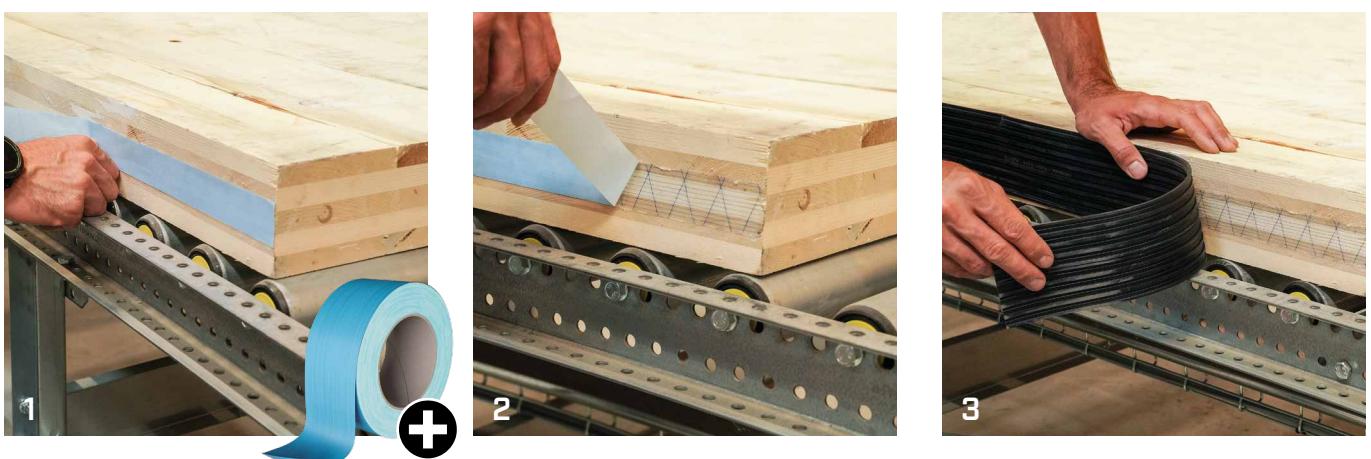

|SILENT FLOOR PUR

TECHNICAL MANUAL

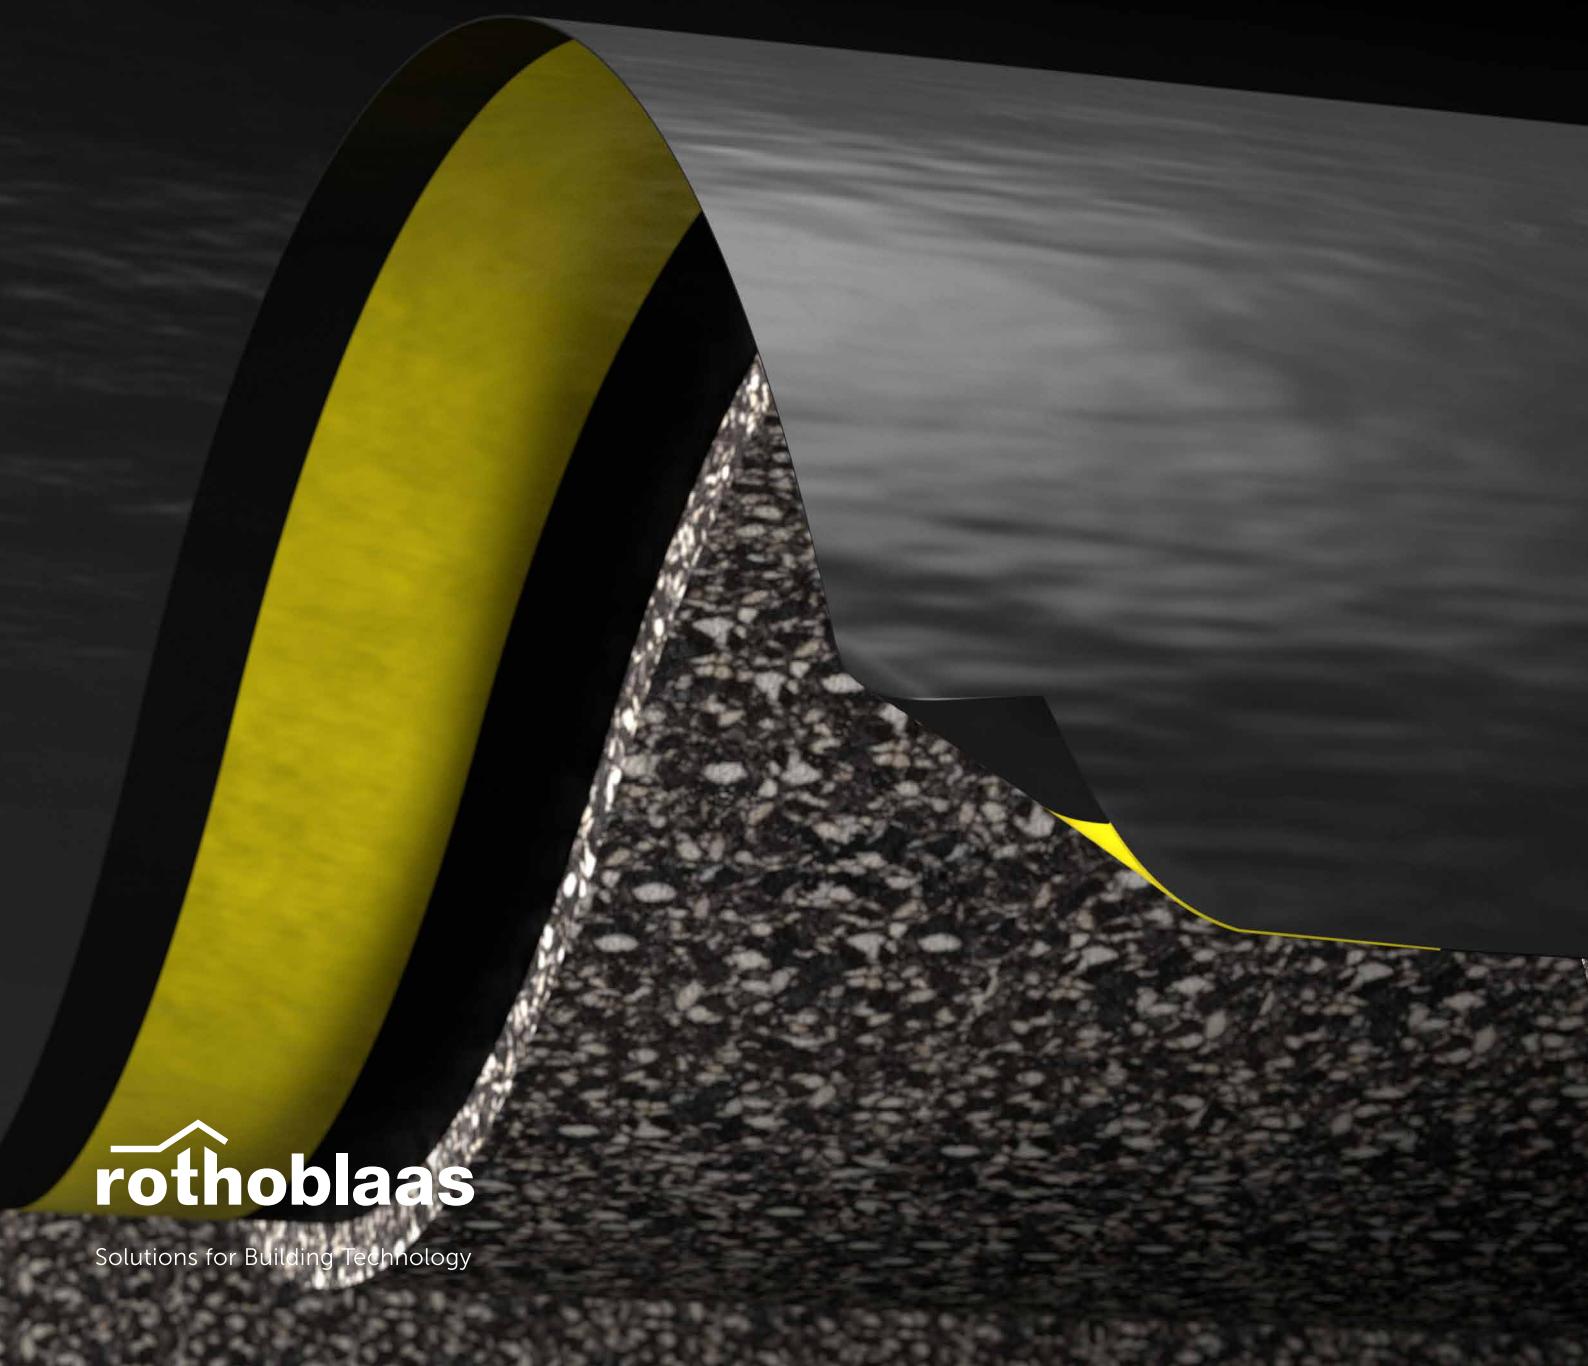

 **rothoblaas**

Solutions for Building Technology

CONTENTS

ACOUSTIC PROBLEMS OF FLOORS.....	172
SILENT FLOOR PUR.....	174
SILFLOORPUR10	176
LABORATORY MEASUREMENT CLT FLOOR 1.....	178
LABORATORY MEASUREMENT CLT FLOOR 1.....	179
LABORATORY MEASUREMENT CLT FLOOR 2	180
LABORATORY MEASUREMENT CLT FLOOR 2	181
LABORATORY MEASUREMENT CLT FLOOR 3	182
LABORATORY MEASUREMENT CLT FLOOR 3	183
LABORATORY MEASUREMENT FRAME WALL 4A.....	184
LABORATORY MEASUREMENT CLT FLOOR 4B	185
LABORATORY MEASUREMENT FRAME WALL 5A.....	186
LABORATORY MEASUREMENT FRAME WALL 5B.....	187
LABORATORY MEASUREMENT FRAME WALL 6A.....	188
LABORATORY MEASUREMENT FRAME WALL 6B.....	189
LABORATORY MEASUREMENT FRAME WALL 7A.....	190
LABORATORY MEASUREMENT FRAME WALL 7B.....	191
SILFLOORPUR15	193
LABORATORY MEASUREMENT CLT FLOOR 1.....	194
LABORATORY MEASUREMENT CLT FLOOR 1.....	195
LABORATORY MEASUREMENT CLT FLOOR 2	196
LABORATORY MEASUREMENT CLT FLOOR 2	197
SILFLOORPUR20	199
LABORATORY MEASUREMENT CLT FLOOR 1.....	200
LABORATORY MEASUREMENT CLT FLOOR 1.....	201

I ACOUSTIC PROBLEMS OF FLOORS



WHAT IS IMPACT NOISE?

When it comes to floors, impact noise is the main acoustic problem because it constantly affects them. When a body impacts on the floor structure, the noise quickly spreads throughout the building either by air, affecting the nearest rooms, or by structure, propagating into the most distant rooms.



WHAT IS AIRBORNE NOISE?

Airborne noise is generated in the air and, after an initial airborne phase, is transported both by air and by structure. This is a problem that affects both walls and floors, but if we are talking about floors, the most important problem is certainly impact noise.

HERE IS THE SOLUTION

In order to be able to minimise the discomfort caused by impact noise, a stratigraphic package should be designed consisting of layers of different materials that are disconnected from each other and are able to dissipate the energy transmitted by the impact.



MASS-SPRING-MASS SYSTEM


A floating screed system such as the one shown in the images below can be schematised with a mass-spring-mass system, in which the structural floor represents the mass, the impact-absorbing product is equivalent to the spring, and the upper screed with the floor constitutes the second mass of the system. In this context, "resilient layer" is defined as the element with the spring function characterised by its own *dynamic stiffness s'*.



HOW IS THE IMPACT NOISE LEVEL MEASURED?


The impact noise level is a measure of the disturbance perceived in a room when an impact noise source is activated in the upper room. It can be measured both on site and in the laboratory. Clearly, ideal conditions exist in the laboratory for the effects of lateral transmission to be neglected, as the laboratory itself is constructed so that the walls are decoupled from the ceiling.

TAPPING MACHINE method



The TAPPING MACHINE is used to simulate "light" and "hard" impacts, such as walking with heeled shoes or the impact caused by falling objects.

RUBBER BALL method



The RUBBER BALL is used to simulate "soft" and "heavy" impacts, such as a barefoot walk or a child jumping.


HOW TO CHOOSE THE BEST PRODUCT



DYNAMIC STIFFNESS – s'


Expressed in MN/m³, it is measured according to EN 29052-1 and expresses the deformation capacity of a material that is subjected to a dynamic stress. Consequently, it indicates the ability to dampen the vibrations generated by an impact noise.

The measurement method involves, first, measuring the *apparent dynamic stiffness* s'_t of the material and then correcting it, if necessary, to obtain the *real dynamic stiffness* s' . Dynamic stiffness depends in fact on the *flow resistivity* r , which is measured in the lateral direction of the sample. If the material has specific flow resistivity values, the apparent dynamic stiffness must be corrected by adding the contribution of the gas contained within the material: air.



VISCOS SLIDING UNDER COMPRESSION – CREEP

Expressed as a percentage, it is measured according to EN 1606 and represents the long-term deformation of a material under constant load to be simulated. The measurement in the laboratory must be carried out over a period of at least 90 days.









COMPRESSIBILITY - c

The compressibility class expresses the behaviour of a material while subjected to screed loading. During measurement, the product is subjected to different loads and its thickness is measured. The compressibility measurement is carried out to understand what loads the underscreed product can withstand, in order to avoid cracking and splitting of screeds.

CORRECT INSTALLATION

The technological solution of the floating screed is one of the most widely used and one of the most effective, but in order to achieve satisfactory results it is important that the system is designed and implemented correctly.

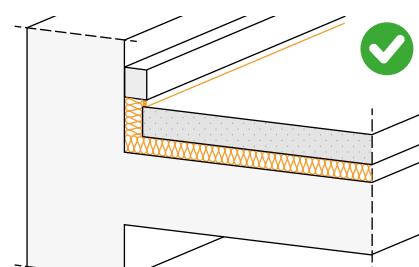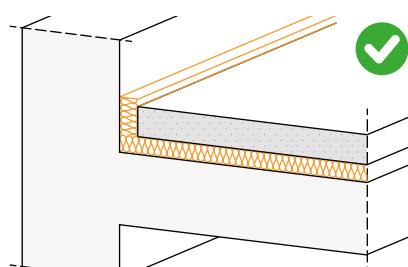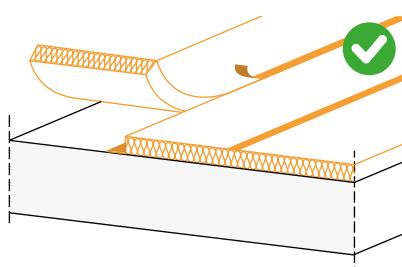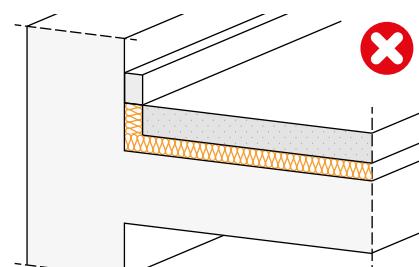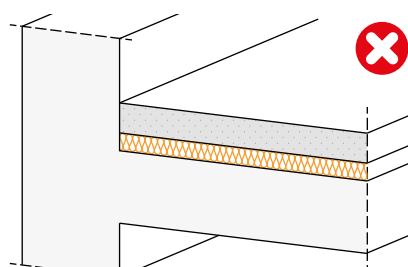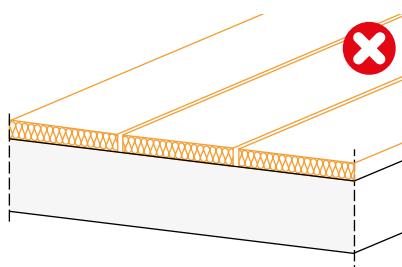

The resilient layer must be continuous because any gap would represent an acoustic bridge. When installing underscreed mats, care must be taken not to create discontinuities.

It is important to use the SILENT EDGE perimeter strip to ensure that the resilient layer is continuous around the entire perimeter of the room. The SILENT EDGE should only be trimmed after the floor has been installed and grouted.

The skirting board must be installed after the SILENT EDGE has been cut, ensuring that it is always suitably raised from the floor.

IIC vs L_w

IIC stands for **Impact Insulation Class** and is the value obtained by subtracting the noise level measured in the receiving room from the noise level measured in the source room. Impact Insulation Class, sometimes referred to as Impact Isolation Class, measures the resistance of the floor construction assembly against the propagation of impact-generated noise.

SILENT FLOOR PUR

RESILIENT HIGH PERFORMANCE UNDERSCREED MEMBRANE
MADE OF RECYCLED POLYMERS

CERTIFIED

The effectiveness of the underscreed membrane has been certified in the labs of the Centre for Industrial Research of the University of Bologna.

SUSTAINABILITY

Recycled and recyclable. The product intelligently reuses polyurethane from production waste that would otherwise have to be disposed of.


HIGH PERFORMANCE

The special composition offers excellent elasticity, reaching attenuation values over 30 dB.

COMPOSITION

polyethylene vapour barrier

polyurethane agglomerate made from pre-consumer industrial waste

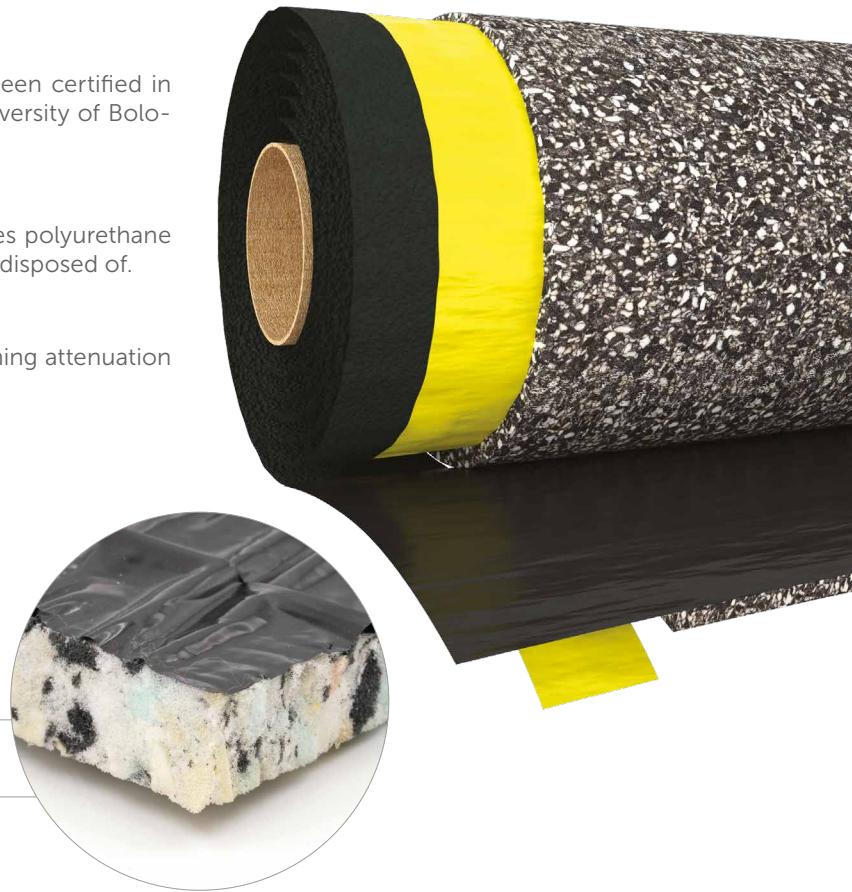

CODES AND DIMENSIONS

CODE	H ⁽¹⁾ [m]	L [m]	thickness [mm]	A _f ⁽²⁾ [m ²]	
SILFLOORPUR10	1,6	10	10	15	6
SILFLOORPUR15	1,6	8	15	12	6
SILFLOORPUR20	1,6	6	20	9	6

(1) 1.5 m of polyurethane agglomerate and vapour barrier + 0.1 m of vapour barrier for overlap with integrated adhesive strip.

(2) Without considering the overlap area.



SAFE


Polyurethane is a noble polymer that maintains elasticity over time, without subsidence or changes in performance.

VOC REQUIREMENTS

The membrane composition safeguards health and meets the recommended VOC limits.

PRODUCT STRATIGRAPHY COMPARISON

integrated adhesive strip	thickness	dynamic stiffness	load	estimate ΔL_w according to formula C.4 of EN ISO 12354-2
✓ 10 mm	12,5 MN/m³	125 kg/m ²	10	32,5 dB
			15	35,1 dB
			20	36,4 dB
✓ 15 mm	8,8 MN/m³	125 kg/m ²	25	34,6 dB
			30	37,3 dB
			35	38,6 dB
✓ 20 mm	7,4 MN/m³	125 kg/m ²	40	35,7 dB
			30	38,4 dB
			25	39,6 dB

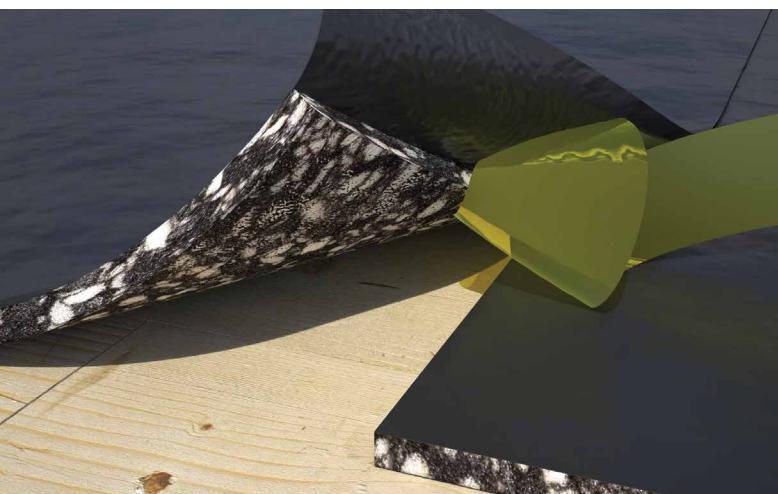

SILFLOORPUR10

TECHNICAL DATA

Properties	standard	value
Surface mass m	-	0,9 kg/m ²
Density ρ	-	80 kg/m ³
Apparent dynamic stiffness s' _t	EN 29052-1	12,5 MN/m ³
Dynamic stiffness s'	EN 29052-1	12,5 MN/m ³
Theoretical estimate of impact sound pressure level attenuation ΔL _w ⁽¹⁾	ISO 12354-2	32,5 dB
System resonance frequency f ₀ ⁽²⁾	ISO 12354-2	50,6 Hz
Impact sound pressure level attenuation ΔL _w ⁽³⁾	ISO 10140-3	21 dB
Thermal resistance R _t	-	0,46 m ² K/W
Resistance to airflow r	ISO 9053	< 10,0 kPa·s·m ⁻²
Compressibility class	EN 12431	CP2
CREEP Viscous sliding under compression X _{ct} (1,5 kPa)	EN 1606	7,50 %
Compression deformation stress	ISO 3386-1	17 kPa
Thermal conductivity λ	-	0,035 W/m·K
Specific heat c	-	1800 J/kg·K
Water vapour transmission Sd	-	> 100 m
Reaction to fire	EN 13501-1	class F
VOC emission classification	French decree no. 2011-321	A+

(1) $\Delta L_w = (13 \lg(m')) - (14,2 \lg(s')) + 20,8$ [dB] con $m' = 125$ kg/m².

(2) $f_0 = 160 \sqrt{s'/m'}$ con $m' = 125$ kg/m².

(3) Measured in the laboratory on 200 mm CLT floor. See the manual for more information on configuration.

EN ISO 12354-2 ANNEX C | ESTIMATE ΔL_w [FORMULA C.4] E ΔL [FORMULA C.1]

The following tables show how the attenuation in dB (ΔL_w e ΔL) of SILFLOORPUR10 varies as the load m' (i.e., the surface mass of the layers with which SILFLOORPUR10 is loaded) changes.

SILFLOORPUR10

s' _t or s'	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	[MN/m ³]
load m'	50	75	100	125	150	175	200	225	250	275	[kg/m ²]
ΔL _w	27,3	29,6	31,2	32,5	33,5	34,4	35,1	35,8	36,4	36,9	[dB]
f ₀	80,0	65,3	56,6	50,6	46,2	42,8	40,0	37,7	35,8	34,1	[Hz]

ΔL in frequency

[Hz]	100	2,9	5,5	7,4	8,9	10,1	11,1	11,9	12,7	13,4	14,0	14,6	[dB]
[Hz]	125	5,8	8,5	10,3	11,8	13,0	14,0	14,8	15,6	16,3	16,9	17,5	[dB]
[Hz]	160	9,0	11,7	13,5	15,0	16,2	17,2	18,1	18,8	19,5	20,1	20,7	[dB]
[Hz]	200	11,9	14,6	16,5	17,9	19,1	20,1	21,0	21,7	22,4	23,0	23,6	[dB]
[Hz]	250	14,8	17,5	19,4	20,8	22,0	23,0	23,9	24,6	25,3	26,0	26,5	[dB]
[Hz]	315	17,9	20,5	22,4	23,8	25,0	26,0	26,9	27,7	28,3	29,0	29,5	[dB]
[Hz]	400	21,0	23,6	25,5	26,9	28,1	29,1	30,0	30,8	31,5	32,1	32,6	[dB]
[Hz]	500	23,9	26,5	28,4	29,8	31,0	32,0	32,9	33,7	34,4	35,0	35,5	[dB]
[Hz]	630	26,9	29,5	31,4	32,9	34,0	35,0	35,9	36,7	37,4	38,0	38,6	[dB]
[Hz]	800	30,0	32,6	34,5	36,0	37,2	38,2	39,0	39,8	40,5	41,1	41,7	[dB]
[Hz]	1000	32,9	35,5	37,4	38,9	40,1	41,1	41,9	42,7	43,4	44,0	44,6	[dB]
[Hz]	1250	35,8	38,5	40,3	41,8	43,0	44,0	44,8	45,6	46,3	46,9	47,5	[dB]
[Hz]	1600	39,0	41,7	43,5	45,0	46,2	47,2	48,1	48,8	49,5	50,1	50,7	[dB]
[Hz]	2000	41,9	44,6	46,5	47,9	49,1	50,1	51,0	51,7	52,4	53,0	53,6	[dB]
[Hz]	2500	44,8	47,5	49,4	50,8	52,0	53,0	53,9	54,6	55,3	56,0	56,5	[dB]

EN ISO 12354-2 Annex C - formula C.4

$$\boxed{\Delta L_w} = \left(13 \lg(m') \right) - \left(14,2 \lg(s') \right) + 20,8 \text{ dB}$$

EN ISO 12354-2 Annex C - formula C.1

$$\boxed{\Delta L} = \left(30 \lg \frac{f}{f_0} \right) \text{dB}$$

EN ISO 12354-2 Annex C - formula C.2

$$\boxed{f_0} = 160 \sqrt{\frac{s'}{m'}}$$

IMPACT NOISE INSULATION ACCORDING TO SCREED THICKNESS


A predictive study of the sound insulation of airborne and impact noise in buildings cannot be determined by calculations alone, but must be supported by experimental data and measurements in the laboratory and on site.

The acoustics laboratory at the University of Northern British Columbia is designed optimized for testing the sound insulation performance of floors in timber buildings. In fact, the receiving room is built of frame walls made of mullions and interposed rock wool insulation and OSB sheathing and two layers of gypsum board.


Impact noise assessment is measured according to ASTM E1007-15 using the impact sound machine and a sound pressure meter according to ISO. The tests involve evaluating the acoustic behavior of the floor slab according to the thickness of the screed (38 mm, 50 mm, 100 mm).

MATERIALS


- ① **X-LAM FLOOR SLABS:** The tested floor slab consists of three of 139 mm thick CLT 139V panels. Each CLT panel is 4.0 m long and 1.8 m wide. All joints are sealed with acoustic sealant and tapes. The edges between floors and walls are also sealed with acoustic sealant. The AIIC of the bare CLT floor slab is 21 ($L'_{n,w} = 89\text{dB}$)
- ② **SILENT FLOOR PUR:** high-performance resilient agglomerate underscreed membrane made from pre-consumer industrial waste and PE vapour barrier.
- ③ **Screed:** ordinary concrete
 - thickness 38 mm, 91 kg/m^2
 - thickness 50 mm, 120 kg/m^2
 - thickness 100 mm, 240 kg/m^2

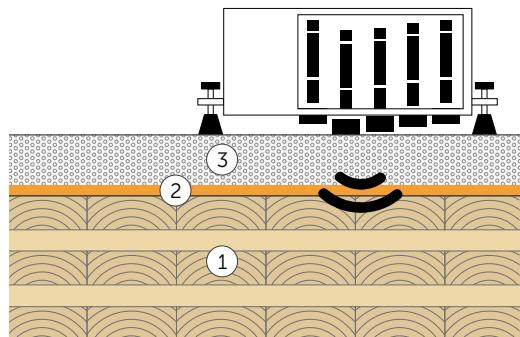

RESULTS

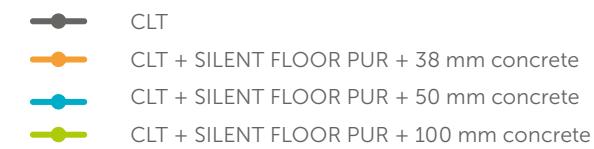


	AIIC (dBA)	$L'_{n,w}$ (dB)	Acoustic improvement (dB)
CLT	21	89	
CLT + SILENT FLOOR PUR + 38 mm concrete	41	69	20
CLT + SILENT FLOOR PUR + 50 mm concrete	42	68	21
CLT + SILENT FLOOR PUR + 100 mm concrete	48	62	27

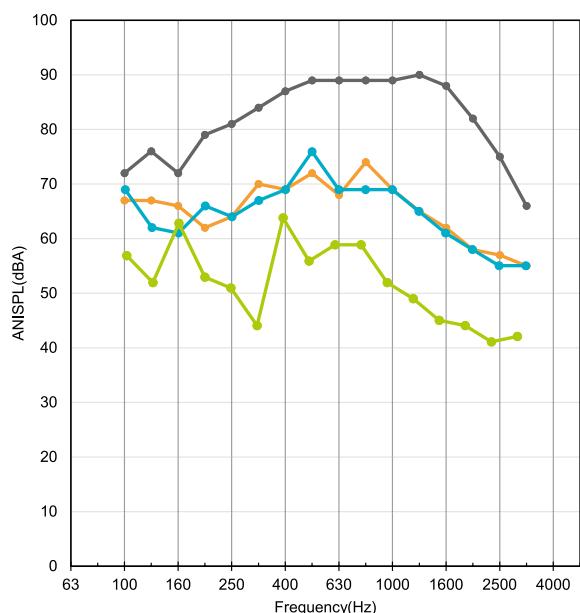

Testing laboratory: University of Northern British Columbia
Test protocol: 20200720

LABORATORY MEASUREMENT | CLT FLOOR 1

AIRBORNE SOUND INSULATION ACCORDING TO ISO 16283-1

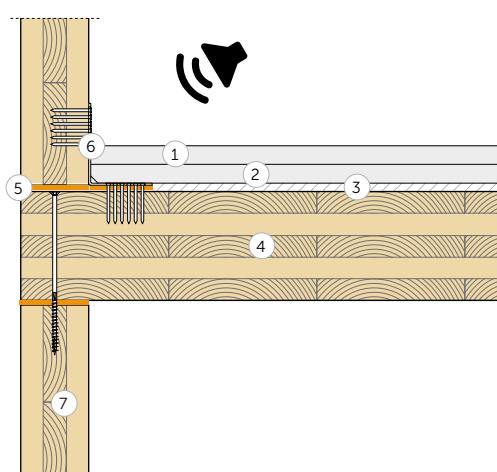

FLOOR SLAB


Surface = 21,64 m²

Mass = 167 kg/m²

Receiving room volume = 75,52 m³

- ① Reinforced gypsum-fibre board (44 kg/m²) (thickness: 32 mm)
- ② High density cardboard and sand panels (34,6 kg/m²) (thickness: 30 mm)
- ③ **SILENT FLOOR PUR - SILFLOORPUR10** (thickness: 10 mm)
- ④ CLT (thickness: 160 mm)
- ⑤ **XYLOFON 35 - XYL35100**
- ⑥ TITAN SILENT
- ⑦ CLT (thickness: 120 mm)

AIRBORNE SOUND INSULATION

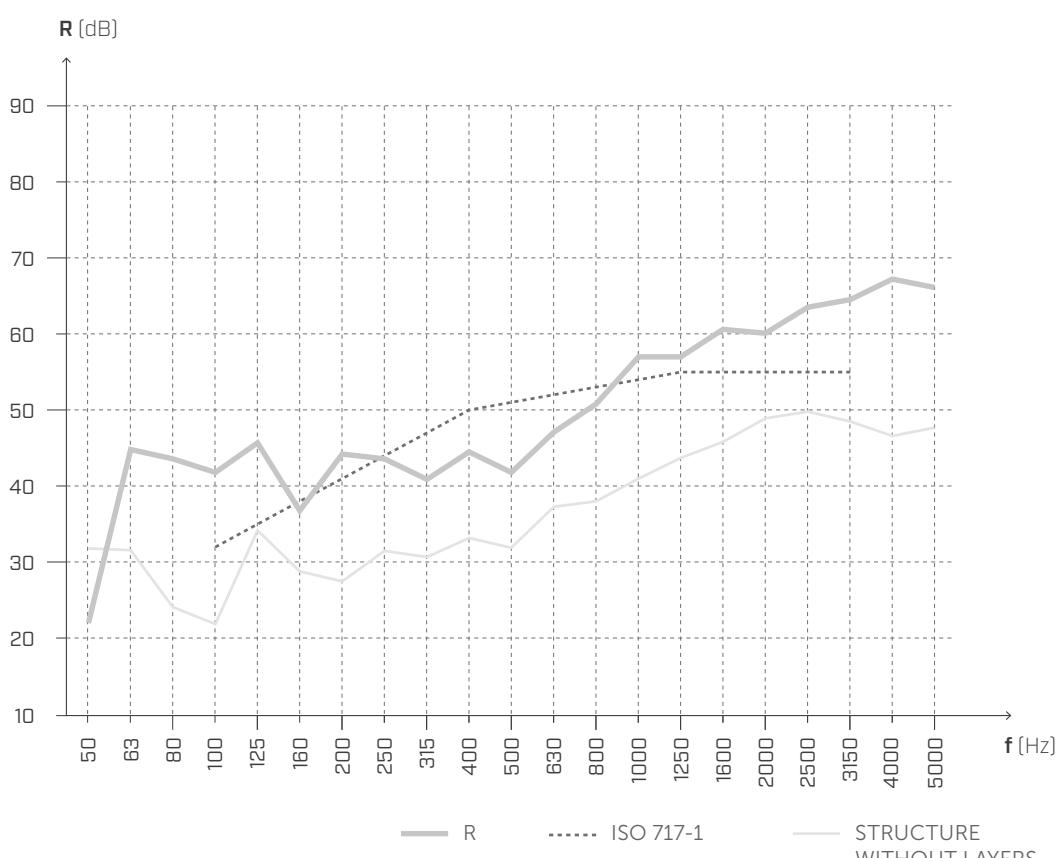

$$R'_w(C;C_{tr}) = \mathbf{51 (0;-6) dB}$$

$$\Delta R'_w = +12 dB^{(1)}$$

$$STC = \mathbf{51}$$

$$\Delta STC = +12^{(1)}$$

Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau
Technikerstraße 13A - 6020 Innsbruck.


Test protocol: M07B_L211217_m-Bodenaufbau

NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1, 2 and 3.

LABORATORY MEASUREMENT | CLT FLOOR 1


IMPACT SOUND INSULATION ACCORDING TO ISO 16283-1

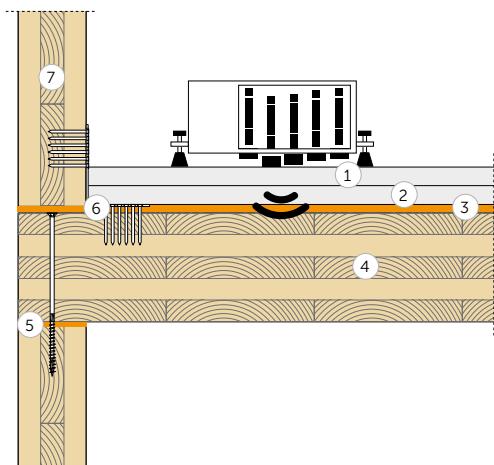

Surface = 21,64 m²
Mass = 167 kg/m²
Receiving room volume = 75,52 m³

- ① Reinforced gypsum-fibre board (44 kg/m²) (thickness: 32 mm)
- ② high density cardboard and sand panels (34,6 kg/m²), (thickness: 30 mm)
- ③ **SILENT FLOOR PUR - SILFLOORPUR10** (s: 10 mm)
- ④ CLT (thickness: 160 mm)
- ⑤ **XYLOFON 35 - XYL35100**
- ⑥ TITAN SILENT
- ⑦ CLT (thickness: 120 mm)

Impact sound NOISE INSULATION

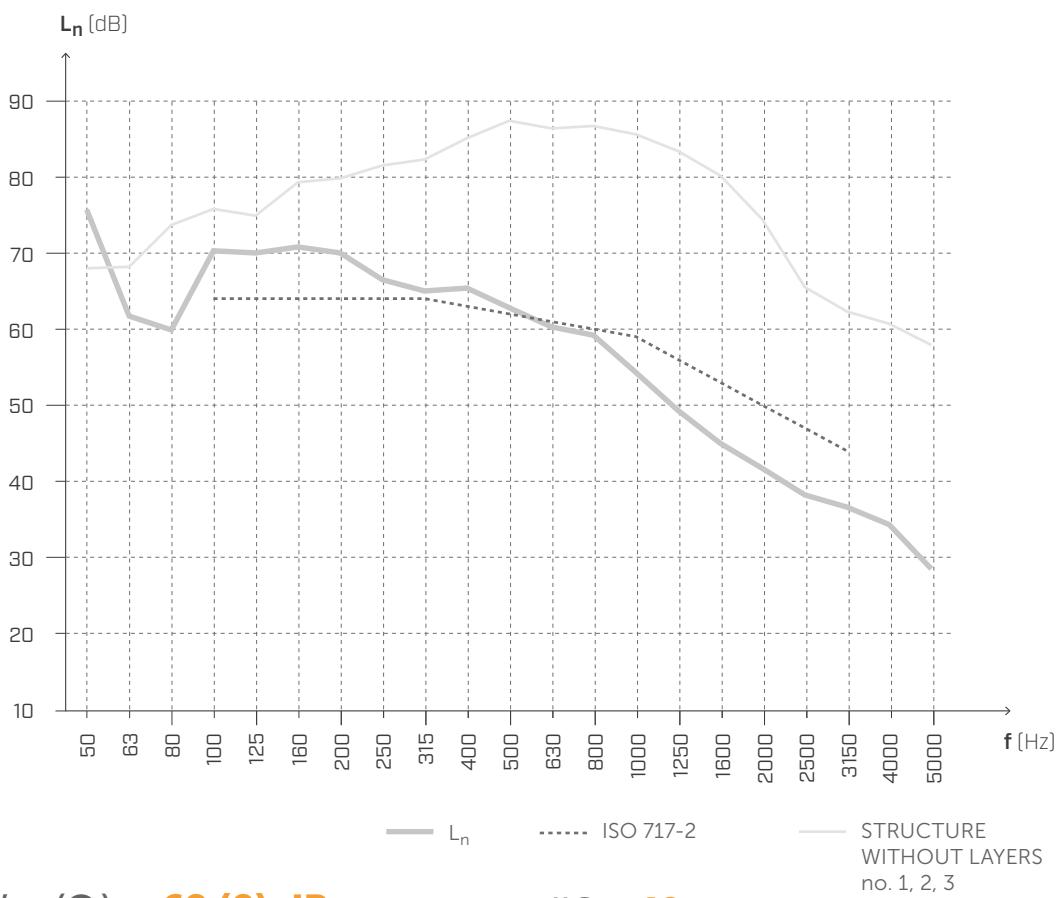

$$L'_{n,w}(C_l) = \text{62 (0) dB}$$

$$IIC = 48$$

$$\Delta L_{n,w}(C_l) = -22 \text{ dB}^{(1)}$$

$$\Delta IIC = +22^{(2)}$$

Testing laboratory: Universität Innsbruck Arbeitsbereich für Holzbau
 Technikerstraße 13A - 6020 Innsbruck.

Test protocol: M07B_T211217_m-Bodenaufbau

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 2


MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD ISO 10140-2

FLOOR SLAB

Surface = 12 m²

Mass = 230 kg/m²

Receiving room volume = 54,7 m³

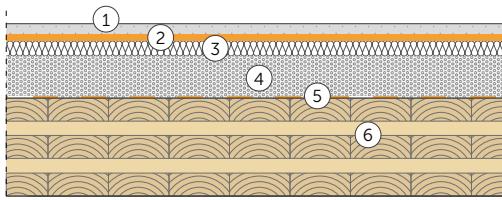

① Concrete screed (2000 kg/m³) (thickness: 50 mm)

② **SILENT FLOOR PUR** (thickness: 10 mm)


③ Mineral wool insulation s' ≤ 10 MN/m³ (110 kg/m³) (thickness 40 mm)

④ Light screed with EPS (500 kg/m³) (thickness: 120 mm)

⑤ **BARRIER SD150**

⑥ CLT 5 layers (thickness: 150 mm)

AIRBORNE SOUND INSULATION

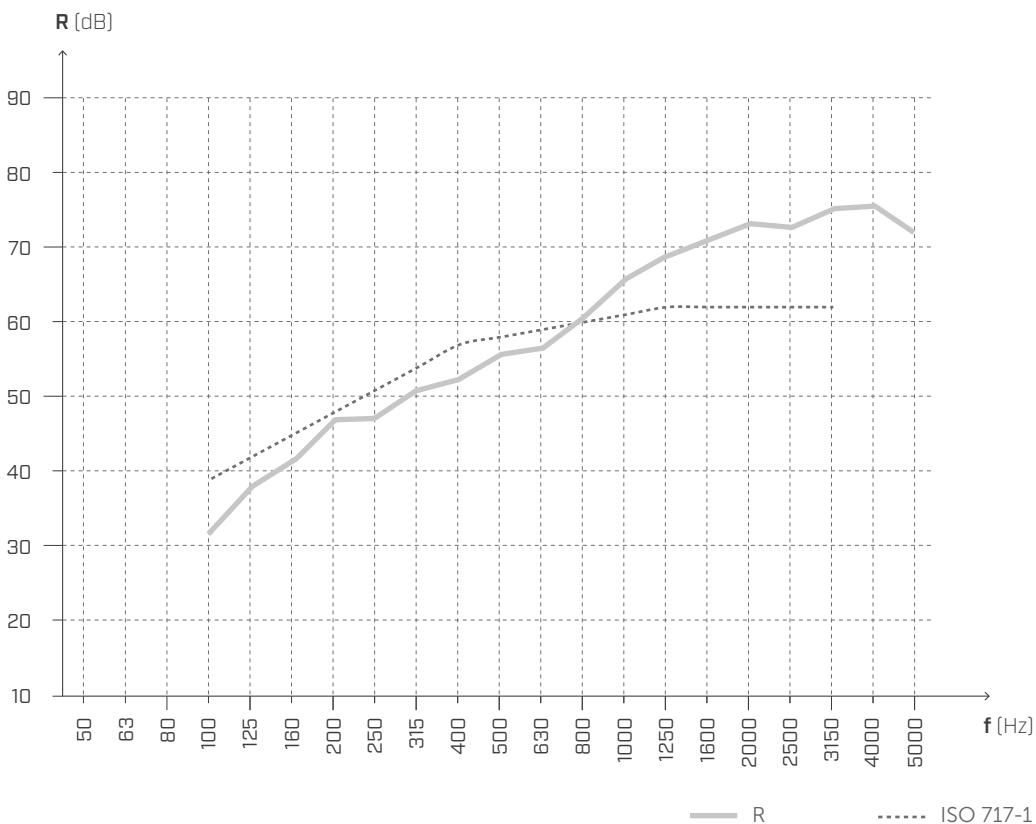

R_w = **57 (-2;-9) dB**

STC = **57**

Testing laboratory: Alma Mater Studiorum Università di Bologna
Test protocol: 01L/RothoB

LABORATORY MEASUREMENT | CLT FLOOR 2


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

Surface = 12 m²

Mass = 230 kg/m²

Receiving room volume = 54,7 m³

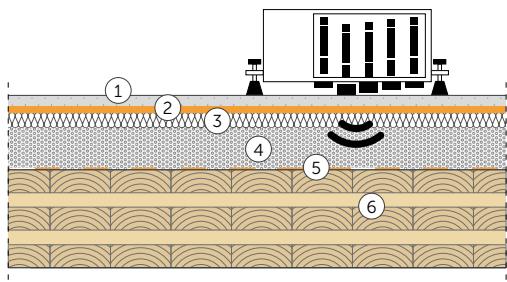

① Concrete screed (2000 kg/m³), (thickness: 50 mm)

② **SILENT FLOOR PUR** (thickness: 10 mm)


③ Mineral wool insulation $s' \leq 10 \text{ MN/m}^3$ (110 kg/m³), (thickness: 40 mm)

④ Light screed with EPS (500 kg/m³) (thickness: 120 mm)

⑤ **BARRIER SD150**

⑥ CLT 5 layers (thickness: 150 mm)

IMPACT SOUND INSULATION

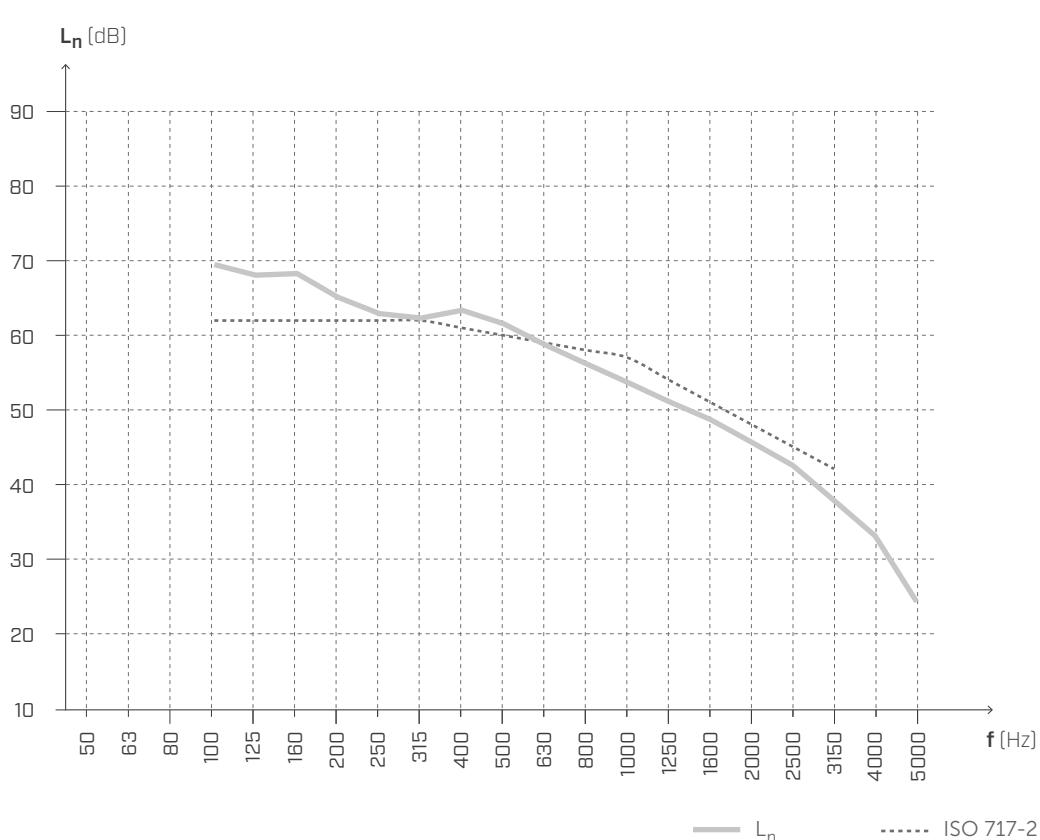

$$L_{n,w}(C_l) = 60 (0) \text{ dB}$$

$$\Delta L_{n,w}(C_l) = -27 \text{ dB}^{(1)}$$

$$IIC = 50$$

$$\Delta IIC = +27^{(2)}$$

Testing laboratory: Alma Mater Studiorum Università di Bologna

Test protocol: 01R/RothoB

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 3


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 215,1 kg/m²

Receiving room volume = 60,1 m³

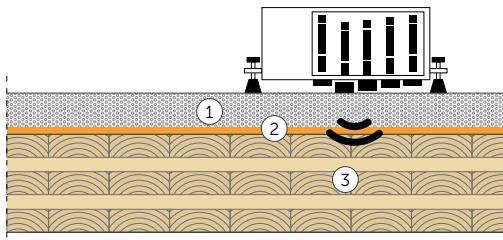


① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② SILENT FLOOR PUR - SILFLOORPUR10 (thickness: 10 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

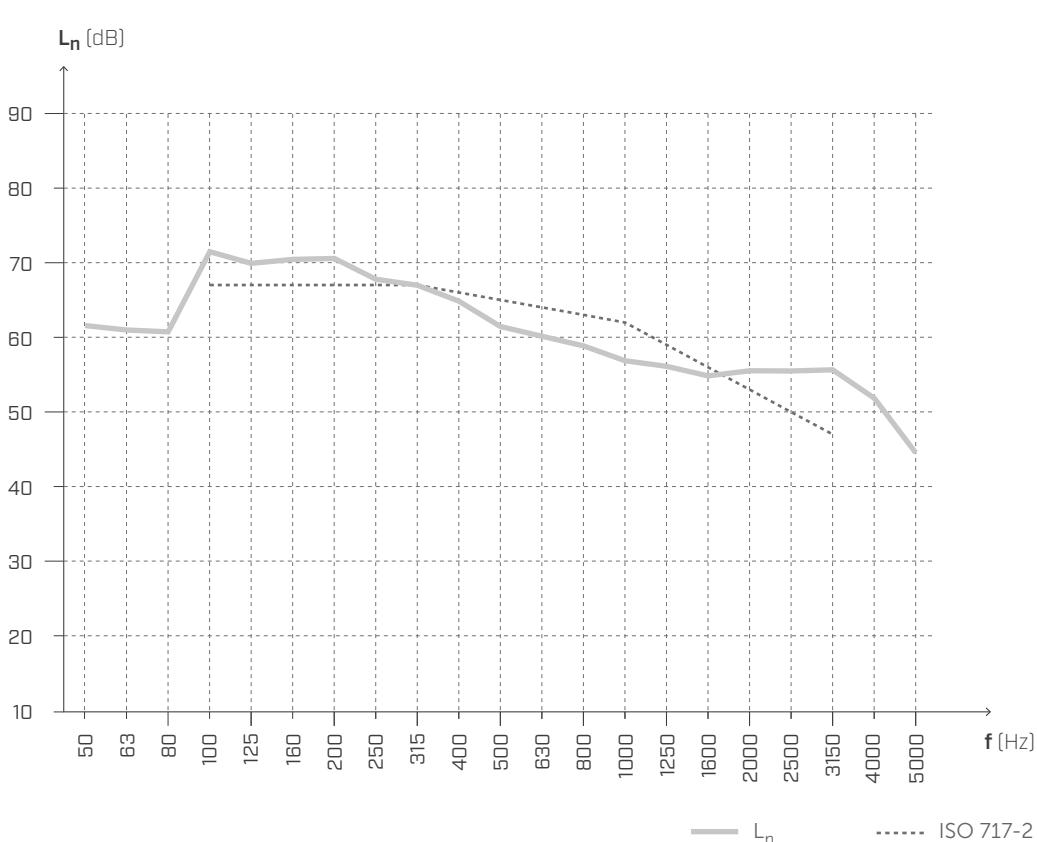

$$L_{n,w}(C_l) = \text{65 (-2) dB}$$

$$IIC = 44$$

$$\Delta L_{n,w}(C_l) = -21 dB^{(1)}$$

$$\Delta IIC = +20^{(2)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L2.

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 3


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
RUBBER BALL METHOD | REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB


Surface = 13,71 m²

Surface mass = 215,1 kg/m²

Receiving room volume = 60,1 m³

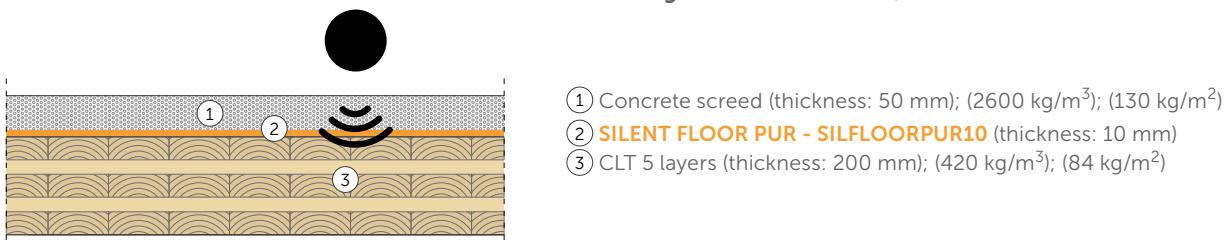

IMPACT SOUND INSULATION

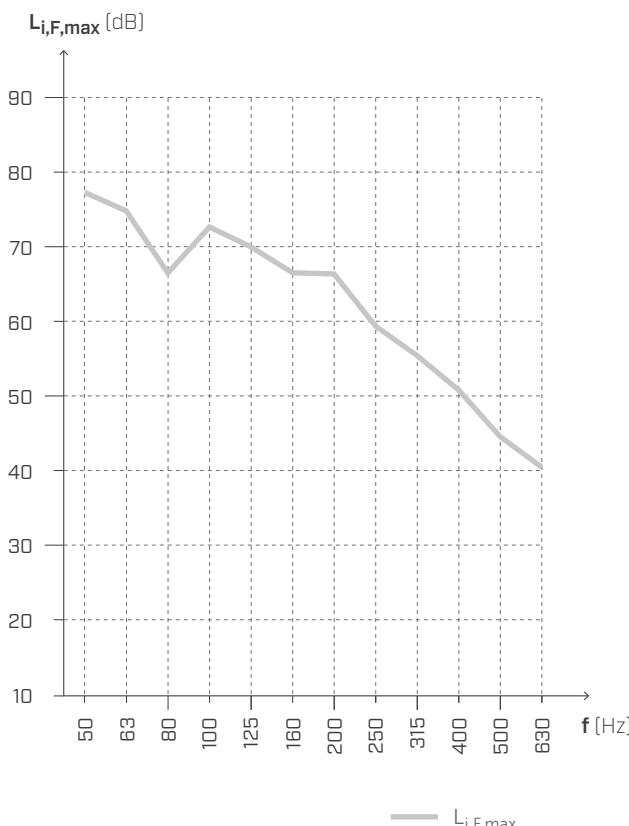


f [Hz]	$L_{i,F,\max}$ [dB]
50	77,3
63	74,8
80	66,5
100	72,7
125	70,0
160	66,5
200	66,3
250	59,4
315	55,4
400	50,8
500	44,5
630	40,4

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr. 2022-rothoLATE-L2.


LABORATORY MEASUREMENT | FRAME WALL 4A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

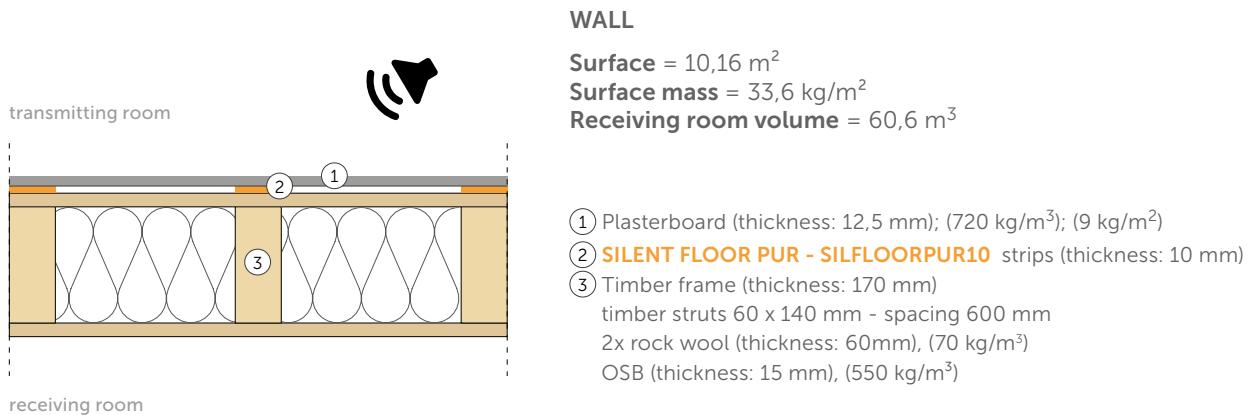

AIRBORNE SOUND INSULATION

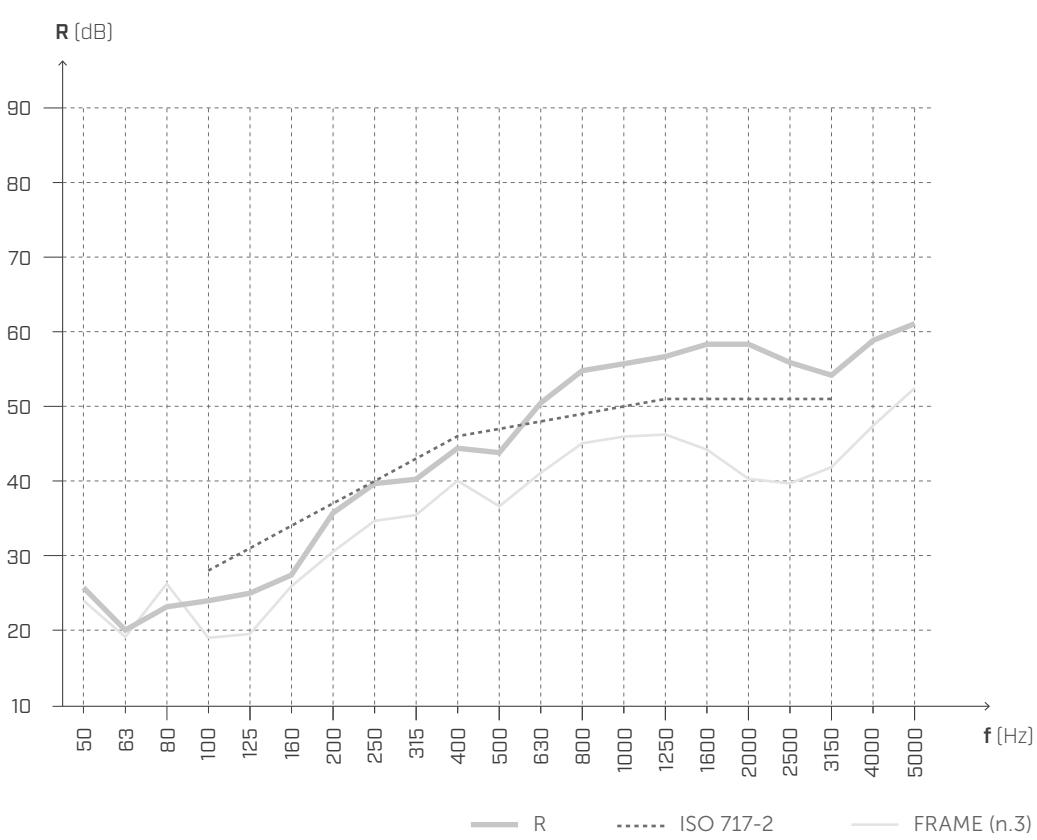

$$R_w(C, C_{tr}) = \text{47} \text{ (-2;-8) dB}$$

$$STC = \text{48}$$

$$\Delta R_w = +6 \text{ dB}^{(1)}$$

$$\Delta STC = +7 \text{ }^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R6a.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 4B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

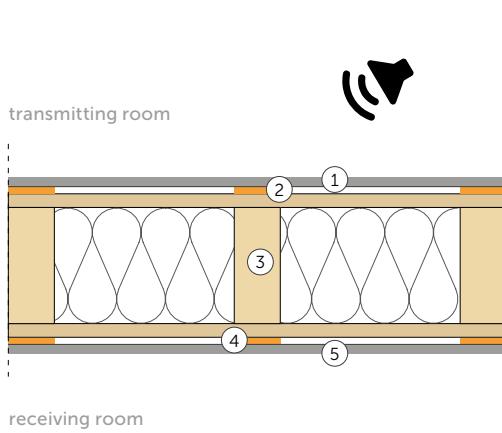

WALL

Surface = 10,16 m²

Surface mass = 42,9 kg/m²

Receiving room volume = 60,6 m³

① Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

② **SILENT FLOOR PUR - SILFLOORPUR10 strips** (thickness: 10 mm)

③ Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm


2x rock wool (thickness: 60mm), (70 kg/m³)

OSB (thickness: 15 mm), (550 kg/m³)

④ **SILENT FLOOR PUR - SILFLOORPUR10 strips** (thickness: 10 mm)

⑤ Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

AIRBORNE SOUND INSULATION

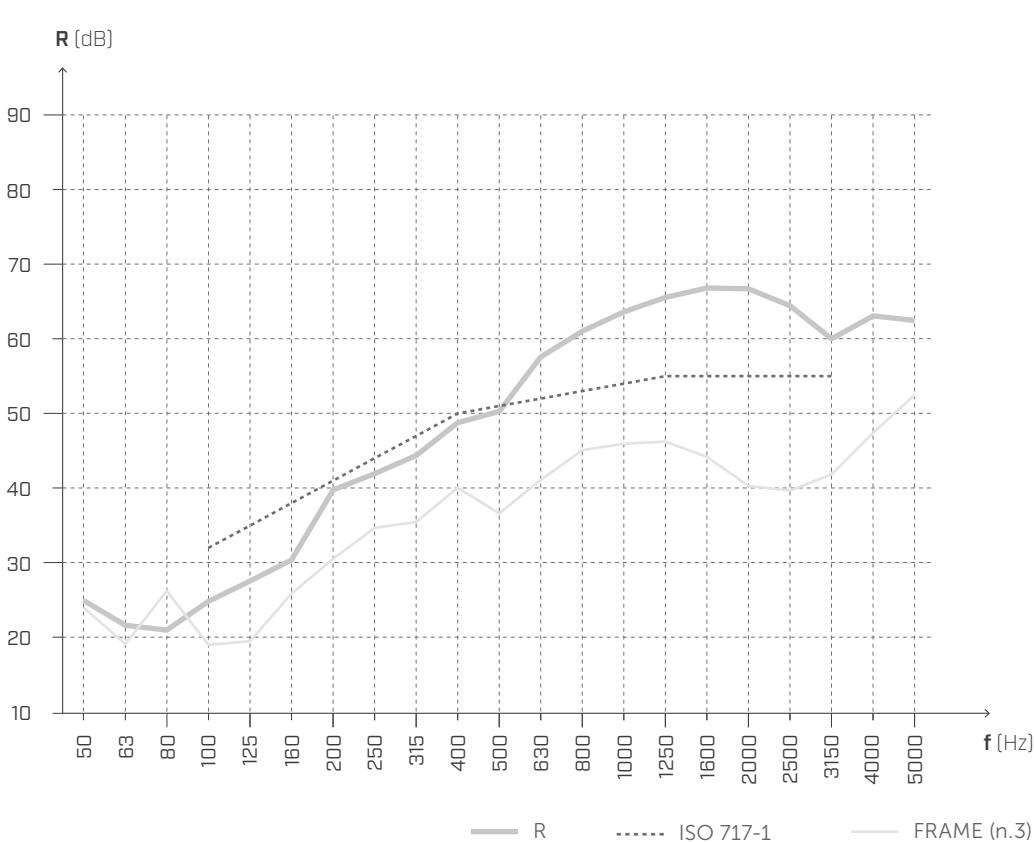

$$R_w(C, C_{tr}) = \text{51} \text{ (-3;-10) dB}$$

$$STC = \text{51}$$

$$\Delta R_w = +10 \text{ dB}^{(1)}$$

$$\Delta STC = +10 \text{ dB}^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R6b.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 5A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

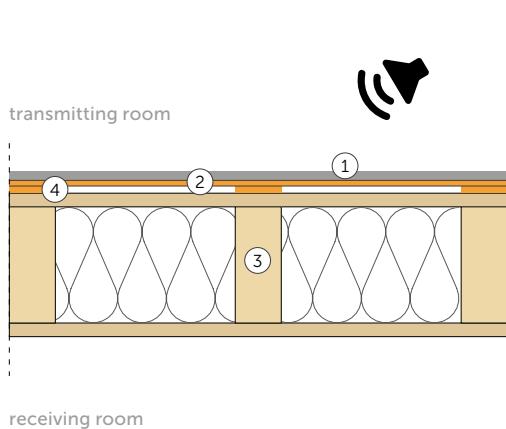

WALL

Surface = 10,16 m²

Surface mass = 38,6 kg/m²

Receiving room volume = 60,6 m³

(1) Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

(2) SILENT WALL BYTUM SA (thickness: 4 mm), (1250 kg/m³), 5 kg/m²

(3) SILENT FLOOR PUR - SILFLOORPUR10 strips (thickness: 10 mm)


(4) Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm

2x rock wool (thickness: 60mm), (70 kg/m³)

OSB (thickness: 15 mm), (550 kg/m³)

AIRBORNE SOUND INSULATION

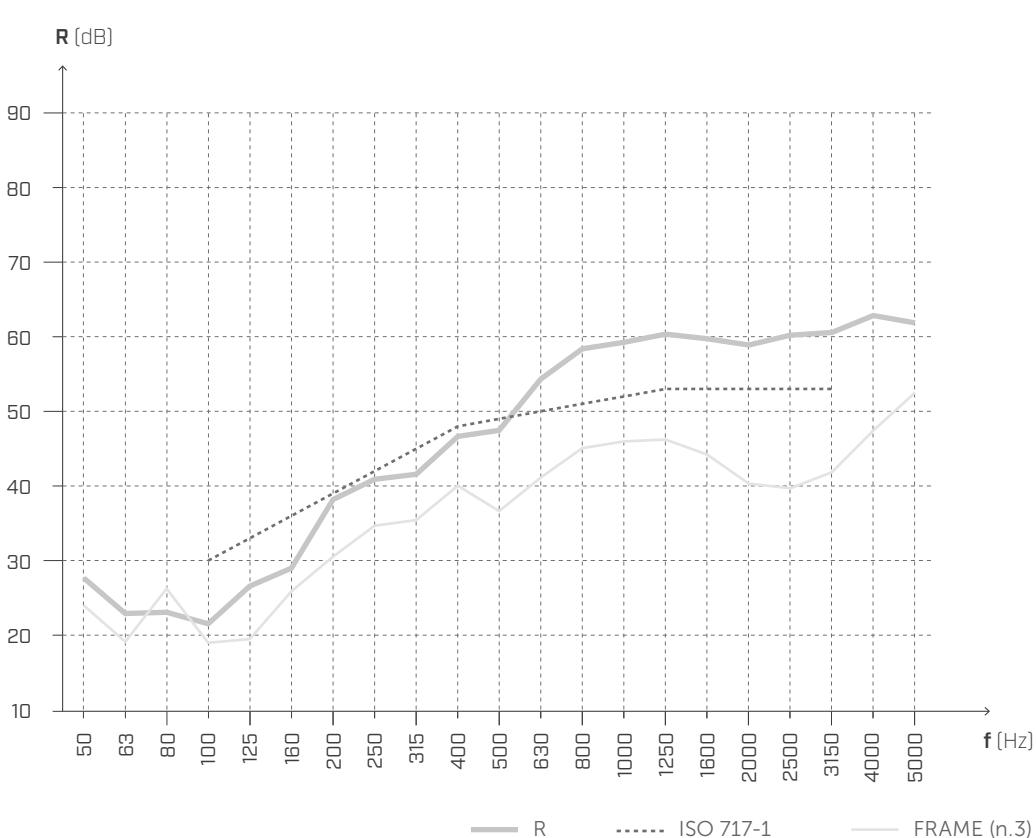

$$R_w(C; C_{tr}) = 49 \text{ (-3;-10) dB}$$

$$STC = 50$$

$$\Delta R_w = +8 \text{ dB}^{(1)}$$

$$\Delta STC = +9^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R5a.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 5B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

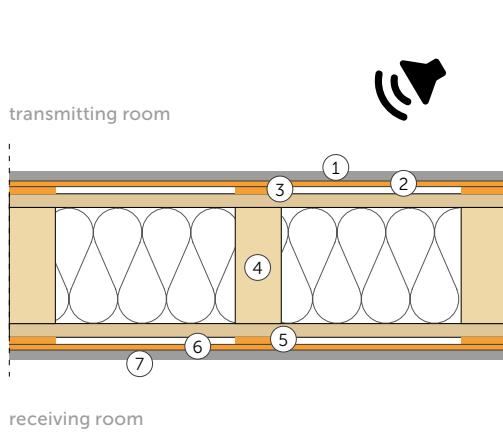

WALL


Surface = 10,16 m²

Surface mass = 52,9 kg/m²

Receiving room volume = 60,6 m³

- ① Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)
- ② **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²
- ③ **SILENT FLOOR PUR - SILFLOORPUR10** strips (thickness: 10 mm)
- ④ Timber frame (thickness: 170 mm)
timber struts 60 x 140 mm - spacing 600 mm
2x rock wool (thickness: 60mm), (70 kg/m³)
OSB (thickness: 15 mm), (550 kg/m³)
- ⑤ **SILENT FLOOR PUR - SILFLOORPUR10** strips (thickness: 10 mm)
- ⑥ **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²
- ⑦ Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

AIRBORNE SOUND INSULATION

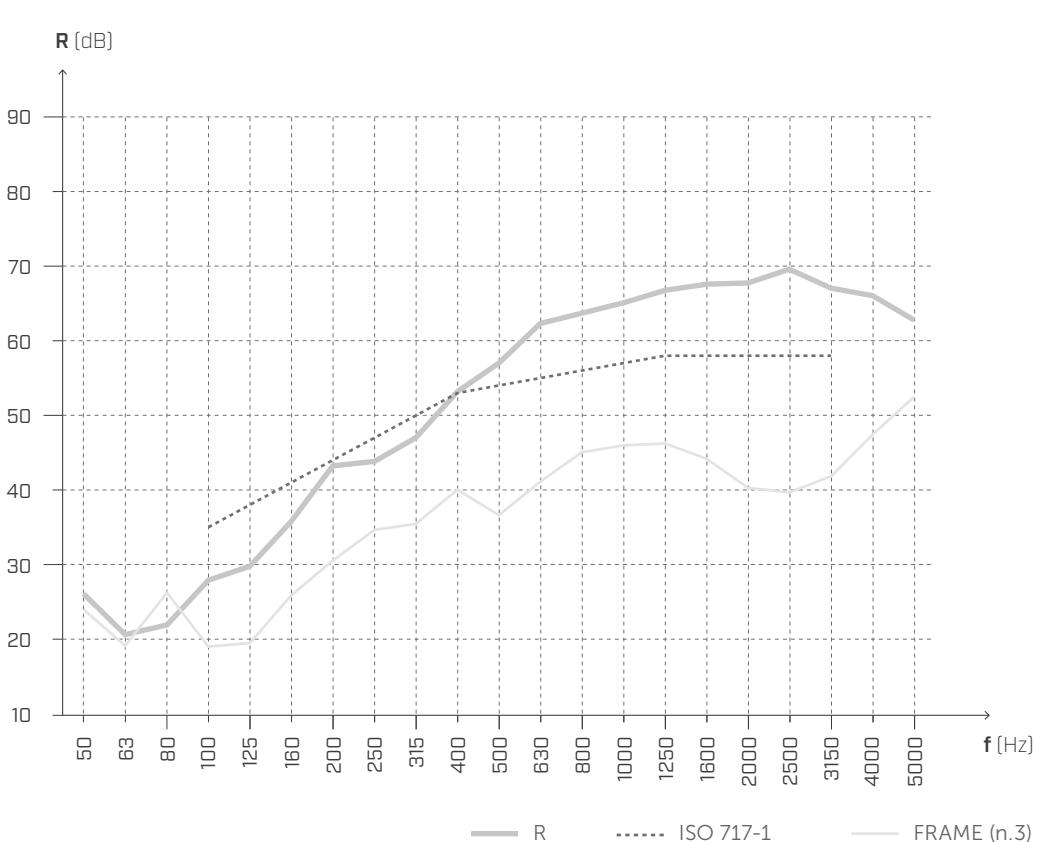

$$R_w(C, C_{tr}) = \mathbf{54} \text{ (-3;-9) dB}$$

$$\Delta R_w = +13 \text{ dB}^{(1)}$$

$$STC = \mathbf{54}$$

$$\Delta STC = +13^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R5b.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 6A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

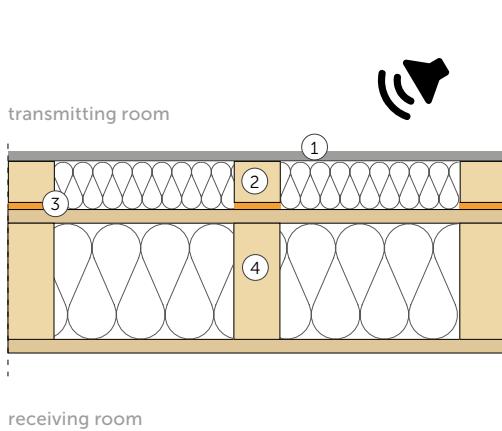

WALL

Surface = 10,16 m²

Surface mass = 37,2 kg/m²

Receiving room volume = 60,6 m³

① Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

② Counter wall (thickness: 40 mm)


timber battens 40 x 60 mm - spacing 600 mm
rock wool (thickness: 40mm), (38 kg/m³)

③ **SILENT FLOOR PUR - SILFLOORPUR10** strips (thickness: 10 mm)

④ Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm
2x rock wool (thickness: 60mm), (70 kg/m³)
OSB (thickness: 15 mm), (550 kg/m³)

AIRBORNE SOUND INSULATION

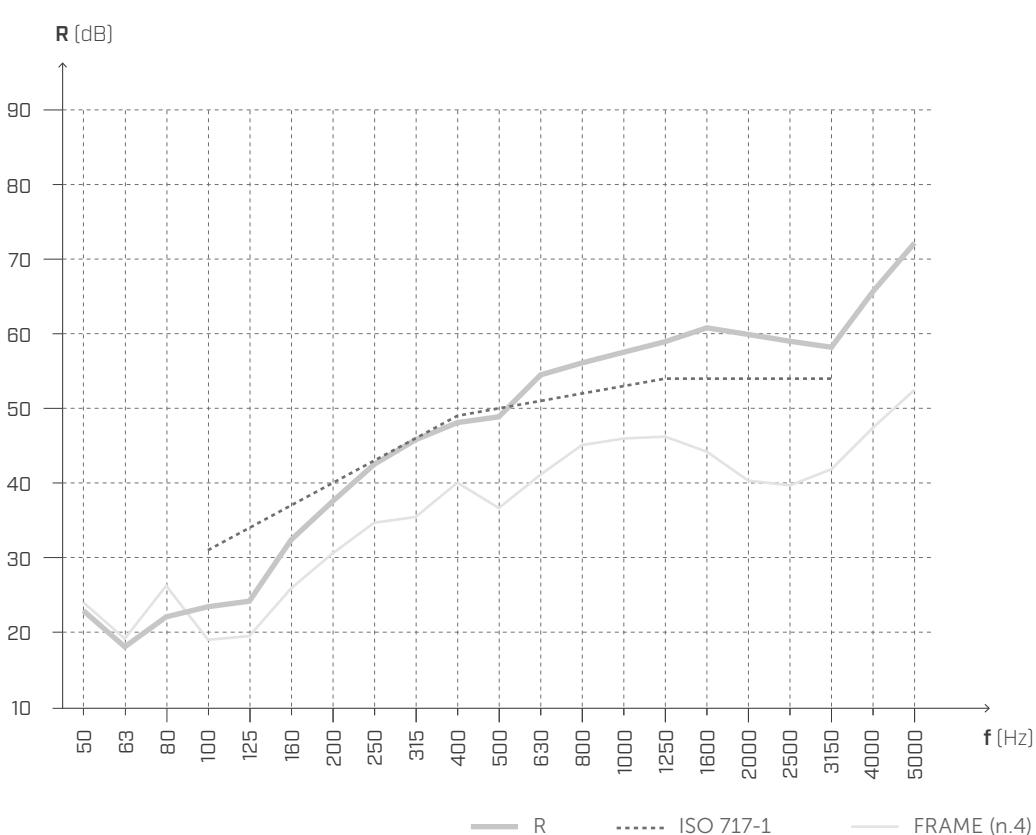

f [Hz]	R [dB]
50	22,9
63	18,0
80	22,1
100	23,4
125	24,2
160	32,4
200	37,5
250	42,5
315	45,8
400	48,1
500	48,9
630	54,5
800	56,1
1000	57,5
1250	58,9
1600	60,8
2000	59,9
2500	59,0
3150	58,2
4000	65,7
5000	72,2

$$R_w(C, C_{tr}) = \mathbf{50 \, (-4;-10) \, dB}$$

$$STC = \mathbf{48}$$

$$\Delta R_w = +9 \, dB^{(1)}$$

$$\Delta STC = +7^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R12a.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 6B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD ISO 10140-2

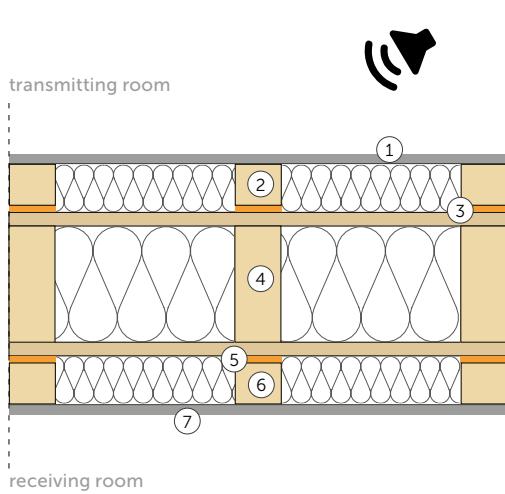

WALL

Surface = 10,16 m²

Surface mass = 52,2 kg/m²

Receiving room volume = 60,6 m³

① Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

② Counter wall (thickness: 40 mm)

timber battens 40 x 60 mm - spacing 600 mm;
rock wool (thickness: 40 mm), (38 kg/m³)

③ **SILENT FLOOR PUR - SILFLOORPUR10 strips** (thickness: 10 mm)

④ Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm;
2x rock wool (thickness: 60mm), (70 kg/m³)
OSB (thickness: 15 mm), (550 kg/m³)

⑤ **SILENT FLOOR PUR - SILFLOORPUR10 strips** (thickness: 10 mm),
(110 kg/m³), (1,1 kg/m²)

⑥ Counter wall (thickness: 40 mm)

timber battens 40 x 60 mm - spacing 600 mm;
rock wool (thickness: 40 mm), (38 kg/m³)

⑦ Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

AIRBORNE SOUND INSULATION



$$R_w(C, C_{tr}) = 55 \text{ (-5; -12) dB}$$

$$STC = 53$$

$$\Delta R_w = +14 \text{ dB}^{(1)}$$

$$\Delta STC = +12^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R12b.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 7A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

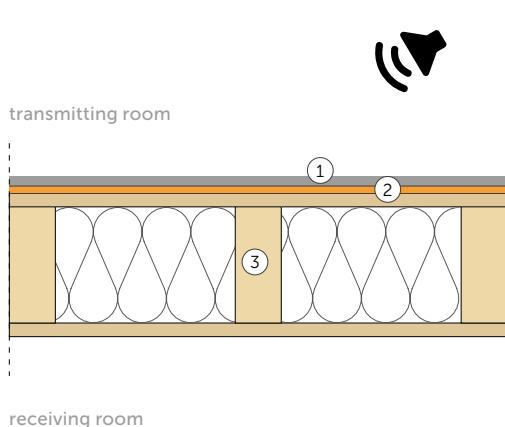

WALL

Surface = 10,16 m²

Surface mass = 34,4 kg/m²

Receiving room volume = 60,6 m³

① Plasterboard (thickness: 12,5 mm); (720 kg/m³); (9 kg/m²)

② **SILENT FLOOR PUR - SILFLOORPUR10** (thickness: 10 mm)


③ Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm

2x rock wool (thickness: 60mm), (70 kg/m³)

OSB (thickness: 15 mm), (550 kg/m³)

AIRBORNE SOUND INSULATION

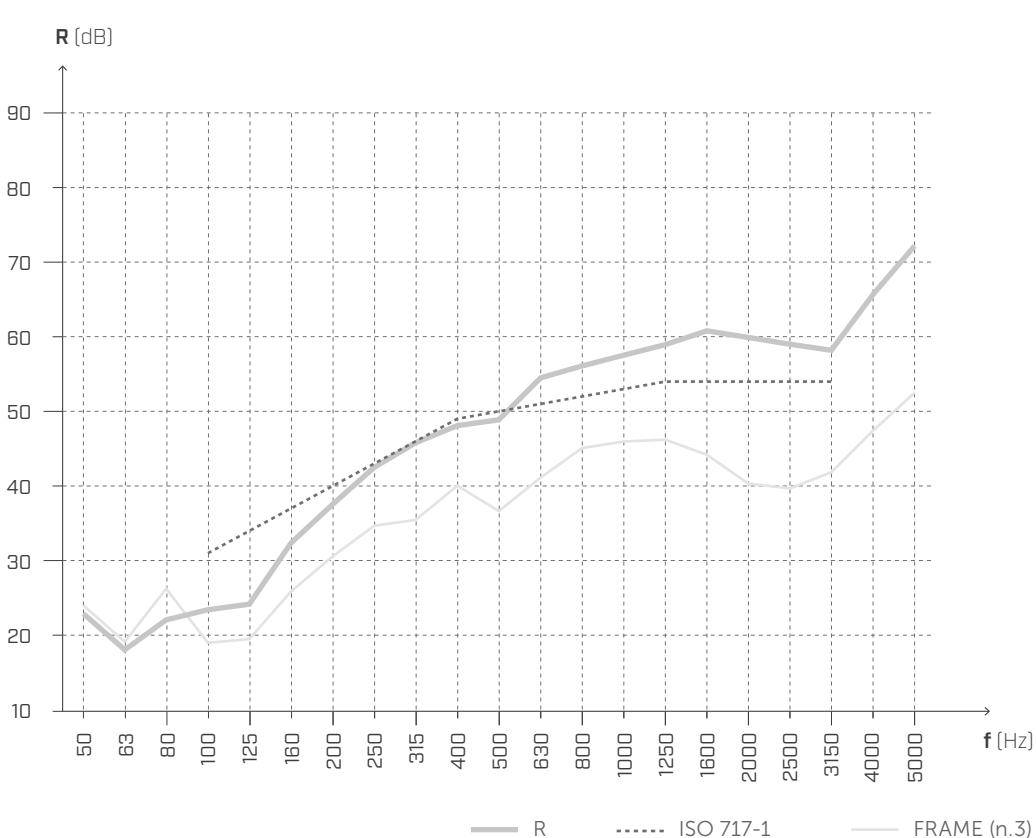

$$R_w(C; C_{tr}) = \text{47} \text{ (-3;-9) dB}$$

$$STC = 47$$

$$\Delta R_w = +6 \text{ dB}^{(1)}$$

$$\Delta STC = +6^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R13a.


NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 7B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2 AND EN ISO 717-1

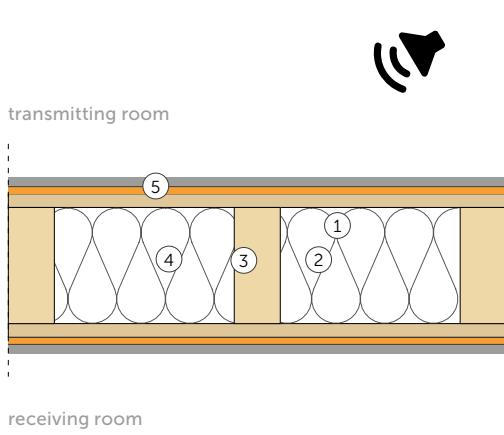

WALL

Surface = 10,16 m²

Surface mass = 44,5 kg/m²

Receiving room volume = 60,6 m³

① Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)

② SILENT FLOOR PUR - SILFLOORPUR10 (thickness: 10 mm)

③ Timber frame (thickness: 170 mm)

timber struts 60 x 140 mm - spacing 600 mm;


2x rock wool (thickness: 60mm), (70 kg/m³)

OSB (thickness: 15 mm), (550 kg/m³)

④ SILENT FLOOR PUR - SILFLOORPUR10 (thickness: 10 mm)

⑤ Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)

AIRBORNE SOUND INSULATION

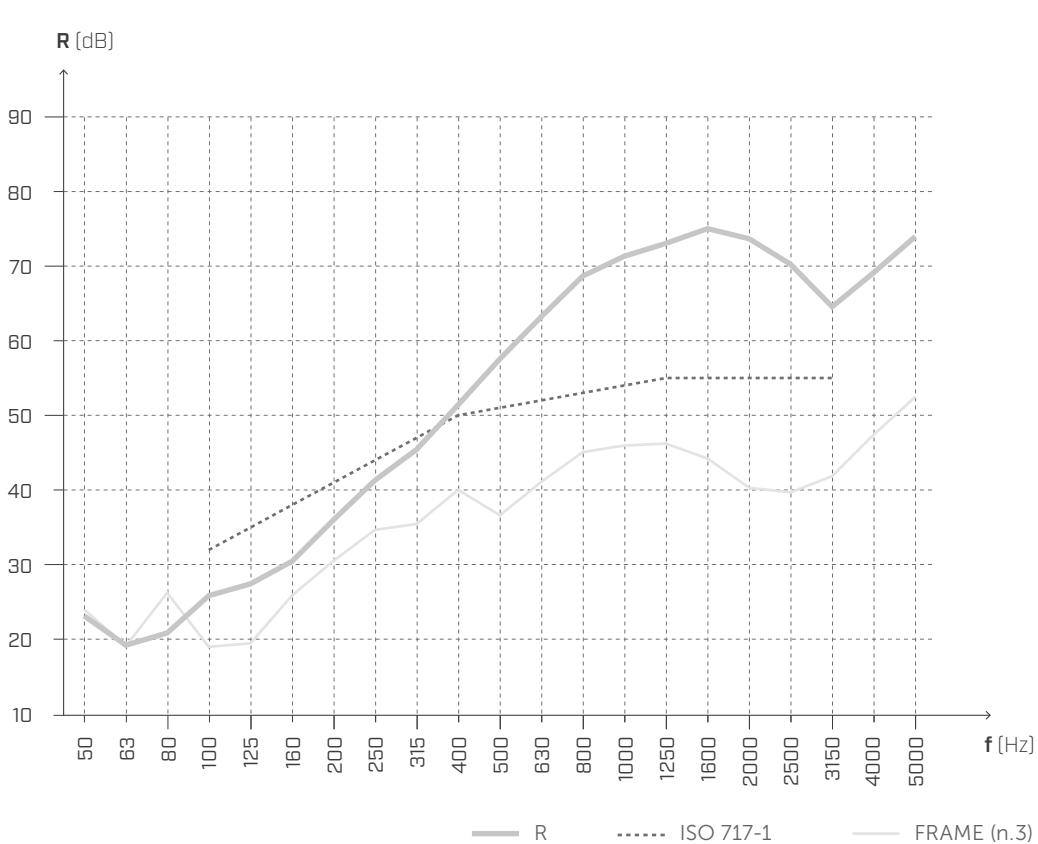

$$R_w(C; C_{tr}) = \textbf{51} \text{ (-3;-9) dB}$$

$$\Delta R_w = +10 \text{ dB}^{(1)}$$

$$STC = \textbf{51}$$

$$\Delta STC = +10^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-R13b.

NOTES:

⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

ON SITE MEASUREMENTS


COMMERCIAL BUILDING

Atlanta [USA]



The newly constructed building boasts office space, restaurants, shops, a hotel and art studios. It is a very innovative project that also uses TIM-BER as a structural material. To improve the acoustic performance of the floors, SILENT FLOOR PUR was used and ALADIN was used to reduce lateral transmission.

description	commercial building covering more than 300000 sq ft
type of structure	mixed
location	Atlanta (Georgia, USA)
products	SILENT FLOOR PUR, ALADIN

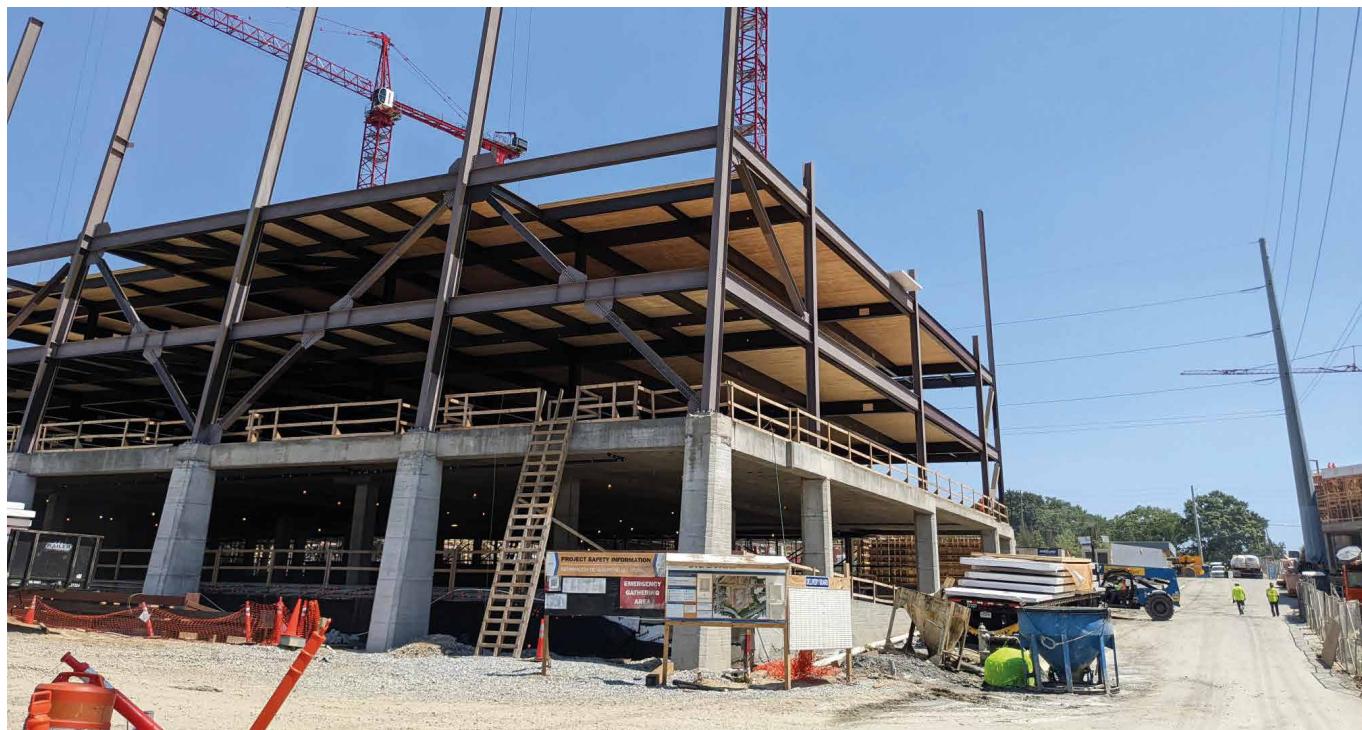

SILFLOORPUR15

TECHNICAL DATA

Properties	standard	value
Surface mass m	-	1,4 kg/m ²
Density ρ	-	90 kg/m ³
Apparent dynamic stiffness s'	EN 29052-1	8,8 MN/m ³
Dynamic stiffness s'	EN 29052-1	8,8 MN/m ³
Theoretical estimate of impact sound pressure level attenuation ΔL _w ⁽¹⁾	ISO 12354-2	34,6 dB
System resonance frequency f ₀ ⁽²⁾	ISO 12354-2	42,5 Hz
Impact sound pressure level attenuation ΔL _w ⁽³⁾	ISO 10140-3	23 dB
Thermal resistance R _t	-	0,52 m ² K/W
Resistance to airflow r	ISO 9053	< 10,0 kPa·s·m ⁻²
Compressibility class	EN 12431	CP2
CREEP Viscous sliding under compression X _{ct} (1,5 kPa)	EN 1606	7,50 %
Compression deformation stress	ISO 3386-1	17 kPa
Thermal conductivity λ	-	0,035 W/m·K
Specific heat c	-	1800 J/kg·K
Water vapour transmission Sd	-	> 100 m
Reaction to fire	EN 13501-1	class F
VOC emission classification	French decree no. 2011-321	A+

(1) $\Delta L_w = (13 \lg(m') - (14,2 \lg(s')) + 20,8$ [dB] con m'= 125 kg/m².

(2) $f_0 = 160 \sqrt{s'/m'}$ con m'= 125 kg/m².

(3) Measured in the laboratory on 200 mm CLT floor. See the manual for more information on configuration.

EN ISO 12354-2 ANNEX C | ESTIMATE ΔL_w [FORMULA C.4] E ΔL [FORMULA C.1]

The following tables show how the attenuation in dB (ΔL_w e ΔL) of SILFLOORPUR15 varies as the load m' (i.e., the surface mass of the layers with which SILFLOORPUR15 is loaded) changes.

SILFLOORPUR15

s' or s'	8,8	8,8	8,8	8,8	8,8	8,8	8,8	8,8	8,8	8,8	[MN/m ³]
load m'	50	75	100	125	150	175	200	225	250	275	[kg/m ²]
ΔL _w	29,5	31,8	33,4	34,6	35,7	36,5	37,3	38,0	38,6	39,1	[dB]
f ₀	67,1	54,8	47,5	42,5	38,8	35,9	33,6	31,6	30,0	28,6	[Hz]

ΔL in frequency											
[Hz]	100	125	160	200	250	315	400	500	630	800	1000
	5,2	7,8	9,7	11,2	12,4	13,4	14,2	15,0	15,7	16,3	16,9
[Hz]	10,7	12,6	14,1	15,3	16,3	17,1	17,9	18,6	19,2	19,8	[dB]
[Hz]	11,3	14,0	15,8	17,3	18,5	19,5	20,3	21,1	21,8	22,4	[dB]
[Hz]	14,2	16,9	18,7	20,2	21,4	22,4	23,3	24,0	24,7	25,3	[dB]
[Hz]	17,1	19,8	21,6	23,1	24,3	25,3	26,2	26,9	27,6	28,2	[dB]
[Hz]	20,1	22,8	24,7	26,1	27,3	28,3	29,2	29,9	30,6	31,2	[dB]
[Hz]	23,3	25,9	27,8	29,2	30,4	31,4	32,3	33,1	33,7	34,4	[dB]
[Hz]	26,2	28,8	30,7	32,1	33,3	34,3	35,2	36,0	36,6	37,3	[dB]
[Hz]	29,2	31,8	33,7	35,1	36,3	37,3	38,2	39,0	39,7	40,3	[dB]
[Hz]	32,3	34,9	36,8	38,3	39,4	40,4	41,3	42,1	42,8	43,4	[dB]
[Hz]	35,2	37,8	39,7	41,2	42,4	43,4	44,2	45,0	45,7	46,3	[dB]
[Hz]	38,1	40,7	42,6	44,1	45,3	46,3	47,1	47,9	48,6	49,2	[dB]
[Hz]	41,3	44,0	45,8	47,3	48,5	49,5	50,3	51,1	51,8	52,4	[dB]
[Hz]	44,2	46,9	48,7	50,2	51,4	52,4	53,3	54,0	54,7	55,3	[dB]
[Hz]	47,1	49,8	51,6	53,1	54,3	55,3	56,2	56,9	57,6	58,2	[dB]
[Hz]	50,1	52,8	54,7	56,1	57,3	58,3	59,2	59,9	60,6	61,2	[dB]

EN ISO 12354-2 Annex C - formula C.4

$$\Delta L_w = \left(13 \lg(m') \right) - \left(14,2 \lg(s') \right) + 20,8 \text{ dB}$$

EN ISO 12354-2 Annex C - formula C.1

$$\Delta L = \left(30 \lg \frac{f}{f_0} \right) \text{ dB}$$

EN ISO 12354-2 Annex C - formula C.2

$$f_0 = 160 \sqrt{\frac{s'}{m'}}$$

LABORATORY MEASUREMENT | CLT FLOOR 1


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 215,7 kg/m²

Receiving room volume = 60,1 m³

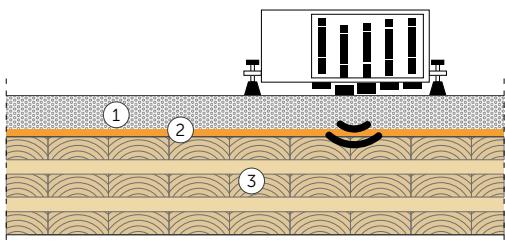

① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② SILENT FLOOR PUR - SILFLOORPUR15 (thickness: 15 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION



$$L_{n,w}(C_l) = \text{63 (-3) dB}$$

$$\Delta L_{n,w} = -23 \text{ dB}^{(1)}$$

$$IIC = 47$$

$$\Delta IIC = +23^{(2)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L6.

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 1


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
RUBBER BALL METHOD | REFERENCE STANDARD: ISO 16283-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 215,7 kg/m²

Receiving room volume = 60,1 m³

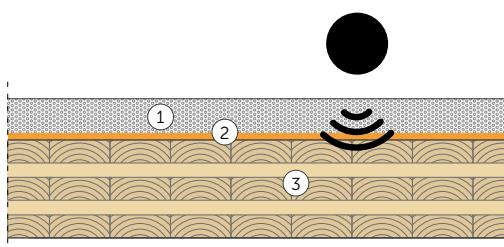


① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② **SILENT FLOOR PUR - SILFLOORPUR15** (thickness: 15 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

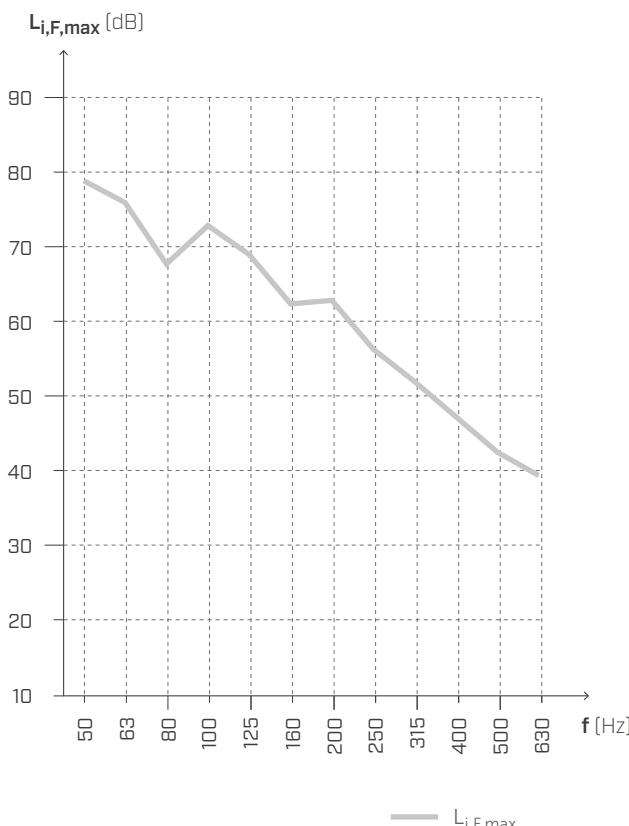

f [Hz]	$L_{i,F,\max}$ [dB]
50	78,8
63	75,9
80	67,7
100	72,8
125	68,9
160	62,3
200	62,8
250	56,3
315	51,9
400	47,2
500	42,5
630	39,4

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L6.

LABORATORY MEASUREMENT | CLT FLOOR 2


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 217,3 kg/m²

Receiving room volume = 60,1 m³

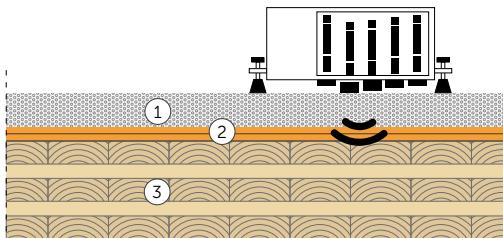


① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② 2x SILENT FLOOR PUR - SILFLOORPUR15 (thickness: 15 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

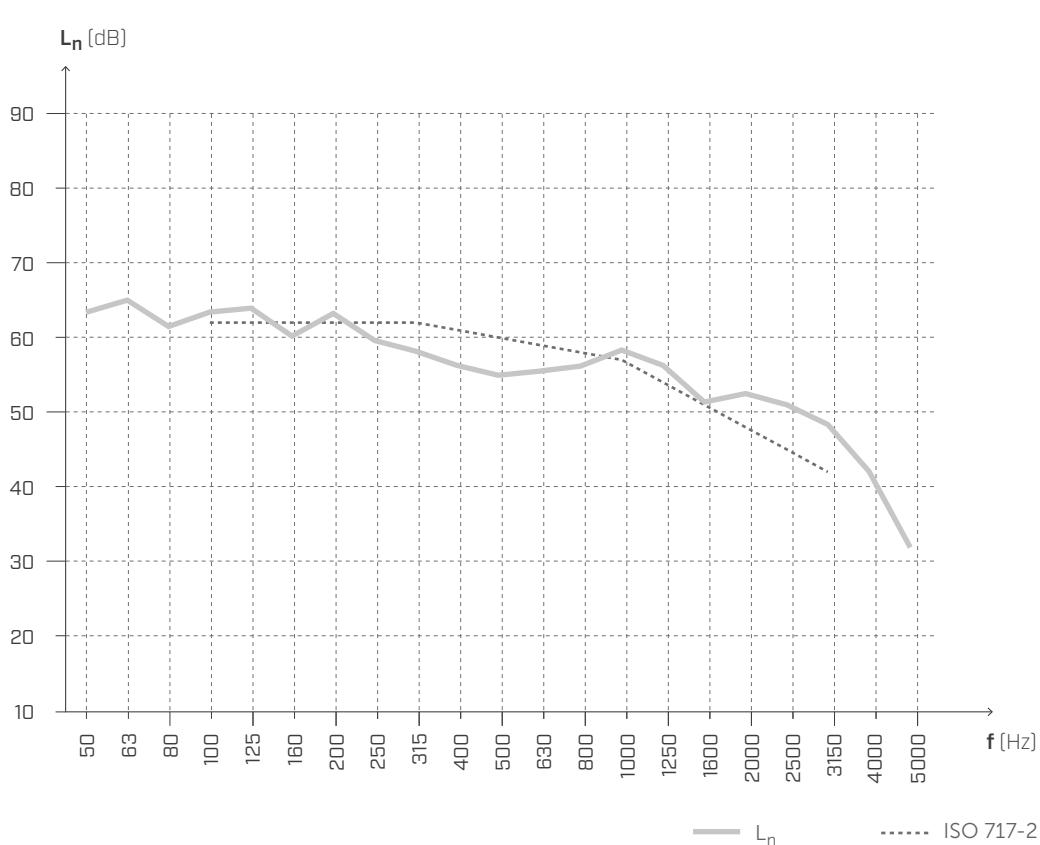

f [Hz]	L _n [dB]
50	63,4
63	65,0
80	61,5
100	63,4
125	63,9
160	60,2
200	63,2
250	59,6
315	58,2
400	56,3
500	55,0
630	55,5
800	56,2
1000	58,3
1250	56,3
1600	51,3
2000	52,5
2500	51,0
3150	48,4
4000	42,1
5000	31,9

$$L_{n,w}(C_l) = \mathbf{60 \, (-4) \, dB}$$

$$\Delta L_{n,w} = -26 \, dB^{(1)}$$

$$IIC = \mathbf{50}$$

$$\Delta IIC = +26^{(2)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L6.

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 2


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
RUBBER BALL METHOD | REFERENCE STANDARD: ISO 16283-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 217,3 kg/m²

Receiving room volume = 60,1 m³

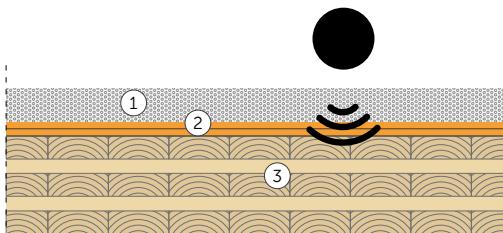


① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② 2x SILENT FLOOR PUR - SILFLOORPUR15 (thickness: 15 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

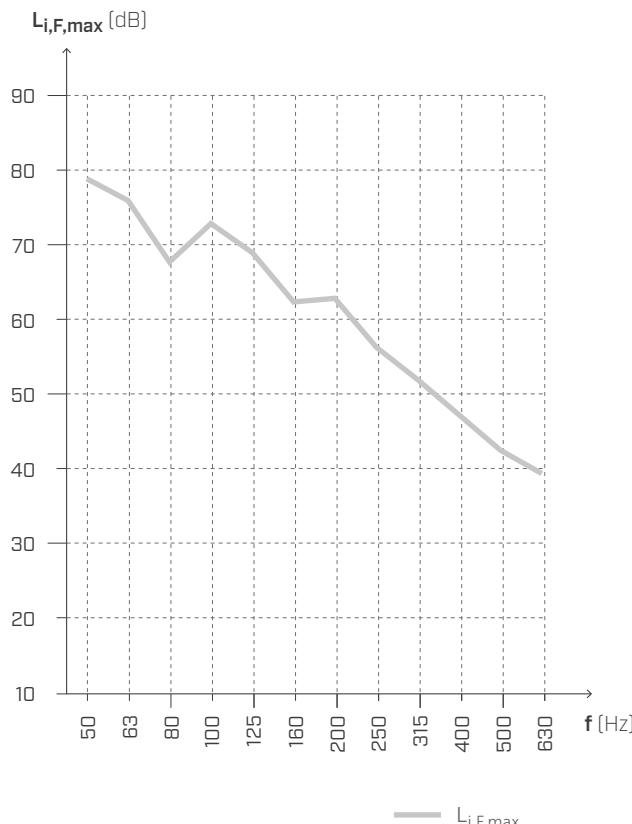


f [Hz]	$L_{i,F,\max}$ [dB]
50	81,5
63	79,0
80	68,2
100	65,2
125	63,5
160	57,8
200	59,6
250	52,9
315	48,5
400	44,3
500	40,7
630	38,0

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L6.

CERTAIN COLLABORATIONS ARE BORN TO LAST

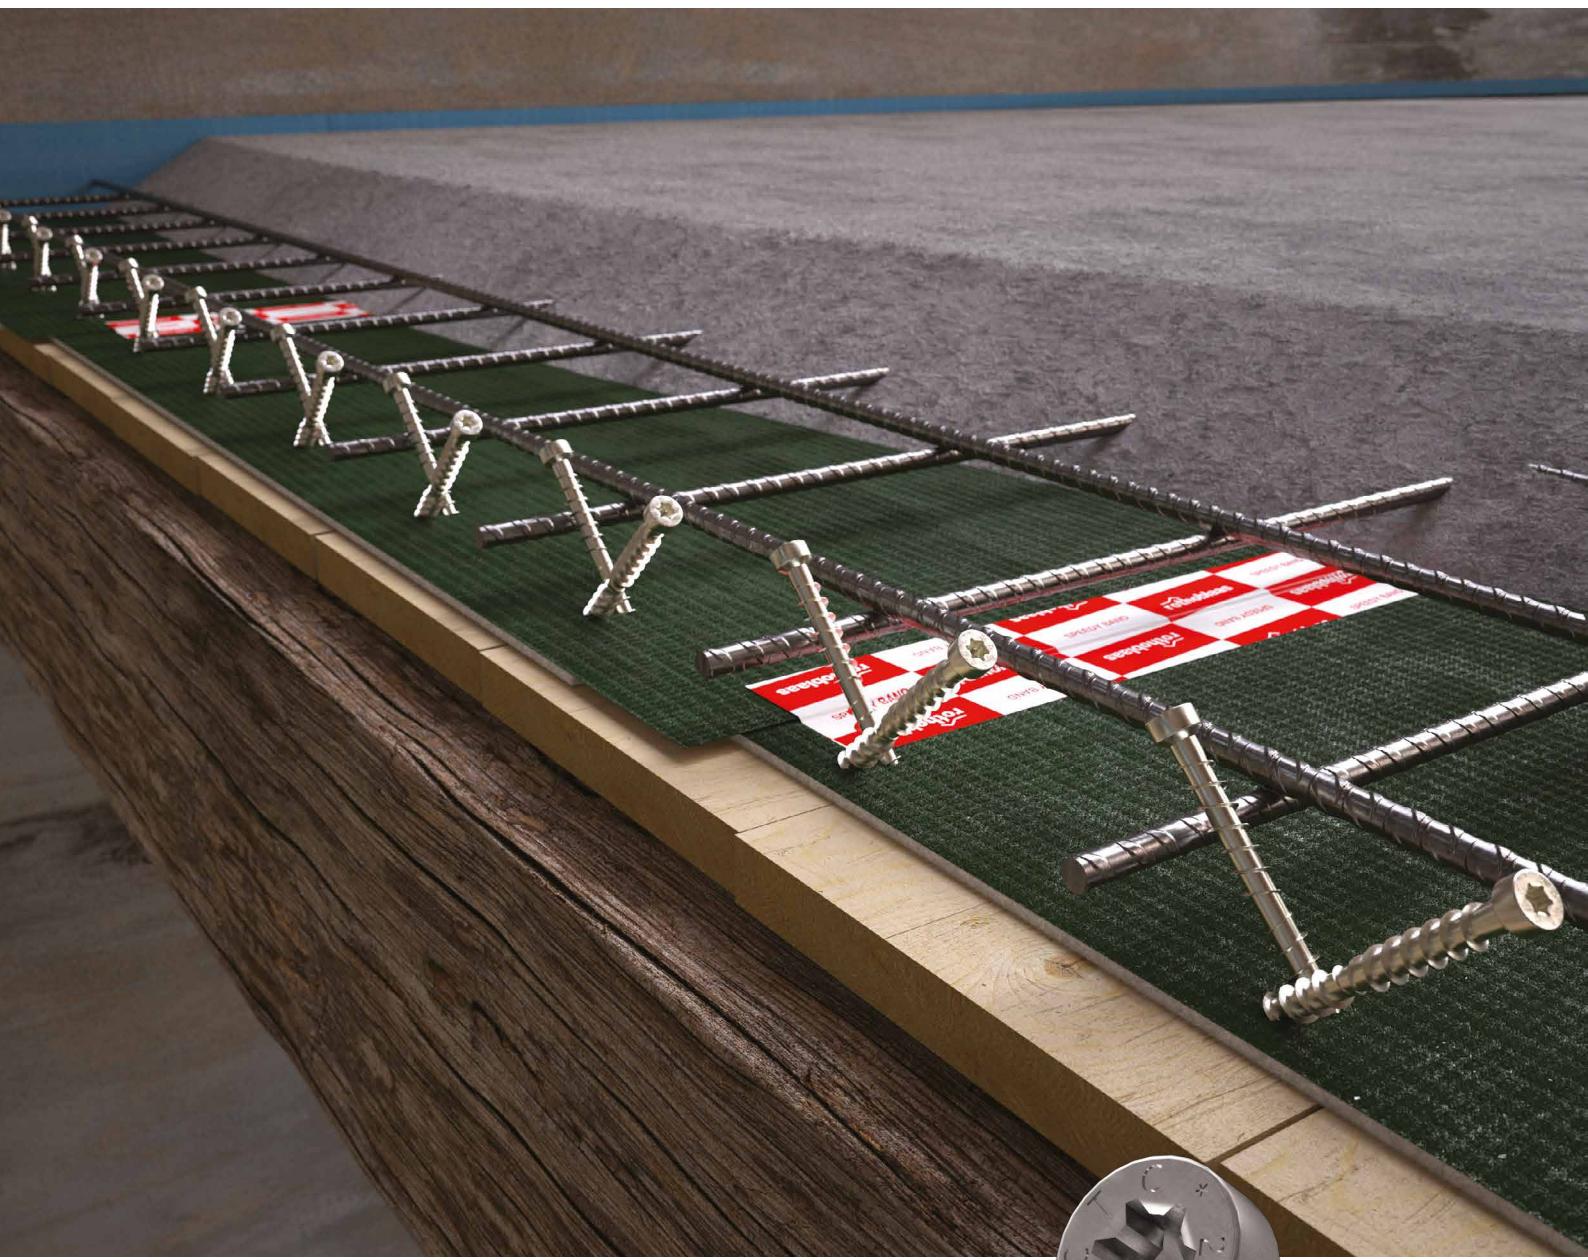

CTC is the connector for timber-to-concrete floors.

CE certified, it allows to connect a 5 or 6 cm reinforced concrete slab to the timber beams of the underneath floor, obtaining a new timber-concrete structure with extraordinary strength and excellent static and acoustic performance. It is an approved self-drilling, reversible, fast and minimally invasive system.

Scan the QR code and discover the technical features of CTC connector



www.rothoblaas.com

**rothoblaas**

Solutions for Building Technology

SILFLOORPUR20

TECHNICAL DATA

Properties	standard	value
Surface mass m'	-	1,8 kg/m ²
Density ρ	-	90 kg/m ³
Apparent dynamic stiffness s'	EN 29052-1	7,4 MN/m ³
Dynamic stiffness s'	EN 29052-1	7,4 MN/m ³
Theoretical estimate of impact sound pressure level attenuation ΔL _w ⁽¹⁾	ISO 12354-2	35,7 dB
System resonance frequency f ₀ ⁽²⁾	ISO 12354-2	38,9 Hz
Impact sound pressure level attenuation ΔL _w ⁽³⁾	ISO 10140-3	25 dB
Thermal resistance R _t	-	0,92 m ² K/W
Resistance to airflow r	ISO 9053	< 10,0 kPa·s·m ⁻²
Compressibility class	EN 12431	CP2
CREEP Viscous sliding under compression X _{ct} (1,5 kPa)	EN 1606	7,50 %
Compression deformation stress	ISO 3386-1	17 kPa
Thermal conductivity λ	-	0,035 W/m·K
Specific heat c	-	1800 J/kg·K
Water vapour transmission Sd	-	> 100 m
Reaction to fire	EN 13501-1	class F
VOC emission classification	French decree no. 2011-321	A+

(1) $\Delta L_w = (13 \lg(m')) - (14,2 \lg(s')) + 20,8$ [dB] con m' = 125 kg/m².

(2) $f_0 = 160 \sqrt{s'/m'}$ con m' = 125 kg/m².

(3) Measured in the laboratory on 200 mm CLT floor. See the manual for more information on configuration.

EN ISO 12354-2 ANNEX C | ESTIMATE ΔL_w [FORMULA C.4] E ΔL [FORMULA C.1]

The following tables show how the attenuation in dB (ΔL_w e ΔL) of SILFLOORPUR20 varies as the load m' (i.e., the surface mass of the layers with which SILFLOORPUR20 is loaded) changes.

SILFLOORPUR20

s' or s'	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	12,5	[MN/m ³]
load m'	50	75	100	125	150	175	200	225	250	275	[kg/m ²]
ΔL _w	27,3	29,6	31,2	32,5	33,5	34,4	35,1	35,8	36,4	36,9	[dB]
f ₀	80,0	65,3	56,6	50,6	46,2	42,8	40,0	37,7	35,8	34,1	[Hz]

ΔL in frequency

[Hz]	100	2,9	5,5	7,4	8,9	10,1	11,1	11,9	12,7	13,4	14,0	14,6	[dB]
[Hz]	125	5,8	8,5	10,3	11,8	13,0	14,0	14,8	15,6	16,3	16,9	17,5	[dB]
[Hz]	160	9,0	11,7	13,5	15,0	16,2	17,2	18,1	18,8	19,5	20,1	20,7	[dB]
[Hz]	200	11,9	14,6	16,5	17,9	19,1	20,1	21,0	21,7	22,4	23,0	23,6	[dB]
[Hz]	250	14,8	17,5	19,4	20,8	22,0	23,0	23,9	24,6	25,3	26,0	26,5	[dB]
[Hz]	315	17,9	20,5	22,4	23,8	25,0	26,0	26,9	27,7	28,3	29,0	29,5	[dB]
[Hz]	400	21,0	23,6	25,5	26,9	28,1	29,1	30,0	30,8	31,5	32,1	32,6	[dB]
[Hz]	500	23,9	26,5	28,4	29,8	31,0	32,0	32,9	33,7	34,4	35,0	35,5	[dB]
[Hz]	630	26,9	29,5	31,4	32,9	34,0	35,0	35,9	36,7	37,4	38,0	38,6	[dB]
[Hz]	800	30,0	32,6	34,5	36,0	37,2	38,2	39,0	39,8	40,5	41,1	41,7	[dB]
[Hz]	1000	32,9	35,5	37,4	38,9	40,1	41,1	41,9	42,7	43,4	44,0	44,6	[dB]
[Hz]	1250	35,8	38,5	40,3	41,8	43,0	44,0	44,8	45,6	46,3	46,9	47,5	[dB]
[Hz]	1600	39,0	41,7	43,5	45,0	46,2	47,2	48,1	48,8	49,5	50,1	50,7	[dB]
[Hz]	2000	41,9	44,6	46,5	47,9	49,1	50,1	51,0	51,7	52,4	53,0	53,6	[dB]
[Hz]	2500	44,8	47,5	49,4	50,8	52,0	53,0	53,9	54,6	55,3	56,0	56,5	[dB]
[Hz]	3150	47,9	50,5	52,4	53,8	55,0	56,0	56,9	57,7	58,3	59,0	59,5	[dB]

EN ISO 12354-2 Annex C - formula C.4

□
$$\Delta L_w = \left(13 \lg(m') \right) - \left(14,2 \lg(s') \right) + 20,8 \text{ dB}$$

EN ISO 12354-2 Annex C - formula C.1

□
$$\Delta L = \left(30 \lg \frac{f}{f_0} \right) \text{ dB}$$

EN ISO 12354-2 Annex C - formula C.2

□
$$f_0 = 160 \sqrt{\frac{s'}{m'}}$$

LABORATORY MEASUREMENT | CLT FLOOR 1


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 216,2 kg/m²

Receiving room volume = 60,1 m³

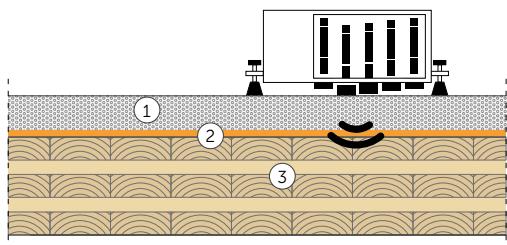

① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② **SILENT FLOOR PUR - SILFLOORPUR20** (thickness: 20 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION



$$L_{n,w}(C_l) = \text{61 (-4) dB}$$

$$\Delta L_{n,w} = -25 \text{ dB}^{(1)}$$

$$IIC = \text{49}$$

$$\Delta IIC = +25^{(2)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L1.

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 1


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
RUBBER BALL METHOD | REFERENCE STANDARD: ISO 16283-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 216,2 kg/m²

Receiving room volume = 60,1 m³

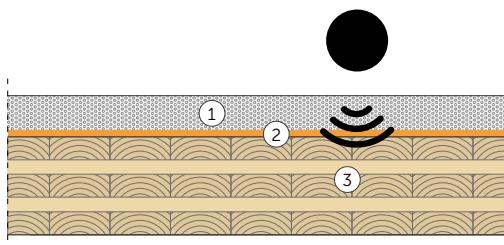


① Concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

② **SILENT FLOOR PUR - SILFLOORPUR20** (thickness: 20 mm)

③ CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

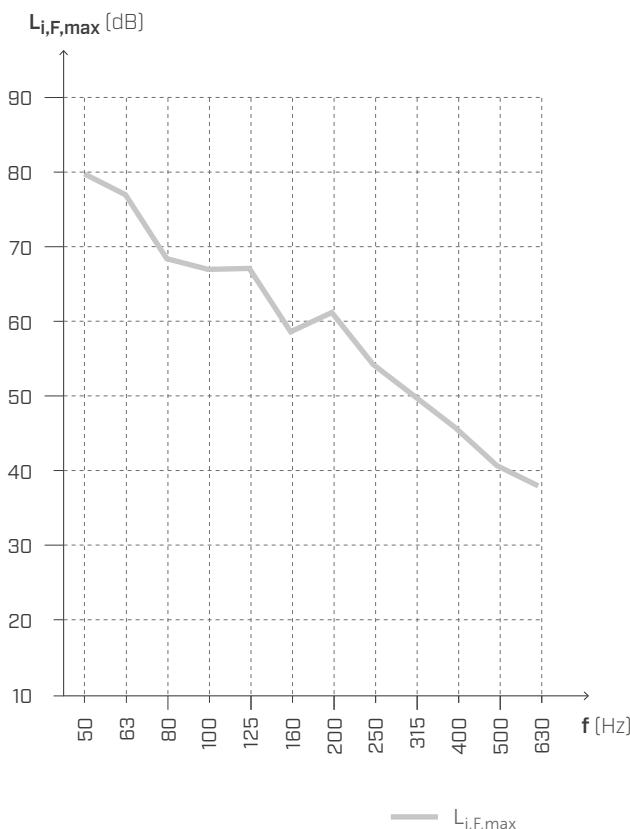


f [Hz]	$L_{i,F,\max}$ [dB]
50	79,8
63	77,0
80	68,4
100	67,0
125	67,1
160	58,6
200	61,2
250	54,2
315	50,0
400	45,7
500	40,7
630	38,0

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L1.

|SILENT FLOOR PE

TECHNICAL MANUAL

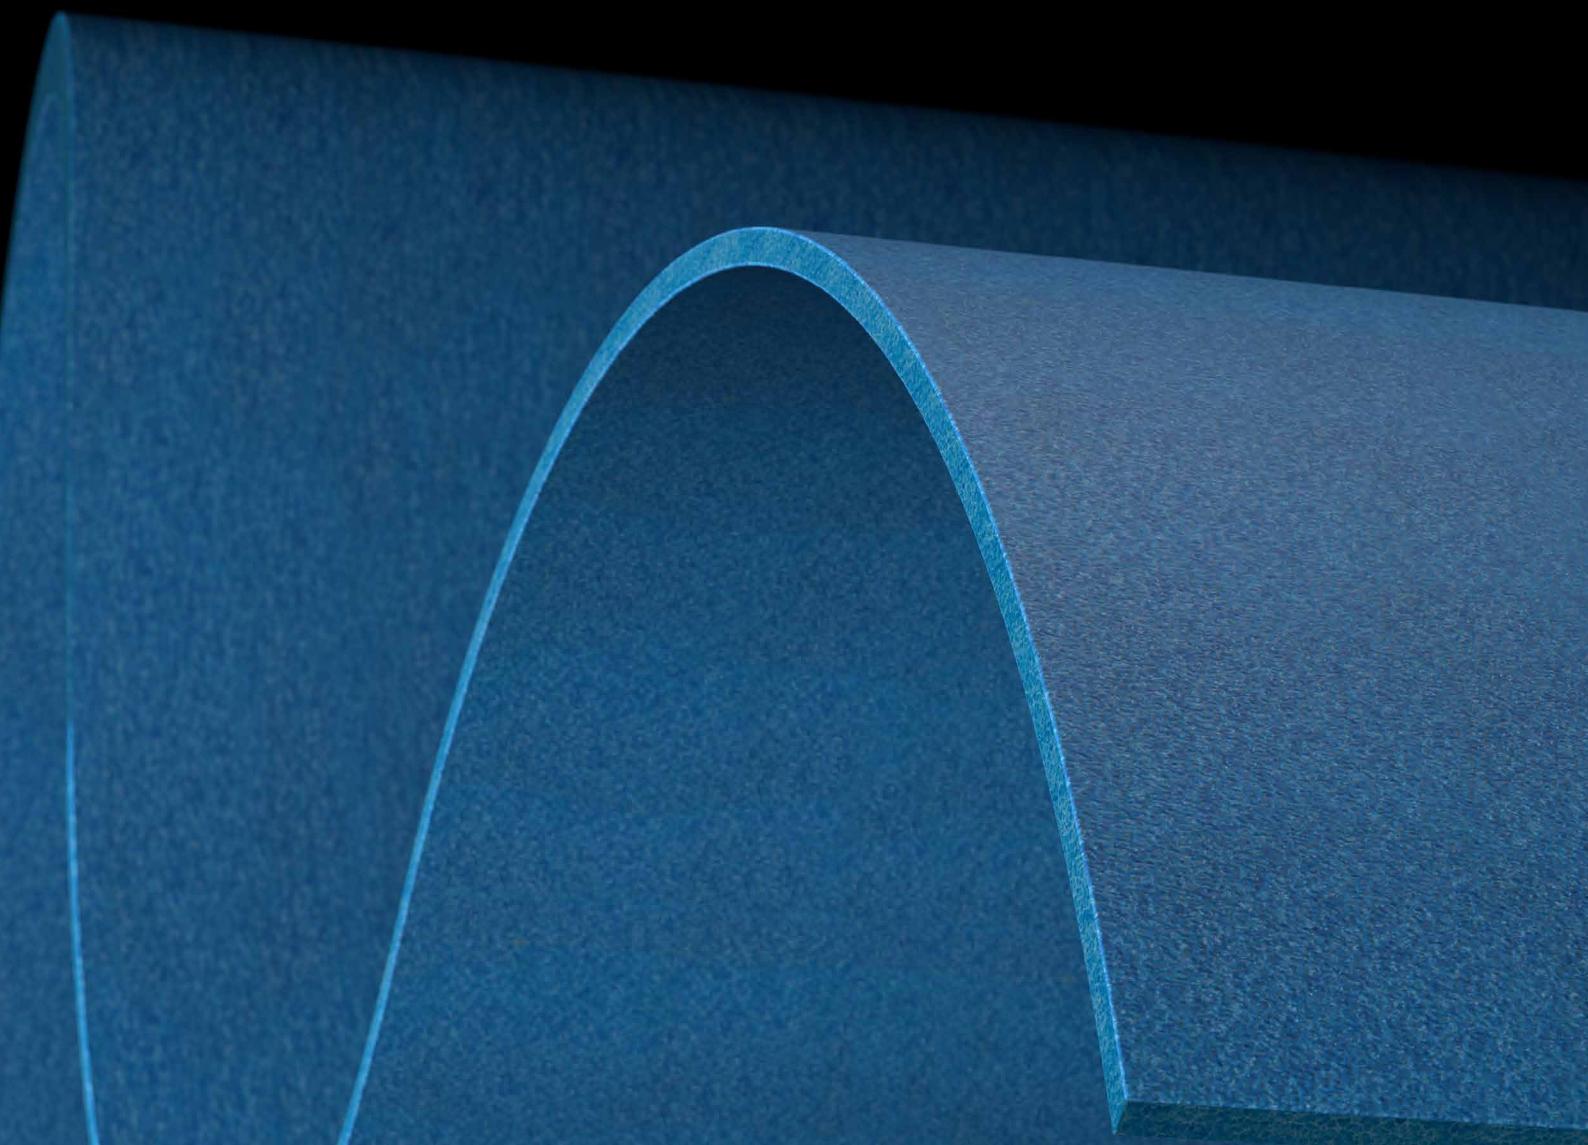

 **rothoblaas**

Solutions for Building Technology

CONTENTS

ACOUSTIC PROBLEMS OF FLOORS.....	206
SILENT FLOOR PE	208
SILFLOORPE6.....	210
LABORATORY MEASUREMENT CLT FLOOR 1.....	211
LABORATORY MEASUREMENT CLT FLOOR 1.....	212
SILFLOORPE10.....	213

I ACOUSTIC PROBLEMS OF FLOORS



WHAT IS IMPACT NOISE?

When it comes to floors, impact noise is the main acoustic problem because it constantly affects them. When a body impacts on the floor structure, the noise quickly spreads throughout the building either by air, affecting the nearest rooms, or by structure, propagating into the most distant rooms.



WHAT IS AIRBORNE NOISE?

Airborne noise is generated in the air and, after an initial airborne phase, is transported both by air and by structure. This is a problem that affects both walls and floors, but if we are talking about floors, the most important problem is certainly impact noise.

HERE IS THE SOLUTION

In order to be able to minimise the discomfort caused by impact noise, a stratigraphic package should be designed consisting of layers of different materials that are disconnected from each other and are able to dissipate the energy transmitted by the impact.



MASS-SPRING-MASS SYSTEM


A floating screed system such as the one shown in the images below can be schematised with a mass-spring-mass system, in which the structural floor represents the mass, the impact-absorbing product is equivalent to the spring, and the upper screed with the floor constitutes the second mass of the system. In this context, "resilient layer" is defined as the element with the spring function characterised by its own *dynamic stiffness s'*.



HOW IS THE IMPACT NOISE LEVEL MEASURED?


The impact noise level is a measure of the disturbance perceived in a room when an impact noise source is activated in the upper room. It can be measured both on site and in the laboratory. Clearly, ideal conditions exist in the laboratory for the effects of lateral transmission to be neglected, as the laboratory itself is constructed so that the walls are decoupled from the ceiling.

TAPPING MACHINE method



The TAPPING MACHINE is used to simulate "light" and "hard" impacts, such as walking with heeled shoes or the impact caused by falling objects.

RUBBER BALL method



The RUBBER BALL is used to simulate "soft" and "heavy" impacts, such as a barefoot walk or a child jumping.


HOW TO CHOOSE THE BEST PRODUCT



DYNAMIC STIFFNESS - s'


Expressed in MN/m³, it is measured according to EN 29052-1 and expresses the deformation capacity of a material that is subjected to a dynamic stress. Consequently, it indicates the ability to dampen the vibrations generated by an impact noise.

The measurement method involves, first, measuring the *apparent dynamic stiffness* s'_t of the material and then correcting it, if necessary, to obtain the *real dynamic stiffness* s' . Dynamic stiffness depends in fact on the *flow resistivity* r , which is measured in the lateral direction of the sample. If the material has specific flow resistivity values, the apparent dynamic stiffness must be corrected by adding the contribution of the gas contained within the material: air.



VISCOSITY SLIDING UNDER COMPRESSION – CREEP

Expressed as a percentage, it is measured according to EN 1606 and represents the long-term deformation of a material under constant load to be simulated. The measurement in the laboratory must be carried out over a period of at least 90 days.









COMPRESSIBILITY - c

The compressibility class expresses the behaviour of a material while subjected to screed loading. During measurement, the product is subjected to different loads and its thickness is measured. The compressibility measurement is carried out to understand what loads the underscreed product can withstand, in order to avoid cracking and splitting of screeds.

CORRECT INSTALLATION

The technological solution of the floating screed is one of the most widely used and one of the most effective, but in order to achieve satisfactory results it is important that the system is designed and implemented correctly.

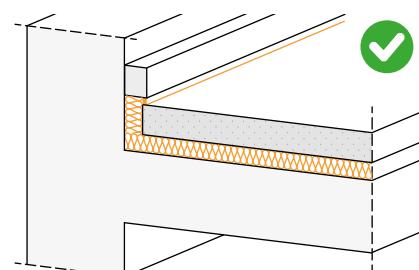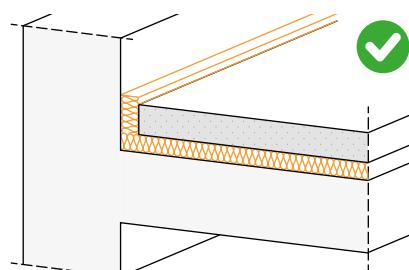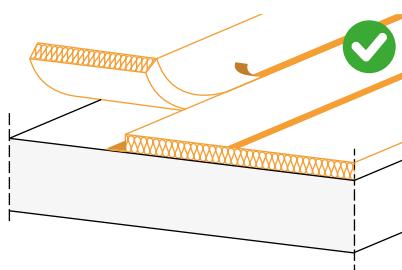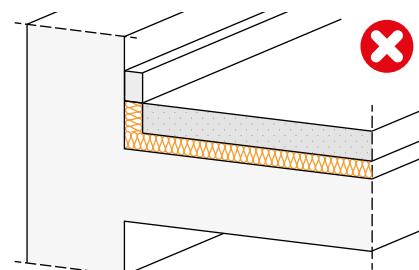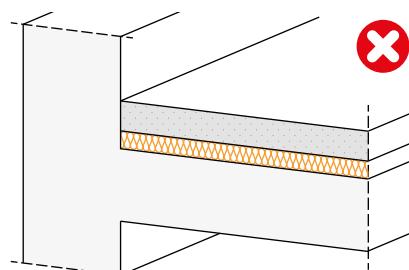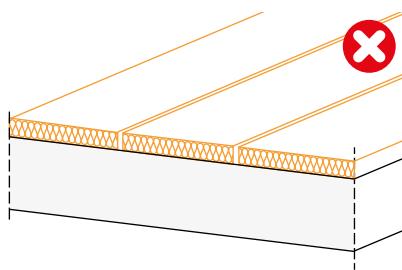

The resilient layer must be continuous because any gap would represent an acoustic bridge. When installing underscreed mats, care must be taken not to create discontinuities.

It is important to use the SILENT EDGE perimeter strip to ensure that the resilient layer is continuous around the entire perimeter of the room. The SILENT EDGE should only be trimmed after the floor has been installed and grouted.

The skirting board must be installed after the SILENT EDGE has been cut, ensuring that it is always suitably raised from the floor.

IIC vs L_w

IIC stands for **Impact Insulation Class** and is the value obtained by subtracting the noise level measured in the receiving room from the noise level measured in the source room. Impact Insulation Class, sometimes referred to as Impact Isolation Class, measures the resistance of the floor construction assembly against the propagation of impact-generated noise.

I SILENT FLOOR PE

RESILIENT UNDERSCREED MEMBRANE MADE OF CLOSED CELL PE

CLOSED CELL

Thanks to the grid of closed cell polyethylene, the foil will not permanently deform and remains effective over time.

COST-PERFORMANCE

Composition of the mixture optimised to provide both good performance and low cost.

VERSATILE

This product is a versatile solution in any application where a light and flexible resilient product is required.

COMPOSITION

closed cell expanded polyethylene



CODES AND DIMENSIONS

CODE	H [m]	L [m]	thickness [mm]	A [m ²]	
SILFLOORPE6	1,55	50	5	77,5	4
SILFLOORPE10	1,30	50	10	65	2



SEVERAL USES

The format and composition offer various uses in the construction field, also as under floor.

STABLE

The grid of polyethylene foam is durable and does not suffer from issues associated with chemical actions or incompatibility of materials.

■ PRODUCT STRATIGRAPHY COMPARISON

thickness	dynamic stiffness	load	estimate ΔL_w							
			according to formula C.4 of EN ISO 12354-2							
5 mm	43 MN/m ³	125 kg/m ²	10	15	20	25	30	35	40	
		200 kg/m ²								24,9 dB
		250 kg/m ²								27,5 dB
10 mm	41 MN/m ³	125 kg/m ²								28,8 dB
		200 kg/m ²								25,2 dB
		250 kg/m ²								27,8 dB
										29,1 dB

SILFLOORPE6

TECHNICAL DATA

Properties	standard	value
Thickness	-	5 mm
Surface mass m	-	0,15 kg/m ²
Apparent dynamic stiffness s'	EN 29052-1	43 MN/m ³
Dynamic stiffness s'	EN 29052-1	43 MN/m ³
Theoretical estimate of impact sound pressure level attenuation ΔL _w ⁽¹⁾	ISO 12354-2	24,9 dB
System resonance frequency f ₀ ⁽²⁾	ISO 12354-2	93,8 Hz
Impact sound pressure level attenuation ΔL _w ⁽³⁾	ISO 10140-3	19 dB
Thermal resistance R _t	-	0,13 m ² K/W
Water vapour transmission S _d	-	24,1 m
Water vapour resistance factor μ	EN 12086	5000
Density ρ	-	30 kg/m ³
Resistance to airflow r	ISO 9053	> 100.0 kPa·s·m ⁻²
Thermal conductivity λ	-	0,038 W/m·K
VOC emission classification	French decree no. 2011-321	A+

(1) $\Delta L_w = (13 \lg(m')) - (14,2 \lg(s')) + 20,8$ [dB] with $m' = 125 \text{ kg/m}^2$.

(2) $f_0 = 160 \sqrt{(s'/m')}$ with $m' = 125 \text{ kg/m}^2$.

(3) Measured in the laboratory on 200 mm CLT floor. See the manual for more information on configuration.

EN ISO 12354-2 ANNEX C | ESTIMATE ΔL_w [formula C.4] E ΔL [formula C.1]

The following tables show how the attenuation in dB (ΔL_w e ΔL) of SILFLOORPE6 varies as the load m' (i.e., the surface mass of the layers with which SILFLOORPE6 is loaded) changes.

SILFLOORPE6

s' or s'	43	43	43	43	43	43	43	43	43	43	[MN/m ³]
load m'	50	75	100	125	150	175	200	225	250	275	[kg/m ²]
ΔL _w	19,7	22,0	23,6	24,9	25,9	26,8	27,5	28,2	28,8	29,3	29,8
f ₀	148,4	121,2	104,9	93,8	85,7	79,3	74,2	69,9	66,4	63,3	60,6

ΔL in frequency

[Hz]	100	-5,1	-2,5	-0,6	0,8	2,0	3,0	3,9	4,7	5,3	6,0	6,5
[Hz]	125	-2,2	0,4	2,3	3,7	4,9	5,9	6,8	7,6	8,3	8,9	9,4
[Hz]	160	1,0	3,6	5,5	7,0	8,1	9,1	10,0	10,8	11,5	12,1	12,7
[Hz]	200	3,9	6,5	8,4	9,9	11,0	12,1	12,9	13,7	14,4	15,0	15,6
[Hz]	250	6,8	9,4	11,3	12,8	14,0	15,0	15,8	16,6	17,3	17,9	18,5
[Hz]	315	9,8	12,4	14,3	15,8	17,0	18,0	18,8	19,6	20,3	20,9	21,5
[Hz]	400	12,9	15,6	17,4	18,9	20,1	21,1	22,0	22,7	23,4	24,0	24,6
[Hz]	500	15,8	18,5	20,3	21,8	23,0	24,0	24,9	25,6	26,3	26,9	27,5
[Hz]	630	18,8	21,5	23,4	24,8	26,0	27,0	27,9	28,6	29,3	29,9	30,5
[Hz]	800	22,0	24,6	26,5	27,9	29,1	30,1	31,0	31,7	32,4	33,1	33,6
[Hz]	1000	24,9	27,5	29,4	30,8	32,0	33,0	33,9	34,7	35,3	36,0	36,5
[Hz]	1250	27,8	30,4	32,3	33,7	34,9	35,9	36,8	37,6	38,3	38,9	39,4
[Hz]	1600	31,0	33,6	35,5	37,0	38,1	39,1	40,0	40,8	41,5	42,1	42,7
[Hz]	2000	33,9	36,5	38,4	39,9	41,0	42,1	42,9	43,7	44,4	45,0	45,6
[Hz]	2500	36,8	39,4	41,3	42,8	44,0	45,0	45,8	46,6	47,3	47,9	48,5
[Hz]	3150	39,8	42,4	44,3	45,8	47,0	48,0	48,8	49,6	50,3	50,9	51,5

EN ISO 12354-2 Allegato C - formula C.4

$$\square \quad \Delta L_w = \left(13 \lg(m') \right) - \left(14,2 \lg(s') \right) + 20,8 \text{ dB}$$

EN ISO 12354-2 Allegato C - formula C.1

$$\square \quad \Delta L = \left(30 \lg \frac{f}{f_0} \right) \text{dB}$$


EN ISO 12354-2 Allegato C - formula C.2

$$\square \quad f_0 = 160 \sqrt{\frac{s'}{m'}}$$

LABORATORY MEASUREMENT | CLT FLOOR 1

MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
REFERENCE STANDARD: ISO 10140-3 AND EN ISO 717-2

FLOOR SLAB

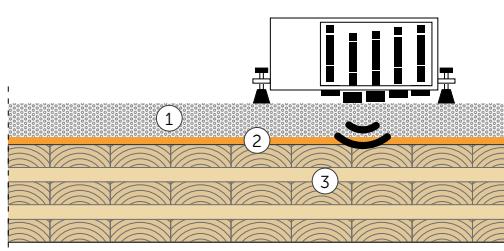

Surface = 13,71 m²

Surface mass = 214,2 kg/m²

Receiving room volume = 60,1 m³

(1) concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

(2) **SILENT FLOOR PE - SILFLOORPE5** (thickness: 5 mm); (30 kg/m³); (0,15 kg/m²)

(3) CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION



$$L_{n,w} (C_l) = \textcolor{orange}{67 \, (-3) \, dB}$$

$$IIC = \textcolor{orange}{43}$$

$$\Delta L_{n,w} = -19 \, dB^{(1)}$$

$$\Delta IIC = +19^{(2)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L7.

NOTES:

⁽¹⁾ Decrease due to the addition of layers no. 1 and no. 2.

⁽²⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | CLT FLOOR 1


MEASUREMENT OF THE EVALUATION INDEX OF THE REDUCTION OF THE IMPACT SOUND PRESSURE LEVEL
RUBBER BALL METHOD | REFERENCE STANDARD: ISO 16283-2

FLOOR SLAB

Surface = 13,71 m²

Surface mass = 214,2 kg/m²

Receiving room volume = 60,1 m³

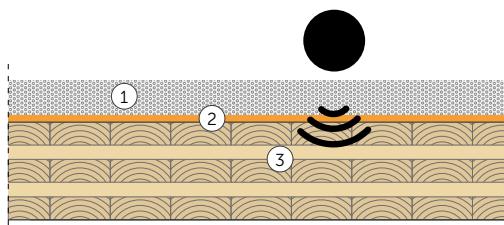


(1) concrete screed (thickness: 50 mm); (2600 kg/m³); (130 kg/m²)

(2) SILENT FLOOR PE - SILFLOORPE5 (thickness: 5 mm); (30 kg/m³); (0,15 kg/m²)

(3) CLT 5 layers (thickness: 200 mm); (420 kg/m³); (84 kg/m²)

IMPACT SOUND INSULATION

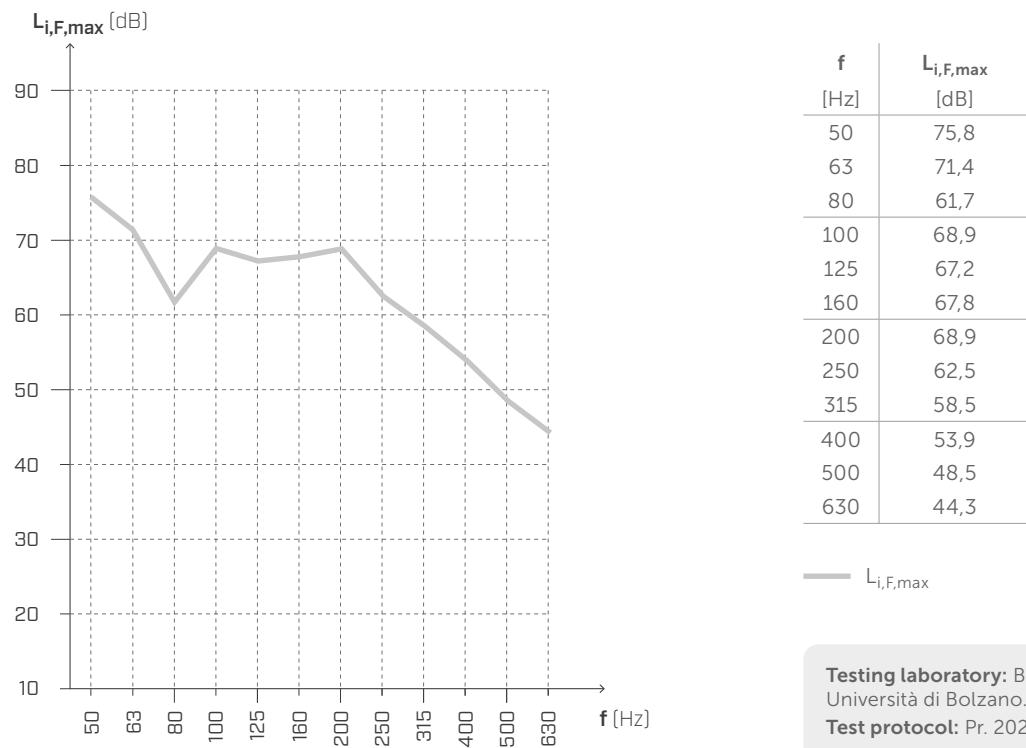

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr. 2022-rothoLATE-L7.

SILFLOORPE10

TECHNICAL DATA

Properties	standard	value
Thickness	-	10 mm
Surface mass m	-	0,30 kg/m ²
Apparent dynamic stiffness s' _t	EN 29052-1	41 MN/m ³
Dynamic stiffness s'	EN 29052-1	41 MN/m ³
Theoretical estimate of impact sound pressure level attenuation ΔL _w ⁽¹⁾	ISO 12354-2	25,2 dB
System resonance frequency f ₀ ⁽²⁾	ISO 12354-2	91,6 Hz
Impact sound pressure level attenuation ΔL _w ⁽³⁾	ISO 10140-3	-
Thermal resistance R _t	-	0,26 m ² K/W
Water vapour transmission S _d	-	48,2 m
Water vapour resistance factor μ	EN 12086	5000
Density ρ	-	30 kg/m ³
Resistance to airflow r	ISO 9053	> 100.0 kPa·s·m ⁻²
Thermal conductivity λ	-	0,038 W/m·K
VOC emission classification	French decree no. 2011-321	A+

(1) $\Delta L_w = (13 \lg(m')) - (14,2 \lg(s')) + 20,8$ [dB] with $m' = 125 \text{ kg/m}^2$.

(2) $f_0 = 160 \sqrt{s'/m'}$ with $m' = 125 \text{ kg/m}^2$.

(3) Measured in the laboratory on 200 mm CLT floor. See the manual for more information on configuration.

EN ISO 12354-2 ANNEX C | ESTIMATE ΔL_w [formula C.4] E ΔL [formula C.1]

The following tables show how the attenuation in dB (ΔL_w e ΔL) of SILFLOORPE10 varies as the load m' (i.e., the surface mass of the layers with which SILFLOORPE10 is loaded) changes.

SILFLOORPE10

s't or s'	41	41	41	41	41	41	41	41	41	41	[MN/m ³]
load m'	50	75	100	125	150	175	200	225	250	275	[kg/m ²]
ΔL _w	20,0	22,3	23,9	25,2	26,2	27,1	27,8	28,5	29,1	29,6	[dB]
f ₀	144,9	118,3	102,4	91,6	83,7	77,4	72,4	68,3	64,8	61,8	[Hz]

ΔL in frequency												[dB]	
[Hz]	100	-4,8	-2,2	-0,3	1,1	2,3	3,3	4,2	5,0	5,7	6,3	6,8	[dB]
[Hz]	125	-1,9	0,7	2,6	4,0	5,2	6,2	7,1	7,9	8,6	9,2	9,7	[dB]
[Hz]	160	1,3	3,9	5,8	7,3	8,4	9,5	10,3	11,1	11,8	12,4	13,0	[dB]
[Hz]	200	4,2	6,8	8,7	10,2	11,4	12,4	13,2	14,0	14,7	15,3	15,9	[dB]
[Hz]	250	7,1	9,7	11,6	13,1	14,3	15,3	16,1	16,9	17,6	18,2	18,8	[dB]
[Hz]	315	10,1	12,8	14,6	16,1	17,3	18,3	19,1	19,9	20,6	21,2	21,8	[dB]
[Hz]	400	13,2	15,9	17,7	19,2	20,4	21,4	22,3	23,0	23,7	24,3	24,9	[dB]
[Hz]	500	16,1	18,8	20,7	22,1	23,3	24,3	25,2	25,9	26,6	27,2	27,8	[dB]
[Hz]	630	19,1	21,8	23,7	25,1	26,3	27,3	28,2	28,9	29,6	30,3	30,8	[dB]
[Hz]	800	22,3	24,9	26,8	28,2	29,4	30,4	31,3	32,1	32,7	33,4	33,9	[dB]
[Hz]	1000	25,2	27,8	29,7	31,1	32,3	33,3	34,2	35,0	35,7	36,3	36,8	[dB]
[Hz]	1250	28,1	30,7	32,6	34,0	35,2	36,2	37,1	37,9	38,6	39,2	39,7	[dB]
[Hz]	1600	31,3	33,9	35,8	37,3	38,4	39,5	40,3	41,1	41,8	42,4	43,0	[dB]
[Hz]	2000	34,2	36,8	38,7	40,2	41,4	42,4	43,2	44,0	44,7	45,3	45,9	[dB]
[Hz]	2500	37,1	39,7	41,6	43,1	44,3	45,3	46,1	46,9	47,6	48,2	48,8	[dB]
[Hz]	3150	40,1	42,8	44,6	46,1	47,3	48,3	49,1	49,9	50,6	51,2	51,8	[dB]

EN ISO 12354-2 Allegato C - formula C.4

$$\square \quad \Delta L_w = \left(13 \lg(m') \right) - \left(14,2 \lg(s') \right) + 20,8 \text{ dB}$$

EN ISO 12354-2 Allegato C - formula C.1

$$\square \quad \Delta L = \left(30 \lg \frac{f}{f_0} \right) \text{ dB}$$

EN ISO 12354-2 Allegato C - formula C.2

$$\square \quad f_0 = 160 \sqrt{\frac{s'}{m'}}$$

|SILENT WALL BYTUM

TECHNICAL MANUAL



Solutions for Building Technology

CONTENTS

WALL ACOUSTIC PROBLEMS	218
SILENT WALL BYTUM	220
LABORATORY MEASUREMENT FRAME WALL 1A	222
LABORATORY MEASUREMENT FRAME WALL 1B	223
LABORATORY MEASUREMENT FRAME WALL 2A	224
LABORATORY MEASUREMENT FRAME WALL 2B	225
LABORATORY MEASUREMENT FRAME WALL 3A	226
LABORATORY MEASUREMENT FRAME WALL 3B	227
LABORATORY MEASUREMENT FRAME WALL 4A	228

I WALL ACOUSTIC PROBLEMS




WHAT IS AIRBORNE NOISE?


Airborne noise is a set of sound waves that originates in the air and is then transmitted into adjacent rooms either by air or by structure. This is the main problem to be solved when designing vertical partitions in buildings.

■ AIRBORNE NOISE TRANSMISSION AND POSSIBLE SOLUTIONS

The purpose of soundproofing measures is to minimise the transmission of sound from one room to another.

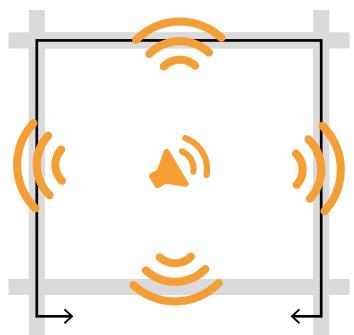

Airborne noise is transmitted to adjacent rooms either by air or by structure, following the paths represented by the arrows (lateral transmission).

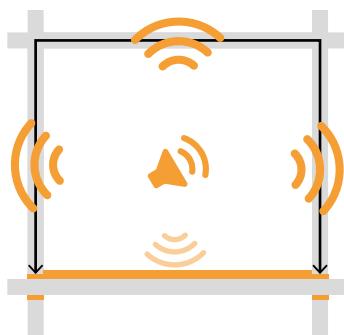

The floor assembly reduces noise propagation through the ceiling. The use of resilient decoupling profiles reduces the propagation of airborne and structural noise.




The correct design of partition walls and of any false ceilings makes it possible to attenuate all types of noise propagation by preventing the transmission of airborne noise generated in the environment.

■ HOW DO YOU MEASURE SOUND REDUCTION?




The measurement is performed by activating a specific noise source in the emitting environment and measuring the sound pressure levels in both environments (emitter and receiver). The sound reduction is given by the difference of the two measured levels. Therefore, the higher the R_w value, the better the acoustic performance of the construction assembly.


SOUNDPROOFING POWER... WHAT DOES IT MEAN "IN PRACTICE"?



Sound reduction is the ability to reduce noise transmission between one room and another. Sound insulation allows noise thresholds to be controlled and makes the building pleasant and comfortable.

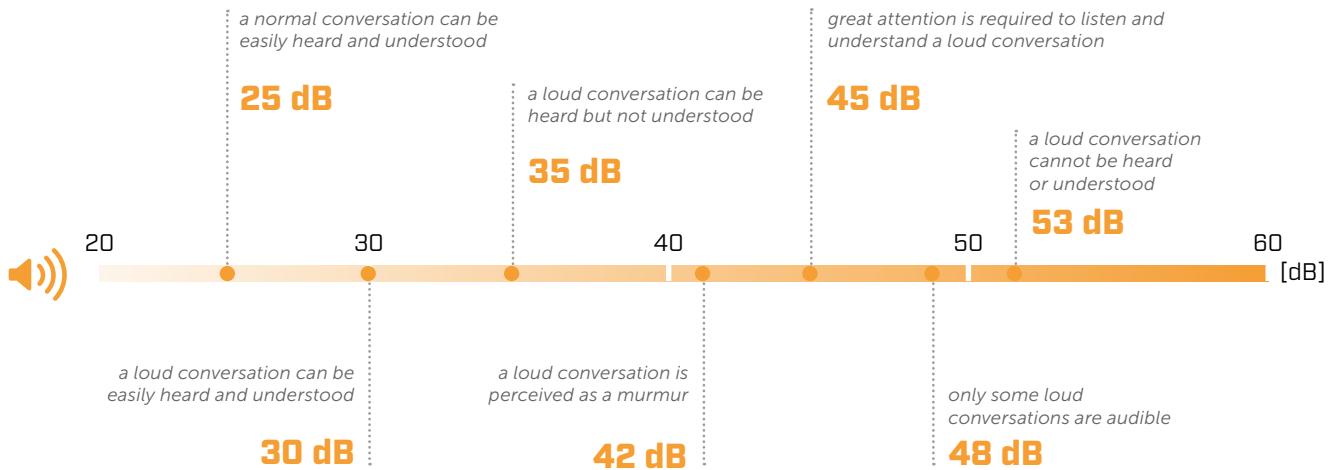


SOUND REDUCTION R VS APPARENT SOUND REDUCTION R'

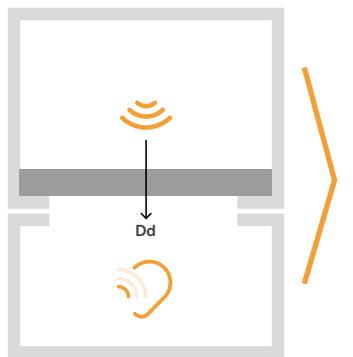

R

Soundproofing power (R) is the performance of a partition **measured in a test laboratory**

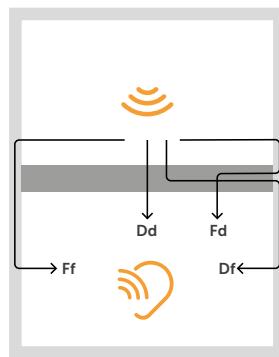

R'

The apparent sound reduction (R'), on the other hand, indicates the performance **measured on site**

The acoustic laboratories are constructed in such a way that the chambers are completely decoupled from each other, so that lateral transmissions are completely eliminated. **For the same construction assembly and installation, the performance measured in the laboratory will therefore be better than the performance measured on site.**

IMPORTANCE OF DETAILS

In acoustic design, as in other fields, the design and correct implementation of details is very important. It is counter productive to design a high-performing construction assembly if discontinuities are neglected (holes, structure-to-doors/windows connection, wall intersections, etc.).

Best practice that: **to increase the sound reduction of a wall constructed of several elements, the sound reduction of the weakest element should be increased.**



R_w vs STC

STC stands for Sound Transmission Classification. It indicates the sound reduction of a construction assembly by evaluating sound sources with frequencies between 125 and 4000 Hz. The higher the number, the better the performance.

SILENT WALL BYTUM

SOUNDPROOFING AND WATERPROOFING BITUMINOUS MEMBRANE

TESTED

Thanks to its high surface mass (6 kg/m^2), excellent reduction of airborne noise transmission can be achieved with minimal thicknesses. Also tested at the University of Bolzano.

PRACTICAL

Mechanical fastening allows the membrane to be applied to any surface, compensating for irregularities.

COST-PERFORMANCE


Composition of the mixture optimised to provide both good performance and low cost.

COMPOSITION

non-woven polypropylene fabric

waterproofing membrane made of elastoplastomeric bitumen

non-woven polypropylene fabric

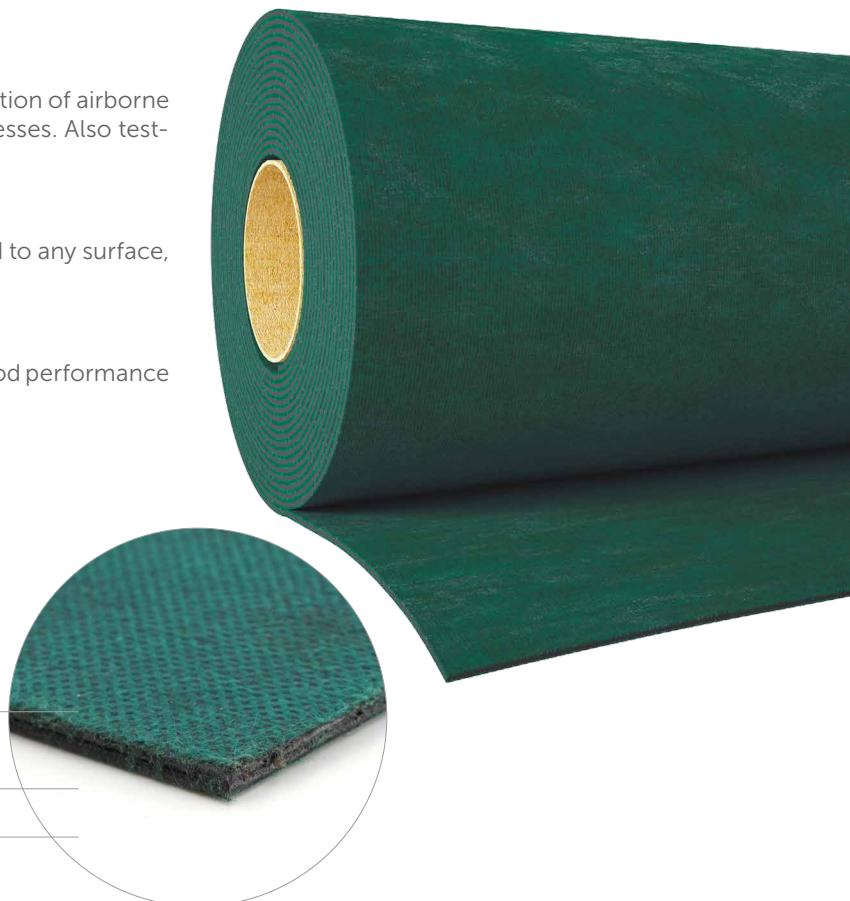

CODES AND DIMENSIONS

CODE	H [m]	L [m]	thickness [mm]	surface mass [kg/m ²]	A [m ²]	
SILWALL	1,2	5	4,2	6	6	30



VERSATILE

For any application where an increase in mass is required.

SAFE

Made of elastoplastomeric bitumen, covered on both sides with a polypropylene non-woven fabric. Does not contain harmful substances.

TECHNICAL DATA

Properties	standard	value
Thickness	-	4,2 mm
Surface mass m	-	6 kg/m ²
Density ρ	-	1500 kg/m ³
Resistance to airflow r	ISO 9053	> 100 kPa·s·m ⁻²
Compressibility class	EN 12431	class CP2
CREEP viscous sliding under compression (1.6 kPa)	EN 1606	0,5 %
Increase of sound reduction ΔR _w ⁽¹⁾	ISO 10140-2	4 dB
Vibration damping - loss factor η (200 Hz)	ASTM E756	0,25
Thermal resistance R _t	-	0,1 m ² K/W
Thermal conductivity λ	-	0,7 W/m·K
Specific heat c	-	900 J/kg·K
Water vapour resistance factor μ	EN 12086	20000
Water vapour transmission S _d	-	80 m
Reaction to fire	EN 13501-1	class E

⁽¹⁾Measured in the laboratory on a 170 mm timber-framed wall. See the manual for more information on configuration.

WALL ASSEMBLIES

THIN ACOUSTIC UPGRADES

Bonded coating is a commonly used method for acoustic upgrades because it allows, in just a few centimetres of thickness, a significant improvement in the sound rating of the partition.

Add mass by coupling **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA** to the plasterboard sheet



FLOORS ASSEMBLIES

ACOUSTIC UPGRADES FROM ABOVE

Cover the underside of the floor by applying a resilient layer **PIANO A**, **SILENT UNDERFLOOR**, **GEMINI**, **GIPS BAND**, **CONSTRUCTION SEALING** to the joists and by adding mass to the plasterboard sheet with **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA**



Values obtained through calculations from experimental data.

INSTALLATIONS


Solutions vary depending on the type of construction and acoustic requirements.

Create a mechanical, electrical, plumbing (MEP) enclosure and use **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA** to improve its sound reduction



LABORATORY MEASUREMENT | FRAME WALL 1A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

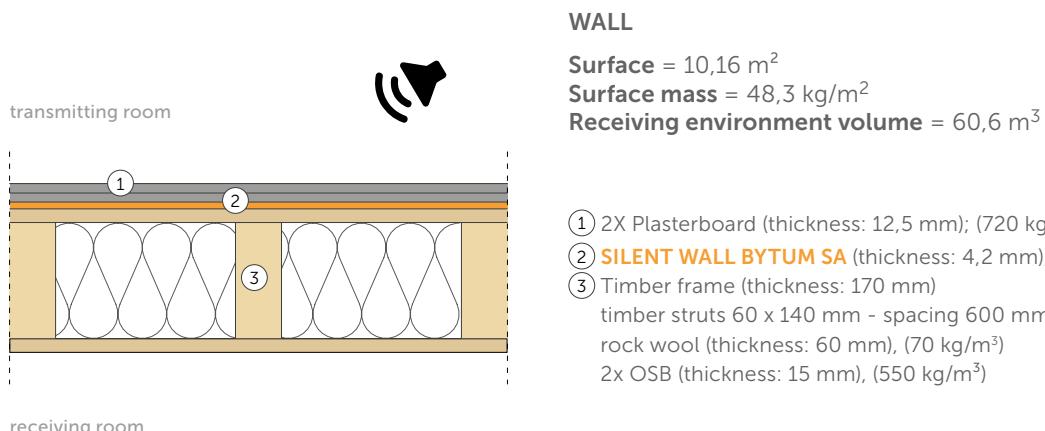

AIRBORNE SOUND INSULATION



$$R_w(C, C_{tr}) = \mathbf{49} \text{ (-3;-8) dB}$$

$$\Delta R_w = +8 \text{ dB}^{(1)}$$

$$STC = \mathbf{49}$$

$$\Delta STC = +8^{(1)}$$


Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R3a

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 1B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

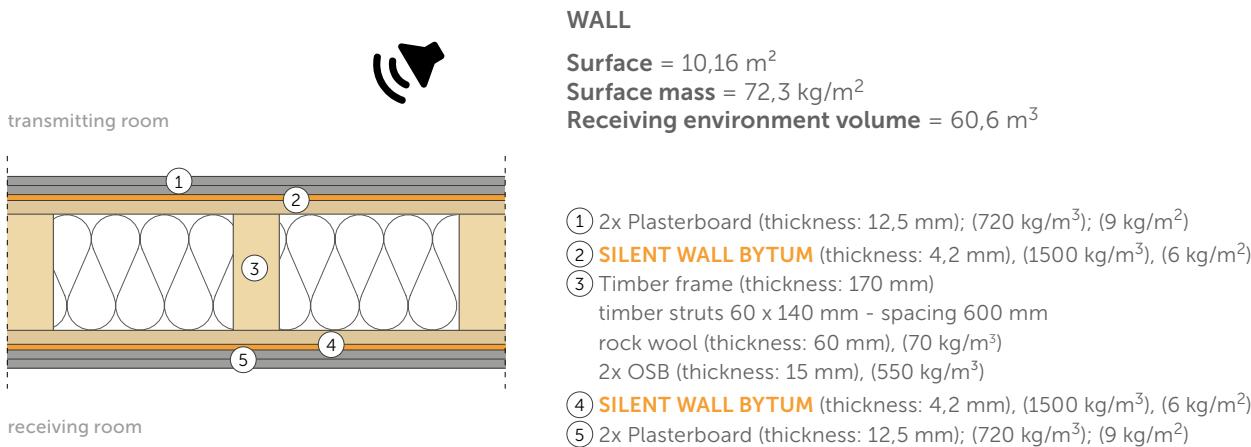

AIRBORNE SOUND INSULATION

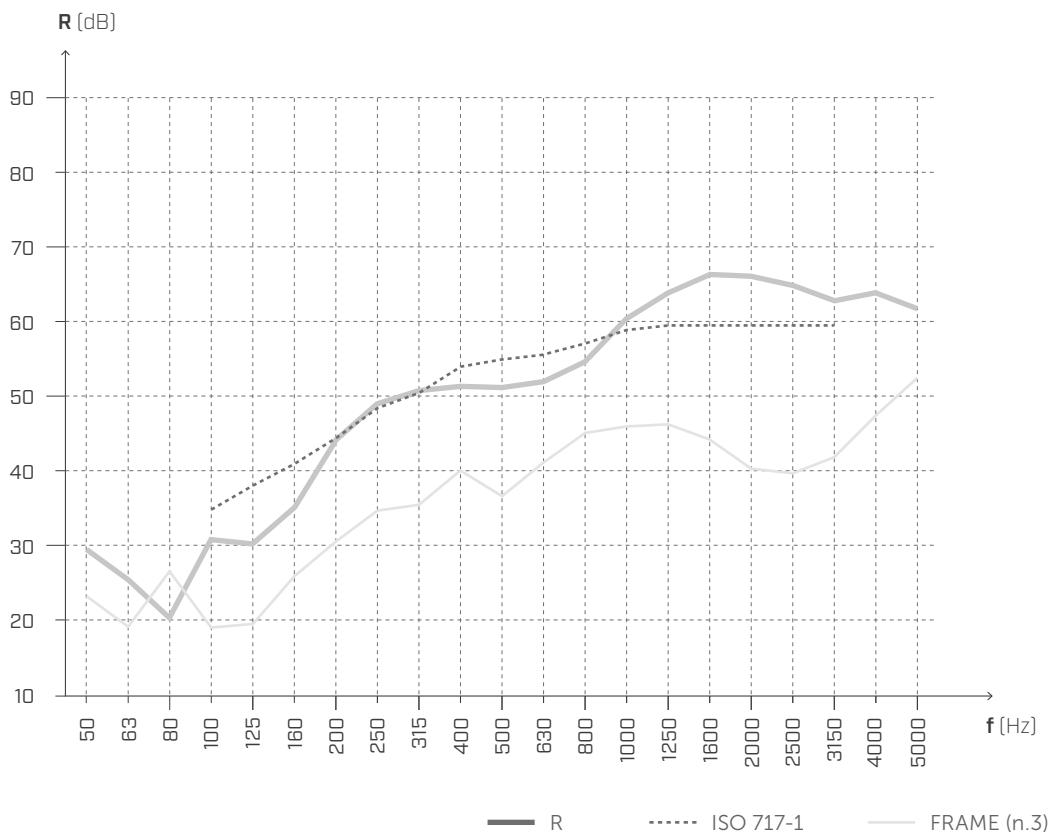

$$R_w(C; C_{tr}) = \textcolor{orange}{55 \ (-3;-9) \ dB}$$

$$\Delta R_w = +14 \ dB^{(1)}$$

$$STC = \textcolor{orange}{54}$$

$$\Delta STC = +13^{(1)}$$


Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R3b

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,4 and no. 5.

LABORATORY MEASUREMENT | FRAME WALL 2A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

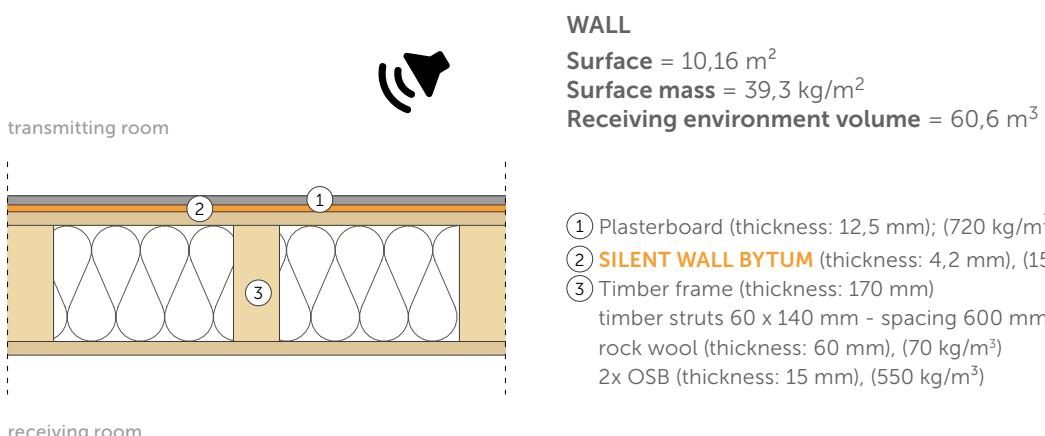

AIRBORNE SOUND INSULATION

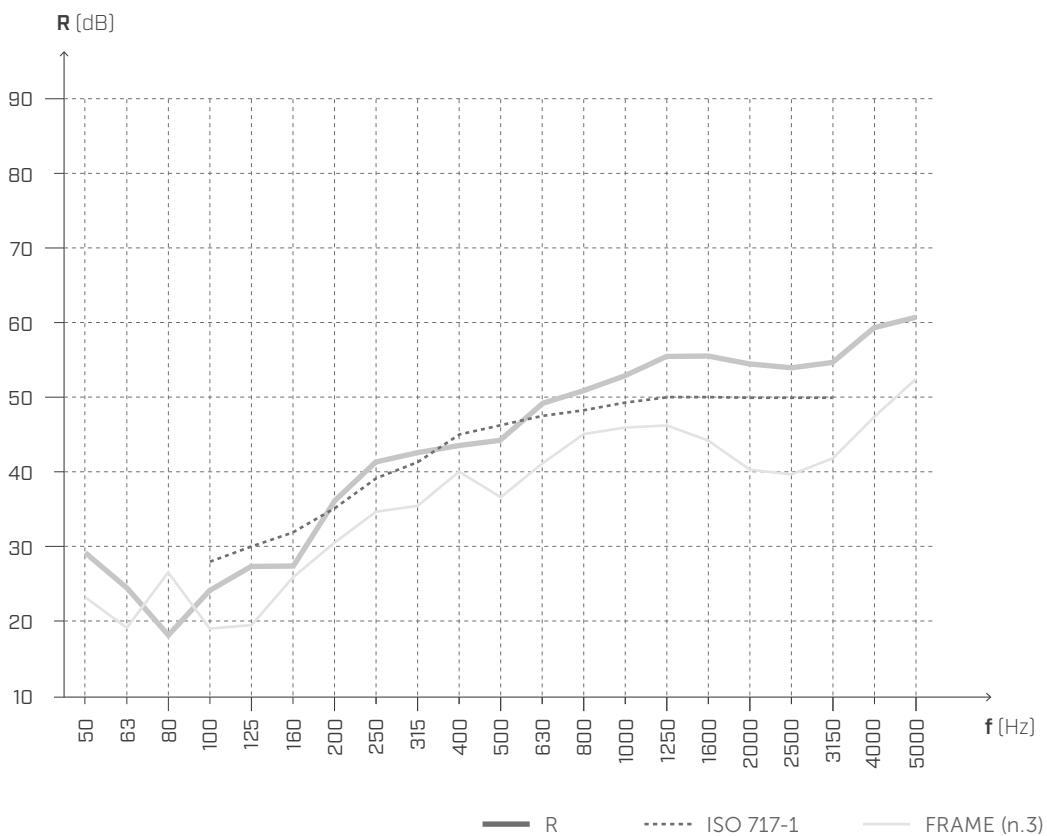

$$R_w(C; C_{tr}) = \mathbf{48} \text{ (-3;-8) dB}$$

$$\Delta R_w = +7 \text{ dB}^{(1)}$$

$$STC = \mathbf{48}$$

$$\Delta STC = +7^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R4a

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 2B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

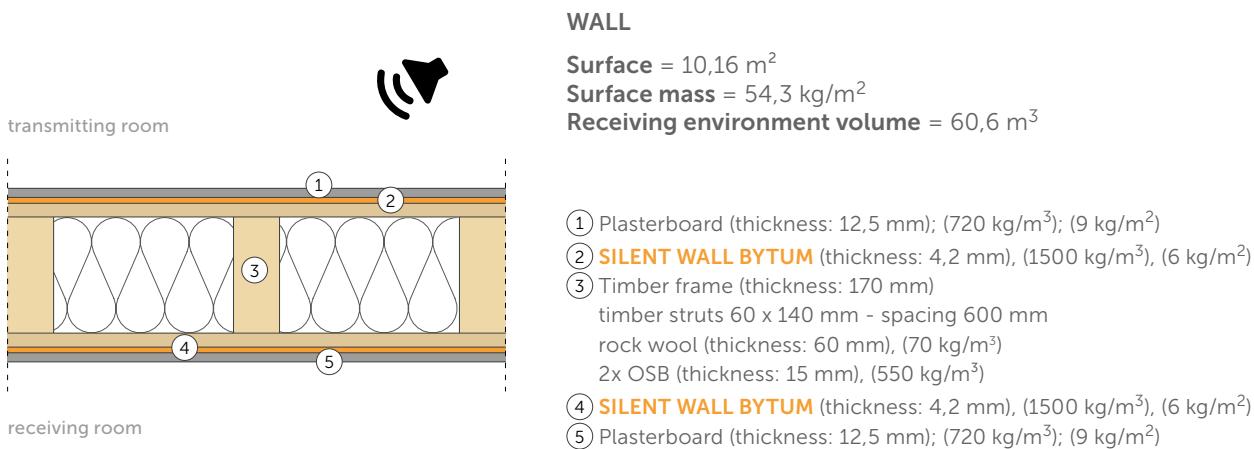

AIRBORNE SOUND INSULATION

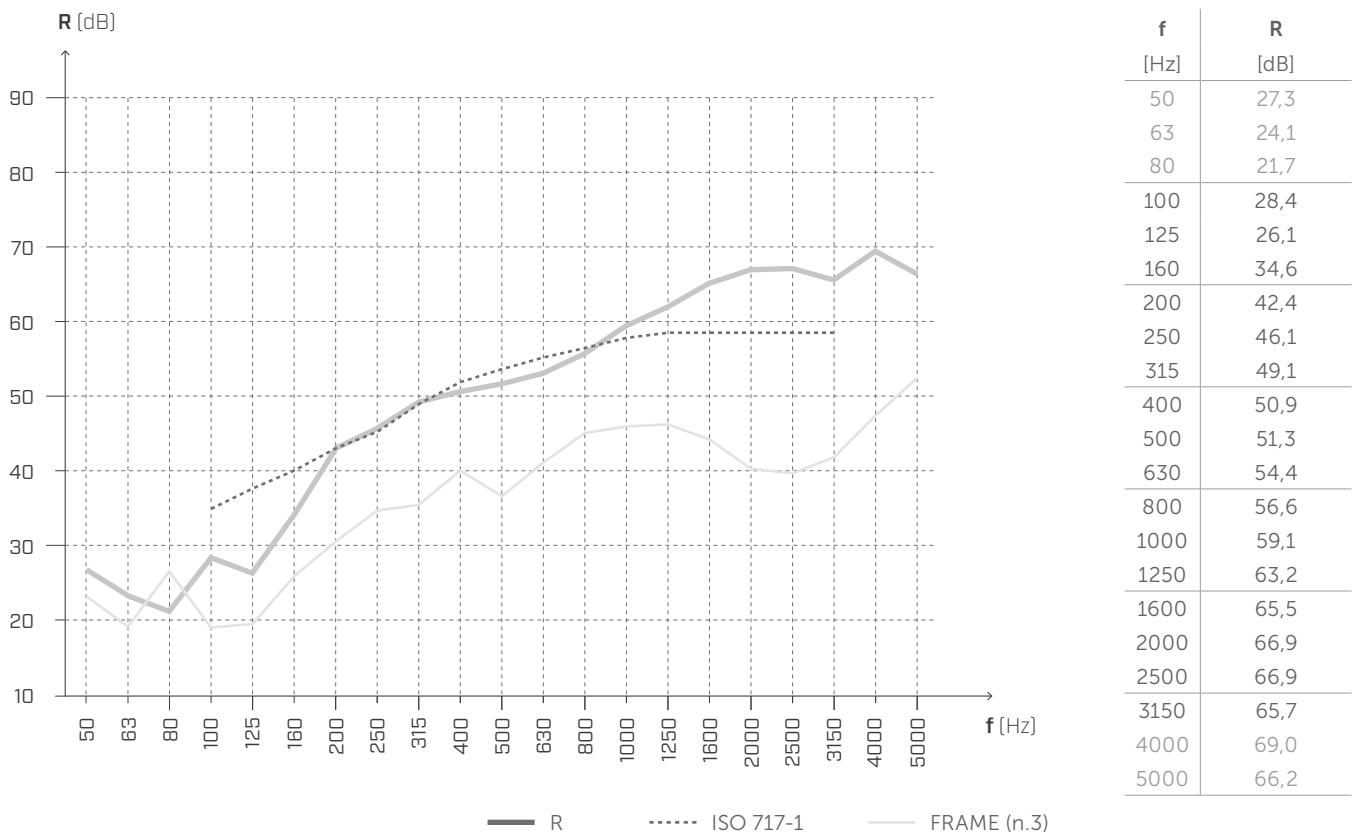

$$R_w(C, C_{tr}) = 53 \text{ (-4; -10) dB}$$

$$\Delta R_w = +12 \text{ dB}^{(1)}$$

$$STC = 50$$

$$\Delta STC = +9^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R4b

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,4 and no. 5.

LABORATORY MEASUREMENT | FRAME WALL 3A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

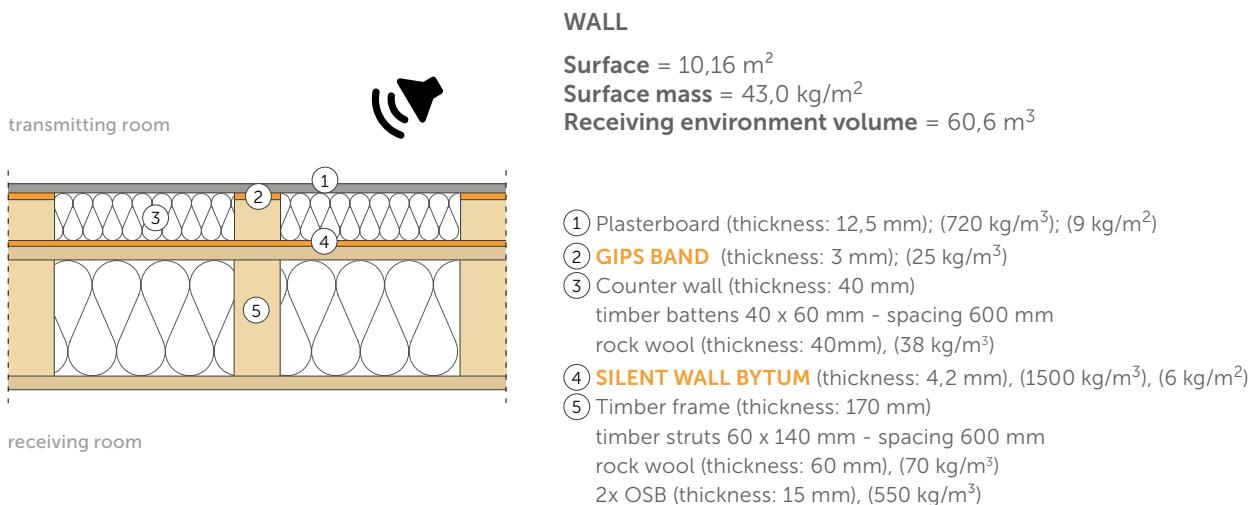

AIRBORNE SOUND INSULATION

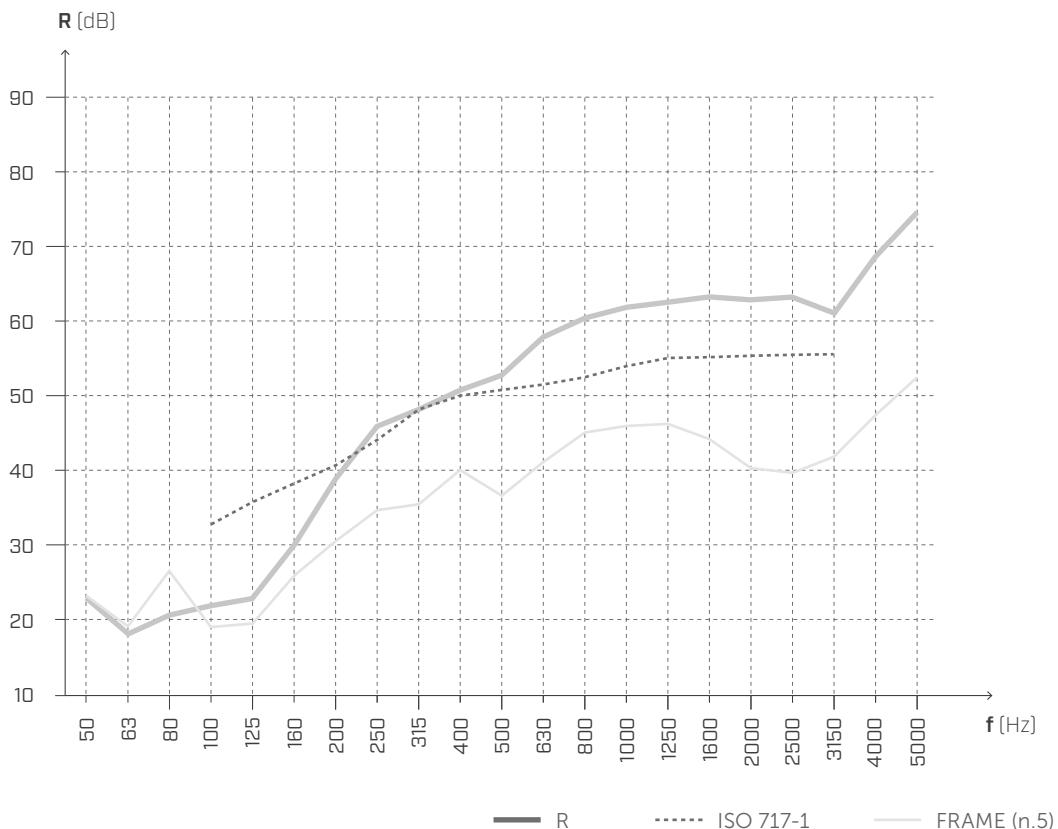

$$R_w(C, C_{tr}) = 51 \text{ (-5;-12) dB}$$

$$\Delta R_w = +10 \text{ dB}^{(1)}$$

$$STC = 47$$

$$\Delta STC = +6^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R11a

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,3 and no. 4.

LABORATORY MEASUREMENT | FRAME WALL 3B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

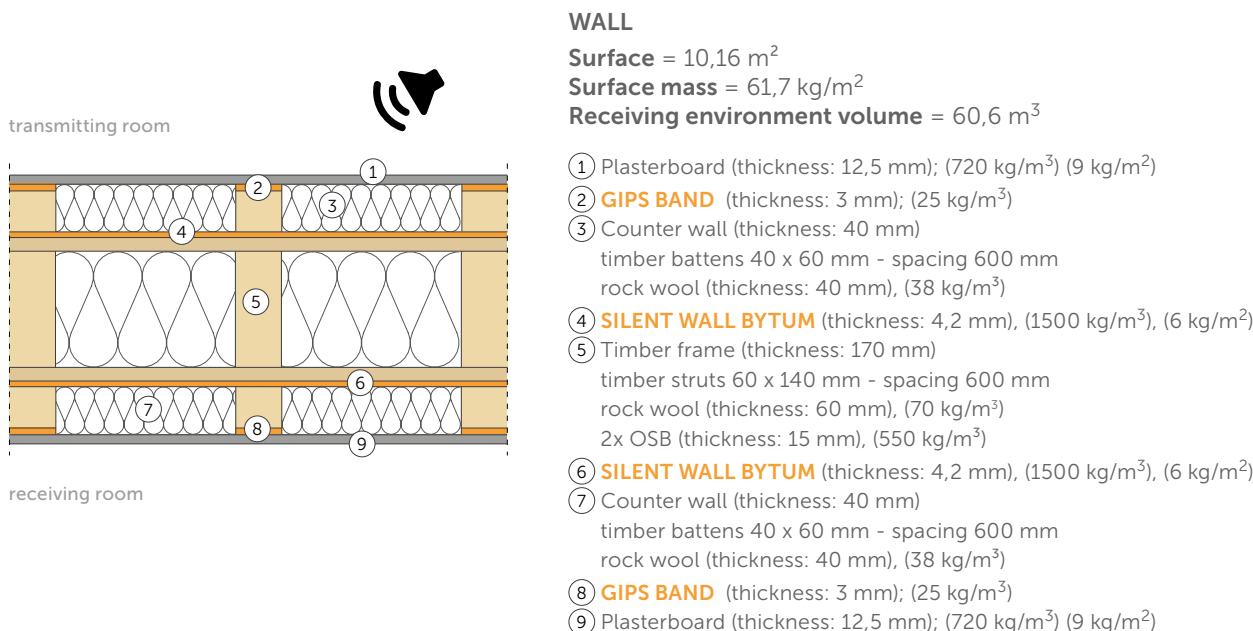

AIRBORNE SOUND INSULATION

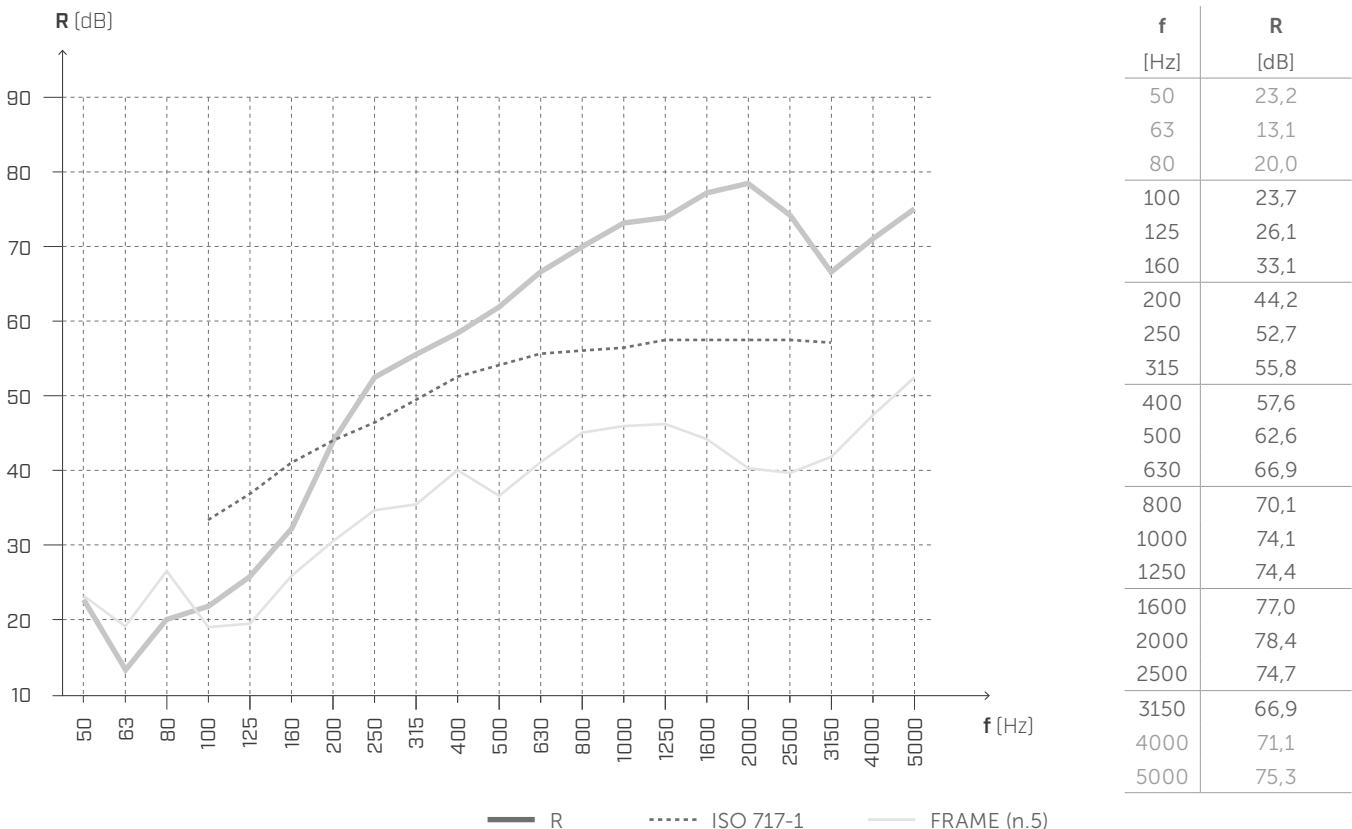

$$R_w(C,C_{tr}) = 54 \text{ (-6;-13) dB}$$

$$\Delta R_w = +16 \text{ dB}^{(1)}$$

$$STC = 50$$

$$\Delta STC = +9^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R11b

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,3,4,6,7,8 and no. 9.

LABORATORY MEASUREMENT | FRAME WALL 4A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

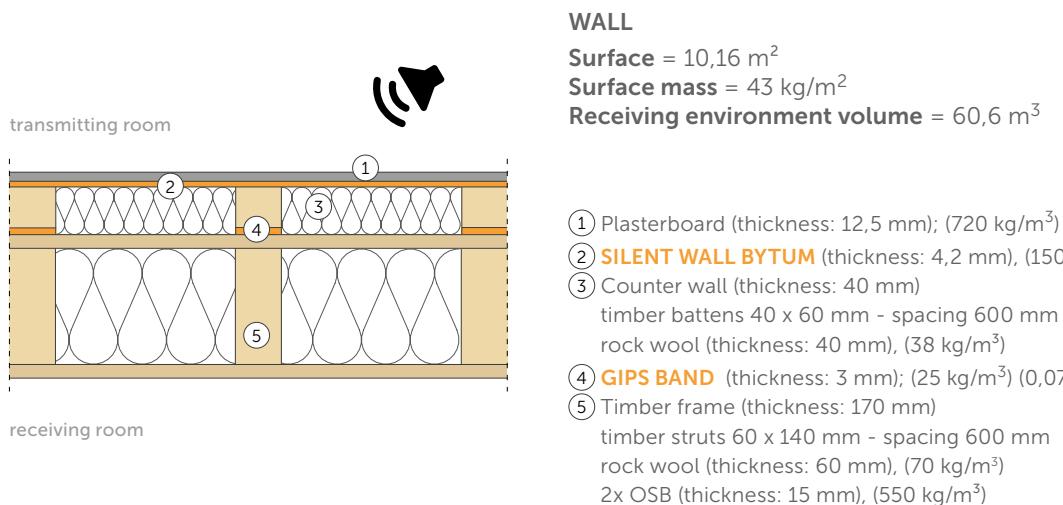

AIRBORNE SOUND INSULATION

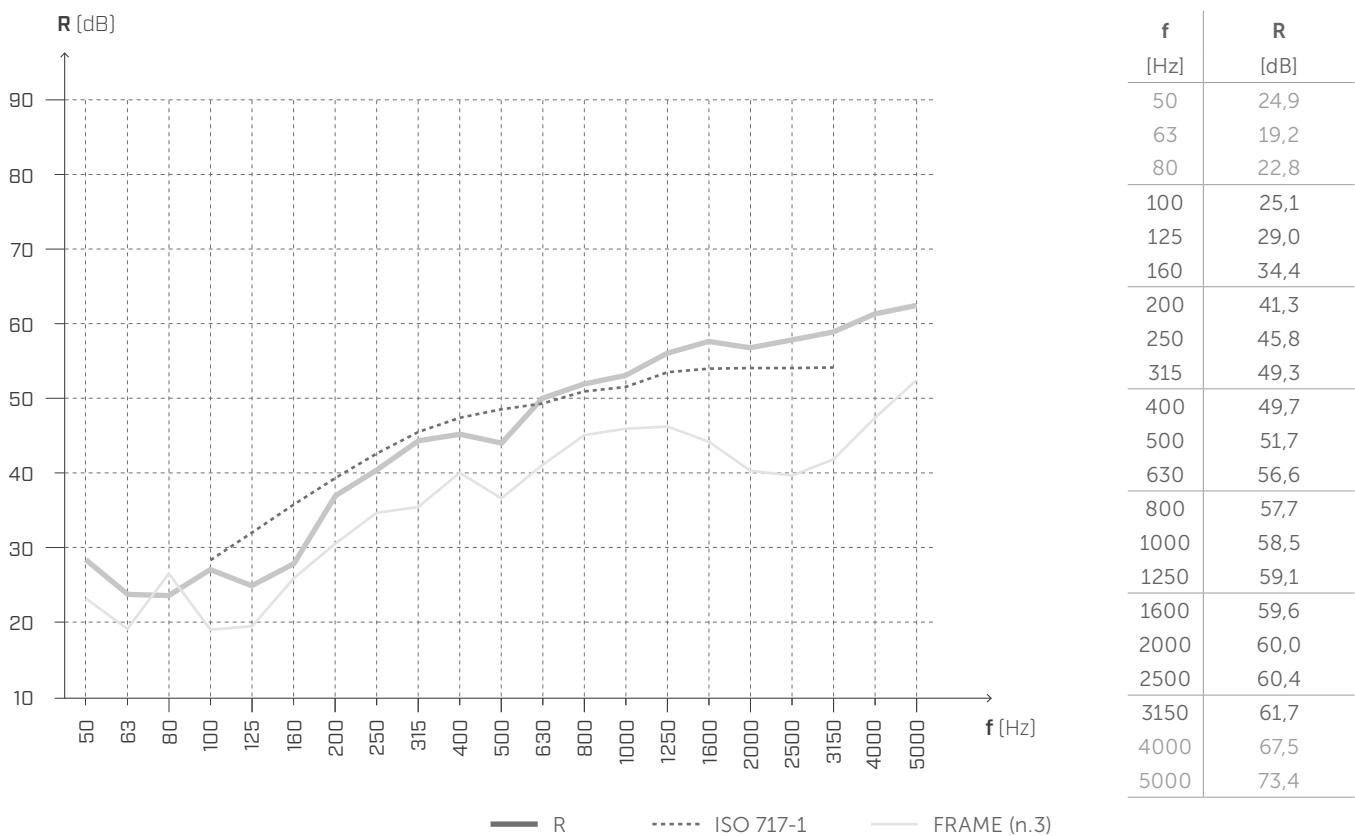

$$R_w(C, C_{tr}) = 53 \text{ (-4; -10) dB}$$

$$\Delta R_w = +12 \text{ dB}^{(1)}$$

$$STC = 53$$

$$\Delta STC = +12 \text{ dB}^{(1)}$$


Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R9a

NOTES :

⁽¹⁾ Increase due to the addition of layers no. 1,2,3 and no. 4.

|SILENT WALL BYTUM SA

TECHNICAL MANUAL

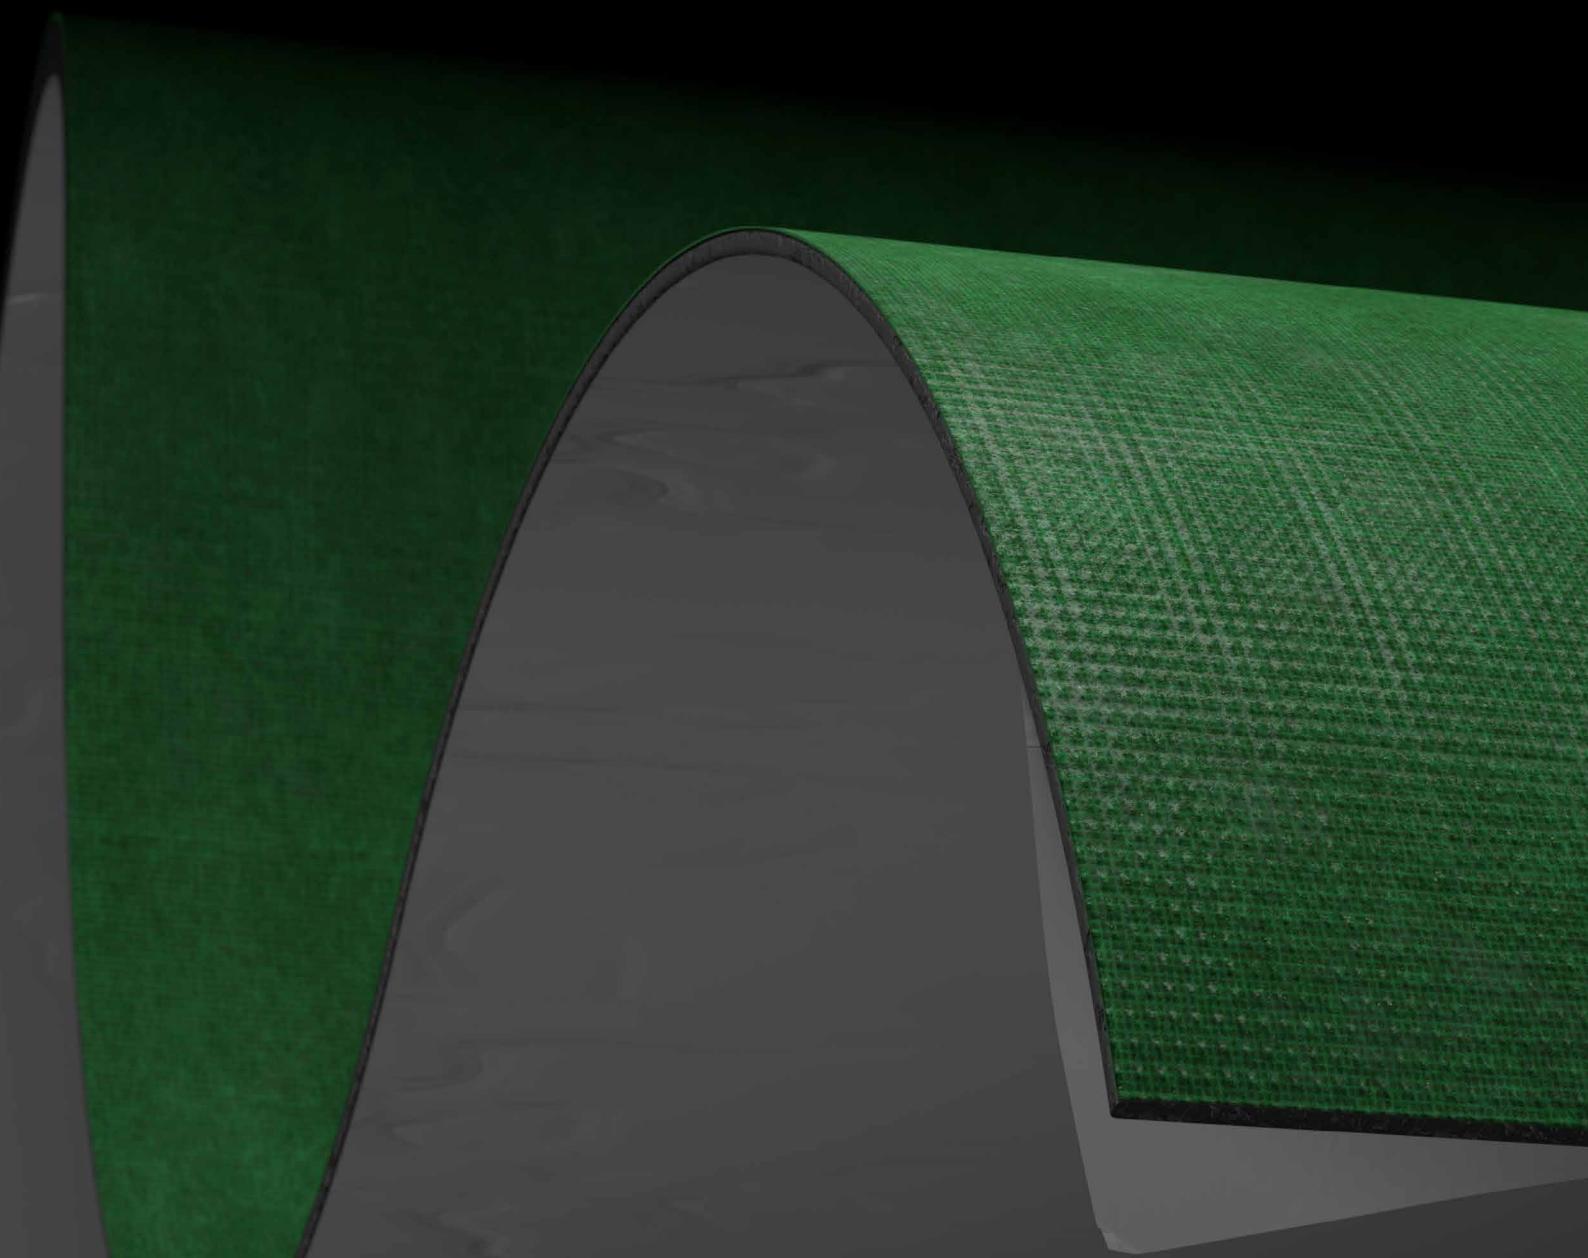

 **rothoblaas**

Solutions for Building Technology

CONTENTS

WALL ACOUSTIC PROBLEMS	233
SILENT WALL BYTUM SA	235
LABORATORY MEASUREMENT CLT WALL 1	237
LABORATORY MEASUREMENT CLT WALL 2	238
LABORATORY MEASUREMENT FRAME WALL 1A	239
LABORATORY MEASUREMENT FRAME WALL 1B	240
LABORATORY MEASUREMENT FRAME WALL 2A	241
LABORATORY MEASUREMENT FRAME WALL 2B	242
LABORATORY MEASUREMENT FRAME WALL 3	243
LABORATORY MEASUREMENT FRAME WALL 4	244
LABORATORY MEASUREMENT FRAME WALL 5	245

I WALL ACOUSTIC PROBLEMS




WHAT IS AIRBORNE NOISE?


Airborne noise is a set of sound waves that originates in the air and is then transmitted into adjacent rooms either by air or by structure. This is the main problem to be solved when designing vertical partitions in buildings.

■ AIRBORNE NOISE TRANSMISSION AND POSSIBLE SOLUTIONS

The purpose of soundproofing measures is to minimise the transmission of sound from one room to another.

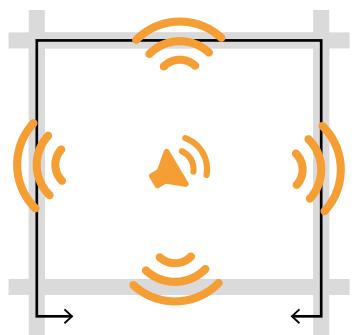

Airborne noise is transmitted to adjacent rooms either by air or by structure, following the paths represented by the arrows (lateral transmission).

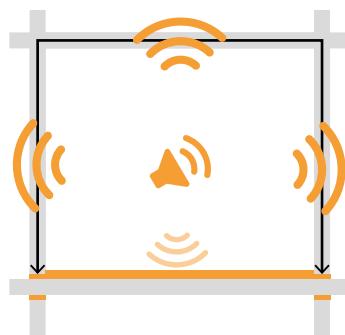

The floor assembly reduces noise propagation through the ceiling. The use of resilient decoupling profiles reduces the propagation of airborne and structural noise.




The correct design of partition walls and of any false ceilings makes it possible to attenuate all types of noise propagation by preventing the transmission of airborne noise generated in the environment.

■ HOW DO YOU MEASURE SOUND REDUCTION?




The measurement is performed by activating a specific noise source in the emitting environment and measuring the sound pressure levels in both environments (emitter and receiver). The sound reduction is given by the difference of the two measured levels. Therefore, the higher the R_w value, the better the acoustic performance of the construction assembly.


SOUNDPROOFING POWER... WHAT DOES IT MEAN "IN PRACTICE"?



Sound reduction is the ability to reduce noise transmission between one room and another. Sound insulation allows noise thresholds to be controlled and makes the building pleasant and comfortable.

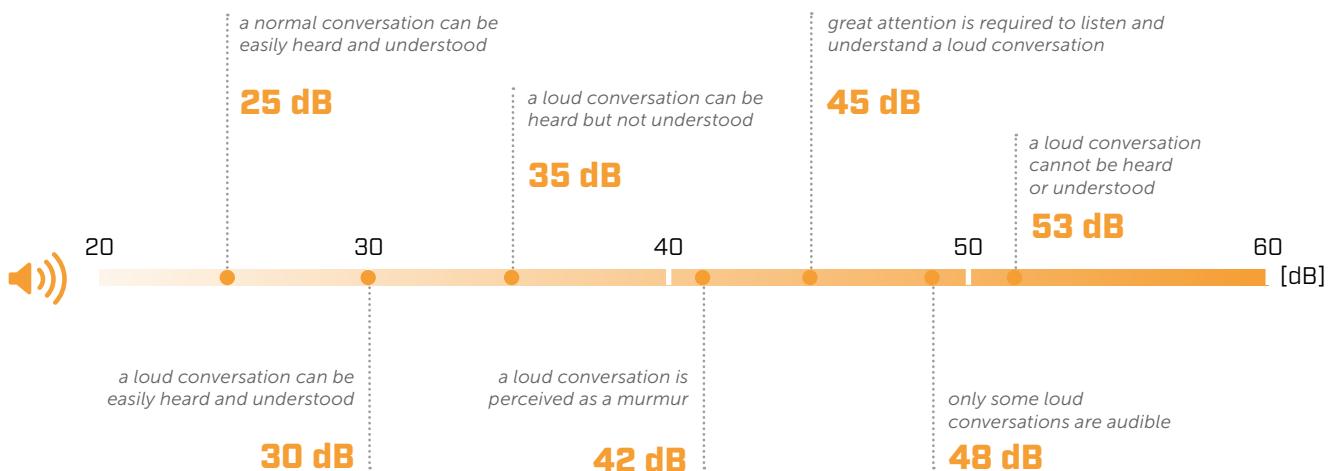


SOUND REDUCTION R VS APPARENT SOUND REDUCTION R'

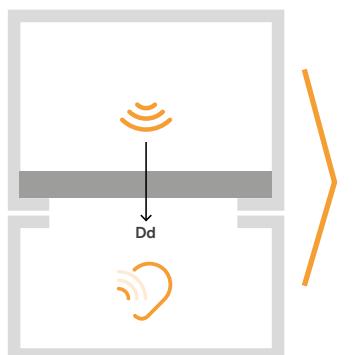

R

Soundproofing power (R) is the performance of a partition **measured in a test laboratory**

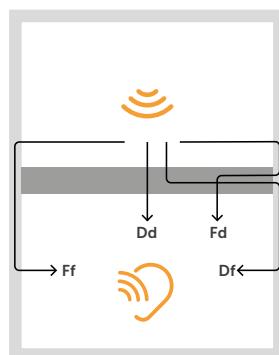

R'

The apparent sound reduction (R'), on the other hand, indicates the performance **measured on site**

The acoustic laboratories are constructed in such a way that the chambers are completely decoupled from each other, so that lateral transmissions are completely eliminated. **For the same construction assembly and installation, the performance measured in the laboratory will therefore be better than the performance measured on site.**

IMPORTANCE OF DETAILS

In acoustic design, as in other fields, the design and correct implementation of details is very important. It is counter productive to design a high-performing construction assembly if discontinuities are neglected (holes, structure-to-doors/windows connection, wall intersections, etc.).

Best practice that: **to increase the sound reduction of a wall constructed of several elements, the sound reduction of the weakest element should be increased.**



R_w vs STC

STC stands for Sound Transmission Classification. It indicates the sound reduction of a construction assembly by evaluating sound sources with frequencies between 125 and 4000 Hz. The higher the number, the better the performance.

SILENT WALL BYTUM SA

SOUNDPROOFING AND WATERPROOFING SELF-ADHESIVE BITUMINOUS MEMBRANE

NOISE REDUCTION

Due to its high surface mass (5 kg/m²), the membrane absorbs up to 27 dB. Also tested in different configurations at the University of Bolzano.

SELF-ADHESIVE


Thanks to its self-adhesive side, installation of the membrane is fast and precise in both horizontal and vertical applications and without mechanical fastening.

PRACTICAL

The pre-cut removable film makes the sound-insulating membrane easier to install.


COMPOSITION

non-woven polypropylene fabric
waterproofing membrane
made of elastoplastic bitumen
adhesive
removable silicone film

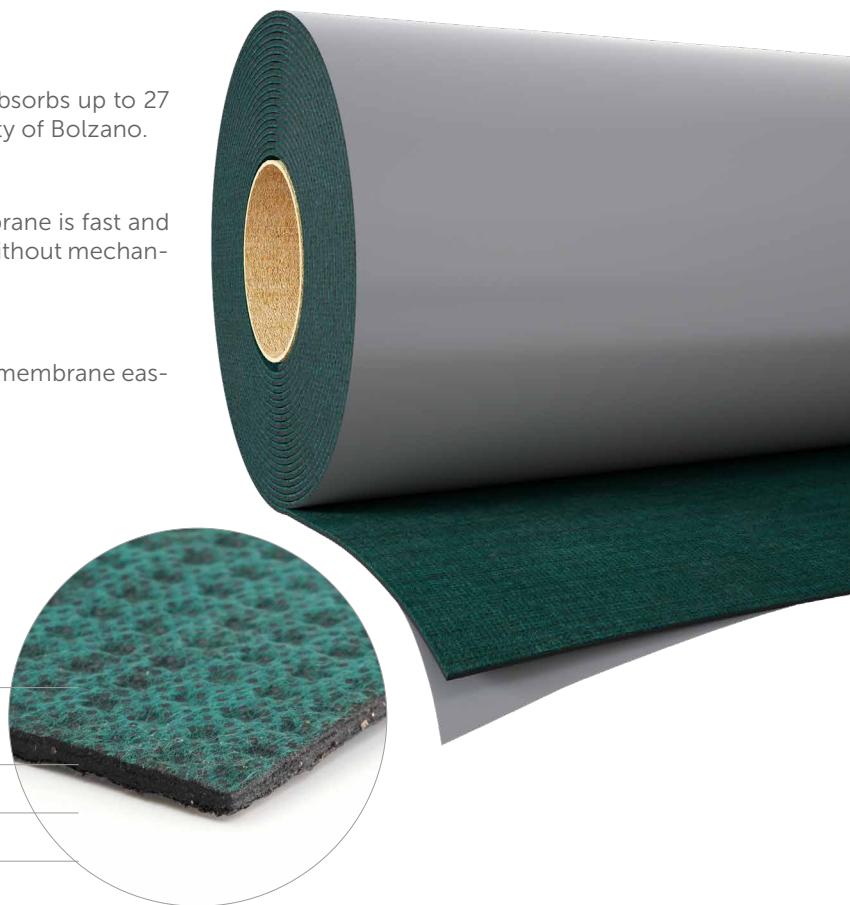

CODES AND DIMENSIONS

CODE	H [m]	L [m]	thickness [mm]	surface mass [kg/m ²]	A [m ²]	
SILWALLSA	1	8,5	4	5	8,5	24

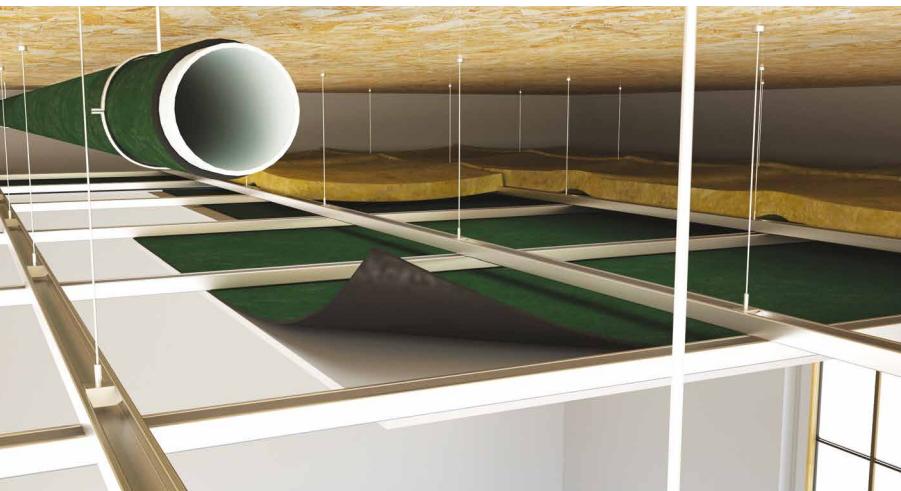

HERMETIC

Watertight and airtight, sealing of penetrations for mechanical fasteners is not required.

WITHOUT LEAD

Made of self-adhesive elastoplastic bitumen, it does not contain lead or harmful substances.

TECHNICAL DATA

Properties	standard	value
Thickness	-	4 mm
Surface mass m	-	5 kg/m ²
Density ρ	-	1250 kg/m ³
Resistance to airflow r	ISO 9053	> 100 kPa·s·m ⁻²
Critical frequency	-	> 85000 Hz
Increase of sound reduction ΔR _w ⁽¹⁾	ISO 10140-2	4 dB
Vibration damping - loss factor η (200 Hz)	ASTM E756	0,26
Thermal resistance R _t	-	0,023 m ² K/W
Thermal conductivity λ	-	0,17 W/m·K
Specific heat c	-	1200 J/kg·K
Water vapour resistance factor μ	EN 12086	100000
Water vapour transmission S _d	-	approx. 400 m
Reaction to fire	EN 13501-1	class E

⁽¹⁾Measured in the laboratory on a 170 mm timber-framed wall. See the manual for more information on configuration.

WALL ASSEMBLIES

THIN ACOUSTIC UPGRADES

Bonded coating is a commonly used method for acoustic upgrades because it allows, in just a few centimetres of thickness, a significant improvement in the sound rating of the partition.



Add mass by coupling **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA** to the plasterboard sheet

FLOORS ASSEMBLIES

ACOUSTIC UPGRADES FROM ABOVE



Cover the underside of the floor by applying a resilient layer **PIANO A**, **SILENT UNDERFLOOR**, **GEMINI**, **GIPS BAND**, **CONSTRUCTION SEALING** to the joists and by adding mass to the plasterboard sheet with **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA**

Values obtained through calculations from experimental data.

INSTALLATIONS


Solutions vary depending on the type of construction and acoustic requirements.



Create a mechanical, electrical, plumbing (MEP) enclosure and use **SILENT WALL BYTUM** or **SILENT WALL BYTUM SA** to improve its sound reduction


LABORATORY MEASUREMENT | CLT WALL 1

AIRBORNE SOUND INSULATION ACCORDING TO ISO 10140-2

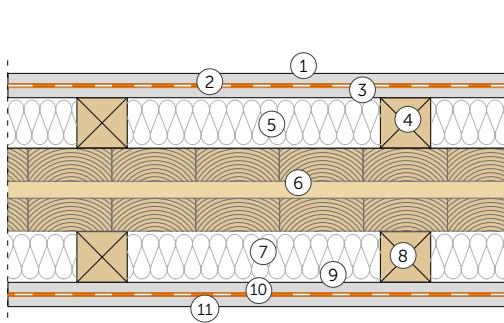

- ① plasterboard panel (thickness: 12,5 mm)
- ② **SILENT WALL BYTUM SA** (thickness: 4 mm)
- ③ plasterboard panel (thickness: 12,5 mm)
- ④ solid wood batten (thickness: 60 mm)
- ⑤ low density mineral wool insulation (thickness: 60 mm)
- ⑥ CLT panel (thickness: 100 mm)
- ⑦ low density mineral wool insulation (thickness: 60 mm)
- ⑧ solid wood batten (thickness: 60 mm)
- ⑨ plasterboard panel (thickness: 12,5 mm)
- ⑩ **SILENT WALL BYTUM SA** (thickness: 4 mm)
- ⑪ plasterboard panel (thickness: 12,5 mm)

AIRBORNE SOUND INSULATION

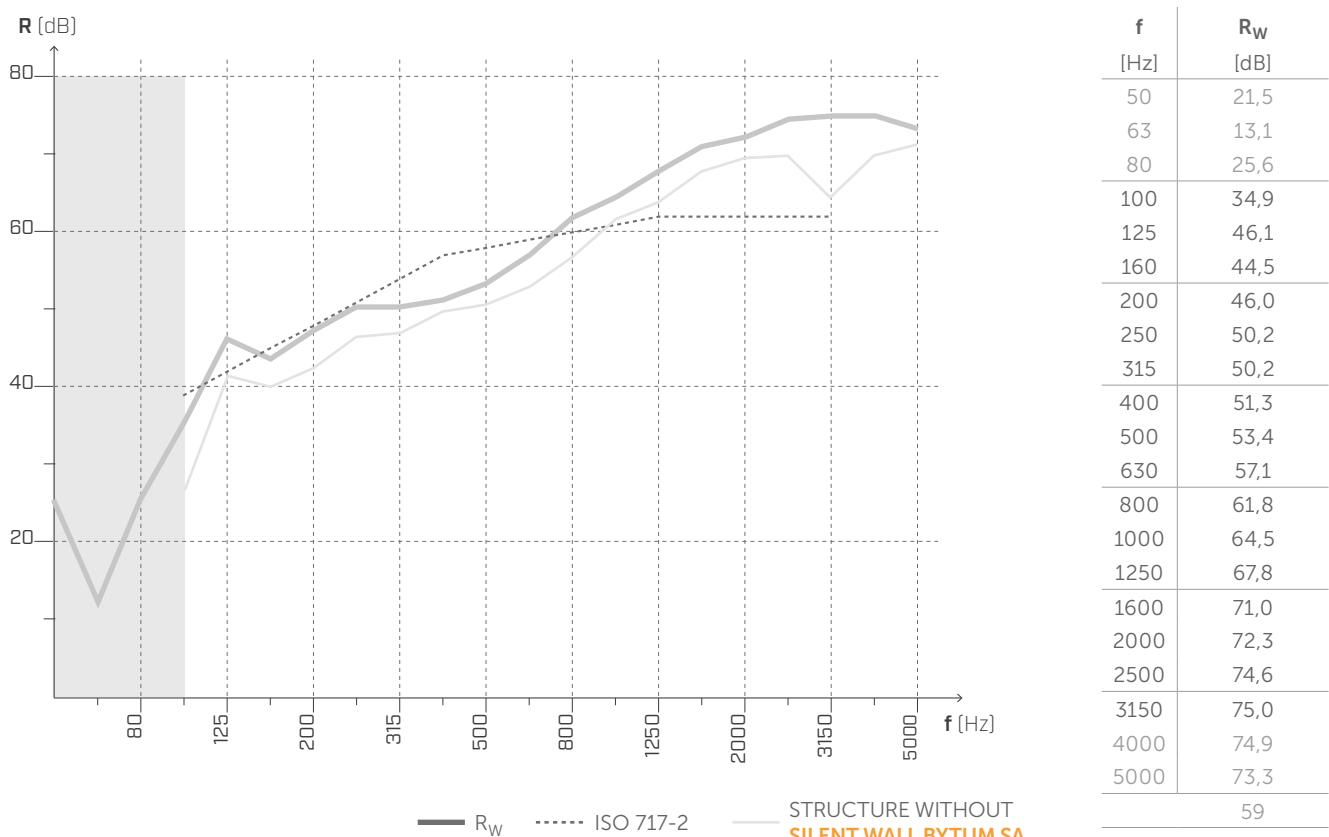

$$R_W (C; C_{tr}) = 59 \text{ (-2;-7) dB}$$

$$\Delta R_W = +5 \text{ dB}^{(1)}$$

$$STC_{ASTAM} = 59$$


Testing laboratory: University of Padua
Test protocol: test 2017.

NOTES :

⁽¹⁾ Increase due to the addition of **SILENT WALL BYTUM SA** (layers 2 and 10)


LABORATORY MEASUREMENT | CLT WALL 2

AIRBORNE SOUND INSULATION ACCORDING TO ISO 10140-2

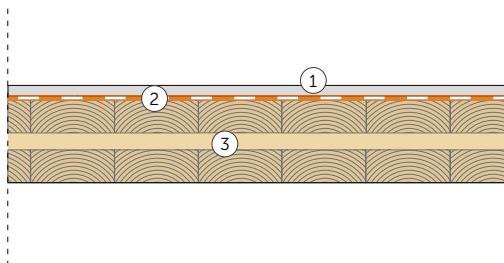

- ① plasterboard panel (thickness: 12,5 mm)
- ② **SILENT WALL BYTUM SA** (thickness: 4 mm)
- ③ CLT (thickness: 100 mm)

AIRBORNE SOUND INSULATION

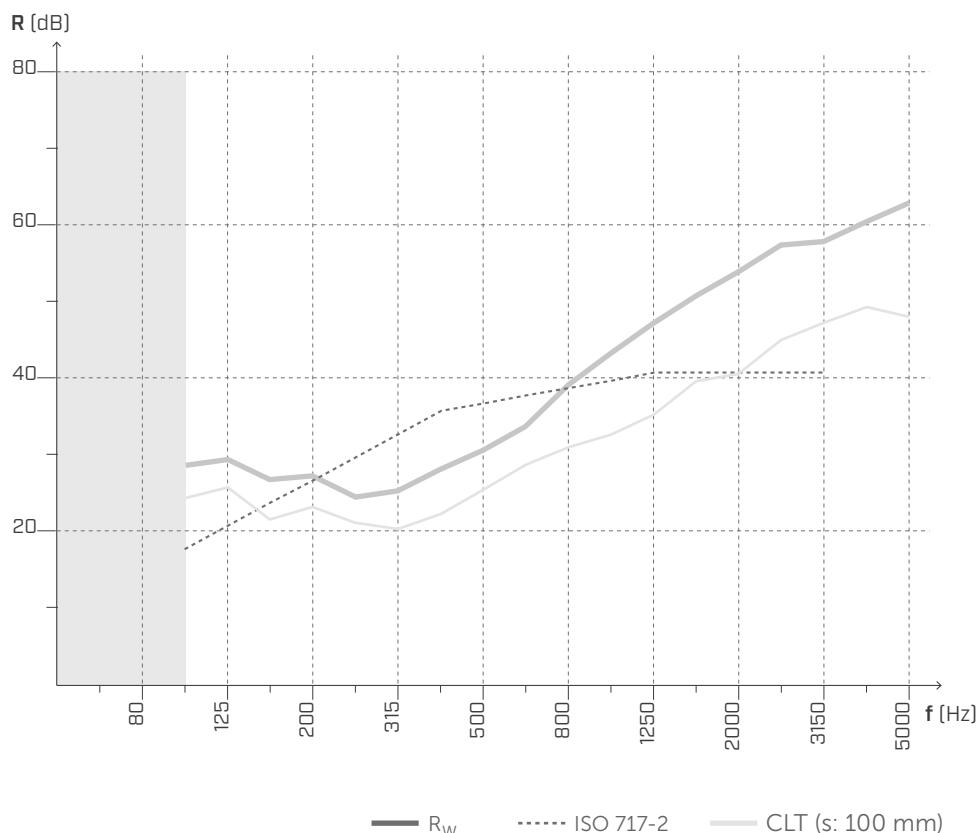

$$R_W (C; C_{tr}) = 37 \text{ (-1;-4) dB}$$

$$\Delta R_W = +6 \text{ dB}^{(1)}$$

$$STC_{ASTAM} = 36$$


Testing laboratory: University of Padua
Test protocol: test 2017.

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 1A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

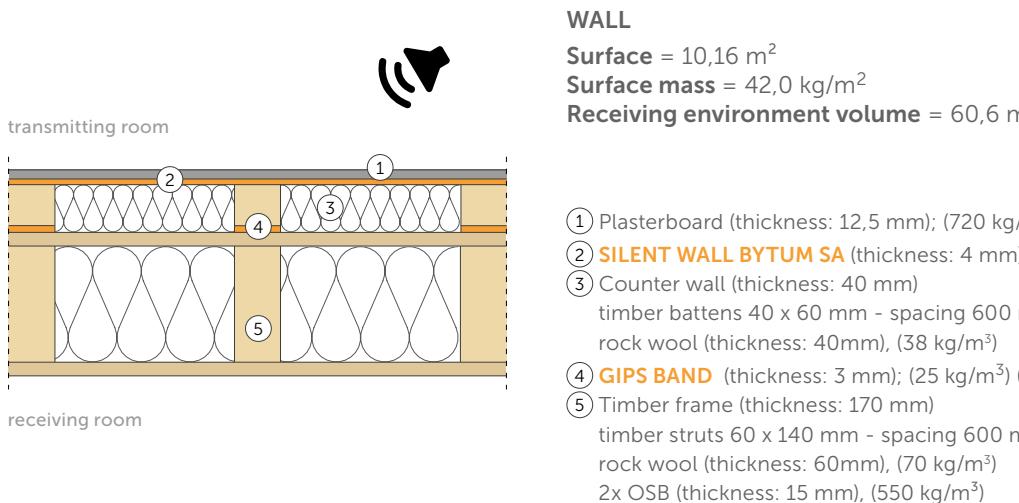

AIRBORNE SOUND INSULATION

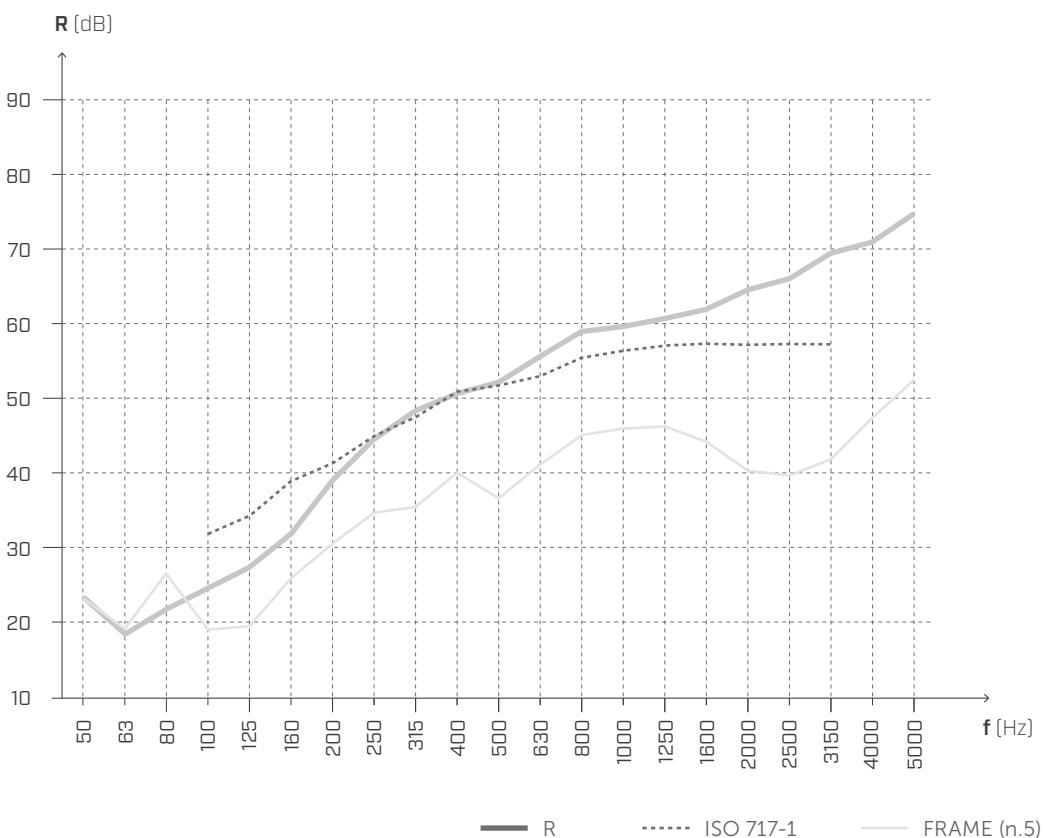

$$R_w(C, C_{tr}) = 52 \text{ (-4; -11) dB}$$

$$\Delta R_w = +11 \text{ dB}^{(1)}$$

$$STC = 51$$

$$\Delta STC = +10^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R10a


NOTES :

⁽¹⁾ Increase due to the addition of layers no. 1,2,3 and no. 4.

LABORATORY MEASUREMENT | FRAME WALL 1B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX

REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

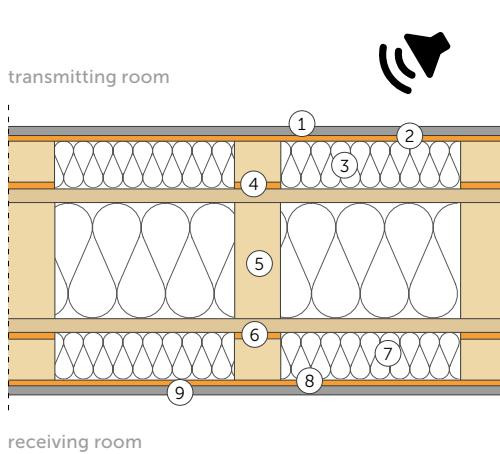

WALL


Surface = 10,16 m²

Surface mass = 59,7 kg/m²

Receiving environment volume = 60,6 m³

- ① Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)
- ② **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²
- ③ Counter wall (thickness: 40 mm)
timber battens 40 x 60 mm - spacing 600 mm
rock wool (thickness: 40 mm), (38 kg/m³)
- ④ **GIPS BAND** (thickness: 3 mm); (25 kg/m³) (0,075 kg/m²)
- ⑤ Timber frame (thickness: 170 mm)
timber struts 60 x 140 mm - spacing 600 mm
rock wool (thickness: 60mm), (70 kg/m³)
2x OSB (thickness: 15 mm), (550 kg/m³)
- ⑥ **GIPS BAND** (thickness: 3 mm); (25 kg/m³) (0,075 kg/m²)
- ⑦ Counter wall (thickness: 40 mm)
timber battens 40 x 60 mm - spacing 600 mm
rock wool (thickness: 40 mm), (38 kg/m³)
- ⑧ **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²
- ⑨ Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)

AIRBORNE SOUND INSULATION

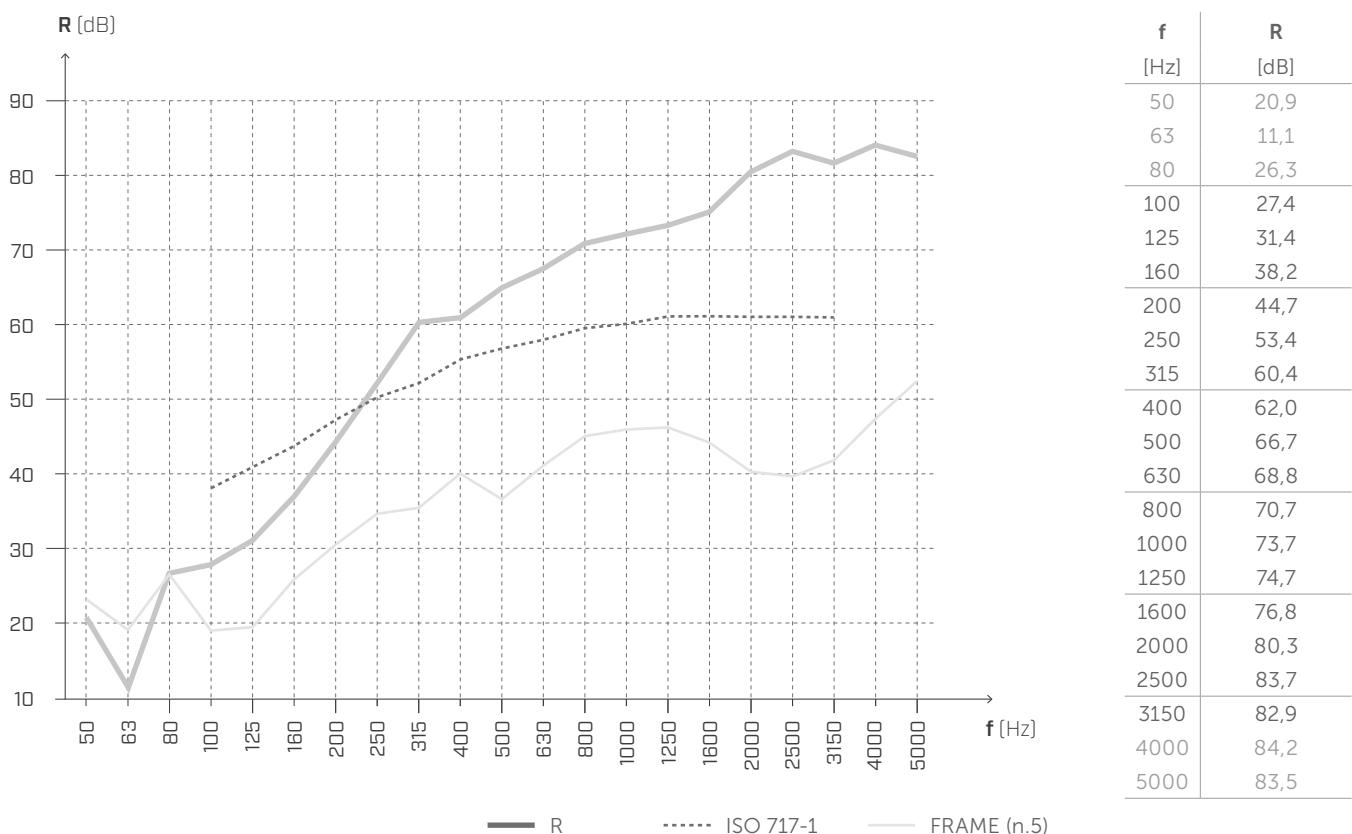

$$R_w(C,C_{tr}) = 57 \text{ (-4;-12) dB}$$

$$\Delta R_w = +16 \text{ dB}^{(1)}$$

$$STC = 55$$

$$\Delta STC = +14^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R10b

NOTES :

⁽¹⁾ Increase due to the addition of layers no. 1,2,3,4,6,7,8 and no. 9.

LABORATORY MEASUREMENT | FRAME WALL 2A

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

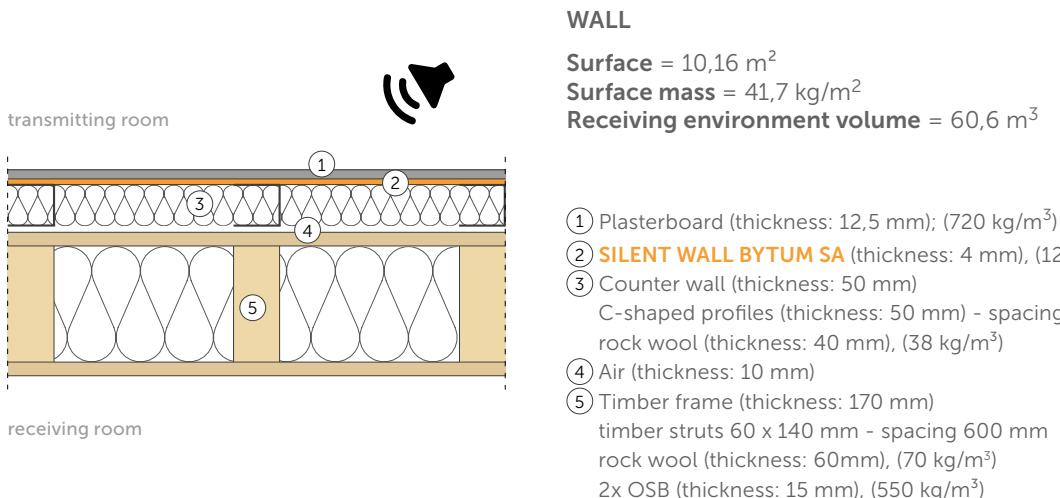

AIRBORNE SOUND INSULATION



$$R_w(C, C_{tr}) = 59 \text{ (-5;-13) dB}$$

$$\Delta R_w = +18 \text{ dB}^{(1)}$$

$$STC = 54$$

$$\Delta STC = +13^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R14a

NOTES :

⁽¹⁾ Increase due to the addition of layers no. 1,2,3 and no. 4.

LABORATORY MEASUREMENT | FRAME WALL 2B

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

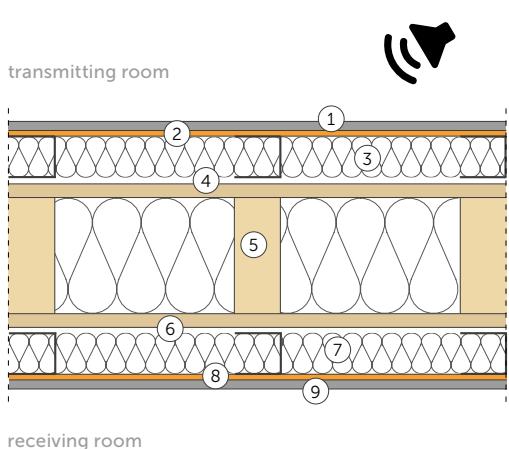

WALL


Surface = 10,16 m²

Surface mass = 59,1 kg/m²

Receiving environment volume = 60,6 m³

- ① Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)
- ② **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²)
- ③ Counter wall (thickness: 50 mm)
C-shaped profiles (thickness: 50 mm) - spacing 600 mm
rock wool (thickness: 40 mm), (38 kg/m³)
- ④ Air (thickness: 10 mm)
- ⑤ Timber frame (thickness: 170 mm)
timber struts 60 x 140 mm - spacing 600 mm
rock wool (thickness: 60mm), (70 kg/m³)
2x OSB (thickness: 15 mm), (550 kg/m³)
- ⑥ Air (thickness: 10 mm)
- ⑦ Counter wall (thickness: 40 mm)
C-shaped profiles (thickness: 50 mm) - spacing 600 mm
rock wool (thickness: 40 mm), (38 kg/m³)
- ⑧ **SILENT WALL BYTUM SA** (thickness: 4 mm), (1250 kg/m³), 5 kg/m²)
- ⑨ Plasterboard (thickness: 12,5 mm); (720 kg/m³) (9 kg/m²)

AIRBORNE SOUND INSULATION

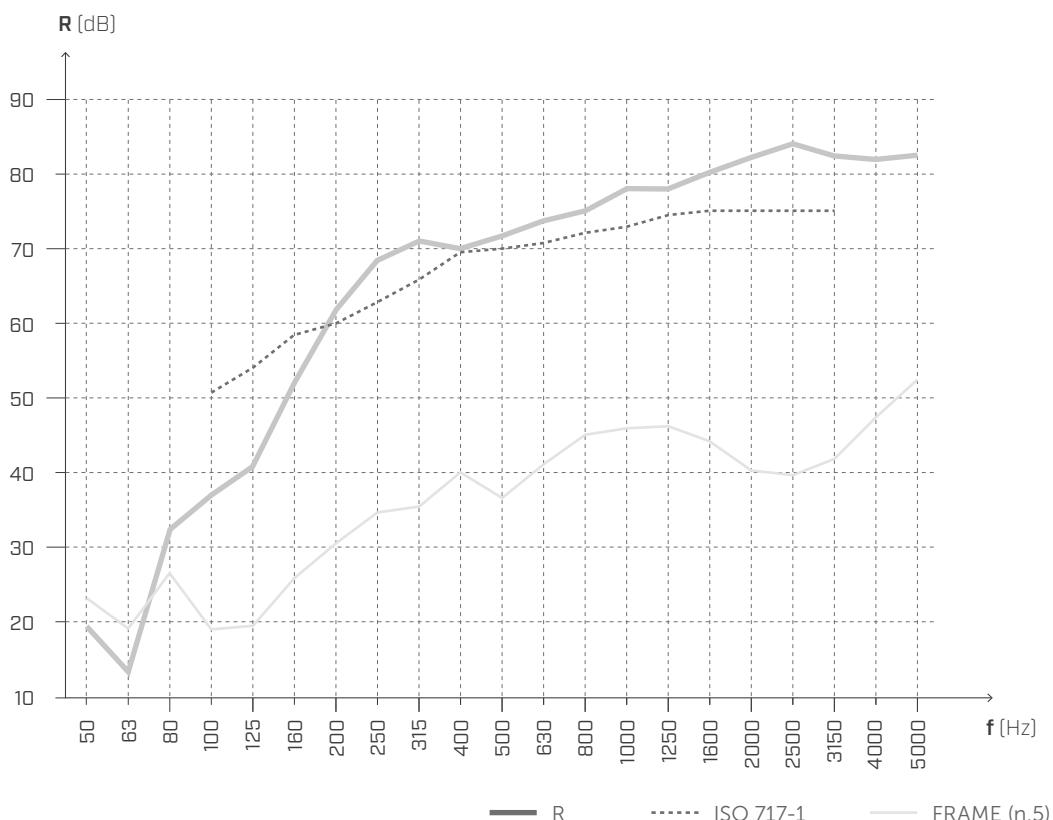

$$R_w(C,C_{tr}) = 70 \text{ (-7;-15) dB}$$

$$\Delta R_w = +29 \text{ dB}^{(1)}$$

$$STC = 65$$

$$\Delta STC = +24^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.


Test protocol: Pr.2022-rothoLATE-R14b

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,4,6,7,8 and no. 9.

LABORATORY MEASUREMENT | FRAME WALL 3

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

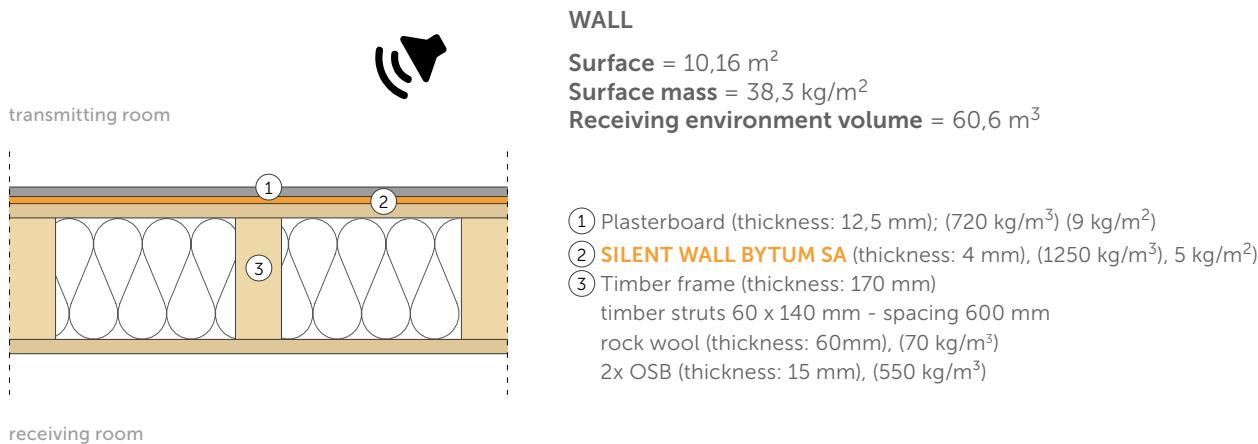

AIRBORNE SOUND INSULATION

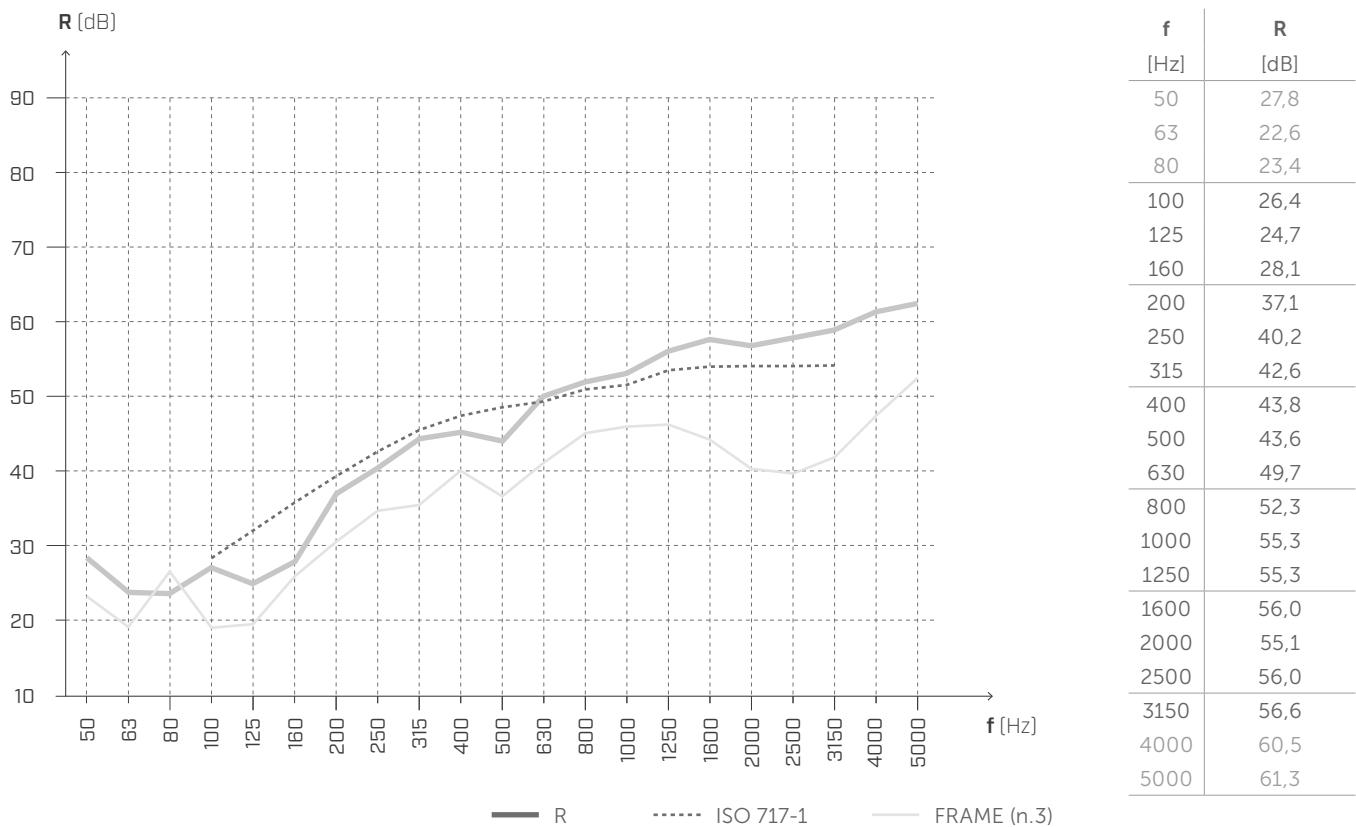

$$R_w(C; C_{tr}) = \mathbf{48} \text{ (-3;-8) dB}$$

$$\Delta R_w = +7 \text{ dB}^{(1)}$$

$$STC = \mathbf{49}$$

$$\Delta STC = +8^{(1)}$$


Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R1a

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1 and no. 2.

LABORATORY MEASUREMENT | FRAME WALL 4

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

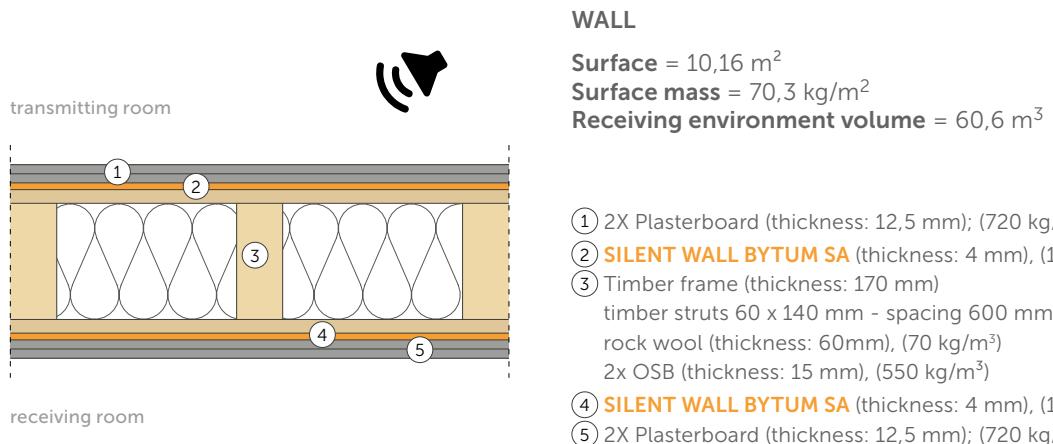

AIRBORNE SOUND INSULATION

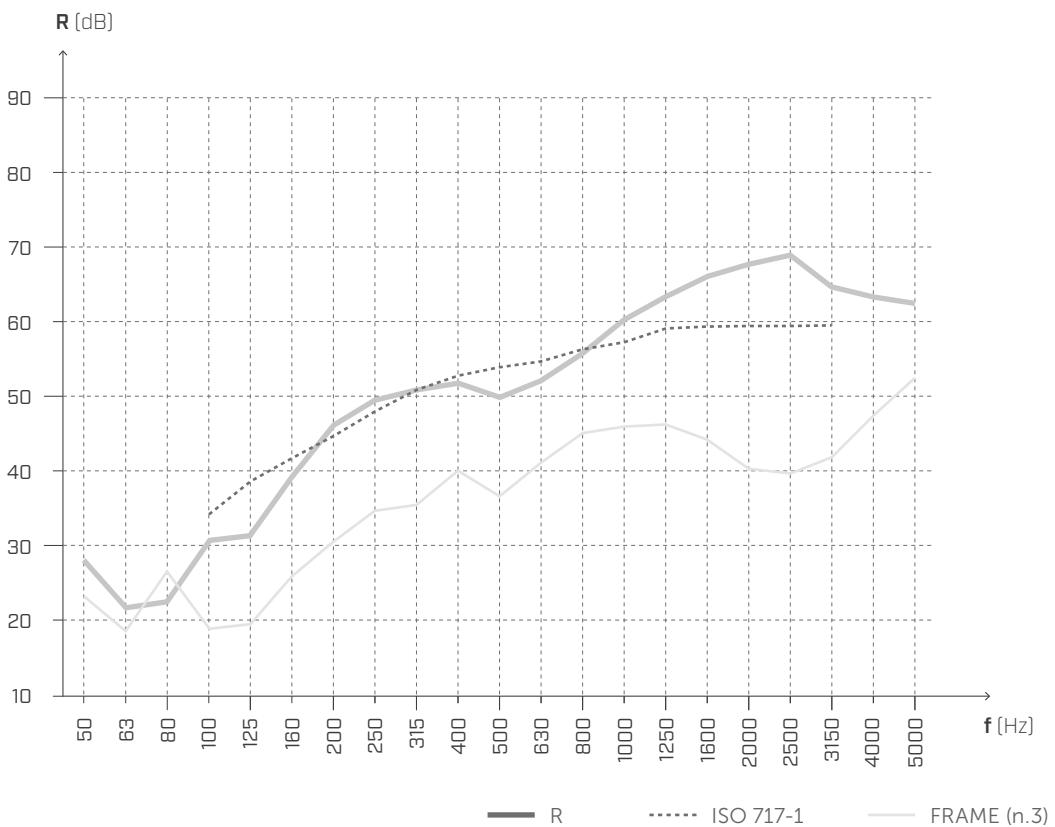

$$R_w(C; C_{tr}) = \text{55} \text{ (-2;-8) dB}$$

$$\Delta R_w = +14 \text{ dB}^{(1)}$$

$$STC = \text{55}$$

$$\Delta STC = +14 \text{ dB}^{(1)}$$


Testing laboratory: Building Physics Lab | Libera Università di Bolzano.
Test protocol: Pr.2022-rothoLATE-R2b

NOTES :


⁽¹⁾ Increase due to the addition of layers no. 1,2,4 and no. 5.

LABORATORY MEASUREMENT | FRAME WALL 5

MEASUREMENT OF AIRBORNE SOUND INSULATION EVALUATION INDEX
REFERENCE STANDARD: ISO 10140-2, EN ISO 717-1

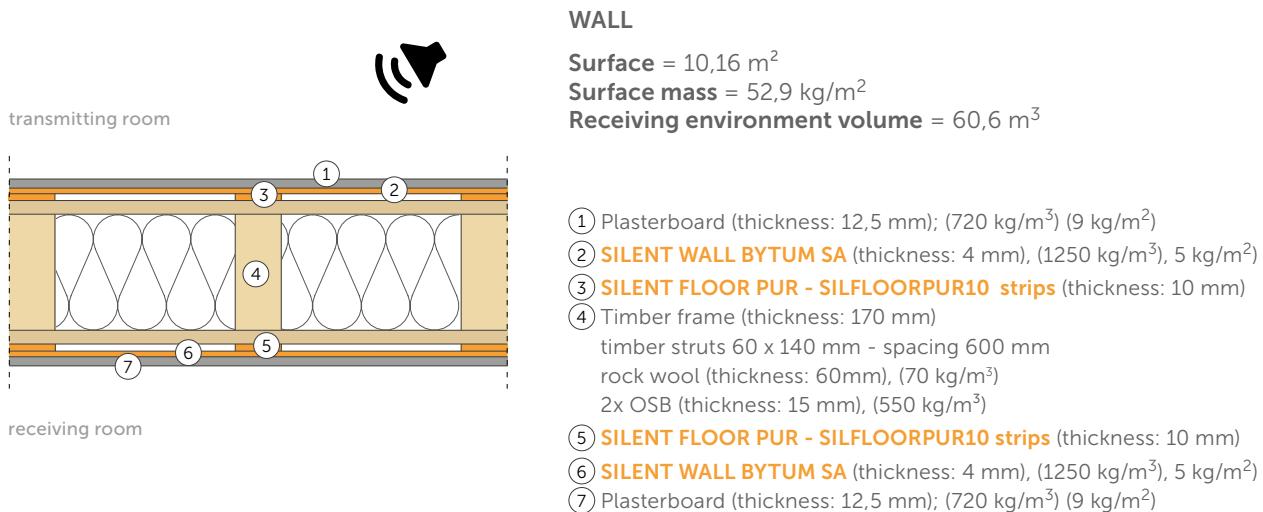

AIRBORNE SOUND INSULATION

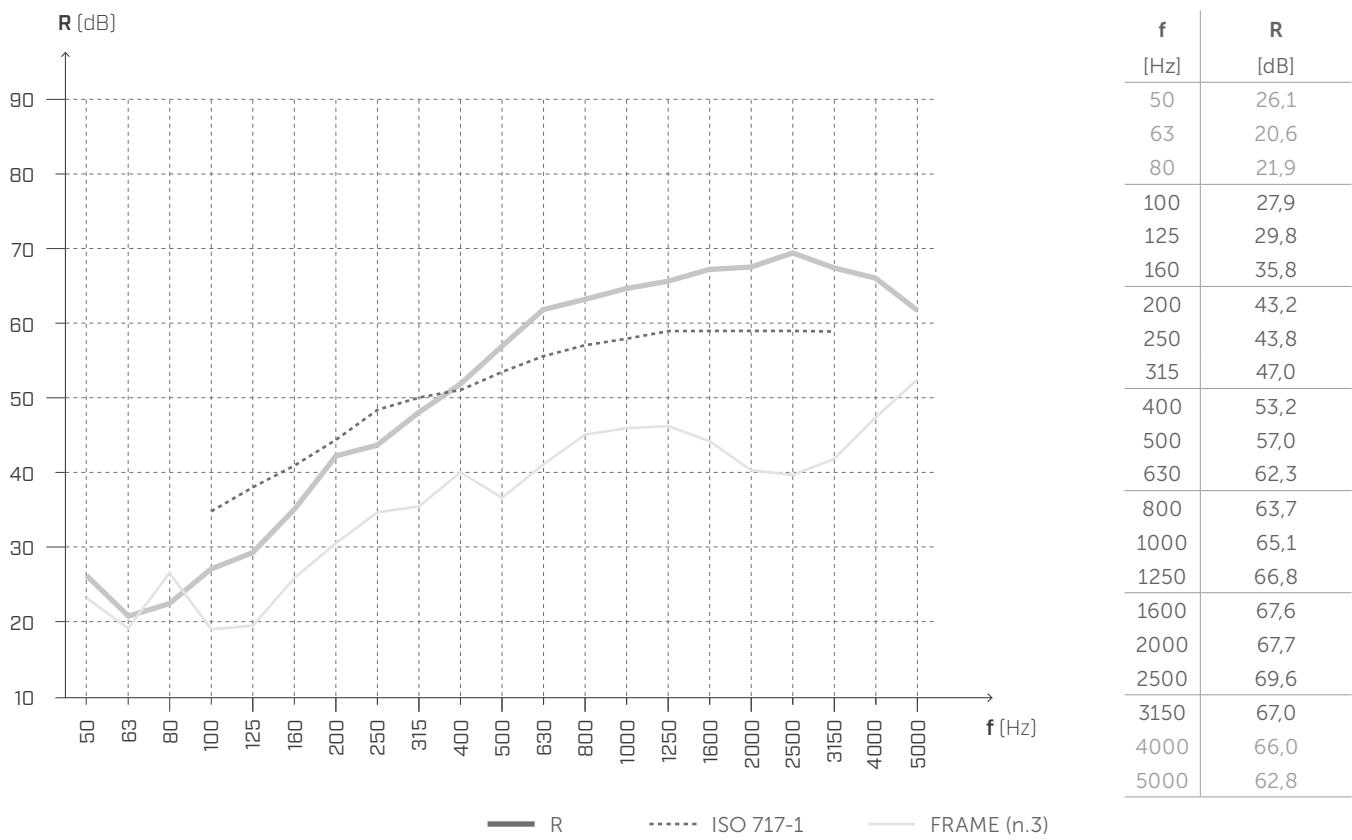

$$R_w(C; C_{tr}) = \text{54} \text{ (-3;-9) dB}$$

$$\Delta R_w = +13 \text{ dB}^{(1)}$$

$$STC = \text{54}$$

$$\Delta STC = +13^{(1)}$$

Testing laboratory: Building Physics Lab | Libera Università di Bolzano.

Test protocol: Pr.2022-rothoLATE-R5b

NOTES :

⁽¹⁾ Increase due to the addition of layers no. 1,2,3,4,5,6 and no. 7.

Rotho Blaas Srl does not guarantee the legal and/or design conformity of data and calculations, as Rotho Blaas provides indicative tools such as technical-commercial service within the sales activity.

Rotho Blaas Srl follows a policy of continuous development of its products, thereby reserving the right to modify their characteristics, technical specifications and other documentation without notice.

The user or the designer are responsible to verify, at each use, the conformity of the data to the regulations in force and to the project. The ultimate responsibility for choosing the appropriate product for a specific application lies with the user/designer.

The values resulting from "experimental investigations" are based on the actual test results and valid only for the test conditions specified.

Rotho Blaas Srl does not guarantee and in no case can be held responsible for damages, losses and costs or other consequences, for any reason (warranty for defects, warranty for malfunction, product or legal responsibility, etc.) deriving from the use or inability to use the products for any purpose; from non-conforming use of the product;

Rotho Blaas Srl is not liable in any way for any errors in printing and/or typing. In the event of differences between the contents of the catalogue versions in the various languages, the Italian text is binding and takes precedence with respect to the translations.

Pictures are partially completed with accessories not included. Images are for illustration purposes only. Packaged quantities may vary.

This catalogue is private property of Rotho Blaas Srl and may not be copied, reproduced or published, totally or in part, without prior written consent. All violations will be prosecuted according to law.

The general purchase conditions of Rotho Blaas Srl are available on the website www.rothoblaas.com.

All rights reserved.

Copyright © 2022 by Rotho Blaas Srl

All renderings © Rotho Blaas Srl

Rotho Blaas Srl

Via dell'Adige N.2/1 | 39040, Cortaccia (BZ) | Italia
Tel: +39 0471 81 84 00 | Fax: +39 0471 81 84 84
info@rothoblaas.com | www.rothoblaas.com

